
Appendix C - Fence Layout

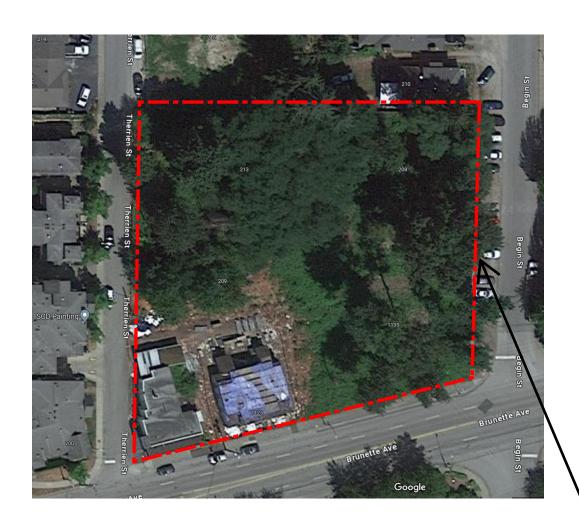

Location of Double Swing 10' wide vehicle access gate

CITY OF COQUITLAM	DIVISION 32	MMCD SECTION 32 31 13S
ENGINEERING AND PUBLIC WORKS DEPARTMENT	ROAD AND SITE IMPROVEMENTS	SS PAGE 36
SUPPLEMENTARY SPECIFICATIONS	Chain Link Fences and Gates	2022

MMCD Section 32 31 13S		Chain Link Fences and Gates		
1.0	GENERAL			
1.2	References	Add 1.2.2 Add 1.2.3	CAN/CGSB-138.1-M80, Fence, Chain Link Fabric CAN/CGSB-138.2-M80, Fence, Chain Link, Framework, Zinc-Coated, Steel.	
		Add 1.2.4 Add 1.2.5 Add 1.2.6	CAN/CGSB-138.3-M80, Fence, Chain Link Installation. CAN/CGSB-138.4-M82, Fence, Chain Link, Gates. CSA G164-M1981, Hot Dip Galvanizing of Irregularly Shaped Articles.	
		Add 1.2.7	ASTM A90-81, Test Method for Weight of Coating on Zinc-Coated (Galvanized) Iron or Steel Articles.	
		Add 1.2.8 Add 1.2.9	ASTM A53-88a, Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated Welded and Seamless. CGSB 1-GP-181M-77, Coating, Zinc-Rich, Organic, Ready	
		, 100 1.2.5	Mixed.	
1.4	Samples	Delete 1.4.1 and replace with the following	Prior to the start of the work, submit a 300 mm long powder-coated pipe sample that will be representative of the quality of the powder-coating for all powder-coated fencing materials installed as part of the <i>Work</i> .	
1.6	Inspection and Testing	Add 1.6.2	The surface of the posts and rails will be scratch tested to ensure the finish does not flake. Finishes that flake when scratched will be rejected.	
1.7	Qualifications	Add 1.7.1 Execute work in this Section only by a <i>Contractor</i> who has adequate equipment, skilled tradesmen, and materials to perform the work expeditiously and to the contract specifications.		
2.0	PRODUCTS			
2.1	Materials	Delete 2.1.1 and replace with the following	Fencing, posts, rails, and fabric shall be constructed as shown on the <i>Contract Drawing</i> and Specifications herein.	
		Delete 2.1.3 and replace with the following	 Chain-link fence fabric: to CAN/CGSB-138.1. All chain link fabric shall be galvanized, vinyl coated, black, commercial and heavy grade with 50 mm openings. The widest rolls of fabric shall be employed in the construction of the appropriate fence type (i.e. 1200 mm wide rolls for 1200 mm high fencing and 2400 mm wide rolls for 2400 mm high fencing, etc.). Fabric gauges, fabric opening sizes, fence heights, and post spacing shall be as follows: 	

3000 mm o.c. and,

.1 For passive and low activity City and Park areas

.1 1200 mm high with the post spacing

the chain link fence shall be:

- 2 Chain link fabric shall be 9 gauge (3.55 mm diameter) galvanized, vinyl coated, black, commercial grade with 50 mm openings.
- .2 For high activity City and Park areas the chain link fence shall be:
 - .1 1200 mm high with the post spacing 2400 mm o.c. and,
 - .2 Chain link fabric shall be 6 gauge (4.50 mm) galvanized, vinyl coated, black, commercial and heavy grade with 50 mm openings
- .3 For the baseball diamond backstop the chain link fence shall be:
 - .1 4600 mm and higher with the post spacing 2400 mm o.c and,
 - .2 Chain link fabric shall be 6 gauge (4.50 mm) galvanized, vinyl coated, black, commercial and heavy grade with 38mm openings.
- .4 For the soccer playing field backstop fences the chain link fence shall be:
 - .1 6000 mm and higher with the post spacing 2400 mm o.c and,
 - .2 Chain link fabric shall be 6 gauge (4.50 mm) 6 gauge galvanized, vinyl coated, black, commercial and heavy grade with 38 mm openings.

Delete 2.1.4 and replace with the following

Posts and rails for all fencing locations are to CAN/CGSB-138.2, schedule 40 galvanized steel pipe and shall be powder-coated black steel pipe. No short lengths, tubing, conduit or open seam material will be permitted.

- .1 Post and rail sizes shall be as follows:
 - .1 For passive/active public/non-public areas which are 1200 mm or 2400 mm and higher:
 - .1 Corner and gate posts shall be 75 mm nominal outside diameter, standard continuous weld Schedule 40 powdercoated black steel pipe.
 - .2 Line posts shall be 60 mm nominal outside diameter, standard continuous weld Schedule 40 powder-coated black steel pipe.
 - .3 Top and bottom rails and horizontal braces shall be 48 mm nominal outside diameter, plain ends, continuous lengths, standard continuous weld Schedule 40 powdercoated black steel pipe.
 - .2 Baseball diamond backstop which are 4600 mm and higher:

- .1 Corner and line posts shall be 114 mm nominal outside diameter, standard continuous weld Schedule 40 powdercoated black steel pipe.
- .2 Top, bottom, and horizontal bracing rails shall be 48 mm nominal outside diameter, plain ends, continuous lengths, standard continuous weld Schedule 40 powdercoated black steel pipe.
- .3 Post extensions for the overhang shall be 75 mm nominal outside diameter, standard continuous weld Schedule 40 powdercoated black steel pipe. At connection install welded 13 mm plate steel gussets as per the drawings herein. Overhang horizontal rails and bracing shall be 48 mm nominal outside diameter, plain ends, continuous lengths, standard continuous weld Schedule 40 powder-coated black steel pipe.
- .3 Soccer playing field backstop which are 6000 mm and higher:
 - .1 Corner and line posts shall be 89 mm nominal outside diameter, standard continuous weld Schedule 40 powdercoated black steel pipe.
 - .2 Top, bottom, and horizontal bracing rails shall be 48 mm nominal outside diameter, plain ends, continuous lengths, standard continuous weld Schedule 40 powdercoated black steel pipe.

Delete 2.1.5 and	
replace with the	
following	

Bottom tension wire: single strand, black vinyl gated galvanized steel wire, 6 gauge (4.5mm Diameter).

Delete 2.1.6 and replace with the following

Tie wire fasteners shall be single strand, black vinyl coated galvanized aluminium or steel wire conforming to requirements of fence fabric.

Delete 2.1.7 and replace with the following

Tension bars: 4.76 x 19 mm minimum galvanized black power coated steel.

Delete 2.1.8 and replace with the following

Tension bar bands: 3 x 20 mm galvanized black powder coated steel or 5x20 mm minimum black powder coated aluminium.

Delete 2.1.9 and replace with the following

Install the chain link fence person gates and vehicle gates as shown on the *Contract Drawing*.

.1 Chain Link Vehicle Gates.

The vehicle gates shall not be used as a centre .1 post. The closure device shall be operated by securing the gates together when in the closed The closure device shall be be position. operated independent of the locking pins. Closure device must accept a standard padlock.

SS PAGE 39

2022

- The vehicle gate is to have locking pins with locking pin aluminum sleeves recessed 25 mm into the concrete walkway to secure the gates in the open and closed positions. The top of the sleeve shall be flused with the surrounding concrete surface. The locking pin rod shall be spring-loaded so that the pin is always in the raised position unless pushed and turn locked into place, as per the drawings herein.
- The vehicle gate shall be to the full height of the fence and shall not be bridged with a top rail over it as to eliminate any restrictions on the height of objects passing through the gate.
- The vehicle gate is to operate on wheels which fully support the weight of the gate. The wheels must be suitable for use on concrete surfaces and must not mark the concrete surface.
- Vehicle gates shall not have signage inserts. .5
- All hinges shall be welded into place. .6

.2 Chain Link Person Gates.

- The person gates are to have clear openings of 1219 mm.
- The person gates shall be used as a closure device to operate by securing the gate to the gate post when in the closed position. The closure devices shall be operated independent of the locking pins. Closure device must accept a standard padlock.
- The person gates shall have locking pins with locking pin aluminum sleeves recessed 25 mm into the concrete walkway to secure the gates in the open and closed positions. The top of the sleeve shall be flushed with the surrounding concrete surface. The locking pin rod shall be spring-loaded so that the pin is always in the raised position unless pushed and turn locked into place, as per the drawings herein.
- For soccer playing field entry gates, the gates shall not have locking pins for the open positions. Field entry gates shall be able to swing 180 degrees wide and lock open by attaching to main fence line.

CITY OF COQUITLAM ENGINEERING AND PUBLIC WORKS DEPARTMENT SUPPLEMENTARY SPECIFICATIONS		DIVISION 32 ROAD AND SITE IMPROVEMENTS Chain Link Fences and Gates	MMCD SECTION 32 31 13S SS PAGE 40 2022	
			the fence and shall no over them as to elim	Ill be to the full height of t be bridged with a top rail hinate any restrictions on passing through the gate. Ided into place.
		Delete 2.1.10 and replace with the following	All fastenings and fittings shall caps shall be powder coated bl	
2.2	Finishes	Add 2.2.4	Powdercoating: .1 Powdercoat all exposed so to use powdercoat paint. Wash and coating shall be system. Dipping is not act baked dry. Colour shall be signage and signage insomer selected custom coat. 2 The powder-coat finish muscratched tested.	on acid washed surfaces. completed on a conveyor ceptable. Finish must be black except for backstop erts which are to have blours.
3.0	EXECUTION	Add 2.2.5	Organic zinc rich Galvicon pain 181M shall be applied to all jo areas. Two coats are required. finish. Use black or a custon match the surrounding powder	ints, welds and damaged Paint to have a high gloss n colour as necessary to
5.0	EXECUTION			
3.1	Grading	Delete 3.1 and replace with the following	 .1 Remove debris and corralong fence line to obtain a between posts. .2 Accurately survey and layor shown on the Contract Dro. .3 The installation procedure be in strict accordance of specifications and provisuccessful installation of all 	smooth uniform gradient out the specified work as awing. es for all materials must with the manufacturer's vide for a long-term
3.2	Installation of Fence	Delete 3.2 and replace with the following	 .1 Erect fences along lines as Drawing and in accordance .2 Space straining posts a exceeding 150 metres if d corner posts on straight fence over reasonably smo 150 metres. .3 Install end posts at end of fence alignment. Install ga gate openings. .4 Embed posts into concre Brace to hold posts in plu alignment and elevation un 	e with CAN/CGSB-138.3. at equal intervals not listance between end or continuous lengths of oth grade is greater than fence and at changes in the posts on both sides of the to depths indicated. The model of the continuous lengths of the continuous lengths of the continuous lengths of the continuous lengths indicated.

Cut posts and rails as required. Prepare surfaces and powder-coat as per the specifications herein. Install posts and rails as per the specifications

CITY OF COQUITLAM ENGINEERING AND PUBLIC WORKS DEPARTMENT SUPPLEMENTARY SPECIFICATIONS			DIVISION 32 MMCD SECTION 32 31 13S ROAD AND SITE IMPROVEMENTS SS PAGE 42 Chain Link Fences and Gates 2022	
			herein. 2400 mm post spacing can be adjusted to accommodate re-used rails. Ensure that where spacing is adjusted it is consistent and in one section of fence. 3. Dispose of damaged or surplus posts, rails, and mesh off-site.	
3.5	Touch Ups	Add 3.5	 Clean damaged surfaces with wire brush removing loose and cracked coatings. Apply two coats of black high gloss organic zinc-rich Galvicon paint to damaged areas, allowing the manufacturer's recommended drying time between coats. Pretreat damaged surfaces according to manufacturers' instructions for zinc-rich paint. Wire brush, clean, and paint all welds with two coats of high gloss zinc rich Galvicon paint, allowing the manufacturer's recommended drying time between coats. Use paint colour that matches surrounding powder-coated surfaces. 	
3.6	Site clean-Up	Add 3.6	Upon completion of the work remove all containers, surplus materials, and installation debris, etc. Project area must be left in a clean and orderly condition.	
3.7	Maintenance Supplies	Add 3.7	Upon completion of the work, the <i>Contractor</i> shall provide the <i>City</i> with maintenance materials consisting of the following.	
			 .1 Two (2) 500 ml cans of black high gloss organic zinc-rich paint. .2 One (1) 500 ml can of high gloss organic zinc-rich paint of each custom colour. .3 Four (4) packages of 50 tie wires. 	
3.8	Protection	Add 3.8	 .1 The Contractor is responsible for the protection of all new and existing facilities from damage and/or disfiguration from the processes of the Work and from vandalism. Any damage or disfiguration must be repaired promptly and to the original condition of the facility prior to the damage. .2 Acceptance of the repair work is at the sole discretion of the Contract Administrator and the City. All repairs must be completed and accepted prior to Total Performance of the Work being granted. 	