

City of Coquitlam

# 2025 Annual Drinking Water Quality Report



*We acknowledge with gratitude and respect that the name Coquitlam was derived from the hən̓q̓əmi̓nəm̓ (HUN-kuh-MEE-num) word kʷikʷə́ləm (kwee-KWET-lum) meaning “Red Fish Up the River”. The City is honoured to be located on the kʷikʷə́ləm traditional and ancestral lands, including those parts that were historically shared with the kátsəy̓ (kat-zee), and other Coast Salish Peoples.*



## Executive Summary

Under the BC *Drinking Water Protection Act* and *Drinking Water Protection Regulation* it is the City's responsibility to continually monitor drinking water quality, create reports that summarize these results, and make them available to the public. This report summarizes the results of the City of Coquitlam's drinking water monitoring program and documents the effectiveness of the systems in place to protect water quality for the year 2025.

A total of 2125 water quality samples were taken in 2025 with two testing positive for non-fecal coliform bacteria. At no point did the City of Coquitlam exceed the 10% Provincial threshold of samples showing the presence of coliform in a 30 day period. There were no samples which had more than 10 cfu/100mL in 2025. There were no samples that tested positive for *Escherichia coli* (E. coli) in 2025.

The majority of the water quality samples had adequate amounts of free chlorine, which is added as a secondary disinfectant at the water's source. Low amounts of free chlorine residual was recorded at three of the thirty-one sampling stations in Coquitlam's water distribution system.

All drinking water samples have come within the acceptable levels of concentrations of disinfection bi-products, metals, and vinyl chloride as established by the *Guidelines for Canadian Drinking Water Quality*. Both the average temperature and turbidity test results were also within the acceptable guideline limits.

The City recorded 95 water quality complaints in 2025. The majority of these complaints were of discoloured water, with 27 due to taste or odour. These issues are usually resolved within two hours by having homeowners flush their taps.

## Table of Contents

Executive Summary .....	3
Introduction.....	6
Drinking Water Regulations.....	6
Federal Requirements .....	6
Provincial Requirements.....	6
Regional Health Authority Requirements.....	6
Metro Vancouver Requirements .....	6
Health Bulletins.....	7
Source Testing .....	7
Distribution Testing.....	7
Sampling Stations .....	8
<i>Figure 1: 2024 Sampling Station Locations .....</i>	<i>9</i>
<i>Table 1: 2025 Sampling Stations.....</i>	<i>10</i>
Sampling Frequency .....	11
<i>Table 2: Number of Samples Taken by Month in 2025.....</i>	<i>11</i>
Test Parameters .....	11
Bacteriological Parameters .....	12
Escherichia Coliform.....	12
Total Coliforms .....	12
<i>Table 3: Water Quality Standards for Potable Water: Total Coliform Bacteria .....</i>	<i>12</i>
<i>Figure 2: 2025 Sampling Stations Indicating Positive for Total Coliforms .....</i>	<i>13</i>
<i>Table 4: 2025 Weekly Test Results for E. coli and Total Coliforms .....</i>	<i>15</i>
Heterotrophic Plate Count.....	16
Physical Parameters.....	16
<i>Table 5: WQMRP and GCDWQ Requirements regarding Physical and Chemical Parameters. ....</i>	<i>17</i>
Temperature.....	17
Turbidity.....	17
Chemical Parameters.....	18
Free Chlorine Residuals .....	18
<i>Table 6: 2025 Chlorine Residuals .....</i>	<i>19</i>
<i>Figure 3: 2025 Free Chlorine Residuals .....</i>	<i>21</i>
Haloacetic Acids.....	22
<i>Table 7: 2025 HAA Test Results .....</i>	<i>23</i>
Trihalomethanes .....	24
<i>Table 8: 2025 THM Test Result .....</i>	<i>25</i>
Metals.....	26
<i>Table 9: GCDWQ Standards for Metals in Drinking Water .....</i>	<i>26</i>
<i>Table 10: 2025 Testing Results for Metals .....</i>	<i>27</i>
Vinyl Chloride.....	27
<i>Table 11: 2025 Vinyl Chloride Results .....</i>	<i>28</i>
pH.....	28
<i>Table 12: 2025 pH Results .....</i>	<i>28</i>
Customer Complaints.....	28
System Improvements .....	29
System Maintenance .....	29
Emergency Response Plan .....	29

## Appendices

- A Health Link BC Bulletin #56 – Preventing Water-Borne Infections For People with Weakened Immune Systems
- B Fraser Health – Metals in Drinking Water – “Flush” Message in Annual Reports (2026)
- C Greater Vancouver Water District 2025 Water Quality Annual Report – Volume I
- D Monitoring Results from Coquitlam Sample Stations

## **Introduction**

This report provides an overview of the regulations regarding drinking water quality and shows that City of Coquitlam continued to provide safe drinking water to its residents in 2025.

## **Drinking Water Regulations**

Drinking water quality in the City of Coquitlam (the City) must meet the following requirements:

### **Federal Requirements**

The *Guidelines for Canadian Drinking Water Quality (GCDWQ)* are established by Health Canada in collaboration with the Federal-Provincial-Territorial Committee on Drinking Water and other federal government departments. The *GCDWQ* provides maximum acceptable concentration values for various chemical and physical parameters for potable water.

### **Provincial Requirements**

The Province of British Columbia has regulations set out in the *Drinking Water Protection Act* (the *Act*) and the *Drinking Water Protection Regulation* (the *Regulation*). The *Act* establishes the requirements for operators and suppliers of drinking water to ensure the public are provided with safe drinking water. Along with the *Act*, the *Regulation* sets out minimum safety standards to be met for water treatment and sampling, further establishing a set of regulations for the operation and monitoring of water distribution systems. The *Regulation* stipulates in Section 8, Water Monitoring Analysis, that a supplier must collect and test samples from their distribution system as directed by a drinking water officer. The *Act* also requires that the results of a supplier's water quality monitoring program must be reported publicly. Under Section 11 of the *Regulation*, it stipulates that a report must be published within six months of the end of each calendar year.

### **Regional Health Authority Requirements**

The *Water Quality Monitoring and Reporting Plan (WQMRP)* was originally created in 2000 as a joint effort between Metro Vancouver (previously known as the Greater Vancouver Regional District), local government members, and the Region's Medical Health Officers. This plan requires water purveyors in BC to hold an Operating Permit as confirmation that the Medical Health Officer for the area approves of the public water supply and the purveyor's plans to provide potability, monitoring, reporting and notification in the case of emergency or other unusual circumstances.

### **Metro Vancouver Requirements**

The *Drinking Water Management Plan* is an overarching plan for Metro Vancouver and its member municipalities. This plan sets the direction and priority for regional drinking water

initiatives such as new infrastructure, identifying additional water supplies, and managing watersheds as natural assets.

## Health Bulletins

Despite the efforts of Metro Vancouver and the City of Coquitlam to provide disinfected drinking water, individuals with weakened immune systems are advised to read the Health Link BC Bulletin attached in Appendix A. Additionally, all individuals are advised to read Fraser Health's message regarding flushing taps that have not been used for 6 hours or longer, which can be found in Appendix B.

## Source Testing

Similar to most municipalities in the region, the City does not have a water supply treatment facility and instead purchases treated potable water from Metro Vancouver. The drinking water that is supplied to the City comes primarily from three regional sources, Capilano Lake, Seymour Lake and Coquitlam Lake; these surface sources are treated by Metro Vancouver. As of January 2010, water distributed out of Seymour Lake and Capilano Lake goes through filtration and is disinfected using ultraviolet light. The water distributed out of Coquitlam Lake is treated by both ozone and ultraviolet light. The pH of the water at Capilano, Seymour and Coquitlam Lakes is also adjusted to make the water less acidic as a corrosion control measure. Supplies from both sources use chlorine as a secondary disinfectant.

Quality of pre and post-treated source water is monitored and tested by Metro Vancouver in accordance with their *WQMRP*. The results of Metro Vancouver's monitoring for 2025 can be found in their publication *Greater Vancouver Water District 2025 Water Quality Annual Report* attached as Appendix C of this report.

## Distribution Testing


As per the requirements of the *Regulation* and to protect public health, the City must continuously test water quality throughout its distribution system. In accordance with the *WQMRP*, Metro Vancouver collects weekly water samples for the City and analyzes the samples at their laboratory.

The weekly drinking water sample test results are forwarded to both the City and the Fraser Health Authority directly by the Metro Vancouver's laboratory. Metro Vancouver's laboratory is a member of the Canadian Association of Analytical Laboratories and is accredited by the Standards Council of Canada. The Provincial Health Officer also approves the laboratory for the analysis of drinking water samples. If a sample shows evidence of fecal contamination, the laboratory contacts both the City and the Fraser Health Region immediately via telephone in accordance with Section 9, Immediate Reporting Standard, of the *Regulation*.

## Sampling Stations

There are 31 dedicated sampling stations distributed throughout the City. The station locations were chosen in consultation with the Fraser Health Authority and Metro Vancouver to provide a representative sample of drinking water quality throughout the entire distribution system. *Figure 1* shows the geographic location of the sampling stations. *Table 1* lists the sampling stations, their supply source, and flow rate at each location.

Figure 1: 2025 Water Sampling Station Locations

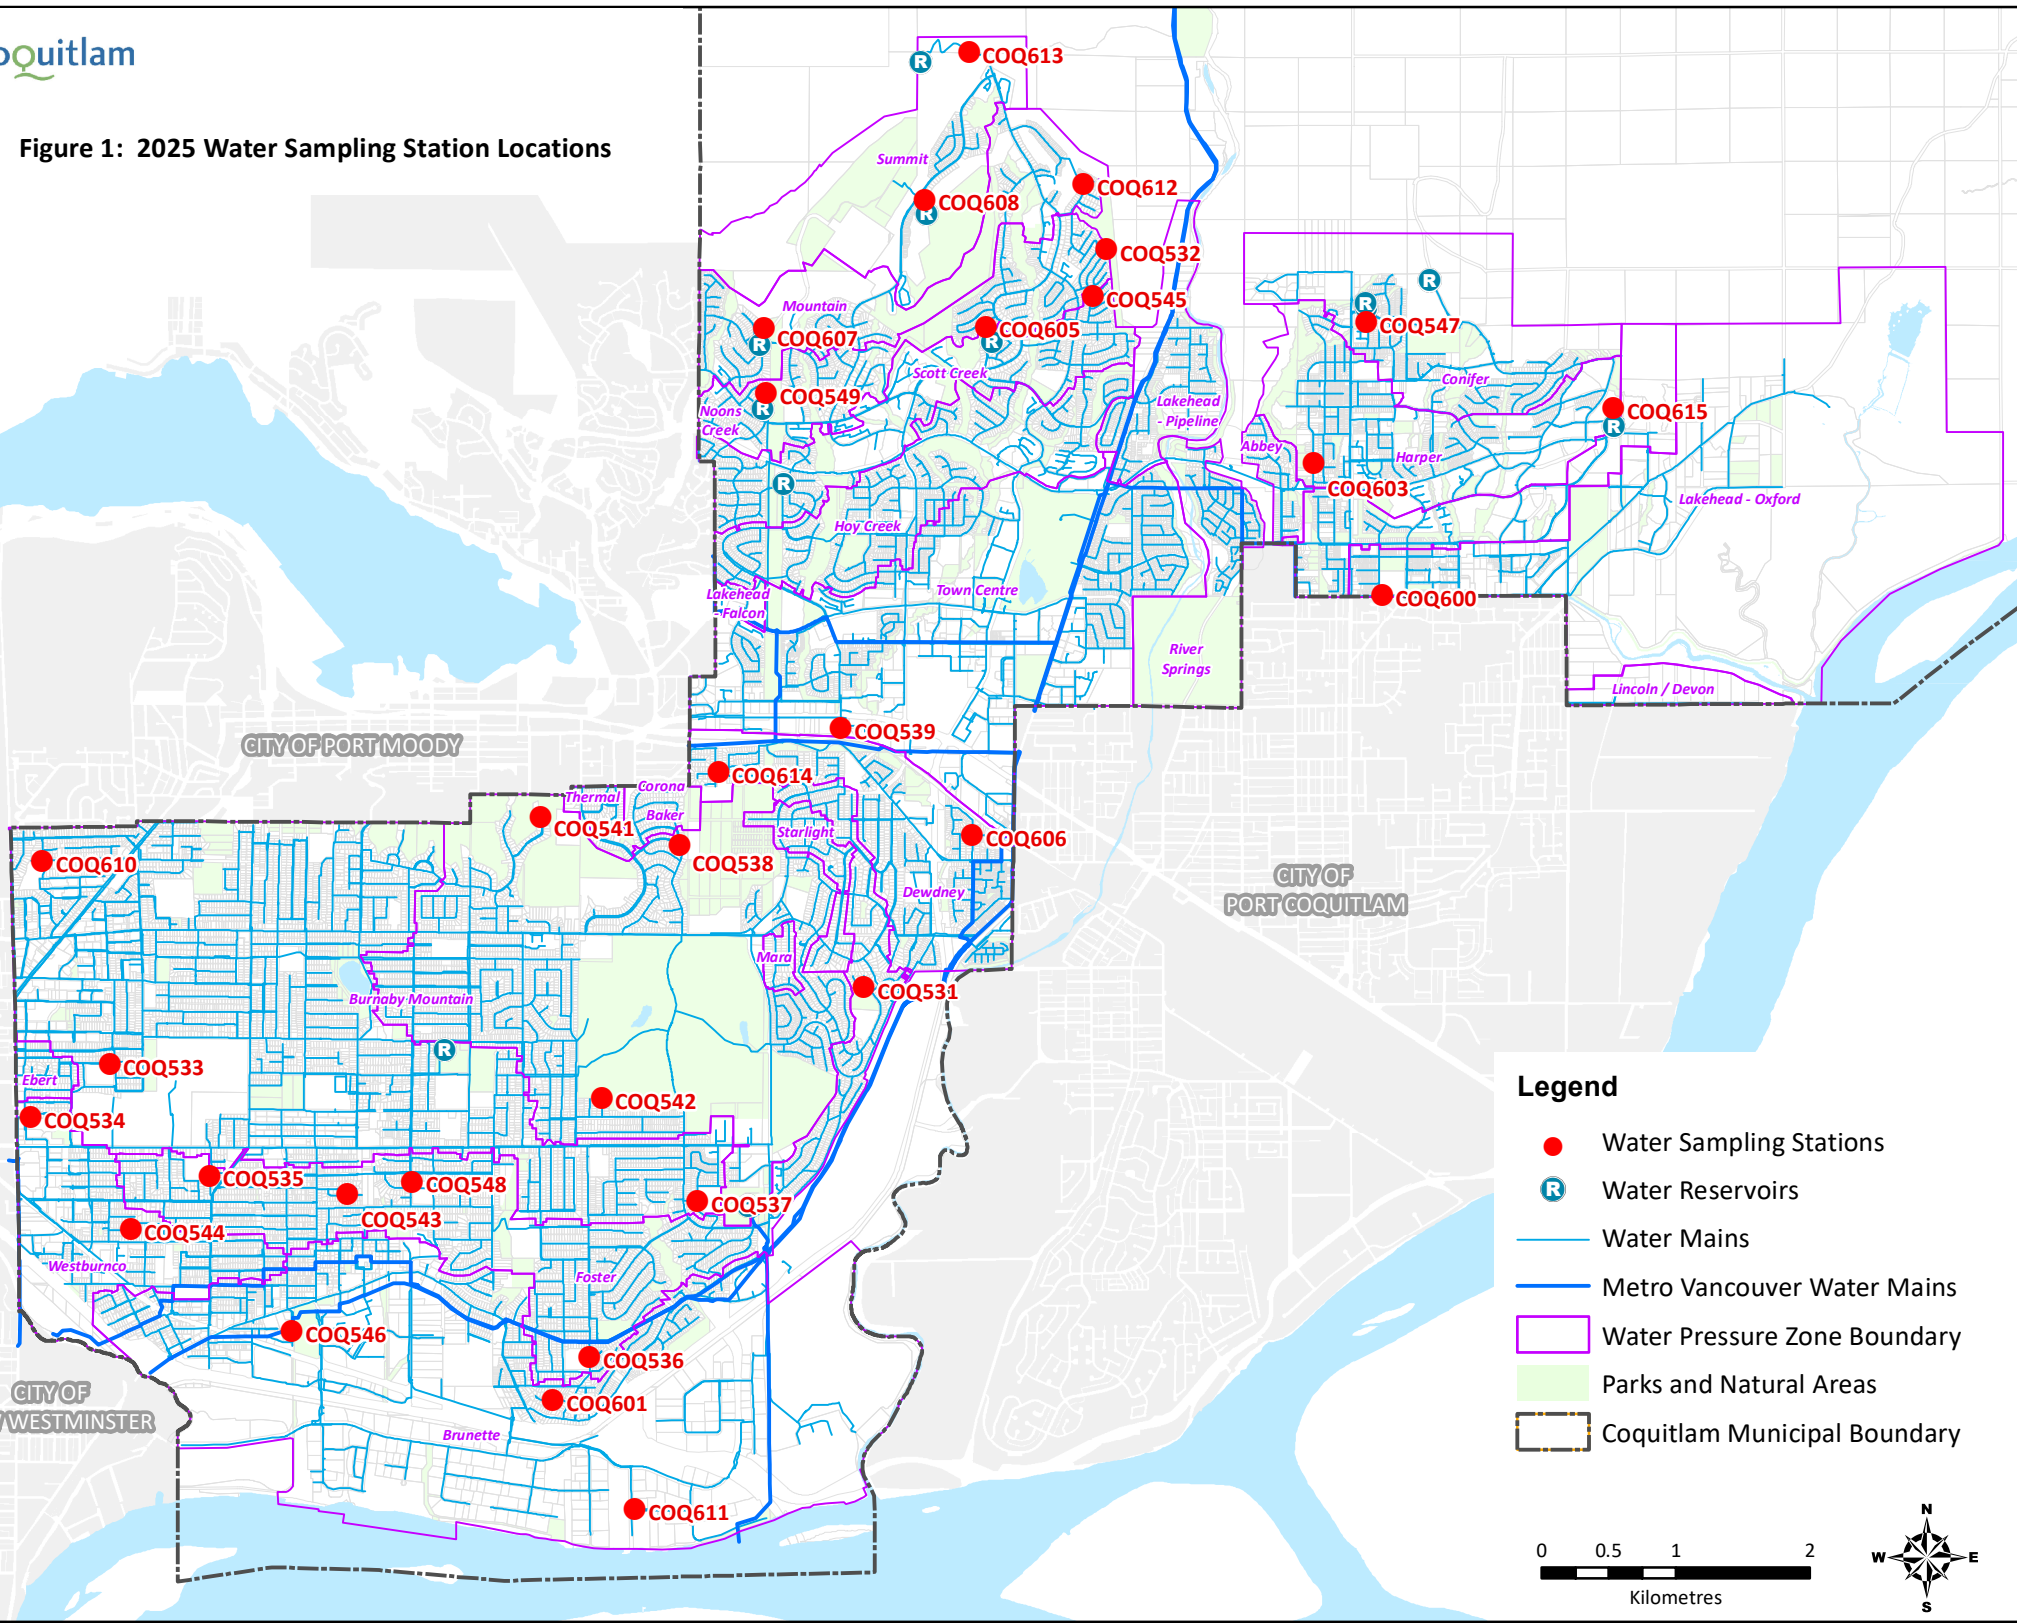

**Legend**

- Water Sampling Stations
- R Water Reservoirs
- Water Mains
- Metro Vancouver Water Mains
- Water Pressure Zone Boundary
- Parks and Natural Areas
- Coquitlam Municipal Boundary

0 0.5 1 2  
Kilometres

Table 1: 2025 Sampling Stations

Station	Location	Pressure Zone	Regional Supply	Sampling Site	Main Dia. (mm)
COQ531	Riverview Park (Clearwater & Paul Lake Gate)	Foster	Coquitlam/Seymour	Dead End	150
COQ532	Mallard Ct. (Mallard & Tanger)	Noons Creek	Coquitlam	Dead End	100
COQ533	600 Fairview St.	Burnaby Mountain	Seymour	Low	150
COQ534	Brookmere Ave. east of Whiting Way	Westburnco	Westburnco	Low	150
COQ535	540 Joyce St.	Foster	Coquitlam/Seymour	Low	200
COQ536	155 Finnigan St.	Foster	Coquitlam/Seymour	Low	150
COQ537	2550 Leduc Ave.	Burnaby Mountain	Coquitlam/Seymour	Low	150
COQ538	885 Baker Dr.	Burnaby Mountain	Seymour	Low	150
COQ539	Lansdowne Dr. south of Aberdeen Ave	Coquitlam	Coquitlam	Medium	150
COQ541	966 Fresno Pl.	Burnaby Mountain	Seymour	Dead End	150
COQ542	590 Orkney Ct.	Burnaby Mountain	Seymour	Dead End	150
COQ543	1150 Howse Pl. south of Madore Ave.	Foster	Coquitlam/Seymour	Dead End	150
COQ544	721 Pembroke Ave.	Westburnco	Westburnco	Dead End	150
COQ545	Blue Jay Way; north of Finch	Scott Creek	Coquitlam	Dead End	200
COQ546	Mackin Park (Nelson St. & Brunette Ave.)	Coquitlam	Coquitlam	Low	150
COQ547	Harper Reservoir	Harper	Coquitlam	Medium	300
COQ548	411 Schoolhouse St.	Foster	Coquitlam	Medium	200
COQ549	Scott Creek Pump Station (2775 Panorama Dr.)	Scott Creek	Coquitlam	Medium	350
COQ600	Victoria Dr. & Toronto St.	Coquitlam	Coquitlam	Low	150
COQ601	2085 Concord Ave.	Coquitlam	Coquitlam	Dead End	150
COQ603	1323 Glenbrook St.	Harper	Coquitlam	Low	150
COQ605	Hoy Creek Reservoir (Whitebark Pl.)	Hoy Creek	Coquitlam	Medium	400
COQ606	998 Irvine St. (Irvine St. & Reese Ave.)	Coquitlam	Coquitlam	Medium	200
COQ607	Noons Creek Reservoir (1550 Eagle Mtn. Blvd)	Noons Creek	Coquitlam	Low	300
COQ608	Eagle Mountain Reservoir	Eagle Mountain	Coquitlam	Low	300
COQ610	550 Thompson	Burnaby Mountain	Seymour	Dead End	150
COQ611	Leeder St. & Rogers Ave.	Coquitlam	Coquitlam	Medium	200
COQ612	1762 Hampton Dr.	Eagle Mountain	Coquitlam	Low	200
COQ613	Eagle Summit Reservoir, Gate	Summit	Coquitlam	Medium	300
COQ614	Buoy Dr. & Quay Pl.	Coquitlam	Coquitlam	Medium	150
COQ615	Crouch Reservoir	Lake Head-Oxford	Coquitlam	Medium	400

The monitoring protocol recommends the following distribution of sampling sites:

- 10% supply
- 40% low flow
- 40% medium flow
- 10% dead end

The City’s current distribution of sampling sites is 0% supply, 39% low flow, 32% medium flow and 29% dead end. The City has a disproportionate number of dead end and medium flow sampling sites due to sampling points being established prior to the creation of the current protocol. However, in combination with Metro Vancouver’s testing along the distribution/supply mains, the sampling stations represent the City’s water quality system adequately. In addition, the City continuously makes an effort to eliminate dead ends via looping water mains through land development projects and Capital projects.

## Sampling Frequency

Schedule B of the *Regulation* requires that the City take a minimum of 90 samples per month plus 1 sample per month for every 10,000 people in excess of 90,000. As the City’s 2025 population is estimated to be 158,000 (considering 2021 Census data), at least 97 samples are required each month. The number of samples taken per month in 2025 is shown in the following table:

Table 2: Number of Samples Taken by Month in 2025

Month	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Grand Total
Number of Samples	170	154	182	215	166	150	159	184	150	238	183	174	2125

Table 2 shows that the lowest amount of samples taken was 150 in September and June, thus fulfilling the monthly sampling frequency protocol in 2025.

## Test Parameters

Weekly samples collected at each sampling site are tested for the following parameters:

### Bacteriological Parameters

- Escherichia coliform measured in colony-forming units per 100 milliliters (cfu/100mL)
- Total coliform measured in in colony-forming units per 100 milliliters cfu/100mL)
- Heterotrophic Plate Count (HPC) measured in in colony-forming units per milliliter (cfu/mL)

### Physical Parameters

- Temperature measured in degrees Celsius
- Turbidity measured in nephelometric turbidity units (NTU)

### Chemical Parameters

- Free chlorine residuals measured in milligrams per liter (mg/L)

Chemical parameters are also measured quarterly at selected stations to test for the following disinfection byproducts:

- Haloacetic acids (HAA) measured in parts per billion (ppb)
- Trihalomethanes (THM) measured in parts per billion (ppb)

Additionally, the following chemical parameters are tested semi-annually:

- Metals measured in micrograms per liter (µg/L)
- Vinyl Chloride measured in milligrams per liter (mg/L)
- pH (acidity or alkalinity)

## Bacteriological Parameters

Weekly tests are conducted at all of the City’s sampling stations to detect Escherichia coliform, total coliforms, and heterotrophic bacteria.

### Escherichia Coliform

Escherichia coliform (E. coli) is an indicator of recent fecal contamination and that microorganisms capable of causing gastrointestinal illnesses may also be present. As per the *GCDWQ* and *Regulation*, no detectable E. coli per 100mL is permitted. The City had no samples which tested positive for E. coli in 2025.

### Total Coliforms

Total coliforms are not used as indicators of potential health effects from pathogenic microorganisms, but rather are indicators of water quality changes within a drinking water distribution system. In a distribution system, detection of total coliforms can indicate regrowth of bacteria or the intrusion of untreated water. The *Regulation* has the following standards regarding the detection of total coliforms:


*Table 3: Water Quality Standards for Potable Water: Total Coliform Bacteria*

Parameter	Standard
(a) 1 sample in a 30 day period	No detectable total coliform bacteria per 100 ml
(b) more than 1 sample in a 30 day period	At least 90% of samples have no detectable total coliform bacteria per 100 ml and no sample has more than 10 total coliform bacteria per 100 ml

Similarly, to the *Regulation’s* standard shown in *Table 3*, the *GCDWQ* states that “in a distribution and storage system, detection of total coliforms from consecutive samples from the same site or from more than 10% of the samples collected sampling period should be investigated.”


There were two samples that contained coliforms; however none of these samples exceeded the standards shown in *Table 3(b)*. The locations of the two samples containing coliforms are shown in the following figure:

Figure 2: 2025 Sampling Stations Indicating Positive for Total Coliforms

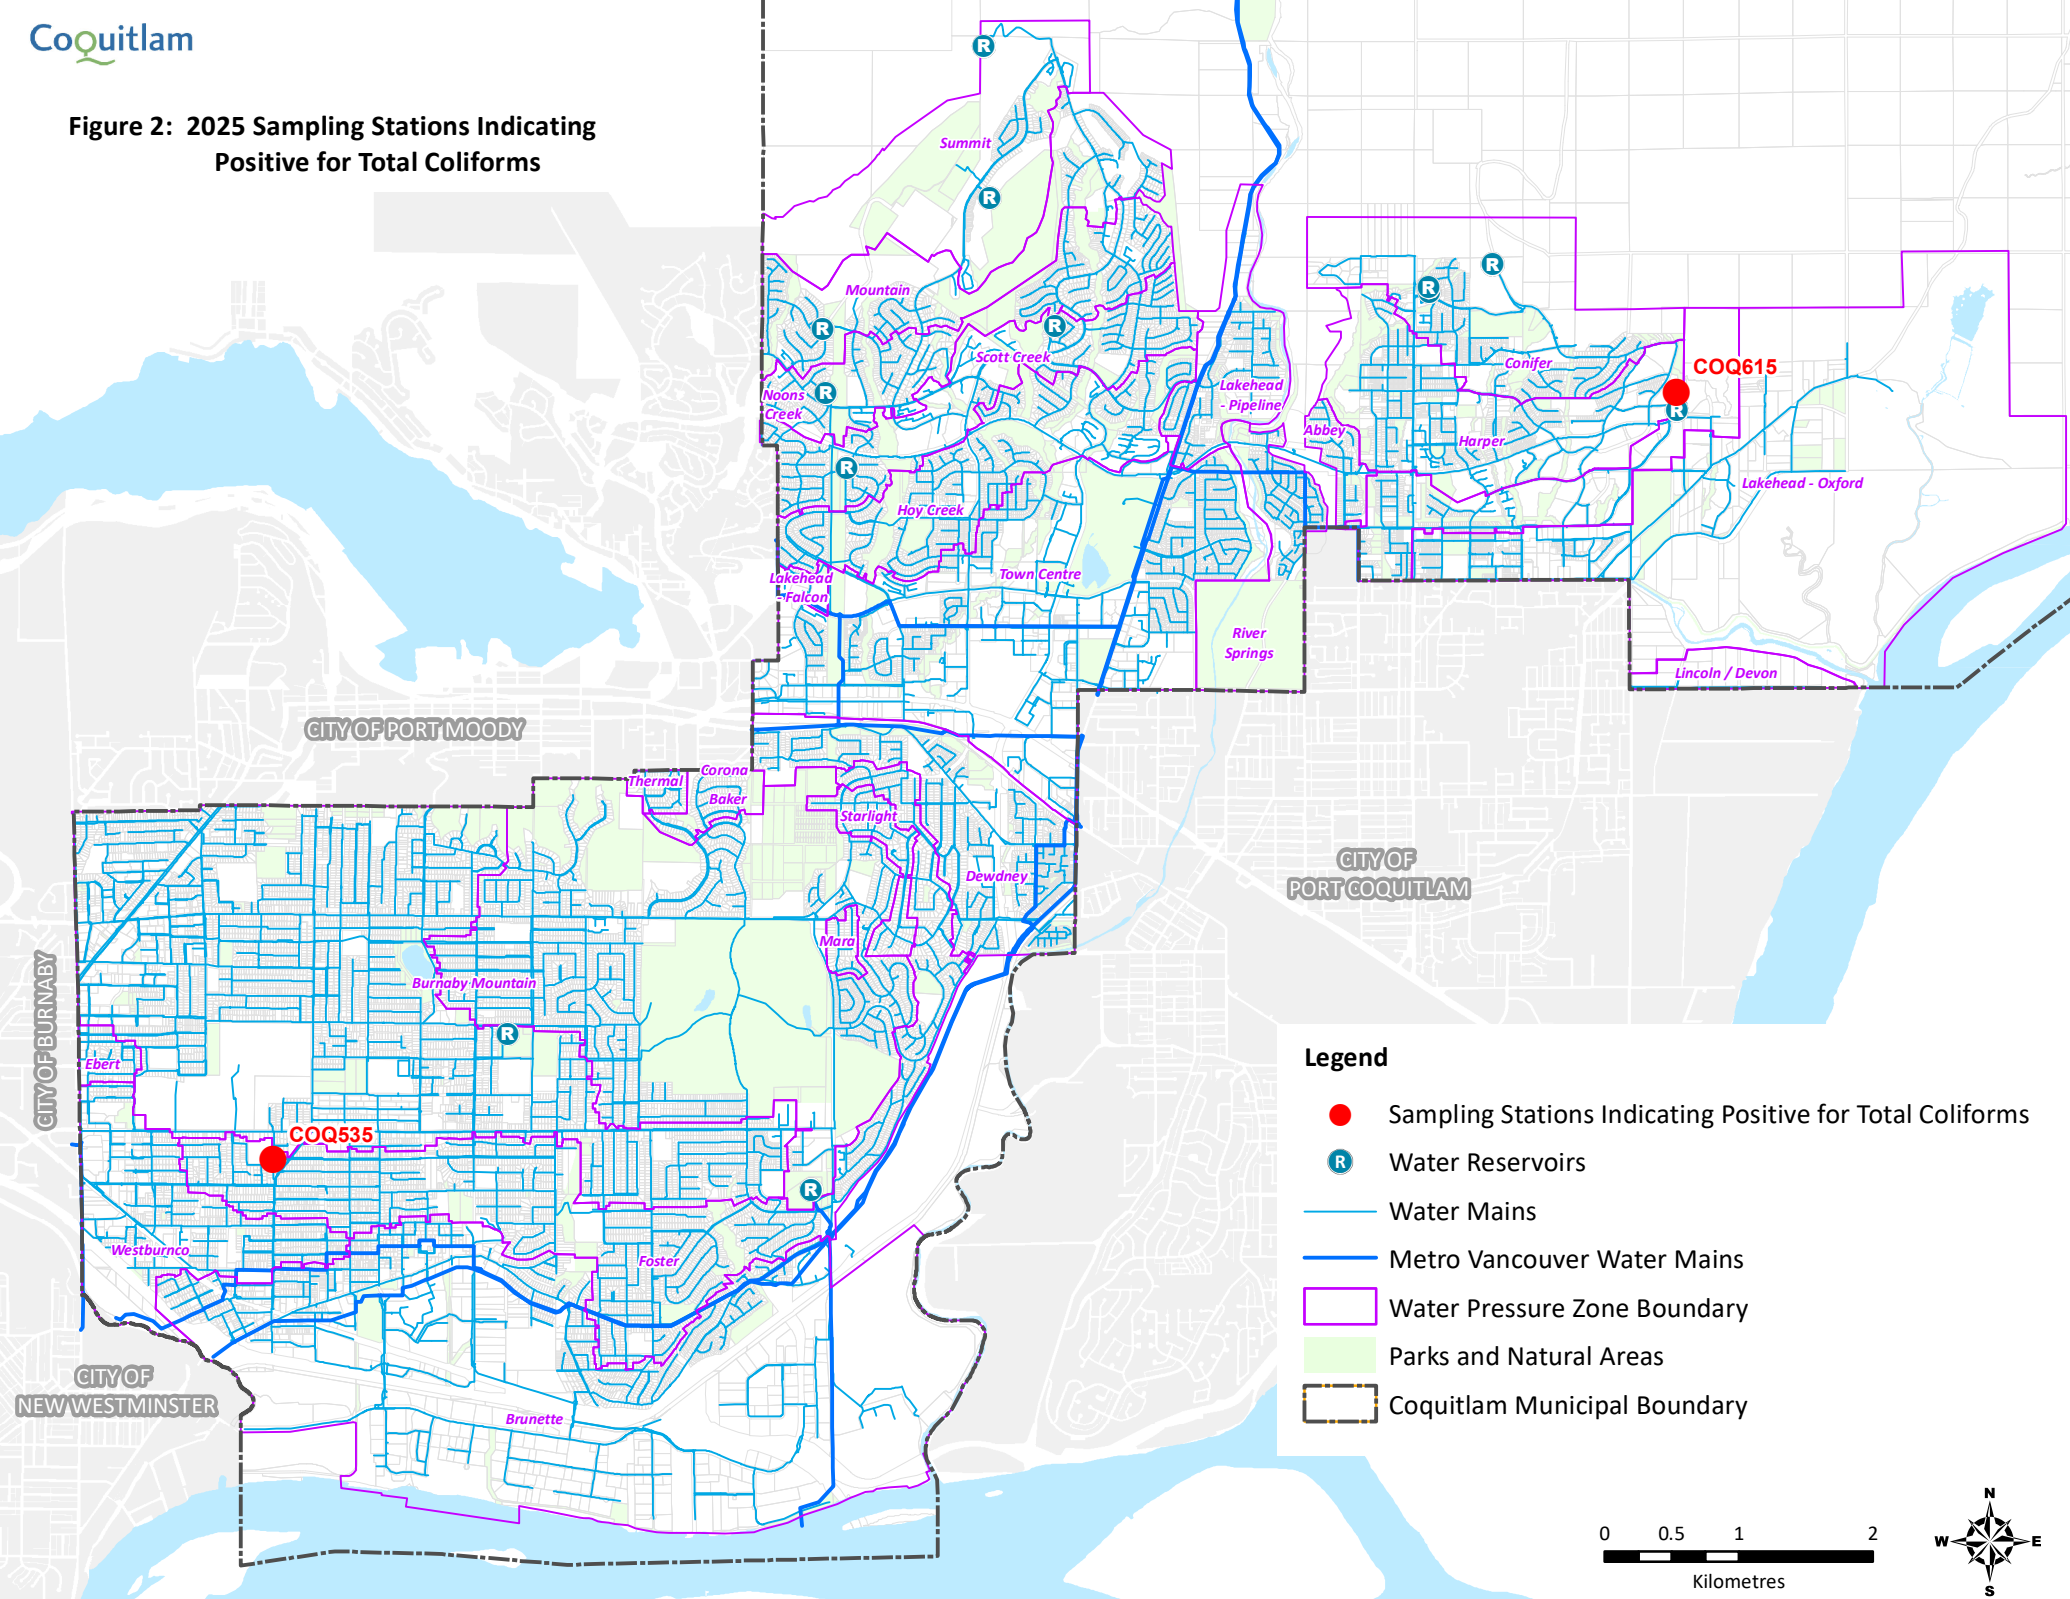

**Legend**

- Sampling Stations Indicating Positive for Total Coliforms
- R Water Reservoirs
- Water Mains
- Metro Vancouver Water Mains
- Water Pressure Zone Boundary
- Parks and Natural Areas
- Coquitlam Municipal Boundary



As *Figure 2* shows, there are two locations where the samples containing total coliforms were found. None of the stations had two samples that were positive for total coliforms occurring within 30 days.

Typically, these positive results are due to the sample stations needing cleaning and disinfecting and not a result of poor water quality itself. If positive results are detected, the City responds by flushing the lines at the location to ensure that any potential water quality issues are resolved.

The results of the weekly testing for *E. coli* and total coliforms is summarized in *Table 4*.

Table 4: 2025 Weekly Test Results for E. coli and Total Coliforms

Week	Number of Samples	Number of Samples Positive for E. coli	Number of Samples Positive for Total Coliforms	Number of Samples > 10% Total Coliforms (10 cfu/100mL)
1	36	0	0	0
2	44	0	0	0
3	54	0	0	0
4	19	0	0	0
5	25	0	0	0
6	15	0	0	0
7	20	0	0	0
8	77	0	0	0
9	55	0	0	0
10	47	0	0	0
11	46	0	0	0
12	26	0	0	0
13	50	0	0	0
14	48	0	0	0
15	56	0	0	0
16	27	0	0	0
17	63	0	0	0
18	55	0	0	0
19	31	0	0	0
20	30	0	0	0
21	49	0	0	0
22	37	0	0	0
23	13	0	1	0
24	19	0	1	0
25	49	0	0	0
26	46	0	0	0
27	26	0	0	0
28	31	0	0	0
29	43	0	0	0
30	43	0	0	0
31	16	0	0	0
32	19	0	0	0
33	54	0	0	0
34	55	0	0	0
35	56	0	0	0
36	46	0	0	0
37	27	0	0	0
38	37	0	0	0
39	40	0	0	0
40	20	0	0	0
41	49	0	0	0
42	74	0	0	0
43	55	0	0	0
44	70	0	0	0
45	40	0	0	0
46	55	0	0	0
47	40	0	0	0
48	41	0	0	0
49	50	0	0	0
50	59	0	0	0
51	27	0	0	0
52	15	0	0	0
<b>Total:</b>	<b>2125</b>	<b>0</b>	<b>2</b>	<b>0</b>
<b>% of Total:</b>		<b>0.00%</b>	<b>0.09%</b>	<b>0.00%</b>

As *Table 4* shows, the City had no instances of *E. coli*. The City had two samples that tested positive for total coliforms. Neither of these two samples surpassed the regulated amount of 10% total coliforms (> 10cfu/100mL).

### **Heterotrophic Plate Count**

Health Canada, the World Health Organization, and the US Environmental Protection Agency all now recognize that there are no negative health effects related to the presence of heterotrophic bacteria in drinking water. The heterotrophic plate count (HPC) test is still conducted on samples as high increases of heterotrophic bacteria is correlated to changes in distribution system water quality. Health Canada recently replaced their document *Guidance on the Use of Heterotrophic Plate Counts in Canadian Drinking Water Supplies* with *Monitoring the Biological Stability of Drinking Water in Distribution Systems* (2023) due to the water industry shifting away from HPC because of the limitations and reliability of this test.

Metro Vancouver continues to test the City's water using HPC and these results, along with all of the monitoring results for each sampling site, are provided in Appendix D.

### **Physical Parameters**

In relation to both physical and chemical parameters, the *WQMRP* has requirements regarding the frequency of testing while the *GCDWQ* states maximum acceptable concentrations and aesthetic objectives. The requirements of these two regulations are shown in the following table:

Table 5: WQMRP and GCDWQ Requirements regarding Physical and Chemical Parameters.

Parameter	Maximum Acceptable Concentration	Aesthetic Objective	Minimum Frequency
Free Chlorine Residual	Min: 0.2 mg/L		With every bacteriological sample
Copper	2 mg/L	< 1.0 mg/L	Semi-Annually
Haloacetic Acid (HAA)	80 ppb		Quarterly
Iron		≤ 0.1mg/L	Semi-Annually
Lead	0.005 mg/L		Semi-Annually
Odour		Inoffensive	Complaint Basis
pH		7.0-10.5	Quarterly
Taste		Inoffensive	Complaint Basis
Temperature		<15°C	With every bacteriological sample
Trihalomethane (THM)	100 ppb		Quarterly
Turbidity		< 1.0 NTU	With every bacteriological sample
Vinyl Chloride	0.002 mg/L		Semi-Annually
Zinc		≤ 5.0 mg/L	Semi-Annually

As Table 5 shows, physical and chemical parameters are required by Metro Vancouver to be tested on various minimum frequencies. The following physical parameters, temperature and turbidity, are measured on a weekly basis.

### Temperature

The GCDWQ states that “temperature indirectly affects health and aesthetics through impacts on disinfection, corrosion control and formation of biofilms in the distribution system.” The guideline suggests that an aesthetic objective of drinking water temperature is less than 15°C, as temperatures higher than this can affect aesthetic qualities such as taste, odour and colour.

The City’s average drinking water temperature throughout the year was 11.6°C in 2025. The average drinking water temperature during the summer season (June 20 to September 22), was 16.7°C. All of the 2025 monitoring results relating to temperature are provided in Appendix D.

### Turbidity

Turbidity is the measure of suspended particles in water that result from silt, clay or organic material. Suspended particles can entrap microorganisms, heavy metals or biocides, protecting them from disinfection. The GCDWQ recommends that water distribution systems contain less than 1.0 NTU (Nephelometric Turbidity Units).

Of the total samples taken in 2025, 0.71% (15 of 2125 samples) were higher than 1.0 NTU and 0.05% (1 of 2125 samples) were higher than 5 NTU. The cause of turbidity within the City's distribution system is often a result of flushing, valve exercising, hydrant use/maintenance, or may be a result of turbidity from the water source. Issues relating to turbidity are usually solved with continuous flushing in the problematic area. All of the 2025 monitoring results relating to turbidity are provided in Appendix D.

## **Chemical Parameters**

Chemical parameters are measured on variable minimum frequencies, as was shown in *Table 5*. Free chlorine residuals are measured on a weekly basis, while disinfection byproducts are tested quarterly, and metals, vinyl chloride and pH are tested semi-annually.

### **Free Chlorine Residuals**

Metro Vancouver adds chlorine as a secondary disinfectant at their treatment plants in order to control the re-growth of bacteria throughout the distribution system. The *GCDWQ* does not specify a maximum guideline value of chlorine as there is low toxicity at concentrations found in drinking water. The *GCDWQ* states that a free chlorine residual of 0.2 mg/L is considered a minimum level for the control of bacterial regrowth in a distribution system.

*Table 5* shows the total number of samples collected from each sampling station, the number of samples with at least 0.2 mg/L of free chlorine, and the number of samples with less than 0.2 mg/L of free chlorine in 2025.

Table 6: 2025 Chlorine Residuals

Sample Station	Number of Samples	Samples with Cl <sub>2</sub> < 0.2 mg/L	Samples with Cl <sub>2</sub> ≥ 0.2 mg/L	Samples with Cl <sub>2</sub> < 0.2 mg/L (%)	Samples with Cl <sub>2</sub> ≥ 0.2 mg/L (%)
COQ-531	94	5	89	5%	95%
COQ-532	58	51	7	88%	12%
COQ-533	60	1	59	2%	98%
COQ-534	90	1	89	1%	99%
COQ-535	78	7	71	9%	91%
COQ-536	67	0	67	0%	100%
COQ-537	79	1	78	1%	99%
COQ-538	61	0	61	0%	100%
COQ-539	56	13	43	23%	77%
COQ-541	83	14	69	17%	83%
COQ-542	84	7	77	8%	92%
COQ-543	84	8	76	10%	90%
COQ-544	79	4	75	5%	95%
COQ-545	58	44	14	76%	24%
COQ-546	73	0	73	0%	100%
COQ-547	52	0	52	0%	100%
COQ-548	92	0	92	0%	100%
COQ-549	50	0	50	0%	100%
COQ-600	67	25	42	37%	63%
COQ-601	82	32	50	39%	61%
COQ-603	68	1	67	1%	99%
COQ-605	47	0	47	0%	100%
COQ-606	74	0	74	0%	100%
COQ-607	63	1	62	2%	98%
COQ-608	45	0	45	0%	100%
COQ-610	79	2	77	3%	97%
COQ-611	76	4	72	5%	95%
COQ-612	58	54	4	93%	7%
COQ-613	49	5	44	10%	90%
COQ-614	60	23	37	38%	62%
COQ-615	59	24	35	41%	59%
<b>Grand Total:</b>	<b>2125</b>	<b>327</b>	<b>1798</b>	<b>15%</b>	<b>85%</b>

As *Table 6* shows, 1798 out of 2125 (85%) of the samples recorded in 2025 achieved the minimum concentration of 0.2mg/L of free chlorine. A map of the chlorine test results amongst all of the sampling stations is shown in the following figure.

Figure 3: 2025 Free Chlorine Residuals


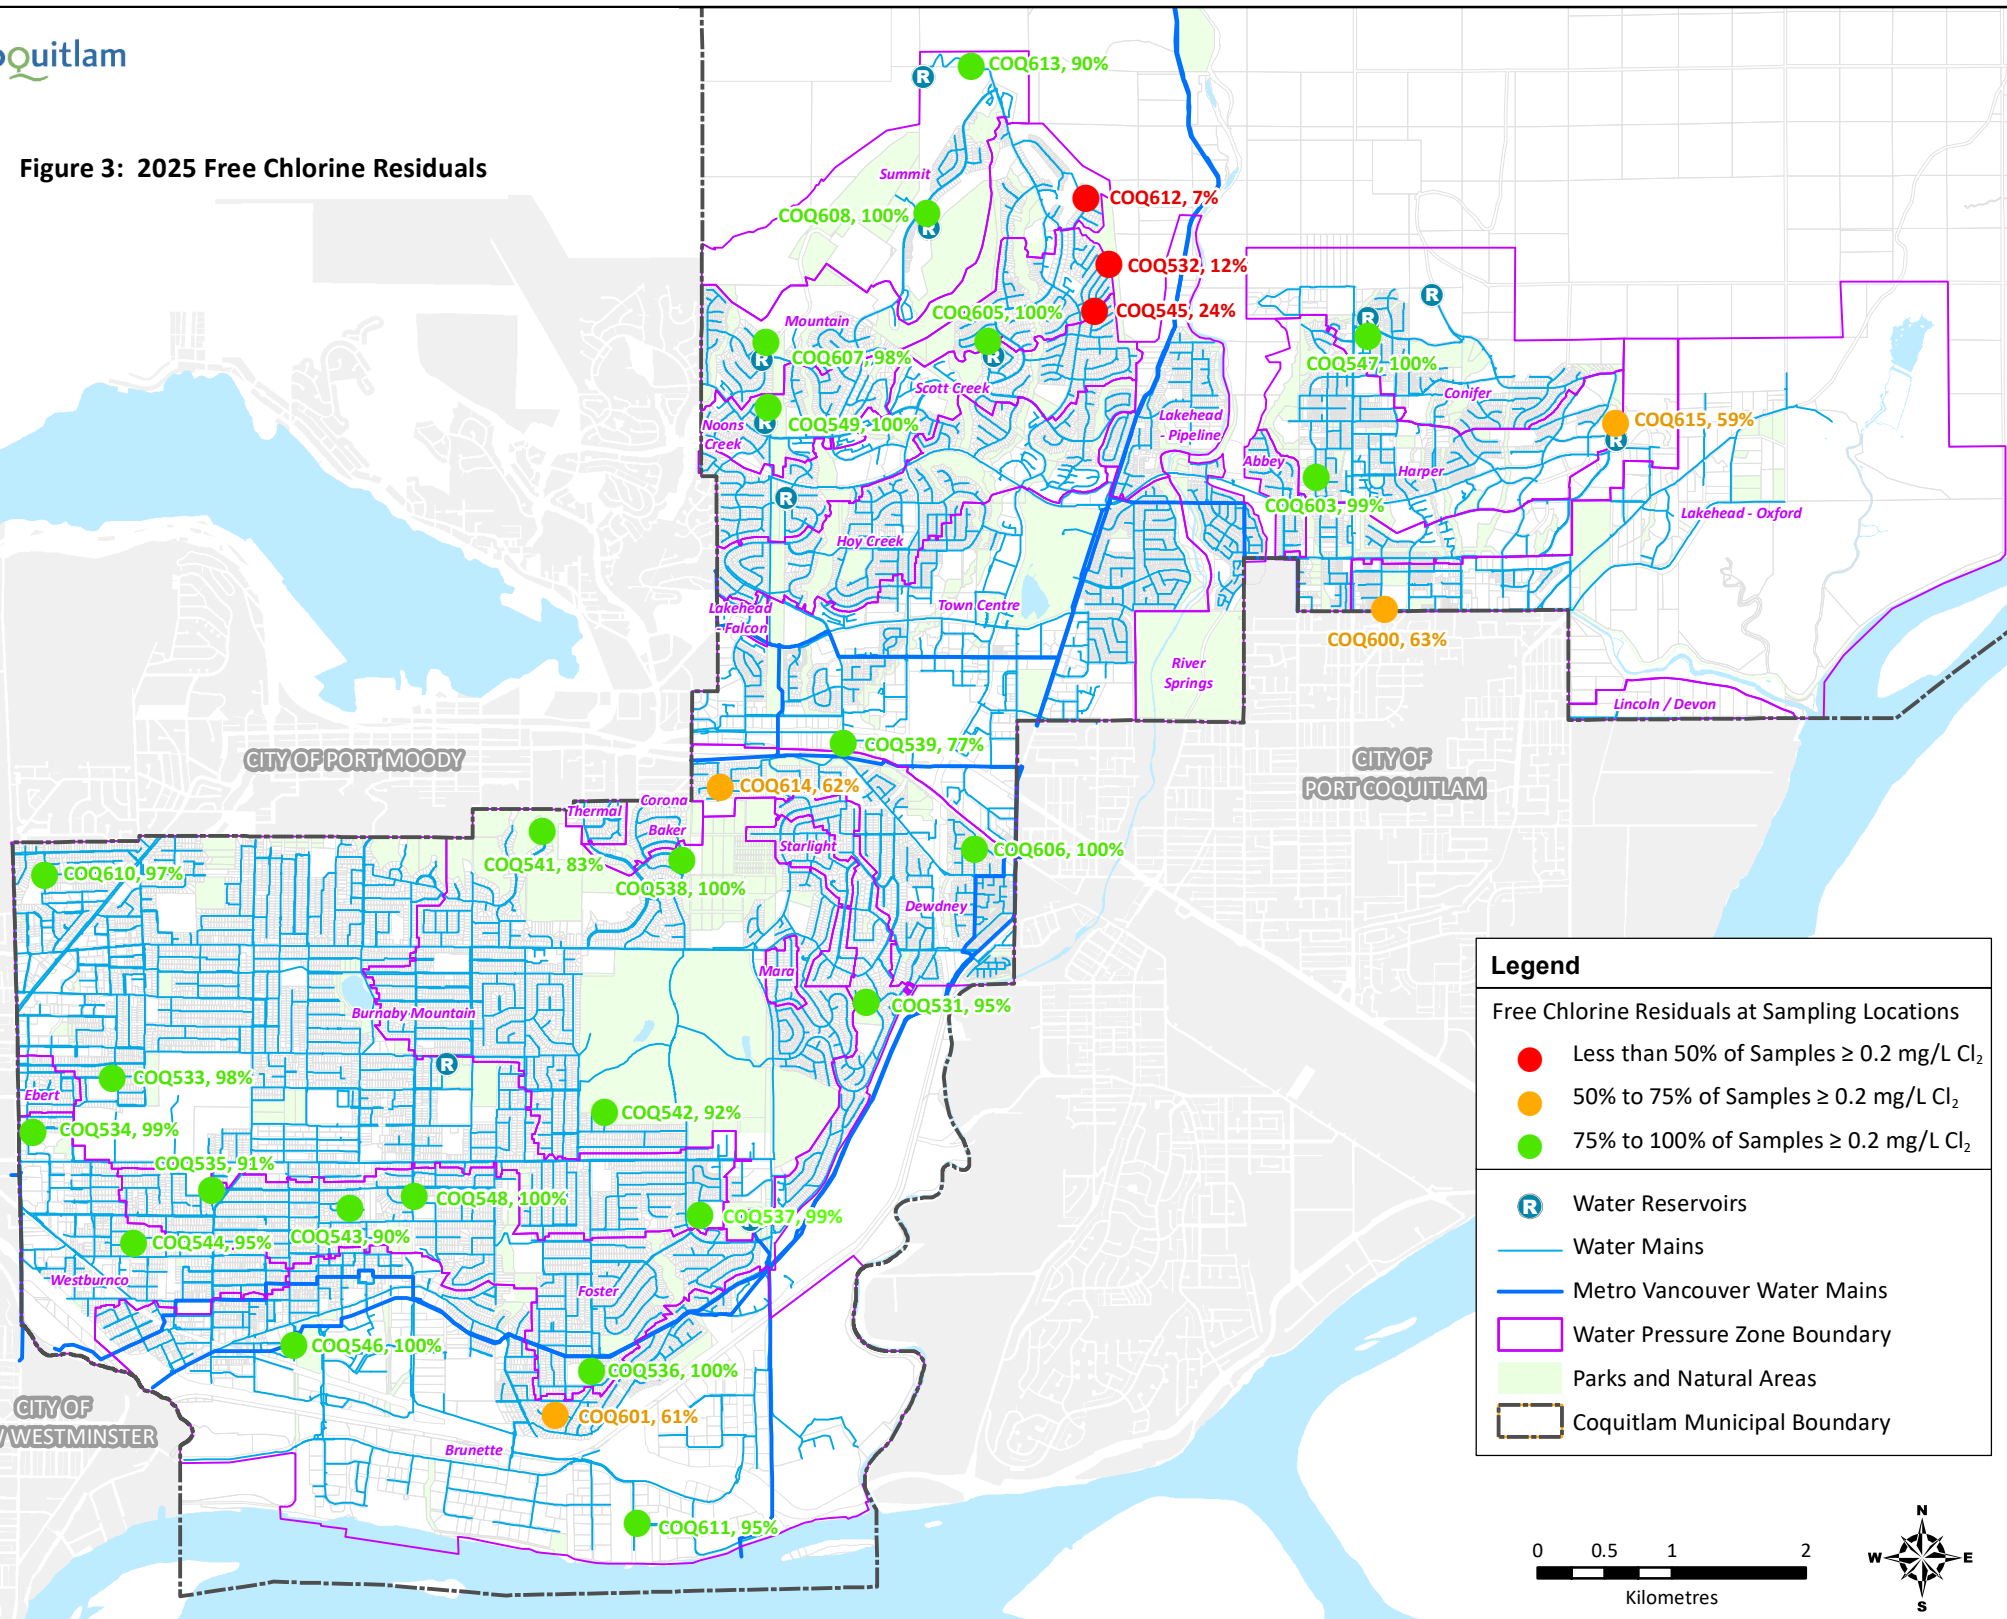


Figure 3 shows that the majority of the City's sampling stations had adequate levels of free chlorine residuals present.

Stations COQ532, COQ545, and COQ612 experienced chlorine residual levels below 0.2 mg/L in over 50% of samples taken. Stations COQ532, COQ545, and COQ612 reside in areas that see little demand for water as they are located on low-flow or dead-end water mains; despite the low amount of free-chlorine, bacteria re-growth was not observed at any of these stations. The level of chlorination in this zone is controlled with re-chlorination stations. They are carefully monitored to ensure adequate chlorine residual while keeping disinfection by-products at acceptable levels, as high levels of chlorine in this area have contributed to resulting disinfection by-products in the past.

The City is continuously reviewing development opportunities in order to loop water mains and reduce dead-end mains. Adding new technology such as the automatic water main flushing system will also assist with water circulation for dead-ends. In the meantime the City will continue monitoring chlorine residuals to control and minimize the re-growth of bacteria.

### **Haloacetic Acids**

HAAs are potentially carcinogenic by-products of chlorine disinfection within a water distribution system and comprise of dibromoacetic acid, dichloroacetic acid, monobromoacetic acid, monochloroacetic acid, and trichloroacetic acid. The *GCDWQ* states that 80 ppb is the maximum acceptable concentration of HAAs based on a locational annual running average of samples taken. The 2025 results of HAAs are shown in the following table.

Table 7: 2025 HAA Test Results

Sample Station	Date Sampled	HAA (ppb)						Total HAA Quarterly Average (Guideline Limit 80 ppb)
		Dibromoacetic Acid	Dichloroacetic Acid	Monobromoacetic Acid	Monochloroacetic Acid	Trichloroacetic Acid	Total Haloacetic Acid	
COQ-541	30-Jan-25	<0.5	5.3	<0.5	<0.5	9.6	15	15
COQ-541	10-Apr-25	<0.5	8.8	<0.5	<0.5	9.8	19	15
COQ-541	10-Sep-25	<0.5	1.9	<0.5	<5.0	16	18	16
COQ-541	19-Nov-25	<0.5	2.8	<0.5	<5.0	13	16	17
COQ-543	18-Feb-25	<0.5	10	<0.5	<0.5	9.4	20	17
COQ-543	9-Apr-25	<0.5	14	<0.5	<0.5	11	25	17
COQ-543	12-Sep-25	<0.5	1.5	<0.5	<5.0	8.5	10	16
COQ-543	19-Nov-25	<0.5	4.9	<0.5	<5.0	10	15	18
COQ-544	18-Feb-25	<0.5	8.5	<0.5	<0.5	9.7	18	22
COQ-544	9-Apr-25	<0.5	13	<0.5	<0.5	13	26	21
COQ-544	12-Sep-25	<0.5	3.8	<0.5	<5.0	11	15	20
COQ-544	19-Nov-25	<0.5	9.3	<0.5	<5.0	11	20	20
COQ-600	31-Jan-25	<0.5	11	<0.5	<0.5	9.8	21	18
COQ-600	9-Apr-25	<0.5	5.6	<0.5	<0.5	11	17	18
COQ-600	10-Sep-25	<0.5	4.5	<0.5	<5.0	11	16	18
COQ-600	19-Nov-25	<0.5	6.5	<0.5	<5.0	14	21	19
COQ-601	18-Feb-25	<0.5	4.8	<0.5	<0.5	13	18	19
COQ-601	9-Apr-25	<0.5	5.4	<0.5	<0.5	19	24	20
COQ-601	12-Sep-25	<0.5	3.8	<0.5	<5.0	14	18	20
COQ-601	19-Nov-25	<0.5	7.3	<0.5	<5.0	27	34	24
COQ-613	19-Feb-25	<0.5	3.4	<0.5	<0.5	27	30	40
COQ-613	8-Apr-25	<0.5	2.1	<0.5	<0.5	35	37	39
COQ-613	10-Sep-25	<0.5	0.6	<0.5	<5.0	24	25	37
COQ-613	19-Nov-25	<0.5	2.5	<0.5	<5.0	38	40	33

As Table 7 shows, no samples exceeded the 80 ppb quarterly average limit for HAAs.

### **Trihalomethanes**

THMs are another potentially carcinogenic by-product of chlorine disinfection and also stem from industrial effluents. THMs refer to the total of bromodichloromethane, bromoform, chlorodibromomethane, and chloroform. The *GCDWQ* states that the running annual average total THM concentration should not exceed 100 parts per billion (ppb). In addition to concentration of bromodichlorimethane should not exceed 16 ppb. The 2025 results of THMs are shown in the following table.

Table 8: 2025 THM Test Result

Sample Station	Date Sampled	THM (ppb)					Total THM Quarterly Average (Guideline Limit 100 ppb)
		Bromodichloromethane	Bromoform	Chlorodibromomethane	Chloroform	Total Trihalomethanes	
COQ-541	30-Jan-25	<1	<1	<1	28	29	37
COQ-541	10-Apr-25	<1	<1	<1	32	34	36
COQ-541	10-Sep-25	1	<1	<1	42	43	37
COQ-541	19-Nov-25	<1	<1	<1	38	39	36
COQ-543	18-Feb-25	<1	<1	<1	22	23	31
COQ-543	9-Apr-25	<1	<1	<1	32	32	30
COQ-543	12-Sep-25	1	<1	<1	30	31	29
COQ-543	19-Nov-25	<1	<1	<1	31	32	30
COQ-544	18-Feb-25	<1	<1	<1	24	25	33
COQ-544	9-Apr-25	<1	<1	<1	35	36	33
COQ-544	12-Sep-25	1	<1	<1	37	39	33
COQ-544	19-Nov-25	<1	<1	<1	33	34	34
COQ-600	31-Jan-25	<1	<1	<1	19	20	29
COQ-600	9-Apr-25	<1	<1	<1	25	25	28
COQ-600	10-Sep-25	<1	<1	<1	28	28	26
COQ-600	19-Nov-25	<1	<1	<1	28	29	26
COQ-601	18-Feb-25	<1	<1	<1	20	22	29
COQ-601	9-Apr-25	<1	<1	<1	25	26	27
COQ-601	12-Sep-25	<1	<1	<1	30	31	27
COQ-601	19-Nov-25	<1	<1	<1	34	35	29
COQ-613	19-Feb-25	1	<1	<1	31	33	49
COQ-613	8-Apr-25	1	<1	<1	39	40	49
COQ-613	10-Sep-25	1	<1	<1	56	58	47
COQ-613	19-Nov-25	1	<1	<1	53	54	46

As Table 8 shows, none of the samples exceeded the 100 ppb limit for THMs and bromodichlorimethane never exceeded the 16 ppb limit.

**Metals**

Table 9 provides the current guidelines for metals in drinking water as established in the GCDWQ.

Table 9: GCDWQ Standards for Metals in Drinking Water

Parameter	Limit (µg/L)	Reason Guideline Established
Aluminum Total	2900	Health
Antimony Total	6	Health
Arsenic Total	10 (ALARA)	Health
Barium Total	2000	Health
Boron Total	5000	Health
Cadmium Total	7	Health
Calcium Total	None	
Chromium Total	50	Health
Cobalt Total	None	
Copper Total	2000	Health
Iron Total	≤ 300	Aesthetic
Lead Total	5 (ALARA)	Health
Magnesium Total	None	
Manganese Total	120	Health
Mercury Total	1.0	Health
Molybdenum Total	None	
Nickel Total	None	
Potassium Total	None	
Selenium Total	50	Health
Silver Total	None	
Sodium Total	≤ 200,000	Aesthetic
Zinc Total	≤ 5000	Aesthetic

\*ALARA= As Low As Reasonably Achievable

The guidelines that are showed in Table 9 were all achieved within the City’s drinking water system, which is shown in Table 10.

Table 10: 2025 Testing Results for Metals

Station:	COQ-533		COQ-536		COQ-538		COQ-541		COQ-544		
Sample Date:	18-Jun	11-Dec	18-Jun	9-Dec	19-Jun	10-Dec	19-Jun	10-Dec	18-Jun	9-Dec	
Total Metals (µg/L)	Aluminum	33	32	42	34	40	34	34	31	43	33
	Antimony	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
	Arsenic	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
	Barium	2.6	3.2	2.7	3.3	2.8	3.1	3.1	3.6	2.3	4.1
	Boron	<10	<10	<10	<10	<10	<10	<10	<10	<10	<10
	Cadmium	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2
	Calcium	5390	8910	5150	9140	5920	9050	5990	8960	3700	9260
	Chromium	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	0.11	<0.05	<0.05
	Cobalt	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
	Copper	0.7	<0.5	3.9	1.6	2.1	1.4	1.2	0.8	6.5	4.2
	Iron	14	10	18	6	19	5	17	17	22	28
	Lead	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
	Magnesium	137	171	132	182	146	177	148	181	113	185
	Manganese	1.6	2.1	3.9	2.1	7.2	1.5	1.8	1.7	1.9	1.8
	Mercury	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05
	Molybdenum	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
	Nickel	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
	Potassium	157	156	150	162	144	162	141	168	141	163
	Selenium	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
Silver	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	
Sodium	3750	1560	4460	1570	4200	1560	3990	1520	5940	1550	
Zinc	<3.0	<3.0	<3.0	<3.0	<3.0	<3.0	<3.0	<3.0	<3.0	<3.0	

These results indicate that the drinking water supplied throughout Coquitlam in 2025 complied with all of the metal standards.

### Vinyl Chloride

Vinyl chloride is a carcinogenic compound that enters drinking water systems via industrial effluents and leaching from polyvinyl chloride (PVC) pipes. According to the GCDWQ, the maximum acceptable limit for vinyl chloride is 2 µg/L. A total of six samples were taken from three sampling locations throughout the City where the distribution system in the area is predominantly PVC pipes. The results of these samples are shown in the following table.

Table 11: 2025 Vinyl Chloride Results

Sample Station	Station Location	Sample Date	Vinyl Chloride (µg/L)
COQ-532	Mallard Court	4/8/2025 8:16	<1
		11/24/2025 8:10	<1
COQ-600	Leigh Elementary School, Victoria Dr.	4/7/2025 8:19	<1
		11/24/2025 8:56	<1
COQ-613	Eagle Summit Reservoir, Gate	4/8/2025 8:57	<1
		11/24/2025 8:56	<1

As shown in Table 11, vinyl chloride was not detected in significant concentrations in any of the City water samples.

## pH

pH is an important measurement in water distribution systems to control corrosion and reduce leaching from pipes and plumbing components. The operational guideline for pH is 7.0 to 10.5, and Metro Vancouver targets pH around 8.3 – 8.5 for the treated water. Test results for 2025 are provided in Table 12.

Table 12: 2025 pH Results

Sample Station	Station Location	Sample Date	pH
COQ-544	721 Pembroke	2/18/2025 8:44	7.8
		4/9/2025 8:54	7.7
		9/12/2025 8:50	7.9
		11/19/2025 8:28	7.9
COQ-601	2085 Concord	2/18/2025 10:36	7.7
		4/9/2025 10:14	7.7
		9/12/2025 10:11	7.6
		11/19/2025 9:45	7.6
COQ-613	Eagle Summit Reservoir, Gate	2/19/2025 9:27	7.7
		4/8/2025 8:57	7.7
		9/10/2025 12:12	7.8
		11/19/2025 8:42	7.7

As Table 12 shows, all of the pH values were within the operational guidelines.

## Customer Complaints

The City received 95 documented complaints regarding water quality in 2025; 68 for discoloured water, and 27 for taste and/or smell. The majority of these problems are

resolved by homeowners running their taps for 1 to 3 hours. Other complaints are usually related to odours which may be due to elevated chlorine levels. When odour is described as skunky or sulfurous, stagnant water in hot water tanks or in the service line may be the source.

There was an influx in drinking water quality complaints in October 2025. This spike was attributed to the Capilano Reservoir water level being lower than usual. The lower water level in the reservoir can result in shoreline erosion. The lower water level in combination with rain events can result in naturally occurring compounds releasing into the reservoir, which in this case involved geosmin. The water was still safe to drink, and the drinking water continued to meet all federal guidelines of the provincial Drinking Water Protection Regulation.

The City's response to complaints varies with the nature and extent of the problem. Persistent turbidity problems related to the City distribution system are usually resolved with City crews purging turbid water from the system by flushing.

The City responds to odour, taste or other customer specific complaints by conducting a site visit. Normally the problem is related to a specific issue within the business or residence. Sampling of water from the residence is done at the discretion of the attending staff member in order to eliminate the possibility that the suspected quality concern is related to the municipal supply.

## **System Improvements**

In 2025, in addition to system improvements built by developers as a condition of their development approval, the City invested roughly \$7.5M in water system improvements, which included roughly 1.8km of watermain replacements, and ongoing water meter replacements.

## **System Maintenance**

The City continued with the Triennial Reservoir Cleaning Program, cleaning the Conifer Reservoir. Approximately 74km of water mains were flushed in 2025.

## **Emergency Response Plan**

The City water utility is included in the *Public Works Response Plan and Division Operation Centre Guidelines*. The plan can be viewed on the City's website:

<https://www.coquitlam.ca/DocumentCenter/View/447/Public-Works-Response-Plan-and-Division-Operation-Centre-Guidelines>

Appendix A

Health Link BC Bulletin #56 – Preventing Water-Borne Infections For People with weakened Immune Systems

## Preventing waterborne infections for people with weakened immune systems

### Who is at higher risk from waterborne infections?

People with very weak immune systems are at higher risk of certain waterborne diseases. This includes those with:

- HIV infection who have a CD4+ count of less than 100 cells/mm<sup>3</sup>
- Lymphoma or leukemia (blood cancers) who are being actively treated or have been in remission and off treatment for less than one year
- Hematopoietic stem cell transplant recipients
- People born with diseases that severely affect their immune systems

Ask your doctor or nurse practitioner how weak your immune system is, and whether you need to take extra precautions.

### How can drinking water become contaminated?

Drinking water can contain different organisms, including bacteria, viruses and parasites, which can cause disease. These organisms can exist in the source water, such as lake water, and survive through treatment, or they can enter the water supply in the distribution system.

Well water can be contaminated if the well is located or constructed in a way that the groundwater it draws from is at risk of containing pathogens (germs), such as a shallow well or a well drilled in fractured rock.

Surface water, such as rivers, lakes and streams, can also contain disease-causing organisms from animal feces.

If you have a weak immune system, you should not drink water from surface sources or

groundwater at risk of containing pathogens, unless the water has been treated to remove or inactivate at least 99.9 percent of parasites (protozoa), 99.99 percent of viruses and all harmful bacteria.

Most community water systems in B.C. have effective treatment, such as disinfection or chlorination, against bacteria and viruses. However, in many cases, treatment may not provide a 99.9 percent reduction in infectious parasites. Some water systems and many private supplies have no treatment at all. If the water you drink has not been disinfected, please refer to [HealthLinkBC File #49b Disinfecting drinking water](#).

### How can I further treat disinfected water?

People with very weak immune systems should consult with their doctor or nurse practitioner, and may need to take extra precautions with their drinking water.

**Boiling:** Please note that boiling water will get rid of viruses, bacteria and parasites but not chemicals which may be found in the water.

If your water supply has already been disinfected, bring the water to a full boil to inactivate any *Cryptosporidium* parasites - a major concern for people with weakened immune systems. For more information, visit [HealthLinkBC File #48 Cryptosporidium infection](#).

If the water has not already been disinfected, bring the water to a full boil for at least one minute. This will kill or inactivate bacteria, viruses and parasites. At elevations over 2,000 meters (6,500 feet), boil water for at least 2 minutes to disinfect it.

Do not drink or use tap water to brush your teeth, rinse your mouth, mix drinks or make ice cubes without boiling it first. Once you have boiled and cooled the water, you can use it as normal, such as to brush your teeth, rinse your mouth, mix drinks or make ice cubes.

**Reverse Osmosis (RO):** RO is effective against all disease-causing organisms and many chemical contaminants. Unless it has a high capacity, it will only produce small amounts of water and waste a large volume. Speak to a water treatment specialist to see if this is the best option for you.

**Ultraviolet (UV) Treatment:** UV light will kill many disease-causing organisms and is effective against almost all parasites. UV light will not kill some bacterial spores and some viruses, so it should not be used unless the water supply is at least disinfected. UV treatment units should meet NSF Standard #55A.

**Filters:** Filters do not remove bacteria and viruses and should not be used unless the water supply is disinfected first.

If you plan to install a drinking water filter in your home, you will need a system labeled as Absolute 1 micron or smaller, and labeled as meeting ANSI/NSF International Standard #53 for removal of parasites.

Jug-type filters, such as a Brita®, which sit in a jug and allow water to trickle through, and some tap-mounted and built-in devices are not an appropriate solution. The jug filter models are not effective in removing many disease-causing organisms.

If you are concerned about your drinking water or want to know about other options to treat your water, speak with your health authority.

### Can I drink bottled water?

Bottled water in B.C. may or may not have been treated. If you have a very weak immune system, check with the bottling company to find out what treatment, if any, it has had. Bottled water that has been properly treated using one of the methods listed above can be used for drinking, brushing teeth, making ice cubes and for recipes where water is used but not boiled, such as cold soups.

### For more information

For more information, including the level of treatment in your local water system, contact your drinking water purveyor or supplier, or the local environmental health officer or drinking water officer. To find your health authority's drinking water contact, visit [www2.gov.bc.ca/gov/content/environment/air-land-water/water/water-quality/drinking-water-quality/health-authority-contacts](http://www2.gov.bc.ca/gov/content/environment/air-land-water/water/water-quality/drinking-water-quality/health-authority-contacts).

For more information about waterborne infections and how to safely disinfect your drinking water, visit the following HealthLinkBC Files:

- [HealthLinkBC File #49a Waterborne infections in British Columbia](#)
- [HealthLinkBC File #49b Disinfecting drinking water](#)
- [HealthLinkBC File #69b Feeding your baby formula: Safely making and storing formula](#)

Appendix B

Fraser Health – Metals in Drinking Water – “Flush” Message in Annual Reports  
(2026)

February 4, 2026

*Water System Operators*

**Re: Metals in Drinking Water – “Flush” Message in Annual Reports**

---

Anytime the water in a particular faucet has not been used for six hours or longer, "flush" your cold-water pipes by running the water until you notice a change in temperature. *(This could take as little as five to thirty seconds if there has been recent heavy water use such as showering or toilet flushing. Otherwise, it could take two minutes or longer.)* The more time water has been sitting in your home's pipes, the more lead it may contain.

Use only water from the cold tap for drinking, cooking, and especially making baby formula. Hot water is likely to contain higher levels of lead.

The two actions recommended above are very important to the health of your family. They will probably be effective in reducing lead levels because most of the lead in household water usually comes from the plumbing in your house, not from the local water supply.

Conserving water is still important. Rather than just running the water down the drain you could use the water for things such as watering your plants.

If you have any questions, please contact our Drinking Water Program at 604-870-7903 or 604-870-7900.

Sincerely,

Emily McGuire  
Manager, Drinking Water Program  
Fraser Health Authority  
[HPLand@fraserhealth.ca](mailto:HPLand@fraserhealth.ca)

Appendix C

Greater Vancouver Water District 2025 Water Quality Annual Report – Volume I



**Greater Vancouver Water District**  
**2025 Water Quality Annual Report**  
**Volume 1 of 2**

March 2026

81892647

Metro Vancouver acknowledges that the region’s residents live, work, and learn on the shared territories of many Indigenous Peoples, including 10 local First Nations: ǵíǵǵǵ (Katzie), ǵʷǵ:ǵǵǵ (Kwantlen), kʷíkʷǵǵǵ (Kwikwetlem), máthxwi (Matsqui), xʷmǵǵǵǵǵǵ (Musqueam), qíqǵǵ (Qayqayt), Semiahmoo, Sǵǵǵǵǵǵǵǵ Úxwumixw (Squamish), scǵǵǵǵǵǵǵǵǵǵǵǵ (Tsawwassen), and sǵǵǵǵǵǵǵǵǵǵǵǵ (Tsleil-Waututh).

Metro Vancouver respects the diverse and distinct histories, languages, and cultures of First Nations, Métis, and Inuit, which collectively enrich our lives and the region.

Volume 1 of 2 – A report produced annually summarizing the analysis of samples collected from the GVWD source reservoirs, water treatment plants and transmission system, as well as microbiological water quality of member jurisdictions’ systems supplied by the Greater Vancouver Water District.

Volume 2 of 2 – A volume of analytical results from untreated and treated source water as well as representative locations throughout the GVWD Transmission system. Published under separate cover: Orbit 83836176.

# Table of Contents

- Table of Contents .....i
- List of Tables ..... ii
- List of Figures ..... ii
- List of Appendices ..... ii
- Acronyms/Abbreviations ..... iii
- Executive Summary ..... iv
- 1. Source Water Quality .....1
  - 1.1. Bacteriological Quality of Source Water Supply Areas .....1
  - 1.2. Source Water Monitoring for *Giardia* and *Cryptosporidium*.....2
  - 1.3. Turbidity .....3
  - 1.4. Chemistry .....4
    - 1.4.1. Chemical and Physical Analysis of the Source Water .....4
    - 1.4.2. Analysis of Water for Organic Components and Radionuclides.....5
    - 1.4.3. Per- and Polyfluorinated Substances .....5
    - 1.4.4. Limnology .....5
    - 1.4.5. Geosmin .....7
- 2. Quality Control Assessment of Water Treatment .....8
  - 2.1. Seymour Capilano Filtration Plant .....8
    - 2.1.1. Filtration .....9
    - 2.1.2. Ultraviolet Treatment .....12
    - 2.1.3. Chlorination.....13
  - 2.2. Coquitlam Water Treatment Plant.....13
    - 2.2.1. Ozonation .....14
    - 2.2.2. Ultraviolet Treatment .....14
    - 2.2.3. Chlorination.....14
  - 2.3. Secondary Disinfection.....15
  - 2.4. Corrosion Control.....16
- 3. Transmission/Distribution System Water Quality .....18
  - 3.1. Microbiological Water Quality in the GVWD System.....18
    - 3.1.1. GVWD Water Mains .....18
    - 3.1.2. GVWD In-System Reservoirs .....20
  - 3.2. Microbiological Water Quality in GVWD Supplied Systems.....22
  - 3.3. Disinfection By-Products in the Transmission and Distribution Systems.....23
  - 3.4. Polycyclic Aromatic Hydrocarbons in the Transmission System .....26
- 4. Quality Assurance/Quality Control .....27
- 5. Results Summary .....28

## List of Tables

Table 1: Percent of Samples in Six Continual Months that have <i>E. coli</i> /100 mL Exceeding 20 .....	1
Table 2: Percent of Source Water Samples Positive for <i>Giardia</i> .....	3
Table 3: Percent of Source Water Samples Positive for <i>Cryptosporidium</i> .....	3
Table 4: Percent of SCFP Recycled Water Samples Positive for <i>Giardia</i> and <i>Cryptosporidium</i> .....	3
Table 5: Comparison of Water Quality in GVWD Water Supply Sources to Standard Water Quality Classifications....	6
Table 6: Capilano and Seymour Source Water and Treated Water Results for Geosmin .....	7
Table 7: Monthly Filter Effluent Turbidity Summary .....	12
Table 8: Percent of Volume Meeting Ultraviolet Dosage Requirements at SCFP.....	13
Table 9: Percent of Volume Meeting Ultraviolet Dosage Requirements at CWTP .....	14
Table 10: Performance of Secondary Disinfection Facilities.....	15
Table 11: Performance of Corrosion Control Facilities.....	17
Table 12: Status of GVWD In-System Reservoirs (2022-2025) .....	21
Table 13: GVWD Connected Water Systems Water Quality Compared to the Provincial Bacteriological Standards ..	23

## List of Figures

Figure 1: Percent of Samples Exceeding 20 <i>E. coli</i> /100 mL from GVWD Water Supply Sources (2022 to 2025) .....	2
Figure 2: Average Daily Turbidity of GVWD Water Supply Sources (From In-line Readings) .....	4
Figure 3: Trophic State Index of Source Waters .....	6
Figure 4: Seymour Capilano Filtration Plant Treatment Process.....	9
Figure 5: Apparent Colour Levels Before and After Filtration .....	10
Figure 6: Daily Turbidity Levels Before and After Filtration at SCFP.....	11
Figure 7: Coquitlam Water Treatment Plant Treatment Process .....	13
Figure 8: Bacteriological Quality of Water in GVWD Water Mains .....	19
Figure 9: Bacteriological Quality of Water in GVWD In-System Reservoirs.....	20
Figure 10: Bacteriological Quality of Water in GVWD Supplied Systems .....	22
Figure 11: Average Total Trihalomethane Concentrations.....	24
Figure 12: Average Haloacetic Acid 5 (HAA5) Concentrations .....	25

## List of Appendices

Appendix A — Water Sampling Frequency .....	31
Appendix B — Metro Vancouver Chemical and Physical Analysis Summaries .....	35
Appendix C — Analysis of Water for Organic Components and Radionuclides .....	41
Appendix D — Metro Vancouver Detection of Waterborne <i>Cryptosporidium</i> and <i>Giardia</i> Annual Report January – December 2025 .....	51

## Acronyms/Abbreviations

ACU	Apparent Colour Unit
ALARA	As Low As Reasonably Achievable
AO	Aesthetic Objective (characteristics such as taste, odour, colour, appearance, temperature that are not health related)
BTEX	Benzene, Ethylbenzene, Toluene, Xylene
CALA	Canadian Association for Laboratory Accreditation
CO <sub>2</sub>	Carbon Dioxide
CWTP	Coquitlam Water Treatment Plant
DBP	Disinfection By-product
DWPR	<i>Drinking Water Protection Regulation</i>
DWTO	<i>Drinking Water Treatment Objectives (Microbiological) for Surface Water Supplies in British Columbia</i>
<i>E. coli</i>	<i>Escherichia coli</i>
GCDWQ	<i>Guidelines for Canadian Drinking Water Quality</i>
GVWD	Greater Vancouver Water District
HAA5	Haloacetic Acid 5 (measured as the sum of monochloroacetic acid, dichloroacetic acid, trichloroacetic acid, monobromoacetic acid, and dibromoacetic acid)
HPC	Heterotrophic Plate Count
IFE	Individual Filter Effluent
MAC	Maximum Acceptable Concentration
µg/L	Microgram per litre (0.000001 g/L)
mg/L	Milligram per litre (0.001 g/L)
mL	Milliliter
ng/L	Nanogram per litre (0.000000001 g/L)
N/A	Not Applicable
NTU	Nephelometric Turbidity Unit
PAH	Polycyclic Aromatic Hydrocarbon
PFAS	Per- and polyfluoroalkyl Substances
PFOA	Perfluorooctanoic Acid
PFOS	Perfluorooctane Sulfonate
pH	Measure of acidity or basicity of water; pH 7 is neutral
SCFP	Seymour Capilano Filtration Plant
TSI	Trophic State Index
TTHM	Total Trihalomethane (measured as the sum of chloroform, bromodichloromethane, dibromochloromethane and bromoform)
UV <sub>254</sub>	Ultraviolet Absorbance at 254 nm
UVT	Ultraviolet Transmittance
VOC	Volatile Organic Compound
WQMRP	<i>Water Quality Monitoring and Reporting Plan for Metro Vancouver (GVWD) and Local Government Members</i>

## Executive Summary

The Greater Vancouver Water District (GVWD) 2025 Water Quality Annual Report is required under the provincial *Drinking Water Protection Regulation* (DWPR). This annual report summarizes the analysis of approximately 169,000 tests conducted on samples collected from the GVWD source reservoirs, water treatment plants and transmission system, as well as microbiological and select chemical water quality testing results from member jurisdictions' systems, supplied by the GVWD.

The annual report outlines how GVWD's water quality monitoring program continues to fulfill its role in confirming that multiple protection barriers are maintaining high-quality drinking water for the region. This includes the continued protection of our water supply areas, effective and efficient water treatment processes, and uninterrupted operation of the water supply system by trained and certified operators.

In 2025, all of the health-based water quality parameters monitored by Metro Vancouver for the regional drinking water supply met the GVWD water supply operating permit, provincial water quality regulations, and the federal Guidelines for Canadian Drinking Water Quality (GCDWQ). Results of the analyses from the source water supply areas for herbicides, pesticides, volatile organic compounds and radionuclides were all found to be below the recommended limits for these substances as listed in the GCDWQ as well as British Columbia's *Source Drinking Water Quality Guidelines*.

As in past years, heavy rains were the cause of turbidity within the source supply reservoirs; however, in 2025 the turbidity levels were not as high as previous years. The highest daily average turbidity for the Capilano source was 4.2 Nephelometric Turbidity Unit (NTU) measured on December 16. The Seymour source's highest daily average turbidity of 6.0 NTU which occurred on December 19. The Seymour Capilano Filtration Plant (SCFP) effectively removed the excess sedimentation originating from these two sources. The unfiltered Coquitlam source water was greater than 1.0 NTU for just 5 days in the year and never exceeded 5.0 NTU; the highest daily average was 1.7 NTU on February 24.

The SCFP performance as measured by the quality of the delivered water was excellent in 2025. The daily average turbidity of water leaving the clearwell and entering the GVWD transmission system was 0.17 NTU. Filtration consistently removed iron, colour, and organics from the Capilano and Seymour source waters, and all disinfection requirements were met.

The Coquitlam Water Treatment Plant (CWTP), using ozone, ultraviolet, and chlorination systems, met all disinfection requirements.

Bacteriological water quality was excellent in the GVWD transmission mains and in-system storage reservoirs. The total coliforms detected in samples from both GVWD and water systems supplied with GVWD water was very low. More than 31,700 samples were collected and analyzed for GVWD and GVWD supplied systems in 2025; of those, only one sample from a GVWD supplied system was positive for *E. coli*. Repeat samples for the same location were taken, and no additional *E. coli* was found.

The isolation of Capilano Main No. 7, as part of the Second Narrows Water Supply Tunnel project water main tie-in work, caused some water to stagnate, which was followed by localized odour complaints. Tests confirmed low levels of four Polycyclic Aromatic Hydrocarbons (PAHs), including naphthalene, which is considered an aesthetic issue as there are no health-based drinking water guidelines for PAHs, except for benzo[a]pyrene (not detected). After flushing and returning the main to regular service, odours dissipated.

For the first time, Metro Vancouver experienced widespread earthy or musty tap water odour complaints in October that were caused by naturally occurring geosmin from the Seymour source. Odours were mitigated through operational changes. Drinking water remained safe to drink throughout the event.

# 1. Source Water Quality

The first barrier for assuring quality drinking water is protection of the source water supply areas. Source water monitoring provides ongoing confirmation that the barrier is effective, identifies seasonal changes, and provides the monitoring data necessary to inform water treatment process optimization changes, when necessary. Regular monitoring of the water sources is a requirement of the *Water Quality Monitoring and Reporting Plan for Metro Vancouver (GVWD) and Local Government Members (WQMRP)*. Refer to Appendix A for a summary of the water sampling frequencies for various parameters. Volume 2 of the Greater Vancouver Water District (GVWD) 2025 Water Quality Annual Report (published under a separate cover), contains detailed analytical test results from the source water supply areas.

## 1.1. Bacteriological Quality of Source Water Supply Areas

The bacteriological quality of the source water is an important indicator of the degree of any potential contamination, and the treatment required to ensure a high-quality water supply. *The Drinking Water Treatment Objectives (Microbiological) for Surface Water Supplies in British Columbia* (DWTO) Section 4.3 states: “The number of *E. coli* in raw water does not exceed 20/100 mL (or if *E. coli* data are not available less than 100/100 mL of total coliform) in at least 90% of the weekly samples from the previous six months. Treatment target for all water systems is to contain no detectable *E. coli* or fecal coliform per 100 mL.”


Table 1 summarizes *E. coli* data for all three GVWD water supply sources. The concentrations of *E. coli* for all three sources were below the 10% limit in the provincial DWTO.

**Table 1: Percent of Samples in Six Continual Months that have *E. coli*/100 mL Exceeding 20**

Month	Capilano	Seymour	Coquitlam
Jan	0.5	7.1	0.5
Feb	0.6	7.2	0.6
Mar	0.6	6.6	0.6
Apr	0.0	0.6	0.0
May	0.0	0.0	0.0
Jun	0.0	0.0	0.0
Jul	0.0	0.0	0.0
Aug	4.4	2.7	1.1
Sep	5.5	3.3	1.1
Oct	5.9	6.0	1.1
Nov	6.1	6.0	1.1
Dec	6.0	6.0	1.1

Figure 1 shows results for the analysis of source water from 2022 to 2025 at all three intakes compared to the limits for source water bacterial levels in the DWTO. As in previous years, all three sources met the limit of not more than 10% exceeding 20 *E. coli*/100 mL. Also, as is typical, samples collected at the intakes in the fall and winter had the highest *E. coli* levels. Typically, *E. coli* can be traced back to high flow levels at the main tributaries of the supply lakes, and a first flush phenomenon after a period of dry weather.

**Figure 1: Percent of Samples Exceeding 20 *E. coli*/100 mL from GVWD Water Supply Sources (2022 to 2025)**

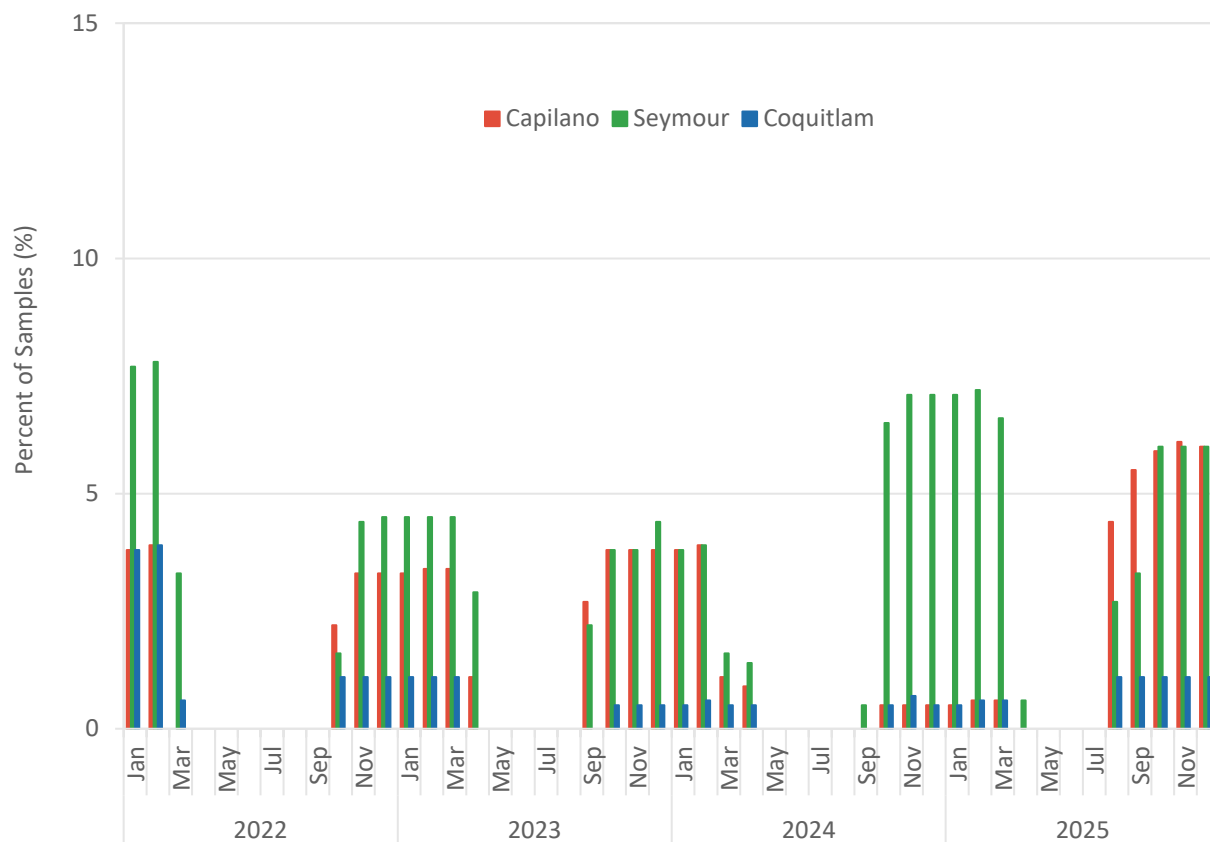

## 1.2. Source Water Monitoring for *Giardia* and *Cryptosporidium*

Surface water supplies have the potential of containing the protozoan pathogens *Giardia* and *Cryptosporidium*. Outbreaks of *Giardiasis* occurred in a number of locations in BC and Washington State in the late 1980s, and Metro Vancouver has been monitoring source water for *Giardia* since 1987. Since 1992, Metro Vancouver has participated in a program with the Environmental Microbiology Laboratory of the BC Centre of Disease Control Public Health Laboratory to gather more information about the number and nature of cysts found within the GVWD water supply sources. The program has involved collecting samples from the Capilano, Seymour and Coquitlam sources upstream of disinfection.

Complete results of the 2025 testing program are contained in the Metro Vancouver Detection of Waterborne *Cryptosporidium* and *Giardia* Annual Report January - December, 2025, prepared by the Environmental Microbiology Laboratory of the BC Centre for Disease Control Public Health Laboratory, included in Appendix D.

One of twelve (8%) samples collected at Capilano, one of the twelve (8%) at Seymour, and one of twelve (8%) at Coquitlam were positive for *Giardia* in 2025. Table 2 summarizes *Giardia* data for the past ten years (Seymour sample collection began in 2022).

**Table 2: Percent of Source Water Samples Positive for *Giardia***

	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025
Capilano	50	58	33	33	33	25	17	50	8	8
Seymour	N/A	N/A	N/A	N/A	N/A	N/A	0	8	25	8
Coquitlam	17	67	8	25	25	25	8	8	0	8

Zero of twelve (0%) samples collected at Capilano, one of twelve (8%) at Seymour, and zero of twelve at Coquitlam (0%) were positive for *Cryptosporidium* in 2025. Table 3 summarizes *Cryptosporidium* data for the past 10 years (Seymour sample collection began in 2022).

**Table 3: Percent of Source Water Samples Positive for *Cryptosporidium***

	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025
Capilano	25	17	8	0	0	0	0	0	0	0
Seymour	N/A	N/A	N/A	N/A	N/A	N/A	0	8	0	8
Coquitlam	0	0	0	0	0	0	0	0	0	0

Year to year fluctuations are observed for *Giardia* and *Cryptosporidium*, with some years showing considerable variation in the results.

At the SFCP, monitoring for *Giardia* and *Cryptosporidium* has focused on the recycled water returning to the head of the plant, and this monitoring has confirmed that the procedures in place effectively control the levels of *Giardia* and *Cryptosporidium* in the recycled wash water from the filters. Zero of twelve (0%) samples collected were positive for *Giardia*, and zero of twelve (0%) were positive for *Cryptosporidium* in 2025. Table 4 shows the percentage of samples positive for *Giardia* and *Cryptosporidium* for the past 10 years.

**Table 4: Percent of SFCP Recycled Water Samples Positive for *Giardia* and *Cryptosporidium***

	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025
<i>Giardia</i>	17	8	0	0	0	0	0	0	0	0
<i>Cryptosporidium</i>	0	0	0	0	0	0	0	0	0	0

### 1.3. Turbidity


As shown in Figure 2, GVWD water sources have been susceptible to turbidity events due to high runoff from storms, which can cause slides and stream scouring in the water supply areas, or from suspension of sediment from the edges of the reservoirs during periods of low water levels. The DWTO allows a utility to be exempt from filtration if a minimum of two disinfectants providing 4-log reduction of viruses and 3-log reduction of *Cryptosporidium* and *Giardia* are used; the number of *E. coli* in raw water does not exceed 20/100 mL in at least 90% of the weekly samples from the previous six months; average daily turbidity level before disinfection is around 1 Nephelometric Turbidity Unit (NTU), but does not exceed 5 NTU for more than two days in a 12-month period; and a watershed control program is maintained. Specifically, Section 4.4 of the DWTO (Version 1.2, November 2012) contains the following provision for filtration exemption:

“For nonfiltered surface water to be acceptable as a drinking water source supply, average daily turbidity levels should be established through sampling at equal intervals (at least every four hours) immediately before the disinfectant is applied. Turbidity levels of around 1.0 NTU but not exceeding 5.0 NTU for more

than two days in a 12-month period should be demonstrated in the absence of filtration. In addition, source water turbidity also should not show evidence of harbouring microbiological contaminants in excess of the exemption criteria.”

Capilano and Seymour water is filtered, therefore the above source water criteria does not apply to the delivered water from these sources. Coquitlam, which is unfiltered, was in-service for all of 2025 in accordance with the DWTO.

**Figure 2: Average Daily Turbidity of GVWD Water Supply Sources (From In-line Readings)**

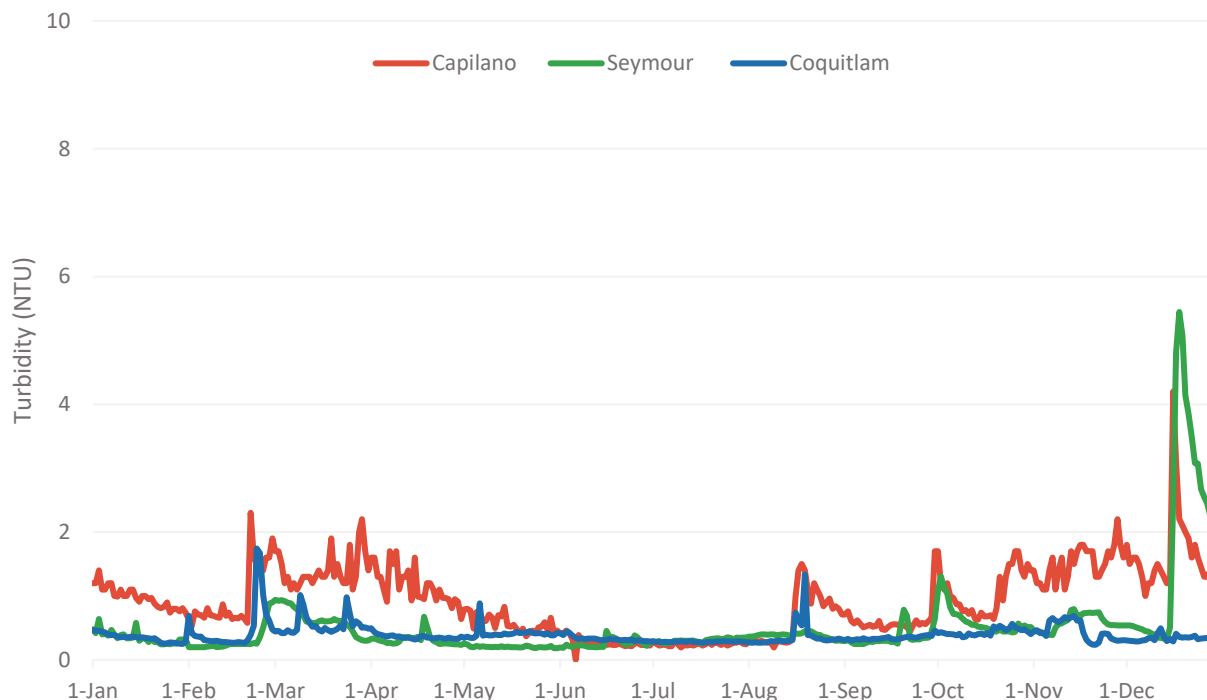

## 1.4. Chemistry

### 1.4.1. Chemical and Physical Analysis of the Source Water

The chemical and physical characteristics of the GVWD source water are summarized in Appendix B of this report; detailed analytical results are provided in Volume 2. The results from the chemical and physical analyses of the source water in 2025 were similar to those for previous years, with the exception of detecting geosmin in the Seymour source. Source water supply monitoring was carried out by accredited laboratories using methods based on the current version of *Standard Methods for the Examination of Water and Wastewater*. In 2025, at the request of the provincial Drinking Water Officers for Metro Vancouver, source water monitoring was also compared against British Columbia’s *Source Drinking Water Quality Guidelines* (2020). While Metro Vancouver historically monitored for most of the parameters within the *Source Drinking Water Quality Guidelines*, in 2025 three new parameters that had not previously been tested for were included (diisopropanolamine, sulfolane, and monochlorophenol). All tested parameter results within Metro Vancouver’s three source water supplies were below the values within the *Source Drinking Water Quality Guidelines* - see Appendix 3 for detailed analytical results.

### 1.4.2. Analysis of Water for Organic Components and Radionuclides

Analyses of the source water supplies for a variety of organic and other compounds, including all of the compounds with a specified Maximum Acceptable Concentration (MAC) from Health Canada's GCDWQ, is carried out on an annual basis in accordance with the WQMRP. The results are contained in Appendix C of this report and in Volume 2. No parameters were detected above the applicable GCDWQ health-based guidelines.

### 1.4.3. Per- and Polyfluorinated Substances

Per- and polyfluoroalkyl substances are a group of synthetic compounds collectively known PFAS. Common sources of these ubiquitous chemicals, which were used because of their water and oil repellent properties, include a variety of consumer products and fire-fighting foams. In August 2024, Health Canada released a drinking water objective of 30 ng/L for the sum of 25 individual PFAS compounds. Source water and treated water data for all 25 PFAS compounds can be found in Appendix C. Within the three source water supplies, all results for PFAS compounds were below both British Columbia's *Source Drinking Water Quality Guidelines* as well as Health Canada's drinking water objective value.

### 1.4.4. Limnology

The annual reservoir limnology monitoring, started in 2014, collects limnology data (physical, chemical and biological parameters) for the Capilano, Seymour and Coquitlam supply reservoirs. This monitoring information significantly contributes to the proactive management of the supply reservoirs, as water quality could be impacted by environmental variability and climate change. This program assists in ensuring that variation and trends in reservoir water quality are scientifically tracked over time.

Water samples from the source reservoirs, inflow streams, and tributaries are collected between April and November. Biological productivity that can influence water quality is highest during this time of year, making it an important time for taking samples and measurements. Monthly sampling of source waters is conducted and sample testing is undertaken by accredited labs. More frequent water quality data are measured by arrays of scientific instruments located in each reservoir.

Analysis of 2025 data, as in previous years, confirms that the three source reservoirs fall well within the oligotrophic classification based on the parameters shown in Table 5, which means they have low nutrient concentrations, low levels of biological production, and are considered very high-quality source waters. These parameters are at the lower end of data ranges for oligotrophic waterbodies identified in the literature, and the three reservoirs can be deemed 'ultra-oligotrophic'.

**Table 5: Comparison of Water Quality in GVWD Water Supply Sources to Standard Water Quality Classifications**


Parameter	Average Value			
	Mean Value - Oligotrophic Status <sup>1,2</sup>	Capilano Reservoir 2014-2025 (2025 only)	Seymour Reservoir 2014-2025 (2025 only)	Coquitlam Reservoir 2014-2025 (2025 only)
Total Phosphorus (µg/L)	8.0	2.9 (3.0)	3.3 (3.0)	2.1 (2.2)
Total Nitrogen (µg/L)	661	109 (111)	92 (108)	88 (109)
Phytoplankton Biomass (µg/L of chlorophyll-a)	1.7	0.67 (0.50)	0.65 (0.57)	0.8 (0.62)
Status of Reservoirs <sup>1,2</sup>		Ultra-oligotrophic	Ultra-oligotrophic	Ultra-oligotrophic

<sup>1</sup>General trophic classification based on study of more than 200 lakes and reservoirs.

<sup>2</sup>Wetzel, R.G. 2001 Lake and River Ecosystems. 3<sup>rd</sup> edition. Academic Press. New York.

The Trophic State Index (TSI) is used to infer change over time in water quality based on the amount of algal biomass in the water column of each source reservoir. Figure 3 shows TSI values over the last 10 years for each of the three primary source reservoirs, which will continue to be tracked and referenced to assist in monitoring changing weather, climate and nutrient conditions. A TSI of <30 to 40 is considered oligotrophic.

**Figure 3: Trophic State Index of Source Waters**

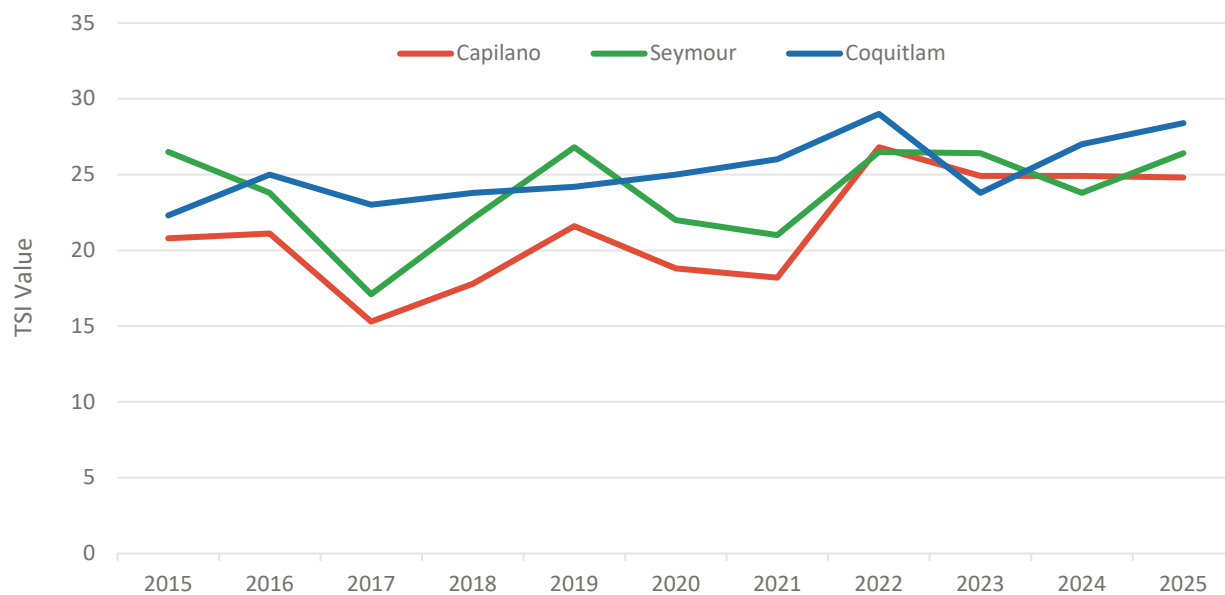

The ultra-oligotrophic classification and low TSI values are highly desirable for source drinking water supplies and shows that the GVWD Water Supply Areas continue to supply high-quality source water.

There is worldwide interest in blue-green algae (also known as cyanobacteria) in drinking water reservoirs. These algae can produce toxins that are collectively known as microcystins. A common cyanobacterium in GVWD reservoirs, called *Merismopedia* spp., is thought to have the ability to produce microcystins. Despite the presence of cyanobacteria, the concentration of microcystins in GVWD source reservoirs remains consistently below the detection limit of 0.2 µg/L. This desirable condition is due to the ultra-oligotrophic status of the supply reservoirs. Metro Vancouver continues to monitor cyanobacteria, including *Merismopedia* spp., as well as processes in the source reservoirs that control the growth of cyanobacteria and other algae. These data are routinely used to help predict changes to water quality over time related to climatic and environmental change, and aid in making proactive decisions about ongoing source reservoir management strategies.

### 1.4.5. Geosmin

For the first time, Metro Vancouver began receiving public reports of unusual odours in tap water in mid-October. Specifically, earthy or musty odours were being reported from residents of the District of North Vancouver, City of North Vancouver, Vancouver, Burnaby, Delta, parts of Coquitlam, and the Tsawwassen First Nation. Based on described odours, geosmin and 2-methylisoborneol were suspected and tested for in all source water supplies as well as treated drinking water. Geosmin is a naturally occurring compound produced by bacteria and algae in surface waters as well as by benthic (bottom-dwelling) cyanobacteria, which imparts an earthy or musty odour. While unpleasant, geosmin is not harmful to health.

Initial sampling on October 27 showed geosmin concentrations of 11 ng/L in raw water from the Seymour source and 10 ng/L in treated water leaving the SCFP. Both the Capilano and Coquitlam Reservoirs showed no detectable levels. There was no detection of 2-methylisoborneol in any of the samples that were tested.

In response to the detection of geosmin, the system operation was adjusted by reducing the amount of source water originating from Seymour and increasing flows from Capilano to mitigate the aesthetic issue. Throughout this period, the drinking water remained safe to consume. Following operational changes, monitoring showed a steady decline in geosmin concentrations in the treated water leaving the SCFP. By November 5, while there was still detectable geosmin (6 ng/L) in the Seymour Reservoir, treated water from the SCFP tested below detectable limits (<3 ng/L), and public complaints had largely subsided. Geosmin testing results for samples collected from the Capilano and Seymour sources as well as for the treated water leaving the SCFP are shown in Table 6.

**Table 6: Capilano and Seymour Source Water and Treated Water Results for Geosmin**

	Capilano Source (ng/L)	Seymour Source (ng/L)	SCFP Treated Water (ng/L)
October 27, 2025	<3	11	10
November 5, 2025	<3	6	<3
November 7, 2025	<3	6	<3
November 17, 2025	<3	<3	<3
November 24, 2025	<3	<3	<3

## 2. Quality Control Assessment of Water Treatment

Following source water protection, primary treatment of the source water is the second barrier used to assure the high-quality of supplied drinking water.


Metro Vancouver filters water from the Capilano and Seymour source reservoirs at the SFCP, which is located in GVWD's Lower Seymour Conservation Reserve. Twin tunnels connect the two supply sources. The untreated Capilano source water is pumped through a raw water tunnel and is blended with the Seymour source water (under regular operations) at the inlet to the SFCP. Both treated sources enter the clearwell at the SFCP for further treatment before the blended water enters the transmission system, typically supplying about two thirds of the region's drinking water. Blended treated water returns to the Capilano service area through a treated water tunnel, providing high-quality drinking water to the Capilano area, while the remainder is transmitted through the Seymour system.

The Coquitlam Water Treatment Plant (CWTP) is located north of the City of Coquitlam, and typically supplies about one third of the region's drinking water. Due to the historically low turbidity levels, the Coquitlam source water is not filtered.

Metro Vancouver operates the water supply system under the *GVWD Permit to Operate* issued jointly by Vancouver Coastal Health and Fraser Health Authorities. The permit stipulates that Metro Vancouver must meet the requirements to achieve at least a 4-log (99.99%) reduction and/or inactivation of viruses, and at least a 3-log (99.9%) reduction and/or inactivation of *Giardia* cysts and *Cryptosporidium* oocysts. Operationally, Metro Vancouver meets the permit requirements, managing microbial risks using a combination of direct filtration, ultraviolet (UV) light and chlorine at the SFCP, and ozone, UV light and chlorine at the CWTP.

### 2.1. Seymour Capilano Filtration Plant

The SFCP is a chemically assisted direct filtration plant, which uses polyaluminum chloride as a coagulant with polymers to improve particle removal. These substances help aggregate particles to form visible floc. The flocculated particles are removed by passing this water through a filter medium of anthracite and sand. The result is the production of filtered water, which is then exposed to UV light as the water exits each filter. The final processes are the addition of sodium hypochlorite (chlorine) and calcium hydroxide (hydrated lime) before the water enters the clearwell. The clearwell, divided into the west and east cells, is a large water storage reservoir that stores and allows controlled passage and mixing of water with the injected chlorine and hydrated lime. The clearwell provides sufficient retention (or contact time) with chlorine to provide any further disinfection required after filtration and UV light treatment. The treatment process of the SFCP is shown in Figure 4.

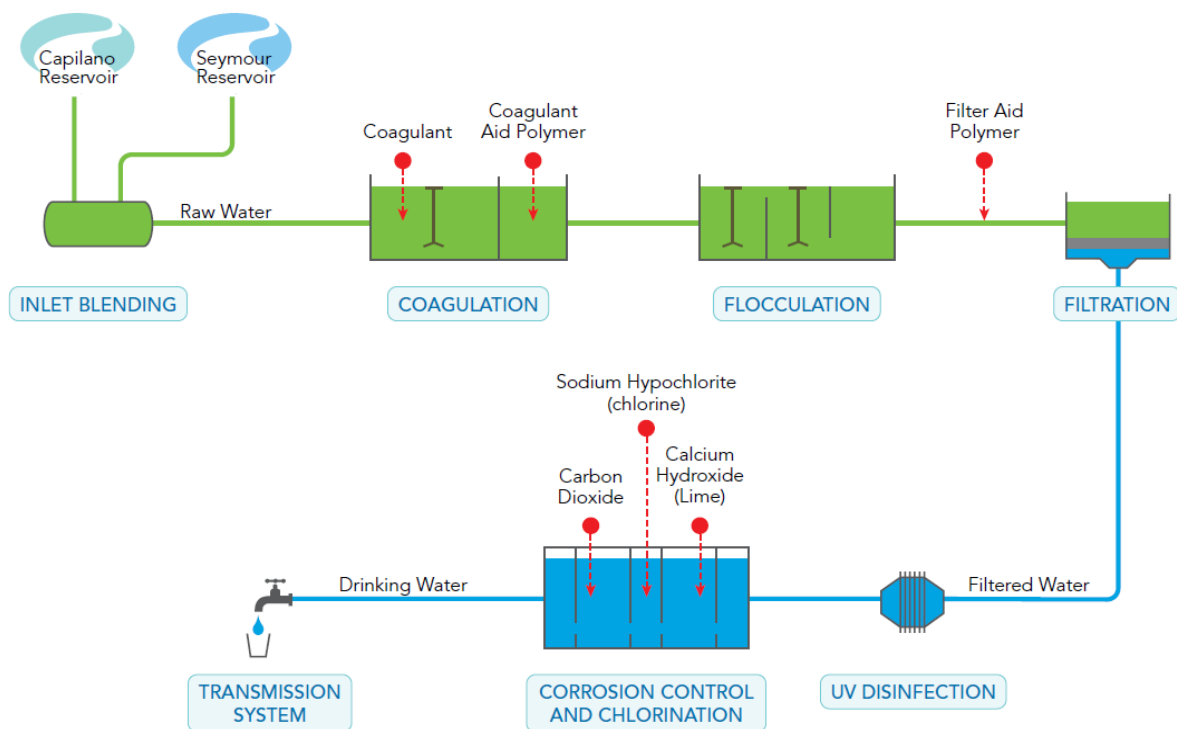**Figure 4: Seymour Capilano Filtration Plant Treatment Process**

As part of corrosion control, carbon dioxide ( $\text{CO}_2$ ) in solution is added to trim pH once the desired alkalinity is reached using hydrated lime. After the clearwell, the finished water enters the transmission system at the Seymour treated water valve chamber.

### 2.1.1. Filtration

Filtration of the Capilano and Seymour water sources improves the characteristics of the delivered water. One improvement is the removal of the brown hue that is characteristic of Capilano and Seymour source waters. This is achieved with the removal of naturally occurring compounds, resulting in a visible decrease in colour and increase in clarity. In addition, suspended particles in water that cause light to scatter (turbidity) are also removed. The end-product is water that is very clear and may have a slight bluish tinge. Figure 5 compares the apparent colour of SCFP filtered water with Capilano and Seymour source waters for 2025. The Seymour source had an Apparent Colour Unit (ACU) of 23 ACU in September, and the Capilano source had an ACU reading of 22 ACU in December. The SCFP removes organic material through filtration, resulting in a final colour of near zero ACU. Throughout 2025, the colour of the filtered water delivered to the public was never greater than 3 ACU.

**Figure 5: Apparent Colour Levels Before and After Filtration**

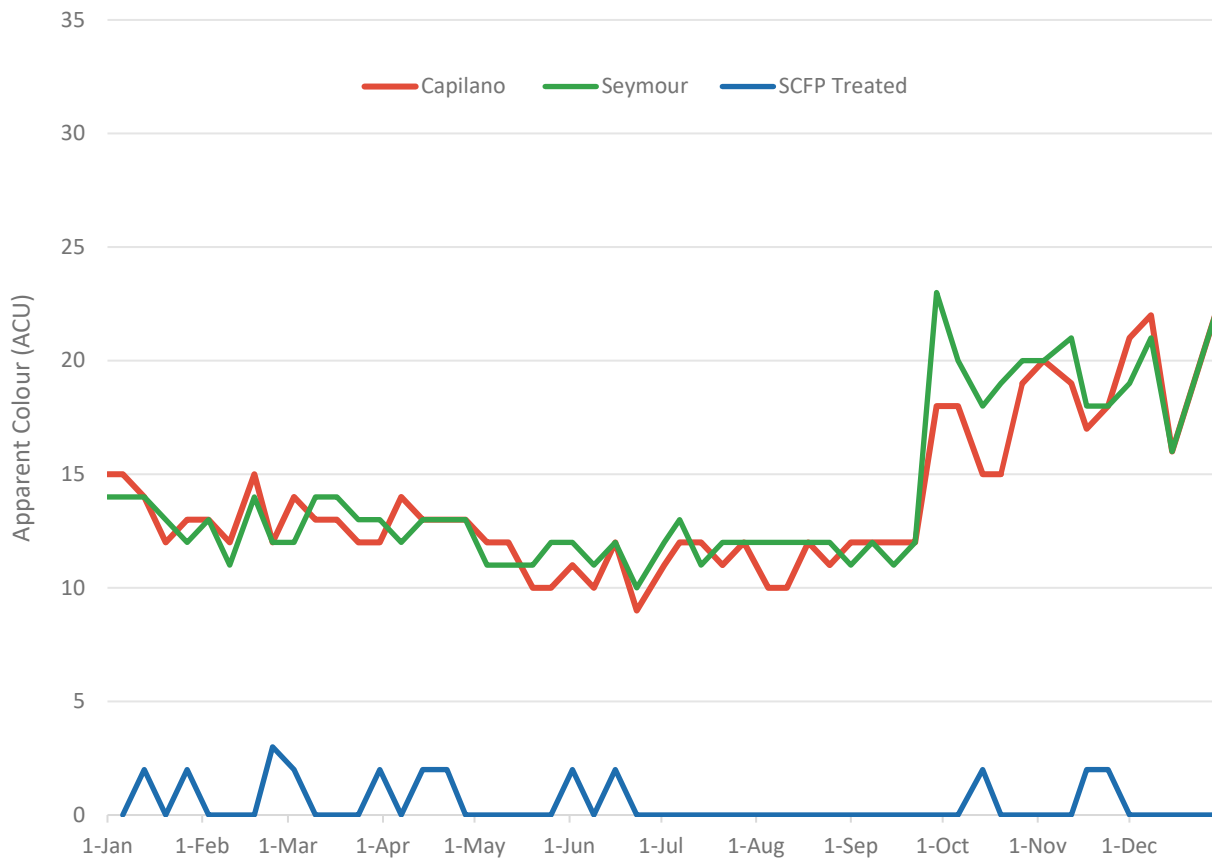
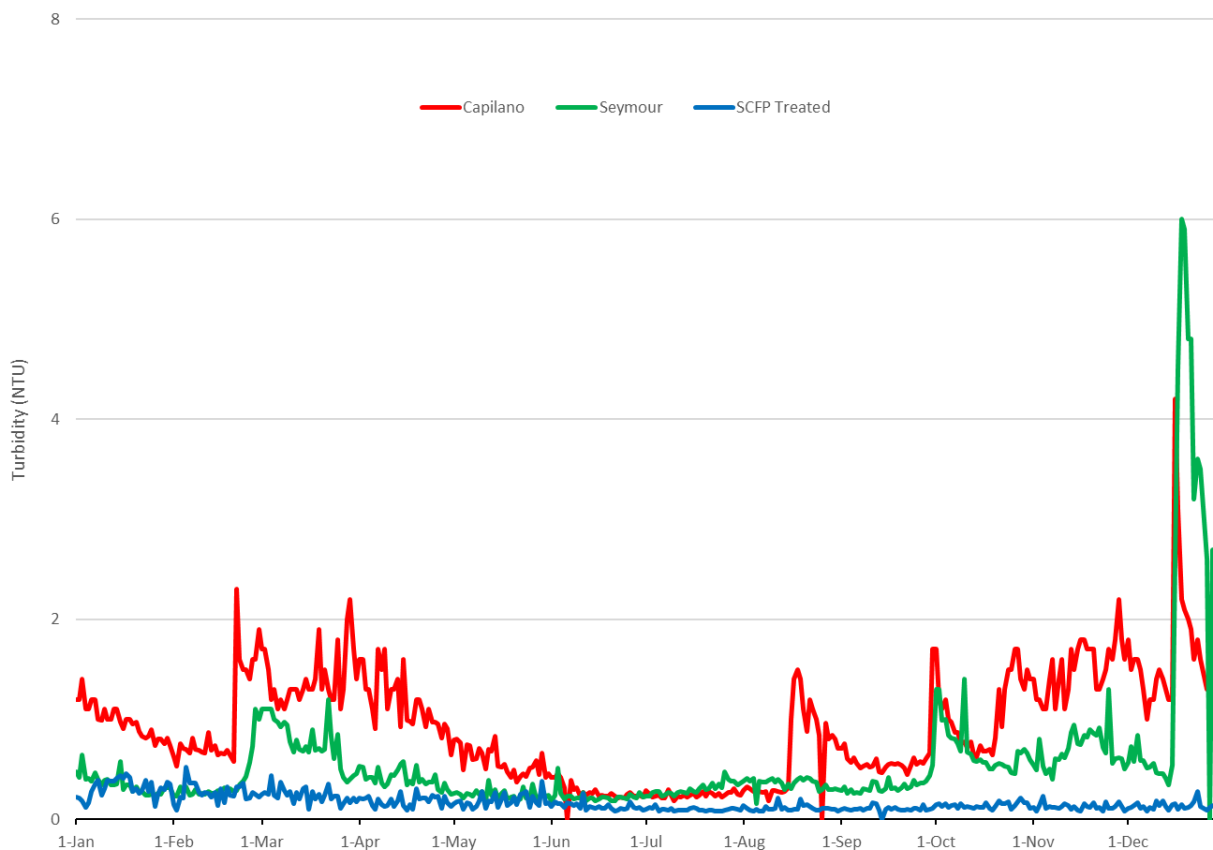


Figure 6 compares turbidity of the two source waters that feed the SCFP to the turbidity level of the treated water. The Seymour source experienced an average daily turbidity greater than 1.0 NTU for 26 days. The Capilano source exceeded 1.0 NTU for 155 days. Since both sources are filtered at the SCFP, the maximum turbidity of the treated water was 0.52 NTU, measured on February 5, 2025, and the annual average was 0.17 NTU.

**Figure 6: Daily Turbidity Levels Before and After Filtration at SCFP**

Removal of turbidity from the source water improves the aesthetic qualities of the water, but it also has the benefit of removing certain types of pathogenic microorganisms that may be present. At a minimum, properly run direct filtration plants such as the SCFP will remove up to 2.5 log (two log is a 99% reduction) of *Giardia* and *Cryptosporidium*, plus 1 log of viruses. To ensure this removal, it is critical that the performance of each filter, determined by the turbidity of its effluent, is monitored on a continuous basis.

The GCDWQ states: “For conventional and direct filtration, less than or equal to 0.3 nephelometric turbidity units (NTU) in at least 95% of measurements either per filter cycle or per month and never to exceed 1.0 NTU.”

According to the GCDWQ, ideally, the turbidity from each filter would never exceed 0.1 NTU; however, there are rare occurrences of turbidity readings that exceed this ideal level. The turbidity performance of all 24 filters is measured by examining the percent of time that the turbidity of each Individual Filter Effluent (IFE) met the turbidity guidelines of not greater than 1.0 NTU, and at least 95% of the time less than 0.3 NTU. The results are summarized in Table 7. In 2025 the IFE was never greater than 1.0 NTU, however, there were a few incidences of filter turbidity readings that were greater than 0.3 NTU, but all remained well within the 95% limit.

**Table 7: Monthly Filter Effluent Turbidity Summary**

Month	Occurrence of IFE Turbidity greater than 1.0 NTU (None Allowed)	Percent of Time IFE Turbidity was less than 0.3 NTU (Minimum 95% Required)
January	0	99.998
February	0	100
March	0	100
April	0	100
May	0	100
June	0	100
July	0	100
August	0	99.998
September	0	100
October	0	99.998
November	0	99.997
December	0	99.997

Under normal operating conditions, the average maximum turbidity of the water, post filtration, and before disinfection and corrosion control at the SCFP was 0.04 NTU.

All water that flows through the filters immediately passes through the UV units. The intensity of the UV lamps automatically increases when there is an increase in turbidity or colour of the water exiting each filter. After UV treatment, the water is chlorinated as it enters the clearwell.

### 2.1.2. Ultraviolet Treatment

Water passing through each filter is subsequently treated with UV light. UV treatment is effective in altering the DNA structure of *Giardia* and *Cryptosporidium* thus rendering cysts and oocysts, respectively, of these parasites, non-infectious. Other disinfectants, especially chlorine, are ineffective against *Cryptosporidium* oocysts at reasonable dosages. In the unlikely event of a breakthrough of *Cryptosporidium* oocysts, especially at the end of a filter run, UV light is present to render any parasites that may be present as non-infectious. Cysts and oocysts are not able to proliferate inside the intestines of human hosts to cause illness after a sufficient dose of UV light. The target dosage for UV light is to achieve 2-Log (99%) *Giardia* and *Cryptosporidium* inactivation.

Under normal operating conditions, two rows of lamps operating at 75% power provide sufficient UV light to meet the dosage requirement for 2-log reduction of *Giardia* and *Cryptosporidium*. Table 8 summarizes the performance of the SCFP UV system in 2025.

**Table 8: Percent of Volume Meeting Ultraviolet Dosage Requirements at SCFP**

Month	Percent of Monthly Volume $\geq$ 2-log of <i>Giardia</i> and <i>Cryptosporidium</i> Inactivation (95% of monthly volume required)
January	99.861
February	99.954
March	99.928
April	99.926
May	99.901
June	99.951
July	99.943
August	99.923
September	99.958
October	99.937
November	99.945
December	99.936


### 2.1.3. Chlorination

Chlorination is used for disinfection at the SCFP, as well as at downstream secondary disinfection stations to minimize bacterial regrowth in the GVWD transmission and GVWD supplied distribution systems. Chlorination provides 4-log virus inactivation with liquid sodium hypochlorite. The chlorination system was operational 100% of the time in 2025.

## 2.2. Coquitlam Water Treatment Plant

The CWTP treats Coquitlam source water using multiple disinfection barriers, specifically, ozone, UV and chlorine, and provides corrosion control as shown in Figure 7. The Coquitlam source water is not filtered. Ozone contact is achieved in a stainless steel contactor water main that connects the Ozonation facility with the Corrosion Control and Chlorination facility. The primary function of ozone is to improve the ultraviolet transmittance (UVT) of the water to improve its clarity for subsequent UV light treatment and oxidize organic precursors responsible for the formation of disinfection by-products (DBPs) following chlorination.

**Figure 7: Coquitlam Water Treatment Plant Treatment Process**

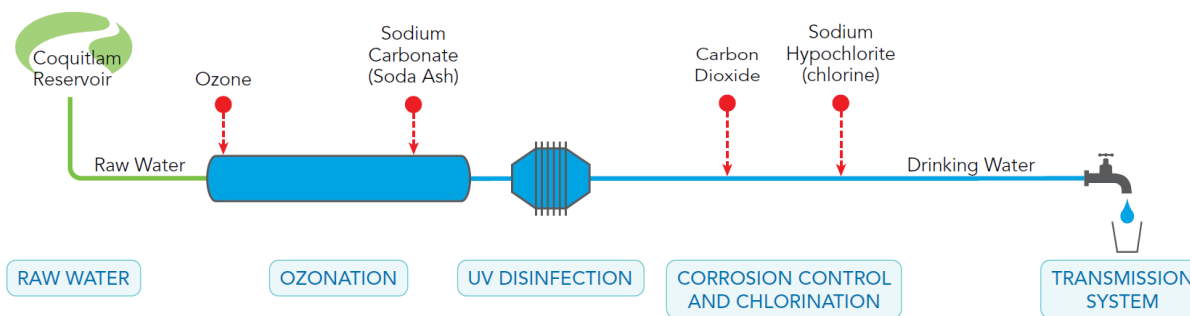

Ozone also provides disinfection capacity for *Giardia* and viruses. UV light is the primary process for inactivation of *Giardia* and *Cryptosporidium* and chlorine for viruses. Corrosion control is achieved using sodium carbonate and CO<sub>2</sub>; the latter is added to trim the pH once the desired alkalinity is reached. After chlorination, the finished water enters the transmission system.

### 2.2.1. Ozonation

Ozone is intended as a pre-treatment; however, it also provides complete backup for inactivation of *Giardia*, should the UV treatment system be offline. Ozonation also provides full virus inactivation in addition to chlorination. The ozonation system was operational for 99.6% of the time in 2025. The ozone outages were due to a combination of planned and unplanned events that included electrical or instrument maintenance, ozone dosing tests, and ozone generator faults or testing.

### 2.2.2. Ultraviolet Treatment

UV light treatment provides for primary disinfection and achieves 3-log inactivation of the chlorine-resistant microorganisms, *Giardia* and *Cryptosporidium*. Water is directed into 8 UV units. BC *Guidelines for Ultraviolet Disinfection of Drinking Water* requires that the ultraviolet disinfection process results in target *Giardia* and *Cryptosporidium* inactivation in at least 95% of the treated water volume on a monthly basis, which is summarized in Table 9. There was no loss of UV in 2025. The small percentage of water that did not meet the criteria was the result of unplanned events, as well as planned power outages required to test the emergency back-up power system.

**Table 9: Percent of Volume Meeting Ultraviolet Dosage Requirements at CWTP**

Month	Percent of Monthly Volume ≥ 3-log <i>Giardia</i> and <i>Cryptosporidium</i> Inactivation (Minimum 95% Required)
January	99.835
February	99.903
March	99.908
April	99.768
May	99.909
June	99.909
July	99.891
August	99.891
September	99.908
October	99.872
November	99.895
December	99.893

### 2.2.3. Chlorination

Chlorination is used for disinfection at the CWTP, as well as at secondary disinfection stations to minimize bacterial regrowth in the GVWD transmission and GVWD supplied distribution systems. Chlorination provides 4-log virus inactivation using a liquid sodium hypochlorite solution. There was one event in 2025 when the chlorination system did not operate continually. On October 14, 2025, a valve on the sodium hypochlorite system feed closed unexpectedly while ozone treatment was off-line for planned maintenance. The UV system remained operational during the event. There was a resulting drop in chlorine residual that lasted for approximately 9 minutes. Leaving the plant, chlorine residuals in Coquitlam water

mains No. 2 and 3 were in the order of 0.2 to 0.3 mg/L, while turbidity remained low at 0.4 NTU. At the time of the event, Fraser Health was notified.

## 2.3. Secondary Disinfection

There are eight secondary disinfection stations operated by Metro Vancouver. The purpose of these stations is to increase the chlorine residual in the GVWD transmission and GVWD supplied distribution systems to meet a target residual based on a number of factors, including source water turbidity, the amount of bacterial regrowth detected in the GVWD supplied distribution system samples, and the chlorine demand in the water. The rate of chlorine decay is lower in the areas receiving filtered water from the SCFP and consequently, lower chlorine dosage levels are required to maintain desired chlorine residual levels. The target chlorine residual leaving the SCFP is 0.80 mg/L. The target chlorine residual leaving the CWTP ranges from 1.3 to 1.5 mg/L. These chlorine residuals leaving the treatment plants have been established to maintain target chlorine residuals throughout the GVWD transmission system of 0.5 mg/L or greater. The secondary disinfection facilities receiving SCFP water frequently have an incoming chlorine residual high enough that boosting is not required.

Table 10 summarizes the performance of the secondary disinfection facilities in 2025.

**Table 10: Performance of Secondary Disinfection Facilities**

Facility	Branch Main	Average Free Chlorine (mg/L)	Range of Free Chlorine (mg/L)	Discussion
Clayton	Whalley/Clayton	1.19	0.94 - 1.46	Supplied by CWTP water.
	Jericho/Clayton	1.23	1.06 - 1.72	
Chilco	Capilano No.4 and No.5	0.78	0.39 - 0.97	Supplied by SCFP water. Station was removed from service for the Stanley Park Water Supply Tunnel project beginning on October 15 and remained out of service for the remainder of the year.
Pitt River	Haney Main No.2	1.21	0.75 - 1.41	Supplied by CWTP water. In 2025 the station was continually operated, with the exception of two outages related to power loss, February 2 for 20 minutes and February 13 for 3 hours.
	Haney Main No.3	1.20	0.90 - 1.43	
Newton	Surrey Hickleton Main	1.22	0.70 - 1.70	This station is alternately supplied by SCFP or CWTP water. In 2025, the station was in operation when required. From November 21 to 23, there was lower than expected residual chlorine leaving the station due to an issue with the chlorine outlet valve.
Kersland	Capilano No.4 and No.5	0.89	0.82 - 0.93	Supplied by SCFP water.

Facility	Branch Main	Average Free Chlorine (mg/L)	Range of Free Chlorine (mg/L)	Discussion
Central Park	South Burnaby Main No.1	0.88	0.77 - 1.31	Primarily supplied by SCFP water, but is occasionally supplied by CWTP water, depending on flow demands.
	South Burnaby Main No.2	0.92	0.66 - 1.26	From October 15 to 21, the dosing setpoint was increased to counteract any possible in-system turbidity issues resulting from a flow reversal within a regional water main supplying the City of Vancouver. This was required to facilitate the Stanley Park Water Supply Tunnel project construction.
Cape Horn	Coquitlam Main No.2	1.21	0.98 - 1.48	Supplied by CWTP water.
	Coquitlam Main No.3	1.21	1.05 - 1.44	In 2025 the station operated continually.
Vancouver Heights	Boundary Road Main No.5	0.86	0.72 - 1.00	Supplied by SCFP water.  This station was out of service from March 31 to May 5 and September 2 to October 7 as sections of water mains were isolated for worker safety during the tie-in of Capilano Main No.7 to the Second Narrows Water Supply Tunnel.

## 2.4. Corrosion Control

Metro Vancouver's corrosion control program began in the 1990s, and involves several steps to reduce pipe corrosion. As part of the *Corrosion Control Program: Copper Pipes Protection* initiative, further changes in pH and alkalinity were made in June 2021 to help reduce pipe corrosion through the addition of natural minerals. Corrosion control parameters are continually monitored to assess need for future adjustments.

Untreated water from all three sources had a pH lower than the limit of the GCDWQ of pH 7.0.

In the SCFP process, filtered water is dosed with calcium hydroxide (hydrated lime) to raise its pH and alkalinity before it enters the Clearwell. To achieve the desired alkalinity, the resultant pH is trimmed using CO<sub>2</sub> to reduce it to target levels.

At the CWTP, sodium carbonate (soda ash) is added to raise the pH and neutralize the remaining ozone in the water prior to it entering the UV units. Similar to the SCFP, CO<sub>2</sub> is used to trim the resultant pH to desired target levels.

During 2025, the average pH of the treated water was 8.4 leaving both the SCFP and CWTP.

Performance of the corrosion control facilities is summarized in Table 11.

**Table 11: Performance of Corrosion Control Facilities**

Facility	Performance	Discussion
SCFP Corrosion Control	pH ranged from 7.2 to 9.6	The annual average pH was 8.4, as continually monitored with online instrumentation, and was within the GCDWQ range.
CWTP Corrosion Control	pH ranged from 6.8 to 9.6	<p>The annual average pH was 8.4, as continually monitoring with online instrumentation.</p> <p>The GCDWQ for pH of 7.0 to 10.5 was not met on March 9, 2025 for 30 minutes while repairs to the soda ash system were conducted.</p>

### 3. Transmission/Distribution System Water Quality

Schedule A of the BC *Drinking Water Protection Regulation* (DWPR) stipulates standards for the bacteriological quality of potable water in the Province. There are three components of this standard that apply to large utilities such as the GVWD and GVWD supplied systems. These are:

**Part 1:** No sample should be positive for *E. coli*.

**Part 2:** Not more than 10% of the samples in a 30-day period should be positive for total coliform bacteria when more than one sample is collected.

**Part 3:** No sample should contain more than 10 total coliform bacteria per 100 mL.

The DWPR does not contain any water standards other than the three limits for *E. coli* and total coliform bacteria. Information on the significance of the detection of these organisms can be found in the GCDWQ – Supporting Documents, specifically:

“*E. coli* is a member of the total coliform group of bacteria and is the only member that is found exclusively in the faeces of humans and other animals. Its presence in water indicates not only recent faecal contamination of the water but also the possible presence of intestinal disease-causing bacteria, viruses and protozoa.”

“The presence of total coliform bacteria in water in the distribution system (but not in water leaving the treatment plant) indicates that the distribution system may be vulnerable to contamination or may simply be experiencing bacterial regrowth.”

To summarize, the detection of *E. coli* bacteria in a sample of treated water is an indication of a potentially serious risk. The detection of total coliform bacteria may indicate intrusion into the system, or it may indicate that these bacteria are growing in the system itself (regrowth).

In 2025, 99.9% of the samples tested were negative for coliforms, which is a good indicator of effective water treatment as well as good GVWD transmission system and overall distribution system water quality.


#### 3.1. Microbiological Water Quality in the GVWD System

##### 3.1.1. GVWD Water Mains

Water quality in GVWD water mains is monitored from the point leaving the source and throughout the transmission system. In 2025, there were approximately 4,400 samples collected and tested for the presence of indicator bacteria. The percentage of samples from the GVWD water mains that were positive for total coliform bacteria was well below the 10% standard. Fifteen samples in the GVWD system tested positive for total coliforms of which one had more than 10 CFU/100mL. In all instances the residual chlorine values were acceptable and follow-up samples did not detect any total coliforms. No samples were positive for *E. coli* bacteria. The compliance of monitoring results from GVWD water mains with the BCDWPR criteria are shown in Figure 8.

In addition, there are in-line stations collecting chlorine data every 10 minutes after chlorination at each source, but these samples are not included in the calculations for compliance monitoring.

**Figure 8: Bacteriological Quality of Water in GVWD Water Mains**

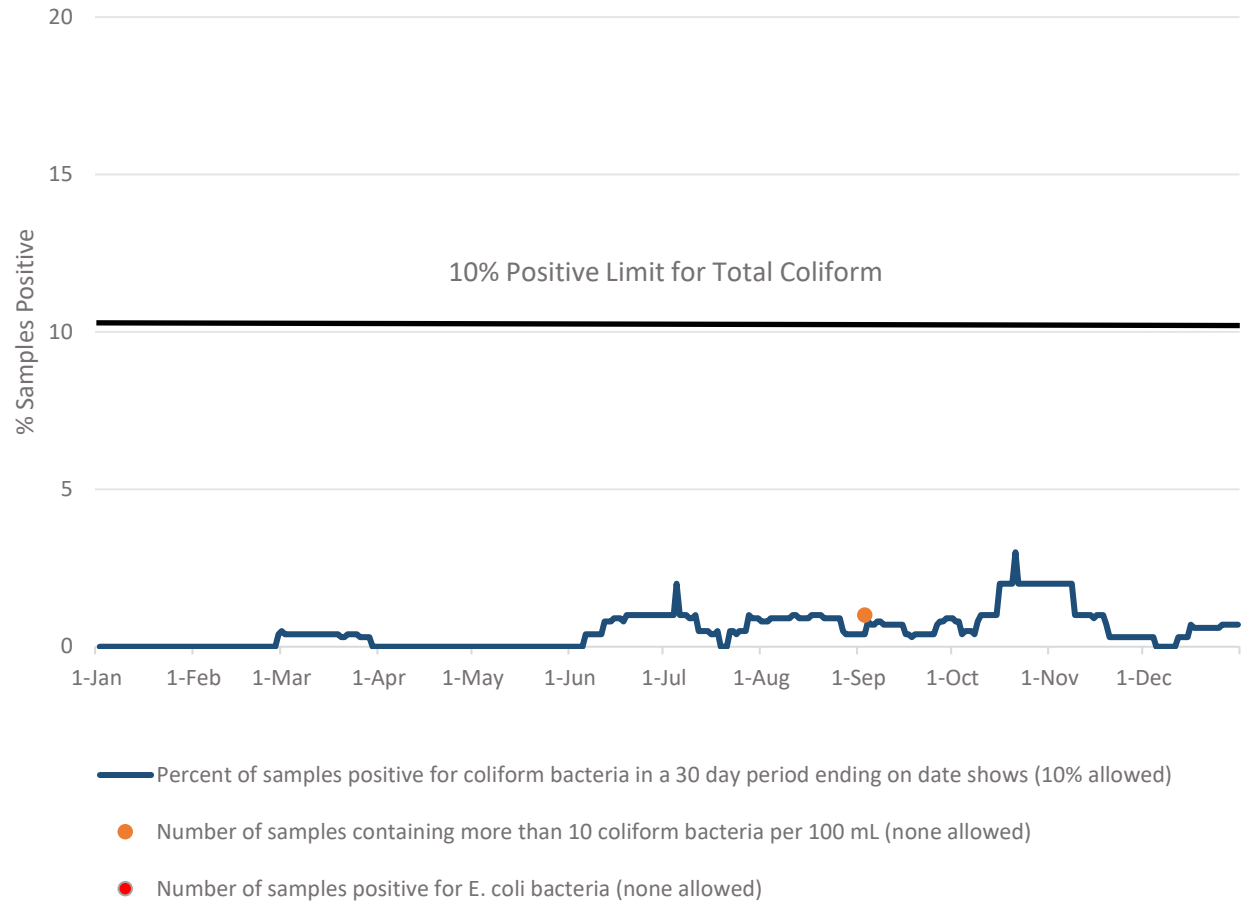


### 3.1.2. GVWD In-System Reservoirs

In 2025, almost 1,900 samples were collected from in-system reservoirs that are located throughout the GVWD transmission system. One sample was positive for total coliforms. No samples from a reservoir were positive for *E. coli*.

The compliance of 2025 monitoring results from GVWD reservoirs with the criteria in the DWPR are shown in Figure 9.

**Figure 9: Bacteriological Quality of Water in GVWD In-System Reservoirs**

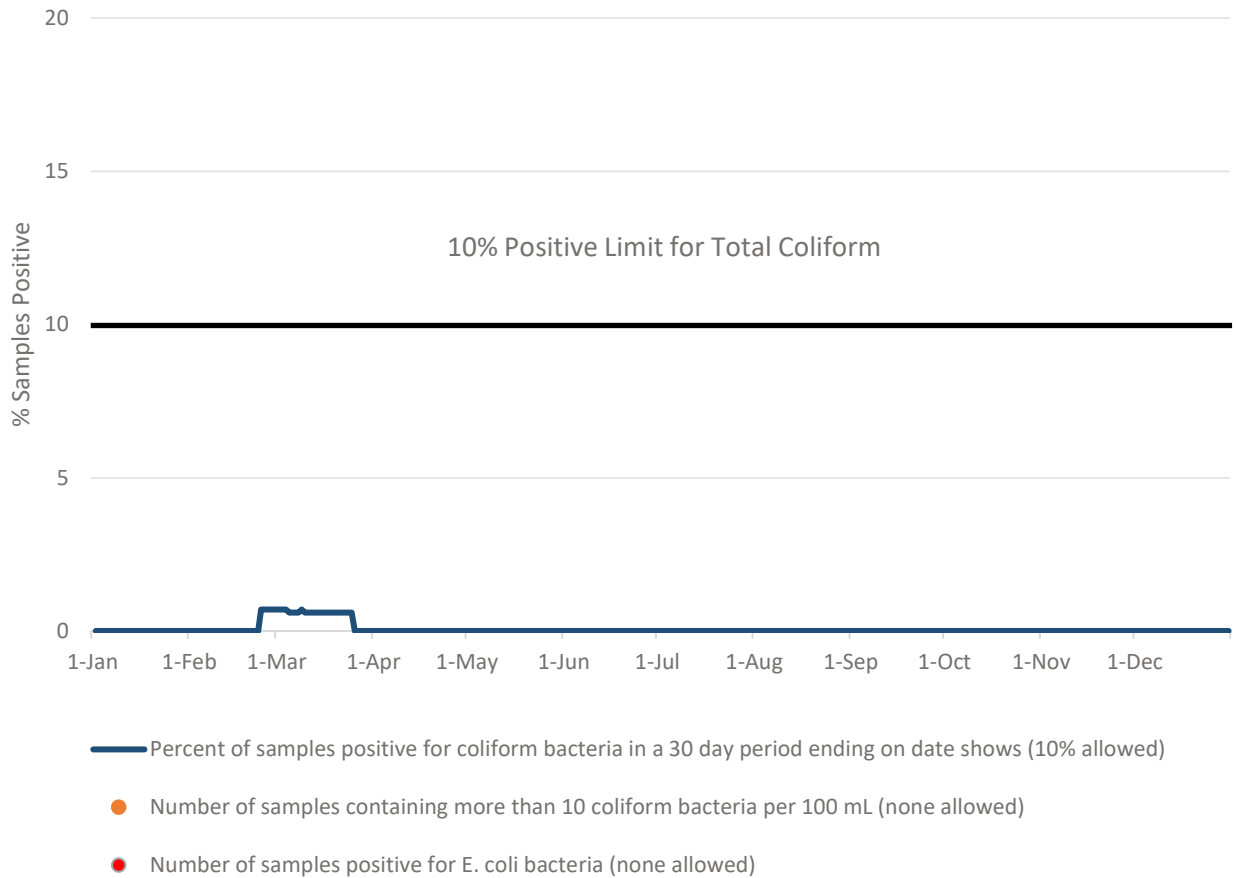

Reservoir water quality is optimized using secondary disinfection coupled with an active reservoir cycling (fill and draw) and cleaning program. As a minimum, weekly monitoring of chlorine residuals and bacteriological testing are performed, which helps inform the need for operational changes to filling cycles.

Table 12 provides an overview of the status of the GVWD in-system reservoirs from 2022 to 2025. During certain times of the year, it is not possible to cycle reservoirs as often as desired due to operational constraints with the system. Despite constraints, only one out of almost 1,900 samples taken from in-system reservoirs contained total coliforms.


**Table 12: Status of GVWD In-System Reservoirs (2022-2025)**

Reservoir (Capacity in Million Litres)	Average free chlorine residual (mg/L)				Discussion
	2022	2023	2024	2025	
Burnaby Mountain Reservoir (13.2)	0.49	0.43	0.45	0.50	No operational issues.
Burnaby Tank (2.3)	0.56	0.52	0.56	0.57	No operational issues.
Cape Horn Reservoir (40.0)	0.78	0.82	0.74	0.71	No operational issues.
Central Park Reservoir (35.0)	0.56	0.43	0.59	0.52	No operational issues.
Clayton Reservoir (21.6)	1.05	1.09	1.06	1.0	No operational issues.
Fleetwood Reservoir (13.6)	-	-	-	1.1	Cell 1 to be operational in 2026. Cell 2 was completed, disinfected, commissioned and put into service in November 2025.
Glenmore Tanks (1.0)	0.67	0.68	0.68	0.73	Tanks were cleaned and disinfected.
Grandview Reservoir (13.5)	0.84	0.71	0.76	0.77	No operational issues.
Greenwood Reservoir (8.8)	0.68	0.70	0.72	0.75	No operational issues.
Hellings Tank (4.3)	0.52	0.44	0.47	0.56	No operational issues.
Jericho Reservoir (20.0)	0.92	0.87	0.82	0.81	No operational issues.
Kennedy Reservoir (16.3)	0.60	0.57	0.55	0.57	No operational issues.
Kersland Reservoir (73.7)	0.61	0.53	0.56	0.67	No operational issues.
Little Mountain Reservoir (171.0)	0.66	0.65	0.65	0.70	No operational issues.
Maple Ridge Reservoir (20.0)	0.43	0.52	0.47	0.42	No operational issues.
Newton Reservoir (32.0)	0.64	0.45	0.48	0.54	No operational issues.
Pebble Hill Reservoir (42.2)	0.61	0.49	0.56	0.54	Cell 1 was removed from service in October due to the low demand season. Cell 2 began the year out of service; it was cleaned and disinfected before it was returned to service in June. Cell 3 no operational issues.
Prospect Reservoir (4.4)	0.69	0.70	0.72	0.77	Removed from service in October for seismic upgrades and remained out-of-service for the remainder of the year.
Sasamat Reservoir (26.0)	0.61	0.50	0.44	0.59	Conducted structural remediation repairs.
Sunnyside Reservoir (22.7)	0.78	0.68	0.76	0.86	Cell 1 had no operational issues. Cell 2 was removed from service in October for seismic upgrades and remained out of service for the remainder of the year.
Vancouver Heights Reservoir (43.0)	0.71	0.75	0.73	0.75	No operational issues.
Westburnco Reservoir (73.0)	0.65	0.55	0.67	0.53	No operational issues.
Whalley Reservoir (33.4)	0.65	0.72	0.74	0.62	Reservoir was cleaned and disinfected in March.

### 3.2. Microbiological Water Quality in GVWD Supplied Systems

For samples collected from GVWD supplied systems, the percent positive-per-month for total coliform bacteria from 2022-2025 is shown in Figure 10.

**Figure 10: Bacteriological Quality of Water in GVWD Supplied Systems**

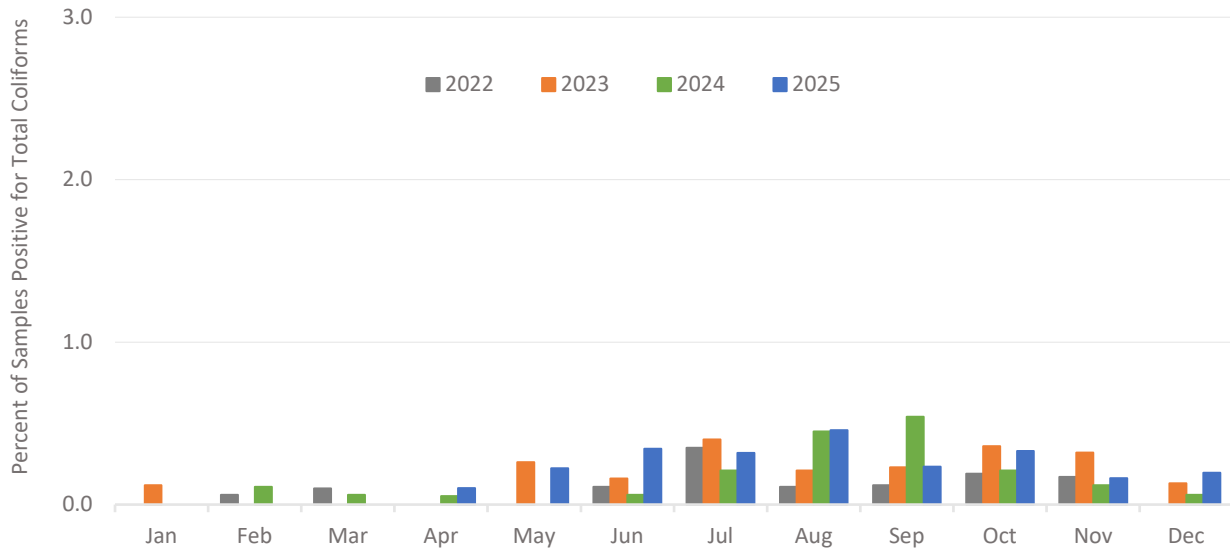

The percentage of samples that were positive for total coliform bacteria continues to be low; the annual average in 2025 was 0.19%.

As per Part 1 of the DWPR, no sample should be positive for *E. coli*. In September a single sample from a GVWD supplied system was positive for *E. coli*. All subsequent follow-up resamples were negative.

As per Part 2 of the DWPR, not more than 10% of the samples in a 30-day period should be positive for total coliform bacteria when more than one sample is collected. While there were 44 samples with total coliforms detected out of over 22,200 samples, none of the GVWD supplied systems had more than 10% of samples positive for total coliforms in a 30-day period.

As per Part 3 of the DWPR, no sample should contain more than 10 total coliform bacteria per 100 mL; for samples from GVWD supplied systems, this requirement was met in 2025 with the following four exceptions: two in September, one in October and one in December. Follow-up samples did not detect any total coliforms.

Table 13 shows compliance with the bacteriological standards (3 parts) in the DWPR for samples taken within the distribution systems of the 21 water systems that are supplied with GVWD water.

**Table 13: GVWD Connected Water Systems Water Quality Compared to the Provincial Bacteriological Standards**

Month	Number of water systems that met Part 1 No sample should be positive for <i>E. coli</i>	Number of water systems that met Part 2 Not more than 10% of the samples in a 30-day period should be positive for total coliform bacteria	Number of water systems that met Part 3 No sample should contain more than 10 total coliform bacteria per 100 mL	Number of water systems that met all requirements
January	21	21	21	21
February	21	21	21	21
March	21	21	21	21
April	21	21	21	21
May	21	21	21	21
June	21	21	21	21
July	21	21	21	21
August	21	21	21	21
September	20	21	19	19
October	21	21	20	20
November	21	21	21	21
December	21	21	20	20


### 3.3. Disinfection By-Products in the Transmission and Distribution Systems

As treated water moves through the GVWD transmission system and into the distribution system infrastructure that is connected to the GVWD system, changes in water quality can occur. Reactions between chlorine (used to kill or inactivate harmful organisms in a process called disinfection) and dissolved natural organic matter can lead to the formation of a variety of disinfection by-products (DBPs). Health Canada recommends that utilities should make every effort to maintain concentrations of DBPs as low as reasonably achievable without compromising the effectiveness of disinfection.

There are two major classes of regulated DBPs: trihalomethanes and haloacetic acids. Total trihalomethane (TTHM) is the sum of four compounds: chloroform, bromodichloromethane, dibromochloromethane, and bromoform. Haloacetic Acid 5 (HAA5) is the sum of five compounds: dibromoacetic acid, dichloroacetic acid, monobromoacetic acid, monochloroacetic acid and trichloroacetic acid. Factors that affect DBP formation include: amount of chlorine added to water, reaction time, concentration and characteristics of dissolved organic materials (precursors), water temperature, and water pH.

The MAC in the GCDWQ for TTHMs is a locational yearly running average of 100 µg/L based on quarterly samples. A comparison of TTHM levels in the GVWD and GVWD supplied systems in 2025 is shown in Figure 11. All results were below the MAC of 100 µg/L. In 2025, the annual average TTHM results for GVWD water mains and GVWD supplied systems were 23 µg/L, and 32 µg/L, respectively.

**Figure 11: Average Total Trihalomethane Concentrations**

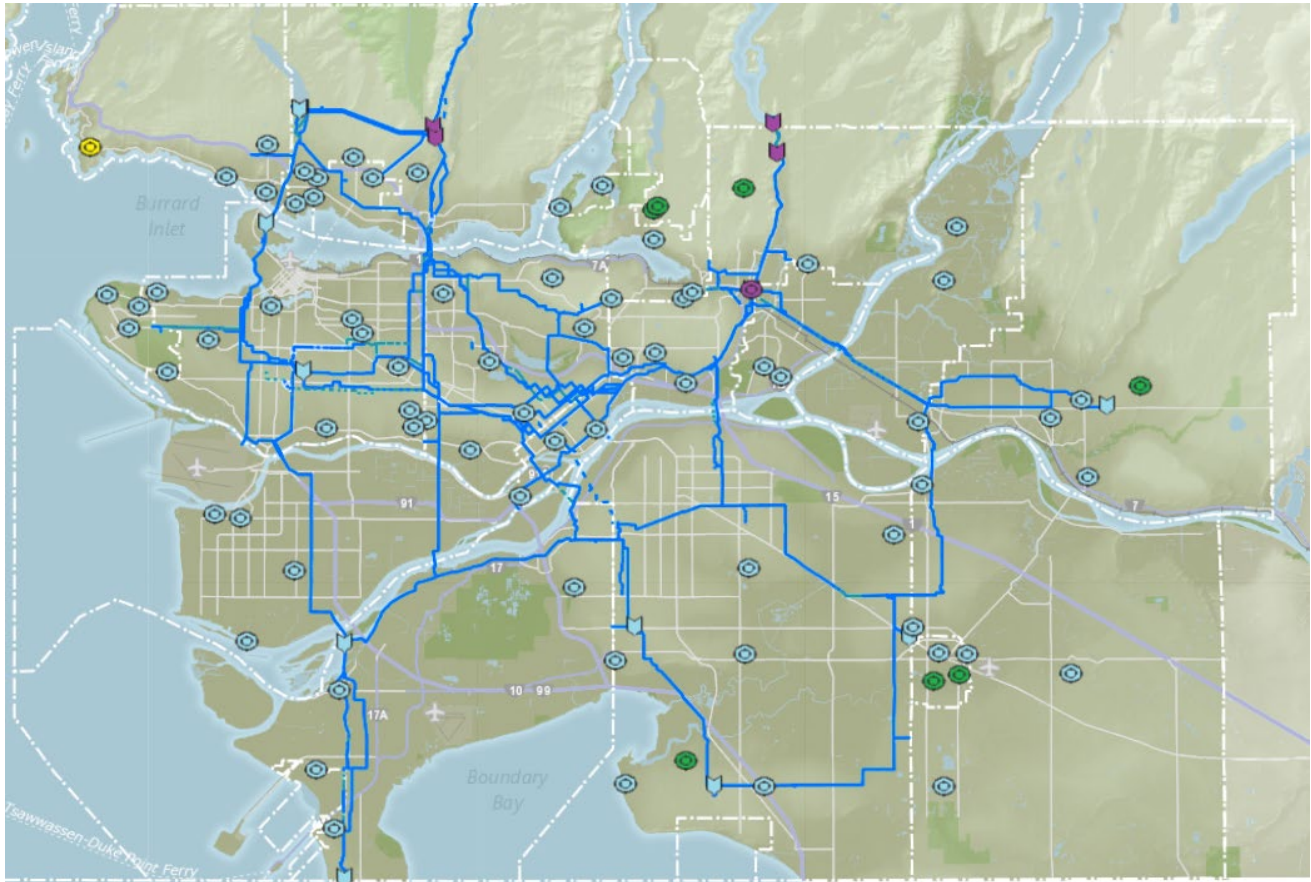

2025 Average GVWD System TTHM = 23 µg/L  
 2025 Average GVWD Supplied Systems TTHM = 32 µg/L  
 MAC for TTHM = 100 µg/L

**TTHM Levels for GVWD System Sites**

-  ≥ 0 and < 20
-  ≥ 20 and < 40
-  ≥ 40 and < 60
-  ≥ 60 and < 80
-  ≥ 80 and < 100
-  ≥ 100


**TTHM Levels at GVWD Supplied Systems Sites**

-  ≥ 0 and < 20
-  ≥ 20 and < 40
-  ≥ 40 and < 60
-  ≥ 60 and < 80
-  ≥ 80 and < 100
-  ≥ 100

The other major regulated class of DBPs is HAA5. Comparison of HAA5 in the GVWD and GVWD supplied systems in 2025 is shown in Figure 12. In 2025, the annual average HAA5 results for GVWD water mains and GVWD supplied systems were 21 µg/L, and 24 µg/L, respectively. All results were below the MAC of 80 µg/L.

N-Nitrosodimethylamine (NDMA) is also a regulated DBP with a MAC of 40 ng/L. In 2025, NDMA was not detected in any treated water samples.

**Figure 12: Average Haloacetic Acid 5 (HAA5) Concentrations**

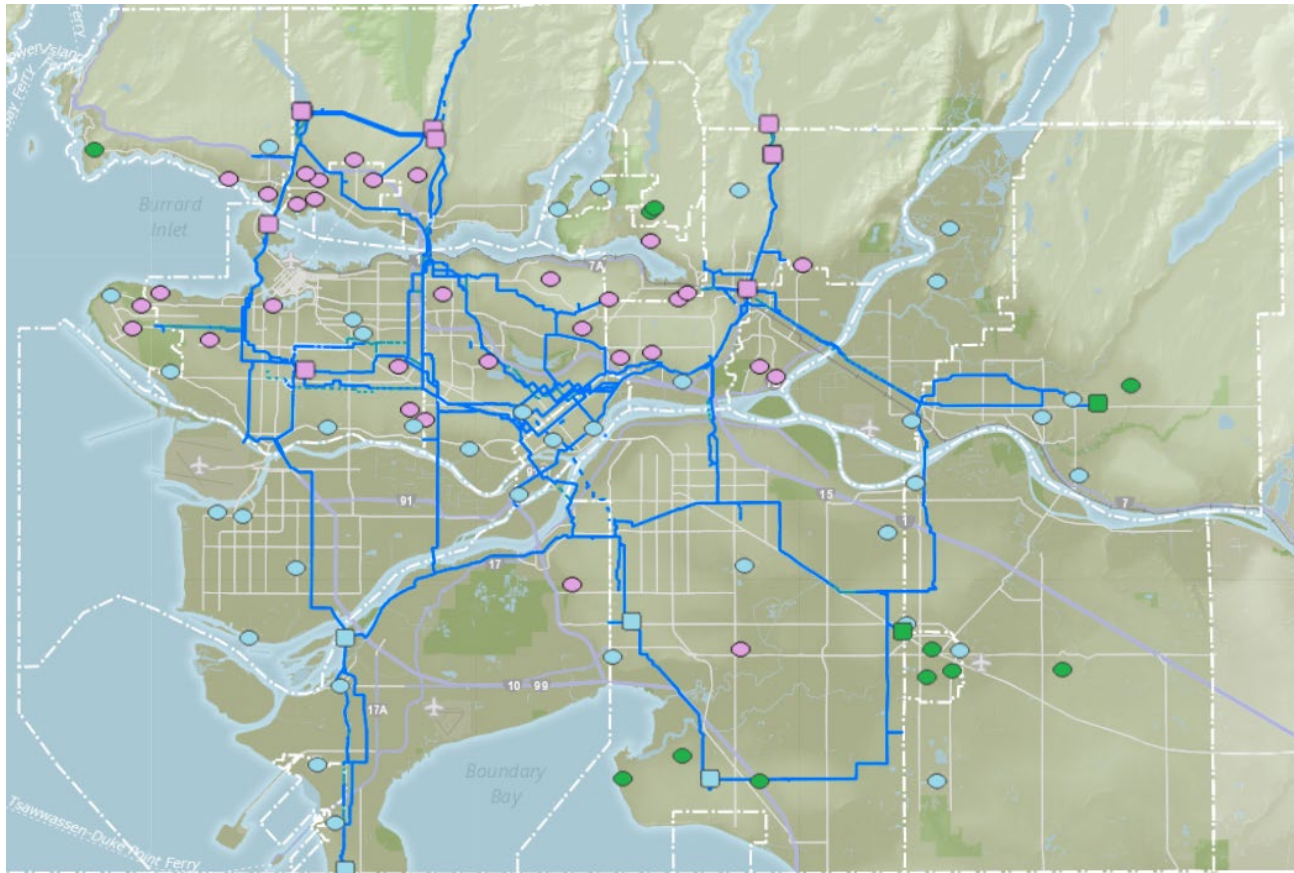

2025 Average GVWD System HAA5 = 21 µg/L  
 2025 Average GVWD Supplied Systems HAA5 = 24 µg/L  
 MAC for HAA5 = 80 µg/L

**HAA5 Levels for GVWD System Sites**

- ≥ 0 and < 20
- ≥ 20 and < 40
- ≥ 40 and < 60
- ≥ 60 and < 80
- ≥ 80 and < 100
- ≥ 100

**HAA5 Levels at GVWD Supplied Systems Sites**

- ≥ 0 and < 20
- ≥ 20 and < 40
- ≥ 40 and < 60
- ≥ 60 and < 80
- ≥ 80 and < 100
- ≥ 100

### 3.4. Polycyclic Aromatic Hydrocarbons in the Transmission System

In early September, the Capilano Main No. 7 was isolated for tie-in work in support of the Second Narrows Water Supply Tunnel project. Within two weeks of isolation, localized reports of drinking water odours within the District of North Vancouver began. Metro Vancouver was notified by the District of North Vancouver on October 2 and sampling was conducted on October 3 along with flushing.

Several locations were sampled and screened for a range of twenty-one PAH compounds. Results from Capilano Main No. 7 at Hunter Street confirmed the presence of low concentrations of fluoranthene (0.61 µg/L), fluorene (1.57 µg/L), naphthalene (3.79 µg/L), and quinoline (0.97 µg/L). The presence of naphthalene was consistent with the odours being reported. There are no Health Canada drinking water guidelines for the PAHs that were detected. The only PAH compound that has a GCDWQ limit is benzo[a]pyrene, which was not detected. At the time of the event, Vancouver Coastal Health was notified of the test results.

After the water main was returned to service and normal flow rates resumed, an additional round of sampling was conducted on October 10, which showed that PAH concentrations had dropped to near detection limits (total PAH concentration of 0.16 µg/L). At this time, reports of odours had ceased.

Additional data for routine PAH monitoring within select transmission mains are reported in Appendix 3.

## 4. Quality Assurance/Quality Control

Since 1994, the Metro Vancouver Microbiology Laboratory has participated in the BC Centre for Disease Control Public Health Laboratory's *Enhanced Water Quality Assurance Program* (EWQA) and has been approved by the Provincial Medical Health Officer to perform microbiological analysis of drinking water as required in the DWPR. An ongoing requirement of this approval is successful participation in the provincial *Clinical Microbiology Proficiency Testing Program*, or its equivalent. Representatives of the Approval Committee for Bacteriology Laboratories inspect the Metro Vancouver Microbiology Laboratory at the Lake City Operations Centre on a routine basis as part of the on-going approval process by the Provincial Health Officer. An audit inspection was planned for 2025 but was rescheduled to March 2026 by the EWQA audit team.

In addition to the approval process discussed above, the Metro Vancouver Laboratories are accredited by the Canadian Association for Laboratory Accreditation (CALA) for the analysis of specific parameters to the ISO/IEC 17025:2017. This is an international standard stipulates the general requirements for the competence of testing and calibration laboratories.

Representatives from CALA have assessed the Metro Vancouver Laboratories bi-annually since 1995. The most recent on-site audit successfully took place in October 2025, and the Metro Vancouver Laboratories were granted accreditation until 2028. The next bi-annual CALA assessment will take place in the fall of 2027. Metro Vancouver's full scope of accreditation is available on the CALA website (<https://cala.ca/>).

## 5. Results Summary

### Source Water Quality

- The Capilano supply was in service for the entire year; this source's highest turbidity reading was 4.2 NTU.
- The Seymour supply was in service for the entire year; this source's highest turbidity reading was 6.0 NTU.
- The Coquitlam supply was in service for the entire year. The unfiltered Coquitlam source water was greater than 1.0 NTU for 5 days and never exceeded 5.0 NTU. The highest turbidity reading on the Coquitlam source water was 1.7 NTU.
- The microbiological quality of the three source reservoirs was excellent. The levels of bacteria and protozoa detected were low, and indicative of high-quality source water.
- Coquitlam source water quality met the bacteriological requirements for an unfiltered source supply as specified in the GCDWQ as well as British Columbia's *Source Drinking Water Quality Guidelines*.
- Results of the source water analyses for herbicides, pesticides, volatile organic compounds and radionuclides were all found to be below the recommended limits as listed in the GCDWQ.
- In mid-October, Metro Vancouver received widespread reports of earthy or musty odours in tap water across several municipalities, prompting testing for geosmin, a naturally occurring compound produced by some bacteria and algae. Sampling on October 27 confirmed the presence of geosmin in the Seymour source water and treated water from the SCFP. Operational adjustments that increased the Capilano supply reduced geosmin levels, and by November 5, treated water tested below detection limits. While unpleasant, geosmin is not harmful to health.

### Water Treatment

- The SCFP performance, as measured by the quality of the delivered water, was excellent. The daily average turbidity of water leaving the clearwell to enter the GVWD transmission system was an average of 0.17 NTU.
- Turbidity levels for Individual Filter Effluent met the turbidity requirements of the GCDWQ and were never greater than 1.0 NTU.
- Filtration consistently removed iron, colour, and naturally occurring organics from the Capilano and Seymour source waters.
- There were no outages of disinfection treatment at the SCFP.
- At the CWTP there was a drop in liquid sodium hypochlorite solution dosing for 9 minutes resulting in lower chlorine residuals in Coquitlam Mains No. 2 and No. 3; they were briefly at 0.2 and 0.3 mg/L respectively, while turbidity remained low at 0.4 NTU. The UV system remained operational during the event.
- In March, there was a 30-minute outage of corrosion control at the CWTP, which resulted in a temporary low pH of 6.8 leaving the plant, as compared to the annual average pH of 8.4.
- The secondary disinfection stations boosted the residual chlorine when required.

## Transmission and Distribution System Water Quality

- Bacteriological water quality was excellent in the GVWD transmission water mains and in-system storage reservoirs. The number of total coliforms detected in samples from both GVWD and water systems supplied with GVWD water is typically very low. More than 31,700 samples were collected and analyzed for GVWD and GVWD supplied systems, of which only one member jurisdiction sample was positive for *E. coli*. Repeat samples were taken, and no additional *E. coli* were found.
- The average concentration of TTHMs measured in the delivered water in the GVWD and water systems supplied with GVWD water were 23 µg/L and 32 µg/L, respectively. The average concentration for HAA5 measured in the delivered water in both the GVWD and water systems supplied with GVWD water were 21 µg/L and 24 µg/L, respectively. All DBP concentrations were below limits established in the GCDWQ.
- The isolation of Capilano Main No. 7, as part of the Second Narrows Water Supply Tunnel project tie-in work, caused some water to stagnate, which was followed by localized drinking water odour complaints. Testing confirmed low levels of four PAHs, including naphthalene. Detection of naphthalene is considered an aesthetic issue as there are no health-based drinking water guidelines for PAHs, except for benzo[a]pyrene, which was not detected. After flushing and returning the water main to regular service, odours dissipated.

*This page intentionally left blank.*

## **Appendix A — Water Sampling Frequency**

*This page intentionally left blank.*

*This page intentionally left blank.*

Water Type	Parameter	Minimum Frequency
Untreated, Source Water	Total coliform and <i>E. coli</i>	Daily
	HPC	Daily
	pH	Daily
	Turbidity	Daily
	<i>Giardia</i> and <i>Cryptosporidium</i>	Monthly
	Alkalinity, Ammonia, colour, iron, organic carbon	Weekly
	Calcium, chloride, fluoride, hardness, magnesium, manganese, nitrate, nitrite, phosphorus, sulphate	Monthly
	Aluminum, residue, silica, sodium	Bi-monthly
	TTHM, HAA5	Quarterly
	Antimony, arsenic, barium, boron, cadmium, chromium, copper, cyanide, lead, mercury, nickel, phenols, potassium, selenium, silver, uranium, zinc	Semi-annually
	Pesticides and herbicides	Annually
	PAHs, BTEX	Annually
	PFOS, PFOA, PFAS (sum of 25 compounds)	Annually
	VOCs	Annually
Radionuclides	Annually	
Treated Water before Transmission	Total coliform and <i>E. coli</i>	Daily
	Free chlorine, pH, temperature	Daily
	Turbidity	Daily
	Alkalinity, Ammonia, colour, conductivity, iron, organic carbon, aluminum at SCFP only	Weekly
	Aluminum, sodium, total and suspended solids (residue)	Bi-Monthly
	TTHM, HAA5	Quarterly at selected sites
	Antimony, arsenic, barium, boron, cadmium, chromium, copper, cyanide, lead, mercury, nickel, phenols, selenium, silver, zinc	Semi-annually
GVWD Water Mains	Total coliform and <i>E. coli</i> , HPC	Weekly
	Free chlorine, pH, temperature	Weekly
	TTHM, HAA5	Quarterly at selected sites
	PAHs, BTEX, vinyl chloride	Semi-annually at selected sites
GVWD Reservoirs	Total coliform and <i>E. coli</i> , HPC	Weekly
	Turbidity	Weekly
GVWD Supplied Distribution Systems	Total coliform and <i>E. coli</i> , HPC	Weekly
	Free chlorine, temperature	Weekly
	Turbidity	Weekly
	TTHM, HAA5, pH	Quarterly at selected sites
	Aluminum, antimony, arsenic, barium, boron, cadmium, calcium, chromium, copper, iron, lead, magnesium, manganese, mercury, selenium, silver, sodium, zinc, vinyl chloride	Semi-annually at selected sites

*This page intentionally left blank.*

## **Appendix B — Metro Vancouver Chemical and Physical Analysis Summaries**

*This page intentionally left blank.*

*This page intentionally left blank.*

## Metro Vancouver Physical and Chemical Analysis of Water Supply 2025 – Capilano Water System

Analyte	Untreated <sup>1</sup>	Treated <sup>2</sup>			Canadian Guideline	
	Average	Average	Range	Days Exceeded	Limit <sup>3</sup>	Reason Established
Alkalinity as CaCO <sub>3</sub> (mg/L)	3.1	21	17-23	N/A	None	N/A
Aluminum Dissolved (µg/L)	64	25	17-37	N/A	None	N/A
Aluminum Total (µg/L)	109	28	18-50	0	2,900/100	Health/Operational
Antimony Total (µg/L)	<0.5	<0.5	<0.5	0	6	Health
Arsenic Total (µg/L)	<0.5	<0.5	<0.5	0	10 (ALARA)	Health
Barium Total (µg/L)	2.6	3.0	2.6 - 3.4	0	2,000	Health
Boron Total (µg/L)	<10	<10	<10	0	5,000	Health
Bromate (µg/L)	<10	<10	<10	0	10	Health
Bromide (µg/L)	<10	<10	<10	N/A	None	N/A
Cadmium Total (µg/L)	<0.2	<0.2	<0.2	0	7	Health
Calcium Total (µg/L)	1,180	7,910	7,180 - 8,880	N/A	None	N/A
Carbon Organic - Dissolved (mg/L)	1.7	0.7	0.5-1.1	N/A	None	N/A
Carbon Organic - Total (mg/L)	1.8	0.7	0.5-1.1	N/A	None	N/A
Chlorate (µg/L)	<10	42	20-110	0	1,000	Health
Chloride (mg/L)	<0.6	2.7	2.4 - 3.5	0	≤250	Aesthetic
Chromium Total (µg/L)	<0.07	<0.05	<0.05 - 0.06	0	50	Health
Cobalt Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Colour - Apparent (ACU)	14	<2	<2-2	N/A	None	N/A
Colour - True (TCU)	10	<1	<1 - 1	0	≤15	Aesthetic
Conductivity (µmhos/cm)	11	52	47 - 58	N/A	None	N/A
Copper Total (µg/L)	3.0	<0.5	<0.5	0	2,000/1,000	Health/Aesthetic
Cyanide Total (mg/L)	<0.002	<0.002	<0.002	0	0.2	Health
Cyanobacterial Toxins – Microcystin – LR (µg/L)	<0.20	N/A	N/A	0	1.5	Health
1,4-Dioxane (µg/L)	<1	N/A	N/A	N/A	50	Health
Formaldehyde (µg/L)	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	None	N/A
Fluoride (mg/L)	<0.05	<0.05	<0.05	0	1.5	Health
Haloacetic Acid 5 (HAA5) (µg/L)	<3	16	10 - 20	0	80 (ALARA)	Health
Hardness as CaCO <sub>3</sub> (mg/L)	3.6	20.5	18.8 - 22.2	N/A	None	N/A
Iron Dissolved (µg/L)	30	<5	<5	N/A	None	N/A
Iron Total (µg/L)	89	<8	<5-15	0	≤100	Aesthetic
Lead Total (µg/L)	<0.5	<0.5	<0.5	0	5 (ALARA)	Health
Magnesium Total (µg/L)	164	216	157 - 296	N/A	None	N/A
Manganese Dissolved (µg/L)	3.7	2.0	0.9 - 4.1	N/A	None	N/A
Manganese Total (µg/L)	4.6	4.2	2.0 - 10.2	0	120/20	Health/Aesthetic
Mercury Total (µg/L)	<0.05	<0.05	<0.05	0	1	Health
Molybdenum Total (µg/L)	<0.5	<0.5	<0.5	N/A	88 <sup>5</sup>	N/A
Nickel Total (µg/L)	<0.5	<0.5	<0.5	N/A	80 <sup>5</sup>	N/A
Nitrotriacetic acid (NTA) (µg/L)	<50	N/A	N/A	N/A	400	Health
Nitrogen - Ammonia as N (mg/L)	<0.02	<0.02	<0.02	N/A	None	N/A
Nitrogen - Nitrate as N (mg/L)	0.07	0.06	0.02 - 0.09	0	10	Health
Nitrogen - Nitrite as N (mg/L)	<0.01	<0.01	<0.01	0	1	Health
N-Nitrosodimethylamine (NDMA) (ng/L)	<1.9	N/A	N/A	N/A	40	Health
pH (pH units)	6.6	8.3	7.9 - 8.5	0	7.0 - 10.5	Aesthetic
Phenol (mg/L)	<0.004	<0.004	<0.002 - <0.005	N/A	None	N/A
Potassium Total (µg/L)	156	154	140 - 166	N/A	None	N/A
Residue Total Dissolved (TDS) (mg/L)	14	32	28 - 37	0	≤500	Aesthetic
Selenium Total (µg/L)	<0.5	<0.5	<0.5	0	10 <sup>5</sup>	Health
Silica as SiO <sub>2</sub> (mg/L)	3.5	3.5	3.2 - 3.8	N/A	None	N/A
Silver Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Sodium Total (µg/L)	575	1,660	1,340 - 2,120	0	≤200,000	Aesthetic
Strontium (µg/L)	5.7	21.5	20.5 - 22.4	0	7000	Health
Total Trihalomethanes (TTHM) (µg/L)	<4	22.5	19 - 26	0	100	Health
Turbidity (NTU)	0.93	0.15	0.07 - 0.40	N/A	None <sup>6</sup>	N/A
Uranium Total (µg/L)	<0.5	<0.5	<0.5	0	20	Health
UV Absorbance 254 nm (Abs/cm)	0.067	0.011	0.007 - 0.015	N/A	None	N/A
Zinc Total (µg/L)	<3	<3	<3	0	≤5,000	Aesthetic

<sup>1</sup>Untreated water is sampled prior to the Seymour Capilano Filtration Plant.

<sup>2</sup>Treated water is sampled prior to entering the Capilano transmission system.

<sup>3</sup>Limits are taken from the *Guidelines for Canadian Drinking Water Quality*, unless otherwise indicated.

<sup>4</sup>Not applicable (N/A) because formaldehyde is a by-product of disinfection with ozone and ozone is not used at SCFP.

<sup>5</sup>A more strict guideline exists in the *Source Drinking Water Quality Guidelines*, BC Ministry of Environment & Climate Change Strategy (2020).

<sup>6</sup>*Guidelines for Canadian Drinking Water Quality* recommends that water entering the distribution system have turbidity levels of 1.0 NTU or less.

## Metro Vancouver Physical and Chemical Analysis of Water Supply 2025 – Seymour Water System

Analyte	Untreated <sup>1</sup>		Treated <sup>2</sup>		Canadian Guideline	
	Average	Average	Range	Days Exceeded	Limit <sup>3</sup>	Reason Established
Alkalinity as CaCO <sub>3</sub> (mg/L)	4.1	20	17 - 23	N/A	None	N/A
Aluminum Dissolved (µg/L)	49	25	15 - 37	N/A	None	N/A
Aluminum Total (µg/L)	76	28	16 - 48	0	2,900/100	Health/Operational
Antimony Total (µg/L)	<0.5	<0.5	<0.5	0	6	Health
Arsenic Total (µg/L)	<0.5	<0.5	<0.5	0	10 (ALARA)	Health
Barium Total (µg/L)	3.4	2.8	2.4 - 3.0	0	2,000	Health
Boron Total (µg/L)	<10	<10	<10	0	5,000	Health
Bromate (µg/L)	<10	<10	<10	0	10	Health
Bromide (µg/L)	<10	<10	<10	N/A	None	N/A
Cadmium Total (µg/L)	<0.2	<0.2	<0.2	0	7	Health
Calcium Total (µg/L)	1,670	7,810	6,930 - 8,760	N/A	None	N/A
Carbon Organic - Dissolved (mg/L)	1.6	0.7	0.5 - 1.0	N/A	None	N/A
Carbon Organic - Total (mg/L)	1.6	0.7	0.5 - 1.0	N/A	None	N/A
Chlorate (µg/L)	<10	43	20 - 110	0	1,000	Health
Chloride (mg/L)	<0.5	2.8	2.3 - 3.5	0	≤250	Aesthetic
Chromium Total (µg/L)	<0.05	<0.05	<0.05	0	50	Health
Cobalt Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Colour - Apparent (ACU)	14	<2	<2 - 3	N/A	None	N/A
Colour - True (TCU)	9	<1	<1 - 1	0	≤15	Aesthetic
Conductivity (µmhos/cm)	14	52	47 - 56	N/A	None	N/A
Copper Total (µg/L)	24.9	<0.5	<0.5	0	2,000/1,000	Health/Aesthetic
Cyanide Total (mg/L)	<0.002	<0.002	<0.002	0	0.2	Health
Cyanobacterial Toxins – Microcystin – LR (µg/L)	<0.20	N/A	N/A	0	1.5	Health
1,4-Dioxane (µg/L)	<1	<1	<1	0	50	Health
Formaldehyde (µg/L)	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	None	N/A
Fluoride (mg/L)	<0.05	<0.05	<0.05	0	1.5	Health
Haloacetic Acid 5 (HAA5) (µg/L)	<3	12	9 - 14	0	80 (ALARA)	Health
Hardness as CaCO <sub>3</sub> (mg/L)	4.8	20.2	18.1 - 22.1	N/A	None	N/A
Iron Dissolved (µg/L)	59	<5	<5	N/A	None	N/A
Iron Total (µg/L)	147	<9	<5 - 20	0	≤100	Aesthetic
Lead Total (µg/L)	<0.5	<0.5	<0.5	0	5 (ALARA)	Health
Magnesium Total (µg/L)	147	213	154 - 302	N/A	None	N/A
Manganese Dissolved (µg/L)	4.1	2.6	0.9 - 5.6	N/A	None	N/A
Manganese Total (µg/L)	5.8	4.6	2.4 - 10.6	0	120/20	Health/Aesthetic
Mercury Total (µg/L)	<0.05	<0.05	<0.05	0	1	Health
Molybdenum Total (µg/L)	<0.5	<0.5	<0.5	N/A	88 <sup>5</sup>	N/A
Nickel Total (µg/L)	<0.5	<0.5	<0.5	N/A	80 <sup>5</sup>	N/A
Nitritotriacetic acid (NTA) (µg/L)	<50	<50	<50	0	400	Health
Nitrogen - Ammonia as N (mg/L)	<0.02	<0.02	<0.02	N/A	None	N/A
Nitrogen - Nitrate as N (mg/L)	0.05	0.06	0.02 - 0.09	0	10	Health
Nitrogen - Nitrite as N (mg/L)	<0.01	<0.01	<0.01	0	1	Health
N-Nitrosodimethylamine (NDMA) (ng/L)	<1.9	<1.9	<1.9	0	40	Health
pH (pH units)	6.6	8.1	7.8 - 8.5	0	7.0 - 10.5	Aesthetic
Phenol (mg/L)	<0.004	<0.004	<0.002 - <0.005	N/A	None	N/A
Potassium Total (µg/L)	156	149	127 - 165	N/A	None	N/A
Residue Total Dissolved (TDS) (mg/L)	15	32	29 - 37	0	≤500	Aesthetic
Selenium Total (µg/L)	<0.5	<0.5	<0.5	0	10 <sup>5</sup>	Health
Silica as SiO <sub>2</sub> (mg/L)	3.4	3.5	3.1 - 3.8	N/A	None	N/A
Silver Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Sodium Total (µg/L)	554	1650	1,310 - 2,100	0	≤200,000	Aesthetic
Strontium (µg/L)	7.2	20.4	18.6 - 21.8	0	7000	Health
Total Trihalomethanes (TTHM) (µg/L)	<4	18.5	15 - 20	0	100	Health
Turbidity (NTU)	0.56	0.17	0.08 - 0.52	N/A	None <sup>6</sup>	N/A
Uranium Total (µg/L)	<0.5	<0.5	<0.5	0	20	Health
UV Absorbance 254 nm (Abs/cm)	0.061	0.011	0.007 - 0.016	N/A	None	N/A
Zinc Total (µg/L)	<3	<3	<3	0	≤5,000	Aesthetic

<sup>1</sup>Untreated water is sampled prior to the Seymour Capilano Filtration Plant.

<sup>2</sup>Treated water is sampled prior to entering the Seymour transmission system.

<sup>3</sup>Limits are taken from *the Guidelines for Canadian Drinking Water Quality*, unless otherwise indicated.

<sup>4</sup>Not applicable (N/A) because formaldehyde is a by-product of disinfection with ozone and ozone is not used at SCFP.

<sup>5</sup>A more strict guideline exists in the *Source Drinking Water Quality Guidelines*, BC Ministry of Environment & Climate Change Strategy (2020).

<sup>6</sup>*Guidelines for Canadian Drinking Water Quality* recommends that water entering the distribution system have turbidity levels of 1.0 NTU or less.

## Metro Vancouver Physical and Chemical Analysis of Water Supply 2025 – Coquitlam Water System

Analyte	Untreated <sup>1</sup>		Treated <sup>2</sup>		Canadian Guideline	
	Average	Average	Range	Days Exceeded	Limit <sup>3</sup>	Reason Established
Alkalinity as CaCO <sub>3</sub> (mg/L)	1.9	20	9.5 - 23	N/A	None	N/A
Aluminum Dissolved (µg/L)	55	61	44 - 74	N/A	None	N/A
Aluminum Total (µg/L)	74	75	58 - 85	0	2,900/100	Health/Operational
Antimony Total (µg/L)	<0.5	<0.5	<0.5	0	6	Health
Arsenic Total (µg/L)	<0.5	<0.5	<0.5	0	10 (ALARA)	Health
Barium Total (µg/L)	2.6	2.4	2.2 - 2.7	0	2,000	Health
Boron Total (µg/L)	<10	<10	<10	0	5,000	Health
Bromate (µg/L)	<10	<10	<10	0	10	Health
Bromide (µg/L)	<10	<10	<10	N/A	None	N/A
Cadmium Total (µg/L)	<0.2	<0.2	<0.2	0	7	Health
Calcium Total (µg/L)	828	824	738 - 914	N/A	None	N/A
Carbon Organic - Dissolved (mg/L)	1.6	1.6	1.3 - 2.1	N/A	None	N/A
Carbon Organic - Total (mg/L)	1.7	1.6	1.3 - 2.1	N/A	None	N/A
Chlorate (µg/L)	<10	110	45 - 160	0	1,000	Health
Chloride (mg/L)	<0.5	2.3	2.0 - 2.7	0	≤250	Aesthetic
Chromium Total (µg/L)	<0.05	<0.05	<0.05	0	50	Health
Cobalt Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Colour - Apparent (ACU)	12	<2	<2 - 2	N/A	None	N/A
Colour - True (TCU)	8	<1	<1 - 2	0	≤15	Aesthetic
Conductivity (µmhos/cm)	8	48	31 - 53	N/A	None	N/A
Copper Total (µg/L)	<0.5	<0.5	<0.5	0	2,000/1,000	Health/Aesthetic
Cyanide Total (mg/L)	<0.002	<0.002	<0.002	0	0.2	Health
Cyanobacterial Toxins – Microcystin – LR (µg/L)	<0.20	N/A	N/A	0	1.5	Health
1,4-Dioxane (µg/L)	<1	<1	<1	0	50	Health
Formaldehyde (µg/L)	N/A	19	19	N/A	None	N/A
Fluoride (mg/L)	<0.05	<0.05	<0.05	0	1.5	Health
Haloacetic Acid 5 (HAA5) (µg/L)	<3	7	5 - 10	0	80 (ALARA)	Health
Hardness as CaCO <sub>3</sub> (mg/L)	2.4	2.4	2.2 - 2.7	N/A	None	N/A
Iron Dissolved (µg/L)	15	17	10 - 29	N/A	None	N/A
Iron Total (µg/L)	44	43	28 - 97	0	≤100	Aesthetic
Lead Total (µg/L)	<0.5	<0.5	<0.5	0	5 (ALARA)	Health
Magnesium Total (µg/L)	92	92	80 - 102	N/A	None	N/A
Manganese Dissolved (µg/L)	3.4	2.4	0.8 - 3.5	N/A	None	N/A
Manganese Total (µg/L)	3.8	3.2	2.2 - 4.2	0	120/20	Health/Aesthetic
Mercury Total (µg/L)	<0.05	<0.05	<0.05	0	1	Health
Molybdenum Total (µg/L)	<0.5	<0.5	<0.5	N/A	88 <sup>4</sup>	N/A
Nickel Total (µg/L)	<0.5	<0.5	<0.5	N/A	80 <sup>4</sup>	N/A
Nitritotriacetic acid (NTA) (µg/L)	<50	<50	<50	0	400	Health
Nitrogen - Ammonia as N (mg/L)	<0.02	<0.02	<0.02	N/A	None	N/A
Nitrogen - Nitrate as N (mg/L)	0.07	0.07	0.05 - 0.09	0	10	Health
Nitrogen - Nitrite as N (mg/L)	<0.01	<0.01	<0.01	0	1	Health
N-Nitrosodimethylamine (NDMA) (ng/L)	<1.9	<1.9	<1.9	0	40	Health
pH (pH units)	6.3	8.3	7.7 - 9.2	0	7.0 - 10.5	Aesthetic
Phenol (mg/L)	<0.004	<0.004	<0.002 - <0.005	N/A	None	N/A
Potassium Total (µg/L)	115	114	104 - 122	N/A	None	N/A
Residue Total Dissolved (TDS) (mg/L)	11	33	30 - 35	0	≤500	Aesthetic
Selenium Total (µg/L)	<0.5	<0.5	<0.5	0	10 <sup>4</sup>	Health
Silica as SiO <sub>2</sub> (mg/L)	2.6	2.6	2.5 - 2.8	N/A	None	N/A
Silver Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Sodium Total (µg/L)	463	10,100	8,910 - 11,200	0	≤200,000	Aesthetic
Strontium (µg/L)	3.8	3.8	3.5 - 4.0	0	7000	Health
Total Trihalomethanes (TTHM) (µg/L)	<4	5.5	4 - 7	0	100	Health
Turbidity (NTU)	0.39	0.33	0.13 - 2.0	N/A	None <sup>5</sup>	N/A
Uranium Total (µg/L)	<0.5	<0.5	<0.5	0	20	Health
UV Absorbance 254 nm (Abs/cm)	0.060	0.018	0.015 - 0.031	N/A	None	N/A
Zinc Total (µg/L)	<3	<3	<3	0	≤5,000	Aesthetic

<sup>1</sup>Untreated water is sampled from the source intake.

<sup>2</sup>Treated water is sampled prior to entering the Coquitlam transmission system.

<sup>3</sup>Limits are taken from the *Guidelines for Canadian Drinking Water Quality*, unless otherwise indicated.

<sup>4</sup>A more strict guideline exists in the *Source Drinking Water Quality Guidelines*, BC Ministry of Environment & Climate Change Strategy (2020).

<sup>5</sup>*Guidelines for Canadian Drinking Water Quality* recommends that water entering the distribution system have turbidity levels of 1.0 NTU or less.

*This page intentionally left blank.*

## **Appendix C — Analysis of Water for Organic Components and Radionuclides**

*This page intentionally left blank.*

*This page intentionally left blank.*

### Analysis of Source Waters for Herbicides, Pesticides, and other Organic Compounds

Analyte	Capilano (µg/L) June 25	Seymour (µg/L) June 25	Coquitlam (µg/L) June 25	MAC (µg/L)	AO (µg/L)
<b>Herbicides</b>					
2,4-Dichlorophenoxyacetic acid (2,4-D)	<1.0	<1.0	<1.0	100	None
Bromoxynil	<0.50	<0.50	<0.50	30	None
Dicamba	<1.0	<1.0	<1.0	110	None
Diclofop-methyl	<0.90	<0.90	<0.90	None	None
Diquat	<7.0	<7.0	<7.0	50	None
Diuron	<10	<10	<10	None	None
Glyphosate	<10	<10	<10	280	None
4-Chloro-2-methylphenoxyacetic acid (MCPA)	<10	<10	<10	350	None
Metribuzin (Sencor)	<5.0	<5.0	<5.0	80	None
Paraquat	<1.0	<1.0	<1.0	None	None
Picloram	<5.0	<5.0	<5.0	None	None
<b>Pesticides</b>					
Atrazine	<0.50	<0.50	<0.50	5	None
Carbaryl	<5.0	<5.0	<5.0	None	None
Carbofuran	<5.0	<5.0	<5.0	None	None
Chlorpyrifos (Dursban)	<1.0	<1.0	<1.0	90	None
Diazinon	<1.0	<1.0	<1.0	None	None
Dimethoate	<2.5	<2.5	<2.5	20	None
Guthion (Azinphos-methyl)	<2.0	<2.0	<2.0	None	None
Malathion	<5.0	<5.0	<5.0	290	None
Metolachlor	<0.50	<0.50	<0.50	None	None
Omethoate <sup>1</sup>	<0.50	<0.50	<0.50	20	None
Phorate (Thimet)	<0.50	<0.50	<0.50	None	None
Simazine	<1.0	<1.0	<1.0	None	None
Terbufos	<0.50	<0.50	<0.50	None	None
Trifluralin	<1.0	<1.0	<1.0	None	None
<b>Other Organic Compounds</b>					
<b>Phenolics</b>					
Monochlorophenol <sup>2</sup>	<0.090	<0.090	<0.090	None <sup>3</sup>	0.1 <sup>3</sup>
2,4-dichlorophenol	<0.25	<0.25	<0.25	900 <sup>3</sup>	None <sup>3</sup>
2,4,6-trichlorophenol	<0.50	<0.50	<0.50	5	≤2
2,3,4,6-tetrachlorophenol	<0.50	<0.50	<0.50	100 <sup>3</sup>	1 <sup>3</sup>
Pentachlorophenol	<0.50	<0.50	<0.50	60	≤30

MAC = Maximum Acceptable Concentration; AO = Aesthetic Objective (values from Health Canada, unless otherwise indicated).

<sup>1</sup>Sampled on November 24, 2025.

<sup>2</sup>Sampled on October 21, 2025.

<sup>3</sup>Source *Drinking Water Quality Guidelines*, BC Ministry of Environment & Climate Change Strategy (2020).

**Analysis of Source Waters for Herbicides, Pesticides, and other Organic Compounds, *Continued***

Analyte	Capilano (µg/L) June 25	Seymour (µg/L) June 25	Coquitlam (µg/L) June 25	MAC (µg/L)	AO (µg/L)
<b>Volatile Organics</b>					
1,1-dichloroethene	<0.50	<0.50	<0.50	None	None
1,2-dichlorobenzene	<0.50	<0.50	<0.50	None	None
1,2-dichloroethane	<0.50	<0.50	<0.50	5	None
1,4-dichlorobenzene	<0.50	<0.50	<0.50	5	≤1
Benzene	<0.40	<0.40	<0.40	5	None
Carbon tetrachloride	<0.50	<0.50	<0.50	2	None
Chlorobenzene	<0.50	<0.50	<0.50	None	None
Dibromomethane	<0.90	<0.90	<0.90	None	None
Dichloromethane	<2.0	<2.0	<2.0	50	None
Ethylbenzene	<0.40	<0.40	<0.40	140	1.6
Methyl-tert-butyl ether	<4.0	<4.0	<4.0	None	≤15
Tetrachloroethene	<0.50	<0.50	<0.50	10	None
Toluene	<0.40	<0.40	<0.40	60	24
Trichloroethene	<0.50	<0.50	<0.50	5	None
Vinyl chloride	<0.50	<0.50	<0.50	2 (ALARA)	None
m & p-Xylene	<0.40	<0.40	<0.40	None	None
o-Xylene	<0.40	<0.40	<0.40	None	None
Xylenes (Total)	<0.40	<0.40	<0.40	90	20
<b>Low Volatility Organics</b>					
Diisopropanolamine (mg/L) <sup>1</sup>	<0.030	<0.030	<0.030	3.5 <sup>2</sup>	None
Sulfolane (µg/L) <sup>1</sup>	<1.0	<1.0	<1.0	90 <sup>2</sup>	None

MAC = Maximum Acceptable Concentration; AO = Aesthetic Objective (values from Health Canada, unless otherwise indicated).

<sup>1</sup>Sampled on October 21, 2025.

<sup>2</sup>Source *Drinking Water Quality Guidelines*, BC Ministry of Environment & Climate Change Strategy (2020).

### Analysis of Select GVWD Water Mains for BTEX

Analyte	Maple Ridge Main		Barnston Island Main at Willoughby Pump Station		Jericho Clayton Main		South Burnaby Main No. 2		MAC (µg/L)	AO (µg/L)
	(µg/L)		(µg/L)		(µg/L)		(µg/L)			
	April 7	Nov 24	April 8	Nov 25	April 8	Nov 25	April 10	Nov 26		
Benzene	<0.5	<0.5	0.5	<0.5	<0.5	<0.5	<0.5	<0.5	5	None
Ethyl Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	140	1.6
Toluene	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	60	24
m & p-Xylene	<1	<1	<1	<1	<1	<1	<1	<1	None	None
o-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	None	None
Total Xylenes	<1.1	<1.1	<1.1	<1.1	<1.1	<1.1	<1.1	<1.1	90	20
Total BTEX	<1.4	<1.4	0.5	<1.4	<1.4	<1.4	<1.4	<1.4	None	None

MAC = Maximum Acceptable Concentration; AO = Aesthetic Objective (values from Health Canada).

### Analysis of Source Water for Polycyclic Aromatic Hydrocarbons (PAHs)<sup>1</sup>

Analyte	Capilano (µg/L)			Seymour (µg/L)			Coquitlam (µg/L)		
	April 8	June 25	Nov 24	April 10	June 25	Nov 24	April 8	June 25	Nov 24
1-Methylnaphthalene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
2-Methylnaphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Acenaphthene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acenaphthylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acridine	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Anthracene	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benzo[a]anthracene <sup>2</sup>	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benzo[a]pyrene <sup>2</sup>	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050
Benzo[b+j]fluoranthene <sup>2</sup>	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030
Benzo[g,h,i]perylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Benzo[k]fluoranthene <sup>2</sup>	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Chrysene <sup>2</sup>	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Dibenz[a,h]anthracene <sup>2</sup>	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030
Fluoranthene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Fluorene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Indeno[1,2,3-cd]pyrene <sup>2</sup>	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Naphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Phenanthrene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Pyrene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Quinoline	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Total PAHs	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10

<sup>1</sup>Source Drinking Water Quality Guidelines, BC Ministry of Environment & Climate Change Strategy (2020).

<sup>2</sup>Representing total carcinogenic polycyclic aromatic hydrocarbons (PAH) as B[a]P total potency.

**Analysis of Select GVWD Mains for Polycyclic Aromatic Hydrocarbons (PAHs)**

Analyte	Coquitlam Main No. 2		Westburnco Reservoir		Barnston Island Main		Annacis Main No. 4		Whalley - Kennedy Link Main		Haney Main No. 2		36 Ave. Main	
	( $\mu\text{g/L}$ )		( $\mu\text{g/L}$ )		( $\mu\text{g/L}$ )		( $\mu\text{g/L}$ )		( $\mu\text{g/L}$ )		( $\mu\text{g/L}$ )		( $\mu\text{g/L}$ )	
	Apr 09	Nov 26	April 08	Nov 26	April 08	Nov 25	Apr 09	Nov 25	Apr 09	Nov 25	April 08	Nov 24	Apr 09	Nov 24
1-Methylnaphthalene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
2-Methylnaphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Acenaphthene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acenaphthylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acridine	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Anthracene	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benz[a]anthracene	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benzo[a]pyrene <sup>1</sup>	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050
Benzo[b+j]fluoranthene	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030
Benzo[g,h,i]perylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Benzo[k]fluoranthene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Chrysene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Dibenz[a,h]anthracene	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030
Fluoranthene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Fluorene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Indeno[1,2,3-c,d]pyrene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Naphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Phenanthrene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Pyrene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Quinoline	<0.020	<0.020	0.027	0.052	<0.020	0.022	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	0.13
Total PAHs	<0.10	<0.10	0.027	0.052	<0.10	0.022	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	0.13

<sup>1</sup>Benzo[a]pyrene is the only PAH compound that has a GCDWQ limit. Maximum Acceptable Concentration of Benzo[a]pyrene is 0.04  $\mu\text{g/L}$ .

### Analysis of Source Water for Radionuclides (June 25, 2025)

Analyte	Capilano (Bq/L)	Seymour (Bq/L)	Coquitlam (Bq/L)	MAC (Bq/L)
Gross Alpha	<0.10	<0.10	<0.10	0.5 <sup>1</sup>
Gross Beta	<0.10	<0.10	<0.10	1 <sup>1</sup>
Cesium-134	<1	<1	<1	None
Cesium-137	<1	<1	<1	None
Iodine-131	<1	<1	<1	None
Lead-210	<0.10	<0.10	<0.10	2
Manganese-54	<1	<1	<1	None
Radium-226	<0.010	<0.010	<0.010	5
Radon-222	<10	<10	<10	None
Strontium-90	<0.10	<0.10	<0.10	None
Tritium	<20	<20	<20	None
Zinc-65	<1	<1	<1	None

<sup>1</sup>Health Canada recommends that drinking water samples should initially be screened against a gross alpha radiation level of 0.5 Bq/L (becquerel/litre) and a gross beta level of 1 Bq/L. Individual radionuclide analysis is only necessary when one (or both) of these are exceeded.

### Analysis of Source<sup>1</sup> and Treated Water<sup>2</sup> for Per- and Polyfluoroalkyl substances (PFAS)

Analyte	Units	Capilano				Seymour				Coquitlam			
		Untreated		Treated		Untreated		Treated		Untreated		Treated	
		June 25	Oct 21	June 25	Oct 21	June 25	Oct 21	June 25	Oct 21	June 25	Oct 21	June 25	Oct 21
11CL-PF3OUds	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
4:2 FTS	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
6:2 FTS	ng/L	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	<1
8:2 FTS	ng/L	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	<1
9CI-PF3ONS	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
ADONA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
HFPO-DA	ng/L	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	1	<4.0	<1	<4.0	<1
NFDHA	ng/L	<4.0	<1	<4.0	<1	<4.0	<1	<4.0	2	<4.0	<1	<4.0	<1
PFBA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	3	<2.0	<1	<2.0	<1
PFBS	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFDA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFDoA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFEESA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFHpA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFHpS	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFHxA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFHxS	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFMBA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	2	<2.0	<1	<2.0	<1
PFMPA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	2	<2.0	<1	<2.0	<1
PFNA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFOA <sup>1</sup>	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFOS <sup>1</sup>	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFPeA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	2	<2.0	<1	<2.0	<1
PFPeS	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
PFUnA	ng/L	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1	<2.0	<1
Total sum of 25 specific PFAS compounds	ng/L	N/A <sup>4</sup>	N/A <sup>4</sup>	Zero <sup>3</sup>	Zero <sup>3</sup>	N/A <sup>4</sup>	N/A <sup>4</sup>	Zero <sup>3</sup>	10	N/A <sup>4</sup>	N/A <sup>4</sup>	Zero <sup>3</sup>	Zero <sup>3</sup>

Note: Detection limits are different, depending on sampling date, as analyses were conducted by different laboratories.

<sup>1</sup>For PFOA and PFOS, untreated values are compared against the *Source Drinking Water Quality Guidelines*, BC Ministry of Environment & Climate Change Strategy (2020) of 200 ng and 600 ng, respectively.

<sup>2</sup>To reduce exposure from drinking water, Health Canada established a drinking water objective of 30 ng/L, which is considered the sum of the concentrations of the 25 specific PFAS listed.

<sup>3</sup>When calculating the sum of PFAS for Health Canada's drinking water objective (2024), a result of "non-detect" is considered to have a value of "zero". It is also recommended that PFAS concentrations in drinking water be maintained as low as reasonably achievable (ALARA).

<sup>4</sup>Not applicable (N/A) because drinking water objective only applies to treated water.

*This page intentionally left blank.*

## **Appendix D — Metro Vancouver Detection of Waterborne *Cryptosporidium* and *Giardia* Annual Report January – December 2025**

*This page intentionally left blank.*

*This page intentionally left blank.*

Appendix D

Monitoring Results from Coquitlam Sample Stations

Sample Type	Sample Name	Description	Sampled Date	Total Coliform	Turbidity	Ecoli	Chlorine Free	Temperature	Total Coliform2	HPC	Ecoli3
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-03 09:20	-	0.14	-	0.5	7.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-08 11:08	-	0.12	-	0.51	7.7	<1	2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-09 11:57	-	0.14	-	0.58	7.1	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-10 11:39	-	0.16	-	0.45	7.3	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-15 12:15	-	0.19	-	0.51	6.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-16 08:20	-	0.11	-	0.41	7.6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-20 12:23	-	0.12	-	0.49	6.3	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-22 12:18	-	0.11	-	0.65	5.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-30 12:35	-	0.15	-	0.67	5.1	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-01-31 11:22	-	0.11	-	0.51	5.3	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-02-20 11:37	-	0.15	-	0.58	4.6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-02-21 08:11	-	0.15	-	0.46	5.9	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-02-23 10:53	-	0.13	-	0.61	5.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-02-25 07:35	-	0.13	-	0.17	6.1	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-02-26 11:38	-	0.14	-	0.52	6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-03-05 09:44	-	0.14	-	0.49	7.3	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-03-06 11:53	-	0.15	-	0.45	7.3	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-03-07 11:42	-	0.17	-	0.51	7.4	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-03-12 12:01	-	0.13	-	0.61	7.2	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-03-20 08:41	-	0.18	-	0.57	7.3	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-03-27 12:23	-	0.14	-	0.41	8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-03-29 12:41	-	0.13	-	0.51	8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-03 08:26	-	0.13	-	0.59	8.6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-10 10:09	-	0.23	-	0.49	8.4	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-11 11:07	-	0.15	-	0.51	9.6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-14 12:02	-	0.11	-	0.42	9.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-24 07:29	-	0.18	-	0.42	10.2	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-26 10:39	-	0.12	-	0.57	8.8	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-27 08:59	-	0.11	-	0.41	11.4	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-04-29 10:51	-	0.14	-	0.55	12.2	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-05-06 12:13	-	0.22	-	0.5	11.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-05-08 08:19	-	0.14	-	0.22	14	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-05-13 08:19	-	0.27	-	0.58	11.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-05-21 07:38	-	0.22	-	0.28	13.7	<1	190	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-05-26 11:36	-	0.17	-	0.39	13	<1	420	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-06 11:50	-	0.31	-	0.63	14.5	<1	26	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-12 10:18	-	0.2	-	0.52	15.4	<1	6	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-17 07:16	-	0.12	-	0.26	16.1	<1	16	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-20 12:03	-	0.16	-	0.36	17.9	<1	54	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-21 09:32	-	0.13	-	0.45	16	<1	20	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-26 07:05	-	0.29	-	0.2	16.5	<1	48	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-27 07:22	-	0.15	-	0.48	15.5	<1	40	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-30 11:28	-	0.22	-	0.98	15.7	<1	8	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-06-30 12:04	-	0.33	-	0.68	14	<1	6	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-09 12:08	-	0.11	-	0.37	17.3	<1	50	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-11 17:37	-	0.13	-	0.33	17.7	<1	100	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-18 10:46	-	0.12	-	0.3	15.7	<1	72	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-23 12:39	-	0.35	-	0.37	18	<1	38	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-24 08:21	-	0.23	-	0.52	15.5	<1	28	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-25 08:05	-	0.22	-	0.4	18	<1	38	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-25 10:12	-	0.21	-	0.39	18.8	<1	42	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-07-26 07:51	-	0.17	-	0.37	17.5	<1	66	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-05 10:09	-	0.14	-	0.15	18.7	<1	520	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-14 11:42	-	0.11	-	0.17	18.7	<1	140	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-16 08:03	-	0.11	-	0.17	19.9	<1	530	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-18 13:27	-	0.1	-	0.31	19	<1	40	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-20 07:34	-	0.12	-	0.38	19.4	<1	34	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-21 10:05	-	0.08	-	0.33	19.4	<1	LA	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-22 09:13	-	0.1	-	0.28	19	<1	48	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-26 07:30	-	0.1	-	0.29	18.5	<1	54	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-27 07:23	-	0.1	-	0.37	18.2	<1	44	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-08-29 09:00	-	0.09	-	0.34	19.5	<1	24	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-09-04 07:22	-	0.14	-	0.3	19.2	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-09-09 07:23	-	0.1	-	0.24	19.3	<1	16	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-09-18 07:31	-	0.09	-	0.27	19	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-09-25 11:23	-	0.17	-	0.21	18.2	<1	<1	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-09-27 07:54	-	0.11	-	0.24	18.7	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-09-29 07:13	-	0.09	-	0.24	18.4	<1	16	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-07 07:57	-	0.11	-	0.34	19	<1	8	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-14 11:35	-	0.12	-	0.44	13.7	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-16 12:08	-	0.14	-	0.38	15.4	<1	6	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-18 11:32	-	0.13	-	0.5	14.8	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-21 12:28	-	0.22	-	0.22	14	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-22 11:25	-	0.14	-	0.54	15	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-24 07:25	-	0.16	-	0.41	14.1	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-25 12:41	-	0.09	-	1	13.6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-28 12:19	-	0.13	-	0.43	13.6	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-10-31 12:01	-	0.13	-	0.4	13.1	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-04 07:38	-	0.16	-	0.42	12.6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-06 10:35	-	0.17	-	0.59	12.5	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-12 10:09	-	0.11	-	0.37	11.9	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-12 12:07	-	0.11	-	0.41	11.7	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-15 11:37	-	0.08	-	0.45	11.9	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-18 11:43	-	0.12	-	0.49	12	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-19 11:54	-	0.12	-	0.29	11.3	<1	4	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-25 09:07	-	0.16	-	0.49	11	<1	2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-11-28 09:48	-	0.17	-	0.38	10.3	<1	LA	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-12-03 10:28	-	0.15	-	0.43	9.9	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-12-05 12:15	-	0.12	-	0.14	10.1	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-12-10 10:45	-	0.18	-	0.42	9.3	<1	2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-12-11 07:42	-	0.12	-	0.17	8.7	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-12-11 12:50	-	0.26	-	0.57	9.6	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-12-19 07:45	-	0.13	-	0.5	9.2	<1	<2	<1
GRAB	COQ-531	Riverview Park (Clearwater @ Paul Lake Cr)	2025-12-24 07:40	-	0.1	-	0.37	8.7	<1	NA	<1
GRAB	COQ-532	Mallard Court	2025-01-02 08:29	-	0.24	-	0.21	7.5	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-01-07 08:24	-	0.23	-	0.17	8	<1	<2	<1

GRAB	COQ-532	Mallard Court	2025-01-10 08:01	-	0.22	-	0.17	7.8	<1	4	<1
GRAB	COQ-532	Mallard Court	2025-01-14 07:54	-	0.19	-	0.16	7.8	<1	2	<1
GRAB	COQ-532	Mallard Court	2025-01-21 08:10	-	0.24	-	0.16	6.6	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-01-23 11:32	-	0.17	-	0.14	6.2	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-01-29 08:11	-	0.17	-	0.17	5.9	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-02-19 08:34	-	0.22	-	0.24	5.8	<1	2	<1
GRAB	COQ-532	Mallard Court	2025-02-21 07:51	-	0.16	-	0.19	5.9	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-02-26 07:51	-	0.23	-	0.21	5.7	<1	4	<1
GRAB	COQ-532	Mallard Court	2025-02-27 08:12	-	0.5	-	0.14	6.4	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-03-04 08:15	-	0.27	-	0.13	7.3	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-03-11 08:43	-	0.23	-	0.23	7.5	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-03-21 08:41	-	0.3	-	0.07	7.3	<1	18	<1
GRAB	COQ-532	Mallard Court	2025-03-26 08:12	-	0.26	-	0.21	7.8	<1	18	<1
GRAB	COQ-532	Mallard Court	2025-04-01 08:09	-	0.29	-	0.16	8.1	<1	24	<1
GRAB	COQ-532	Mallard Court	2025-04-08 08:16	-	0.21	-	0.15	8.9	<1	6	<1
GRAB	COQ-532	Mallard Court	2025-04-15 08:00	-	0.21	-	0.13	10	<1	4	<1
GRAB	COQ-532	Mallard Court	2025-04-17 08:10	-	0.18	-	0.16	10.8	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-04-24 09:13	-	0.2	-	0.05	12.4	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-04-29 08:27	-	0.17	-	0.13	9.4	<1	4	<1
GRAB	COQ-532	Mallard Court	2025-05-06 08:21	-	0.19	-	0.12	13.8	<1	10	<1
GRAB	COQ-532	Mallard Court	2025-05-15 09:14	-	0.2	-	0.23	14.3	<1	4	<1
GRAB	COQ-532	Mallard Court	2025-05-23 10:51	-	0.25	-	0.15	13.6	<1	12	<1
GRAB	COQ-532	Mallard Court	2025-05-30 12:53	-	0.22	-	0.17	14.4	<1	2	<1
GRAB	COQ-532	Mallard Court	2025-06-03 11:40	-	0.27	-	0.2	15.5	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-06-18 07:51	-	0.16	-	0.13	17.8	<1	28	<1
GRAB	COQ-532	Mallard Court	2025-06-19 10:32	-	0.17	-	0.17	16.9	<1	12	<1
GRAB	COQ-532	Mallard Court	2025-06-25 08:27	-	0.16	-	0.14	17.3	<1	26	<1
GRAB	COQ-532	Mallard Court	2025-07-08 11:08	-	0.19	-	0.13	18.2	<1	34	<1
GRAB	COQ-532	Mallard Court	2025-07-16 10:41	-	0.16	-	0.13	19.3	<1	2	<1
GRAB	COQ-532	Mallard Court	2025-07-22 10:00	-	0.15	-	0.13	20.1	<1	20	<1
GRAB	COQ-532	Mallard Court	2025-07-29 08:36	-	0.15	-	0.13	20.4	<1	6	<1
GRAB	COQ-532	Mallard Court	2025-08-11 11:48	-	0.15	-	0.11	20.5	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-08-19 09:41	-	0.16	-	0.11	20.5	<1	1A	<1
GRAB	COQ-532	Mallard Court	2025-08-21 08:00	-	0.21	-	0.05	19.8	<1	1A	<1
GRAB	COQ-532	Mallard Court	2025-08-26 10:50	-	0.18	-	0.13	20.4	<1	8	<1
GRAB	COQ-532	Mallard Court	2025-08-28 08:08	-	0.2	-	0.12	20.4	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-08-29 09:04	-	0.22	-	0.28	20.4	<1	2	<1
GRAB	COQ-532	Mallard Court	2025-09-03 10:34	-	0.17	-	0.13	20.7	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-09-10 11:39	-	0.2	-	0.11	20.9	<1	2	<1
GRAB	COQ-532	Mallard Court	2025-09-14 09:11	-	0.16	-	0.14	20.7	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-09-21 09:28	-	0.2	-	0.09	19.7	<1	<2	<1
GRAB	COQ-532	Mallard Court	2025-10-06 07:57	-	0.21	-	0.12	18	<1	58	<1
GRAB	COQ-532	Mallard Court	2025-10-14 08:17	-	0.28	-	0.13	16.9	<1	240	<1
GRAB	COQ-532	Mallard Court	2025-10-20 08:29	-	0.2	-	0.14	15.2	<1	46	<1
GRAB	COQ-532	Mallard Court	2025-10-24 09:38	-	0.21	-	0.13	14.5	<1	180	<1
GRAB	COQ-532	Mallard Court	2025-10-27 08:29	-	0.21	-	0.15	14.2	<1	84	<1
GRAB	COQ-532	Mallard Court	2025-10-30 10:41	-	0.23	-	0.14	13.7	<1	300	<1
GRAB	COQ-532	Mallard Court	2025-11-03 08:37	-	0.22	-	0.13	13.2	<1	280	<1
GRAB	COQ-532	Mallard Court	2025-11-14 09:06	-	0.2	-	0.03	12.7	<1	450	<1
GRAB	COQ-532	Mallard Court	2025-11-19 09:12	-	0.21	-	0.04	12	<1	90	<1
GRAB	COQ-532	Mallard Court	2025-11-24 08:10	-	0.19	-	0.18	11.1	<1	310	<1
GRAB	COQ-532	Mallard Court	2025-12-01 07:51	-	0.21	-	0.16	10.7	<1	140	<1
GRAB	COQ-532	Mallard Court	2025-12-08 08:11	-	0.21	-	0.14	9.3	<1	160	<1
GRAB	COQ-532	Mallard Court	2025-12-10 08:31	-	0.26	-	0.14	9	<1	NA	<1
GRAB	COQ-532	Mallard Court	2025-12-15 08:03	-	0.19	-	0.13	9.2	<1	380	<1
GRAB	COQ-532	Mallard Court	2025-12-22 07:59	-	0.19	-	0.14	9	<1	NA	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-01-07 07:51	-	0.16	-	0.49	6.8	<1	2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-01-16 10:17	-	0.18	-	0.72	6.5	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-01-21 08:25	-	0.19	-	0.58	5.9	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-02-18 09:12	-	0.11	-	0.61	3.6	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-02-23 08:02	-	0.22	-	0.71	4.6	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-02-26 09:28	-	0.18	-	0.63	4.8	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-03-03 09:12	-	0.13	-	0.74	5.6	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-03-12 09:45	-	0.18	-	0.65	6	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-03-17 08:46	-	0.14	-	0.66	6.3	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-03-26 09:22	-	0.16	-	0.6	6.3	<1	8	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-04-03 06:53	-	0.11	-	0.72	7.3	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-04-09 07:35	-	0.15	-	0.44	7.9	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-04-10 06:44	-	0.09	-	0.68	8.2	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-04-16 08:25	-	0.12	-	0.64	8	<1	12	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-04-23 09:28	-	0.14	-	0.55	9.3	<1	4	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-04-30 09:26	-	0.14	-	0.55	10.2	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-05-01 09:37	-	0.15	-	0.68	10.3	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-05-07 09:33	-	0.15	-	0.63	10.5	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-05-14 10:11	-	0.13	-	0.66	11.6	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-05-21 09:05	-	0.17	-	0.64	11.2	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-05-23 13:05	-	0.14	-	0.77	11.4	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-05-28 09:12	-	0.15	-	0.63	11.8	<1	6	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-06-03 07:45	-	0.16	-	0.51	12.7	<1	24	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-06-10 08:48	-	0.17	-	0.53	13	<1	50	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-06-18 09:12	-	0.13	-	0.42	13.7	<1	140	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-06-25 09:08	-	0.17	-	0.44	13.4	<1	60	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-07-04 07:13	-	0.14	-	0.46	14.2	<1	14	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-07-09 08:52	-	0.11	-	0.45	14.5	<1	60	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-07-18 08:34	-	0.12	-	0.43	16	<1	54	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-07-24 07:01	-	0.18	-	0.78	16.1	<1	110	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-08-07 09:22	-	0.1	-	0.42	17.3	<1	130	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-08-14 14:11	-	0.18	-	0.48	17.1	<1	50	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-08-16 10:19	-	0.1	-	0.63	17.9	<1	24	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-08-20 07:00	-	0.12	-	0.67	16.9	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-08-27 07:53	-	0.12	-	0.65	17.1	<1	34	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-08-28 13:31	-	0.11	-	0.58	17.5	<1	32	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-09-07 12:17	-	0.17	-	0.65	18.1	<1	44	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-09-14 11:44	-	0.11	-	0.74	18.2	<1	28	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-09-19 08:12	-	0.16	-	0.41	18.3	<1	22	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-09-29 12:34	-	0.09	-	0.47	17.6	<1	70	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-08 07:36	-	0.09	-	0.49	16	<1	8	<1

GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-10 08:03	-	0.16	-	0.7	15.1	<1	16	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-12 08:07	-	0.1	-	0.52	15	<1	16	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-15 07:33	-	0.16	-	0.56	14.5	<1	12	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-16 07:11	-	0.21	-	0.62	14.5	<1	2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-19 08:55	-	0.09	-	0.59	13.9	<1	8	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-21 07:43	-	0.22	-	0.82	13.4	<1	8	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-22 07:31	-	0.18	-	0.62	13.2	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-29 09:33	-	0.11	-	0.6	11.8	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-10-30 08:30	-	0.15	-	0.75	11.4	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-11-02 09:12	-	0.11	-	1.08	11.3	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-11-07 09:15	-	0.1	-	0.18	10.8	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-11-09 11:17	-	0.09	-	0.21	10.5	<1	4	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-11-19 08:03	-	0.12	-	0.6	10	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-11-28 08:21	-	0.12	-	0.57	9	<1	4	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-12-02 07:08	-	0.11	-	0.82	8.7	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-12-06 08:23	-	0.11	-	0.65	8	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-12-09 09:28	-	0.13	-	0.5	8.2	<1	16	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-12-11 08:55	-	0.1	-	0.91	8.3	<1	<2	<1
GRAB	COQ-533	Roy Stibbs School - 600 Fairview	2025-12-17 09:11	-	0.12	-	0.52	8.3	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-01-07 07:39	-	0.17	-	0.51	6.5	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-01-10 12:27	-	0.37	-	0.57	6.3	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-01-16 09:57	-	0.15	-	0.66	6.1	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-01-17 12:36	-	0.16	-	0.61	6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-01-21 08:17	-	0.12	-	0.55	5.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-01-31 12:06	-	0.14	-	0.6	4.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-02-03 08:58	-	0.17	-	0.76	3.5	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-02-14 12:38	-	0.16	-	0.56	3.4	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-02-18 08:58	-	0.17	-	0.64	3.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-02-23 08:15	-	0.12	-	0.76	4.6	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-02-26 09:21	-	0.19	-	0.72	4.5	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-03 08:57	-	0.17	-	0.68	5.3	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-05 08:41	-	0.22	-	0.47	5.1	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-09 09:34	-	0.25	-	0.75	5.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-14 12:28	-	0.13	-	0.58	5.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-17 08:30	-	0.14	-	0.81	5.8	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-21 12:31	-	0.16	-	0.55	5.4	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-26 09:12	-	0.11	-	0.63	5.9	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-27 07:20	-	0.1	-	0.75	6.4	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-28 11:02	-	0.13	-	0.6	6.2	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-03-29 06:45	-	0.13	-	0.68	6.8	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-09 09:08	-	0.16	-	0.68	7.3	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-10 06:35	-	0.12	-	0.74	7.7	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-11 12:05	-	0.13	-	0.59	7.3	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-16 08:17	-	0.16	-	0.59	7.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-17 10:43	-	0.19	-	0.56	7.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-23 09:19	-	0.22	-	0.57	8.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-12 12:15	-	0.13	-	0.73	8.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-26 11:47	-	0.21	-	0.65	8.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-04-30 09:16	-	0.11	-	0.61	9.4	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-01 09:27	-	0.24	-	0.67	9.1	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-05 13:27	-	0.13	-	0.67	10.2	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-07 09:23	-	0.14	-	0.59	9.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-09 11:43	-	0.14	-	0.67	10.4	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-14 09:58	-	0.19	-	0.57	10.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-16 12:31	-	0.14	-	0.63	10.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-21 08:42	-	0.14	-	0.67	10.8	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-23 12:37	-	0.25	-	0.8	10.8	<1	6	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-05-28 09:03	-	0.19	-	0.57	11.1	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-06-03 07:51	-	0.11	-	0.48	11.8	<1	38	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-06-10 08:37	-	0.17	-	0.61	12.1	<1	4	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-06-19 09:00	-	0.12	-	0.49	12.8	<1	6	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-06-20 09:28	-	0.26	-	0.6	12.8	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-06-25 08:56	-	0.2	-	0.54	13	<1	14	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-06-27 09:51	-	0.19	-	0.49	12.7	<1	12	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-07-03 13:44	-	0.13	-	0.33	13.7	<1	32	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-07-09 08:39	-	0.14	-	0.62	13.8	<1	8	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-07-11 12:07	-	0.15	-	0.62	13.7	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-07-18 08:24	-	0.27	-	0.73	14.9	<1	6	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-07-24 06:51	-	0.13	-	0.62	18.3	<1	10	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-07-25 12:12	-	0.18	-	0.44	15.1	<1	16	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-07-31 09:35	-	0.19	-	0.5	15.4	<1	12	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-07 09:03	-	0.13	-	0.62	16.2	<1	10	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-14 13:54	-	0.13	-	0.67	16.6	<1	54	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-16 10:06	-	0.09	-	0.65	16.7	<1	28	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-20 06:48	-	0.08	-	0.61	16.4	<1	38	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-23 12:09	-	0.12	-	0.57	16.4	<1	6	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-27 07:36	-	0.13	-	0.6	17	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-28 13:18	-	0.13	-	0.37	16.8	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-08-29 12:00	-	0.12	-	0.39	16.7	<1	36	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-09-03 12:46	-	0.11	-	0.57	17.2	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-09-05 12:50	-	0.08	-	0.48	17.1	<1	24	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-09-12 08:26	-	0.16	-	0.61	17.2	<1	80	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-09-18 09:23	-	0.09	-	0.5	17.5	<1	6	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-09-29 12:20	-	0.21	-	0.53	17.3	<1	14	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-09-30 11:31	-	0.11	-	0.61	17.2	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-08 07:25	-	0.11	-	0.61	15	<1	10	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-09 13:47	-	0.85	-	0.64	14.7	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-10 07:52	-	0.17	-	0.59	14.8	<1	20	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-15 07:51	-	0.15	-	0.63	14.2	<1	34	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-16 06:57	-	0.33	-	0.57	14.3	<1	7	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-19 08:39	-	0.1	-	0.81	13.5	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-21 07:33	-	0.19	-	0.83	13	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-22 07:22	-	0.13	-	0.64	12.9	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-23 12:17	-	0.12	-	0.62	12.8	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-29 09:19	-	0.17	-	0.69	11.3	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-10-30 08:17	-	0.18	-	0.55	11	<1	4	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-02 08:57	-	0.11	-	0.77	11	<1	<2	<1

GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-07 08:05	-	0.09	-	0.2	10.4	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-07 12:23	-	0.13	-	0.61	10.1	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-09 11:29	-	0.1	-	1.02	10.2	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-14 11:14	-	0.12	-	0.54	9.9	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-17 12:23	-	0.14	-	0.57	9.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-19 08:12	-	0.09	-	0.65	9.8	<1	2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-28 08:11	-	0.12	-	0.88	8.8	<1	16	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-12-02 06:56	-	0.11	-	0.84	8.6	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-12-06 08:12	-	0.09	-	0.76	7.8	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-09 09:18	-	0.12	-	0.15	8	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-13 08:41	-	0.08	-	0.78	8.2	<1	<2	<1
GRAB	COQ-534	Coquitlam College (Brookmere @ Whiting)	2025-11-17 09:00	-	0.09	-	0.52	8	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-01-07 08:03	-	0.79	-	0.32	8.7	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-01-16 10:30	-	0.13	-	0.46	8.6	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-01-18 07:11	-	0.09	-	0.38	5.4	<1	4	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-01-21 08:36	-	0.1	-	0.26	8	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-02-10 13:27	-	0.18	-	0.47	5.8	<1	4	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-02-13 09:25	-	0.18	-	0.47	5.8	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-02-20 12:44	-	0.14	-	0.54	6	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-02-21 11:55	-	0.12	-	0.53	5.2	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-02-23 08:56	-	0.13	-	0.48	6.6	<1	16	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-02-25 10:55	-	0.18	-	0.47	6.3	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-02-26 09:40	-	0.2	-	0.44	6.8	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-03-03 09:25	-	0.17	-	0.51	7.2	<1	4	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-03-07 11:42	-	0.16	-	0.44	7.4	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-03-10 09:59	-	0.12	-	0.61	7.5	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-03-13 07:03	-	0.21	-	0.52	7.6	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-03-17 09:04	-	0.14	-	0.51	7.9	<1	12	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-03-26 09:36	-	0.13	-	0.42	7.8	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-03-27 07:45	-	0.35	-	0.5	8.3	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-04-03 07:05	-	0.13	-	0.55	8.7	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-04-09 07:48	-	0.12	-	0.23	9	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-04-10 06:59	-	0.12	-	0.32	8.2	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-04-16 08:36	-	0.11	-	0.36	9.3	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-04-23 09:43	-	0.17	-	0.31	10.3	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-04-26 11:03	-	0.14	-	0.42	8.6	<1	12	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-04-30 09:38	-	0.14	-	0.27	10.7	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-05-01 09:50	-	0.28	-	0.36	11	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-05-07 09:54	-	0.27	-	0.22	11.2	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-05-14 10:24	-	0.22	-	0.16	11.5	<1	10	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-05-21 09:17	-	0.18	-	0.21	12	<1	44	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-05-23 13:17	-	0.18	-	0.21	12.2	<1	880	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-05-28 09:24	-	0.14	-	0.27	12.6	<1	430	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-06-03 08:06	-	0.21	-	0.26	13.2	<1	160	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-06-10 09:00	-	0.21	-	0.25	13.5	1	12	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-06-18 09:25	-	0.13	-	0.21	14.5	<1	12	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-06-20 09:43	-	0.14	-	0.14	14.5	<1	30	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-06-25 09:22	-	0.14	-	0.29	14.5	<1	8	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-07-04 07:33	-	1.1	-	0.25	14.5	<1	110	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-07-09 09:06	-	0.11	-	0.2	15.3	<1	120	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-07-12 12:01	-	0.17	-	0.28	13.5	<1	36	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-07-18 08:48	-	0.11	-	0.11	16	<1	64	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-07-24 07:15	-	0.18	-	0.09	16.4	<1	180	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-07-31 09:49	-	2	-	0.07	15.8	<1	130	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-08-07 09:41	-	0.14	-	0.05	17.7	<1	840	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-08-14 12:41	-	0.13	-	0.27	18	<1	18	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-08-16 07:37	-	0.08	-	0.21	18.3	<1	6	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-08-17 07:11	-	0.1	-	0.13	18	<1	16	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-08-20 07:32	-	0.08	-	0.33	18	<1	8	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-08-27 07:20	-	0.12	-	0.33	17.7	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-09-03 11:40	-	0.09	-	0.09	18.2	<1	18	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-08-31 07:17	-	0.08	-	0.34	18	<1	10	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-09-03 13:06	-	0.09	-	0.26	18.4	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-09-07 12:35	-	0.18	-	0.29	18.5	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-09-12 09:02	-	0.1	-	0.16	17.8	<1	4	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-09-19 08:40	-	0.1	-	0.29	17.9	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-09-29 12:51	-	0.11	-	0.25	18.1	<1	4	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-09-30 11:01	-	0.09	-	0.24	18.2	<1	6	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-08 07:55	-	0.11	-	0.17	17	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-10 08:21	-	0.18	-	0.53	16.7	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-12 08:30	-	0.12	-	0.35	15.7	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-15 08:06	-	0.14	-	0.33	16	<1	4	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-16 07:26	-	0.1	-	0.39	15.9	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-19 09:18	-	0.11	-	0.28	15.1	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-21 07:56	-	0.23	-	0.48	15.1	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-27 07:54	-	0.18	-	0.18	15.1	<1	15.1	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-29 09:51	-	0.18	-	0.33	14	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-10-30 08:43	-	0.09	-	0.39	13.9	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-11-02 09:28	-	0.12	-	0.47	13.5	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-11-07 08:31	-	0.08	-	0.2	13	<1	6	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-11-09 10:46	-	0.11	-	0.27	13.2	<1	4	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-11-14 11:34	-	0.18	-	0.26	12.3	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-11-19 08:37	-	0.13	-	0.13	12.1	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-11-28 08:34	-	0.13	-	0.35	11.1	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-12-02 07:25	-	0.16	-	0.37	11	<1	10	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-12-05 12:30	-	0.13	-	0.35	10.4	<1	<2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-12-06 08:34	-	0.09	-	0.34	10.2	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-12-09 09:43	-	0.15	-	0.71	10.5	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-12-11 09:08	-	0.13	-	0.6	10.4	<1	2	<1
GRAB	COQ-535	Lord Baden Powell School - 540 Joyce	2025-12-17 09:24	-	0.1	-	0.1	10.2	<1	2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-01-07 10:22	-	0.14	-	0.49	7.7	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-01-16 11:10	-	0.11	-	0.61	7.4	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-01-21 09:21	-	0.1	-	0.47	6.8	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-02-01 08:26	-	0.09	-	0.61	6.2	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-02-13 10:13	-	0.12	-	0.43	4.8	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-02-18 10:22	-	0.22	-	0.52	4.9	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-02-20 12:22	-	0.2	-	0.62	5.9	<1	18	<1

GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-02-21 11:20	-	0.13	-	0.54	5.9	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-02-23 09:55	-	0.13	-	0.66	5.5	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-02-26 10:31	-	0.17	-	0.55	5.9	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-03-03 10:22	-	0.17	-	0.66	6.1	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-03-12 11:00	-	0.21	-	0.53	6.8	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-03-13 10:25	-	0.16	-	0.65	6.8	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-03-17 10:40	-	0.13	-	0.7	6.9	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-03-26 10:35	-	0.11	-	0.57	7.4	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-04-03 09:13	-	0.14	-	0.67	7.5	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-04-04 13:15	-	0.14	-	0.46	7.7	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-04-09 09:59	-	0.14	-	0.14	8.4	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-04-10 08:19	-	0.14	-	0.6	8.1	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-04-16 09:50	-	0.12	-	0.59	8.7	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-04-23 10:44	-	0.25	-	0.54	9.1	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-04-30 10:41	-	0.12	-	0.56	10.3	<1	2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-05-01 11:28	-	0.19	-	0.43	9.5	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-05-07 11:26	-	0.23	-	0.32	8.2	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-05-14 11:54	-	0.26	-	0.35	10.3	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-05-21 10:17	-	0.16	-	0.58	10.9	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-05-28 10:14	-	0.22	-	0.36	12	<1	310	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-06-02 11:53	-	0.2	-	0.38	12.3	<1	120	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-06-10 09:56	-	0.22	-	0.4	12.9	<1	8	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-06-18 10:39	-	0.18	-	0.3	13.6	<1	96	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-06-25 10:20	-	0.33	-	0.41	13.5	<1	12	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-07-04 08:00	-	0.3	-	0.43	12.9	<1	730	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-07-09 09:59	-	0.16	-	0.55	14.3	<1	52	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-07-18 09:48	-	0.65	-	0.26	15.4	<1	160	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-07-24 09:31	-	0.33	-	0.62	14.5	<1	340	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-08-07 10:54	-	0.14	-	0.25	16.5	<1	1000	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-08-14 11:12	-	0.15	-	0.51	16.3	<1	1700	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-08-17 08:24	-	0.11	-	0.39	17	<1	56	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-08-20 09:07	-	0.11	-	0.59	16.8	<1	26	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-08-29 09:20	-	0.13	-	0.49	16.3	<1	2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-08-31 08:35	-	0.14	-	0.38	16.9	<1	8	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-09-06 09:42	-	0.21	-	0.41	17.4	<1	2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-09-12 10:07	-	0.11	-	0.45	17.2	<1	8	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-09-19 09:36	-	0.98	-	0.38	18	<1	18	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-09-25 12:53	-	0.13	-	0.23	18.1	<1	4	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-09-29 07:57	-	0.1	-	0.44	17.7	<1	2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-08 10:16	-	0.11	-	0.49	15.3	<1	2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-12 09:47	-	0.1	-	0.54	15	<1	4	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-15 11:45	-	0.17	-	0.62	14.7	<1	8	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-16 09:35	-	0.22	-	0.52	14.3	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-19 11:04	-	0.12	-	0.62	14.1	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-21 09:47	-	0.22	-	0.72	13.9	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-21 12:02	-	0.22	-	0.37	13.8	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-21 11:25	-	0.2	-	0.63	12.7	<1	2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-10-30 10:38	-	0.13	-	0.57	12	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-11-02 10:33	-	0.12	-	0.66	11.7	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-11-07 10:32	-	0.1	-	0.27	11.3	<1	<2	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-11-09 09:19	-	0.1	-	0.47	11	<1	4	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-11-14 12:42	-	0.12	-	0.49	10.9	<1	10	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-11-19 09:37	-	0.1	-	0.47	10.2	<1	10	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-11-28 10:36	-	0.13	-	0.5	9.5	<1	6	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-12-02 08:56	-	0.11	-	0.6	9.3	<1	6	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-12-06 10:25	-	0.08	-	0.68	8.6	<1	6	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-12-09 11:08	-	0.23	-	0.45	8.9	<1	4	<1
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-12-11 10:28	-	0.1	-	0.64	8.7	CG	500	CG
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-12-12 11:33	<1	0.12	<1	0.54	8.8	-	<2	-
GRAB	COQ-536	Cape Horn School - 155 Finnigan	2025-12-17 10:11	-	0.18	-	1.23	8.8	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-03 12:08	-	0.15	-	0.61	8	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-08 11:40	-	0.12	-	0.53	7.4	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-09 12:29	-	0.15	-	0.53	7.2	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-10 11:00	-	0.13	-	0.49	7.3	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-15 12:51	-	0.12	-	0.53	7	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-16 09:20	-	0.12	-	0.61	7.2	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-22 12:53	-	0.16	-	0.52	6.2	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-01-30 13:00	-	0.22	-	0.68	5.5	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-02-20 12:06	-	0.22	-	0.6	4.7	<1	57	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-02-21 10:23	-	0.13	-	0.57	5.4	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-02-23 09:46	-	0.12	-	0.65	5.5	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-02-25 07:46	-	0.13	-	0.65	5.8	<1	14	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-02-26 12:15	-	0.13	-	0.58	5.3	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-05 10:10	-	0.14	-	0.64	6.8	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-06 12:28	-	0.13	-	0.63	6.8	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-07 07:55	-	0.16	-	0.67	7	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-12 12:46	-	0.15	-	0.65	6.8	<1	8	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-19 13:05	-	0.14	-	0.69	7.1	<1	6	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-20 09:07	-	0.13	-	0.58	7	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-27 08:38	-	0.12	-	0.57	7.6	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-03-28 07:15	-	0.11	-	0.61	7.8	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-03 08:58	-	0.13	-	0.45	8	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-03 12:04	-	0.11	-	0.64	8.4	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-10 11:33	-	0.12	-	0.72	9	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-14 12:32	-	0.14	-	0.5	9	<1	38	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-24 07:49	-	0.21	-	0.58	10.2	<1	6	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-26 10:12	-	0.15	-	0.64	8.8	<1	6	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-27 09:31	-	0.11	-	0.62	10.5	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-04-29 11:15	-	0.11	-	0.47	9.1	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-05-04 11:44	-	0.12	-	0.53	11.4	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-05-09 11:54	-	0.1	-	0.52	12.3	<1	4	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-05-14 11:24	-	0.22	-	0.62	11.7	<1	4	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-05-21 08:03	-	0.13	-	0.44	12.5	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-05-26 12:30	-	0.17	-	0.6	13.3	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-06-12 10:44	-	0.19	-	0.47	15.5	<1	12	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-06-19 09:53	-	0.25	-	0.3	15.6	<1	34	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-06-21 08:39	-	0.14	-	0.44	15.8	<1	10	<1

GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-06-26 07:13	-	0.22	-	0.45	14.4	<1	20	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-06-27 07:35	-	0.16	-	0.35	15.6	<1	36	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-07-04 08:27	-	0.12	-	0.37	16.8	<1	180	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-07-11 07:38	-	0.12	-	0.37	16.8	<1	220	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-07-17 12:12	-	0.18	-	0.21	17.3	<1	34	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-07-18 11:06	-	0.13	-	0.44	17.7	<1	34	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-07-24 07:55	-	0.17	-	0.37	15.9	<1	300	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-07-26 07:30	-	0.42	-	0.37	17.3	<1	240	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-08-14 12:10	-	0.12	-	0.2	18.7	<1	410	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-08-20 07:55	-	0.11	-	0.39	17.7	<1	24	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-09-11 08:28	-	0.08	-	0.08	18.2	<1	18.2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-08-11 11:27	-	0.11	-	0.35	18	<1	1A	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-08-26 07:46	-	0.09	-	0.37	18.2	<1	6	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-08-27 07:34	-	0.12	-	1.42	18.4	<1	8	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-08-28 10:58	-	0.1	-	0.35	18.7	<1	8	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-09-04 07:48	-	0.11	-	0.52	18.7	<1	12	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-09-09 08:12	-	0.13	-	0.23	18.9	<1	22	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-09-18 07:46	-	0.11	-	0.34	18.4	<1	22	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-09-25 11:51	-	0.14	-	0.19	18.4	<1	18	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-09-29 07:21	-	0.09	-	0.38	17.9	<1	10	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-09 07:38	-	0.15	-	0.52	16.7	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-14 11:18	-	0.1	-	0.35	15.7	<1	16	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-17 10:12	-	0.11	-	0.49	15.2	<1	14	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-18 11:12	-	0.09	-	0.43	15	<1	8	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-21 12:11	-	0.11	-	0.56	14.5	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-22 11:01	-	0.15	-	0.52	14.4	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-24 07:04	-	0.1	-	0.55	14.5	<1	28	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-25 12:23	-	0.09	-	0.27	13.9	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-28 11:51	-	0.1	-	0.49	13.5	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-30 11:49	-	0.14	-	0.57	13	<1	6	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-10-31 11:16	-	0.14	-	0.3	12.3	<1	10	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-11-04 07:59	-	0.12	-	0.48	12.6	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-11-07 11:55	-	0.13	-	0.58	12.2	<1	2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-11-15 11:21	-	0.1	-	0.48	11.8	<1	10	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-11-18 11:27	-	0.12	-	0.43	12	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-11-21 12:05	-	0.09	-	0.59	11	<1	4	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-11-26 10:44	-	0.13	-	0.6	10.7	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-12-03 10:53	-	0.1	-	0.42	9.6	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-12-10 08:38	-	0.13	-	0.49	9.3	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-12-13 11:31	-	0.15	-	0.65	9.5	<1	<2	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-12-19 07:04	-	0.09	-	0.29	9.1	<1	4	<1
GRAB	COQ-537	R.C. MacDonald School - 2550 Leduc	2025-12-24 07:57	-	0.11	-	0.45	8.7	<1	NA	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-01-08 08:05	-	0.16	-	0.61	6.6	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-01-09 08:39	-	0.16	-	0.6	6.3	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-01-15 08:34	-	0.16	-	0.89	6.3	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-01-22 08:41	-	0.11	-	0.82	5.3	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-01-30 08:15	-	0.17	-	0.66	4.7	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-02-11 08:14	-	0.17	-	0.62	3.8	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-02-20 08:17	-	0.16	-	0.7	3.9	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-02-23 11:10	-	0.16	-	0.69	4.7	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-02-26 08:16	-	0.12	-	0.64	4.8	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-03-06 08:13	-	0.15	-	0.67	5.8	<1	2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-03-07 07:38	-	0.18	-	0.56	6	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-03-15 08:15	-	0.15	-	0.7	6.1	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-03-17 12:23	-	0.17	-	0.52	7.4	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-03-26 07:31	-	0.37	-	0.47	8.6	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-04-04 08:13	-	0.14	-	0.69	7.8	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-04-10 11:20	-	0.1	-	0.58	8.4	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-04-14 13:23	-	0.16	-	0.64	8.4	<1	6	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-04-25 07:11	-	0.14	-	0.62	10.1	<1	4	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-05-01 08:04	-	0.12	-	0.6	11	<1	6	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-05-03 08:11	-	0.14	-	0.73	11.3	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-05-06 07:24	-	0.13	-	0.53	11.3	<1	6	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-05-14 07:28	-	0.28	-	0.47	11.7	<1	40	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-05-21 11:10	-	0.21	-	0.43	12	<1	14	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-05-26 08:27	-	0.18	-	0.52	12.4	<1	18	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-06-04 08:25	-	0.24	-	0.68	13.2	<1	10	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-06-16 09:41	-	0.16	-	0.7	14.4	<1	48	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-06-19 10:26	-	0.24	-	0.38	14.4	<1	8	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-06-21 10:29	-	0.41	-	0.48	14.6	<1	60	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-06-25 07:24	-	0.19	-	0.57	14.1	<1	34	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-06-27 08:18	-	0.1	-	0.34	14.5	<1	50	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-07-03 07:11	-	0.09	-	0.53	14.5	<1	22	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-07-09 07:21	-	0.13	-	0.58	14	<1	50	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-07-17 08:15	-	0.15	-	0.59	15.6	<1	28	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-07-23 12:34	-	0.2	-	0.35	16.2	<1	16.2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-07-24 08:38	-	0.2	-	0.5	16	<1	90	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-07-30 10:06	-	0.19	-	0.32	16.5	<1	480	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-08-14 08:13	-	0.13	-	0.5	16.7	<1	88	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-08-18 12:22	-	0.12	-	0.34	16	<1	24	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-08-20 08:56	-	0.09	-	0.52	17.2	<1	26	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-08-26 13:15	-	0.14	-	0.14	17.8	<1	20	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-09-27 07:57	-	0.14	-	0.56	17.4	<1	17.4	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-09-05 08:06	-	0.1	-	0.51	18.3	<1	46	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-09-09 06:50	-	0.11	-	0.54	18.6	<1	24	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-09-18 08:38	-	0.1	-	0.47	18.4	<1	32	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-09-25 08:19	-	0.12	-	0.28	18	<1	28	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-10-07 07:40	-	0.13	-	0.57	16.5	<1	30	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-10-14 07:23	-	0.11	-	0.63	15.3	<1	8	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-10-18 07:46	-	0.11	-	0.11	13.8	<1	6	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-10-20 07:25	-	0.13	-	0.94	14.1	<1	86	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-10-28 07:29	-	0.11	-	0.65	13.1	<1	6	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-11-04 07:00	-	0.14	-	0.62	12.1	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-11-08 10:54	-	0.1	-	0.3	11.8	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-11-15 10:57	-	0.08	-	0.51	11.4	<1	2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-11-18 07:48	-	0.13	-	0.53	11.2	<1	8	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-11-25 07:04	-	0.1	-	0.49	10.4	<1	6	<1

GRAB	COQ-538	Baker Drive School - 885 Baker	2025-12-03 08:02	-	0.11	-	0.57	9.3	<1	2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-12-10 08:28	-	0.15	-	0.56	8.9	<1	140	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-12-13 07:48	-	0.09	-	0.64	8.9	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-01-15 11:38	-	0.12	-	0.63	8.9	<1	<2	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-02-24 12:36	-	0.13	-	0.49	8.1	<1	NA	<1
GRAB	COQ-538	Baker Drive School - 885 Baker	2025-12-31 12:07	-	0.2	-	0.76	7.7	<1	NA	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-01-08 10:43	-	0.32	-	0.29	8.4	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-01-09 11:39	-	0.17	-	0.81	7.6	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-01-15 11:53	-	0.22	-	0.64	7.3	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-01-22 11:49	-	0.21	-	0.77	6.3	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-01-30 12:13	-	0.28	-	0.76	5.3	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-02-20 11:18	-	0.27	-	0.74	5	<1	62	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-02-21 10:11	-	0.39	-	0.52	6.2	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-02-26 11:20	-	0.54	-	0.37	7	<1	2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-03-05 11:01	-	0.31	-	0.64	6.9	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-03-06 11:31	-	0.39	-	0.37	7.8	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-03-12 11:34	-	0.43	-	0.67	7.7	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-03-20 07:59	-	0.35	-	0.25	8.2	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-03-21 10:43	-	0.43	-	0.48	7.4	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-03-26 08:56	-	0.34	-	0.38	7.8	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-04-04 08:55	-	0.28	-	0.3	8.3	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-04-11 08:23	-	0.27	-	0.29	8.2	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-04-14 08:54	-	0.3	-	0.31	10.2	<1	8	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-04-25 11:24	-	0.23	-	0.68	8.8	<1	4	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-04-29 12:16	-	0.27	-	0.56	11.9	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-05-03 07:23	-	0.26	-	0.22	11.4	<1	8	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-05-06 08:09	-	0.31	-	0.53	12.3	<1	8	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-05-13 09:33	-	0.24	-	0.37	13.4	<1	2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-05-15 10:09	-	0.26	-	0.77	11.1	<1	2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-05-21 11:56	-	0.38	-	0.56	11.5	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-05-26 10:48	-	0.34	-	0.16	14	<1	40	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-06-08 12:46	-	0.34	-	0.66	12	<1	2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-06-10 12:23	-	0.35	-	0.33	14.9	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-06-25 07:46	-	0.24	-	0.19	15	<1	16	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-07-09 13:03	-	0.2	-	0.52	15.7	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-07-17 11:17	-	0.2	-	0.69	15.4	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-07-24 09:22	-	0.18	-	0.2	18	<1	12	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-08-14 11:22	-	0.2	-	0.55	16.5	<1	8	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-08-20 09:30	-	0.28	-	0.16	19.3	<1	46	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-08-27 08:25	-	0.22	-	0.22	17.9	<1	14	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-08-29 09:50	-	0.33	-	0.58	17	<1	14	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-09-05 08:54	-	0.2	-	0.17	20.1	<1	4	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-09-09 10:47	-	0.24	-	0.68	18.7	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-09-18 09:16	-	0.26	-	0.3	18.8	<1	6	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-09-25 11:08	-	0.3	-	0.38	17.8	<1	6	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-09-26 07:48	-	0.24	-	0.21	19	<1	12	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-10-09 08:15	-	0.25	-	0.16	17.5	<1	170	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-10-14 07:23	-	0.32	-	0	17.2	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-10-18 08:54	-	0.18	-	0.16	16.1	<1	10	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-10-22 08:48	-	0.34	-	0.18	15.4	<1	14	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-10-28 09:01	-	0.27	-	0.43	14.3	<1	6	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-11-04 10:32	-	0.29	-	0.29	11.8	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-11-08 12:27	-	0.19	-	0.07	12.9	<1	4	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-11-12 09:50	-	0.29	-	0.46	11.3	<1	6	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-11-15 09:22	-	0.2	-	0.09	12.5	<1	6	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-11-18 09:07	-	0.22	-	0.27	11.6	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-11-25 08:30	-	0.29	-	0.12	11.7	<1	4	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-12-03 10:13	-	0.27	-	0.2	10.4	<1	2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-12-10 10:33	-	0.45	-	0.43	9.5	<1	6	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-12-13 07:59	-	0.28	-	0.1	10.1	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-12-16 12:41	-	0.23	-	0.23	9.4	<1	<2	<1
GRAB	COQ-539	Lansdowne & Aberdeen	2025-12-31 12:39	-	0.26	-	0.22	8.8	<1	NA	<1
GRAB	COQ-541	966 Fresno	2025-01-08 07:47	-	0.16	-	0.36	7.7	<1	4	<1
GRAB	COQ-541	966 Fresno	2025-01-09 08:20	-	0.15	-	0.11	7.3	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-01-15 08:15	-	0.19	-	0.61	6.9	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-01-16 11:43	-	0.13	-	0.39	7.3	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-01-24 10:43	-	0.11	-	0.34	5.6	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-01-30 07:57	-	0.28	-	0.36	4.7	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-02-12 13:21	-	0.15	-	0.58	3.7	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-02-18 13:41	-	0.14	-	0.44	3.6	<1	2	<1
GRAB	COQ-541	966 Fresno	2025-02-20 08:01	-	0.16	-	0.49	3.6	<1	370	<1
GRAB	COQ-541	966 Fresno	2025-02-21 07:52	-	0.18	-	0.41	4	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-02-23 11:48	-	0.12	-	0.47	4.9	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-02-25 07:15	-	0.15	-	0.5	5.3	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-02-26 07:59	-	0.13	-	0.49	5.3	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-03-06 07:57	-	0.15	-	0.46	7	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-03-07 07:23	-	0.12	-	0.47	7.1	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-03-11 07:05	-	0.11	-	0.55	7.1	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-03-12 07:56	-	0.14	-	0.55	7	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-03-17 11:41	-	0.19	-	0.4	7.3	<1	2	<1
GRAB	COQ-541	966 Fresno	2025-03-19 13:26	-	0.15	-	0.45	8	<1	2	<1
GRAB	COQ-541	966 Fresno	2025-03-26 07:18	-	0.11	-	0.22	8.5	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-03-28 12:20	-	0.12	-	0.38	7.9	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-04-04 07:46	-	0.11	-	0.63	7.7	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-04-10 11:04	-	0.11	-	0.32	9.6	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-04-11 07:57	-	0.1	-	0.46	9.2	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-04-11 11:48	-	0.11	-	0.48	9.9	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-04-14 13:36	-	0.18	-	0.29	10.1	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-04-24 07:12	-	0.17	-	0.5	11.8	<1	10	<1
GRAB	COQ-541	966 Fresno	2025-04-25 06:49	-	0.12	-	0.12	12.1	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-04-30 09:58	-	0.11	-	0.42	12.7	<1	16	<1
GRAB	COQ-541	966 Fresno	2025-05-01 07:36	-	0.13	-	0.47	12.7	<1	20	<1
GRAB	COQ-541	966 Fresno	2025-05-03 08:55	-	0.19	-	0.4	12.9	<1	14	<1
GRAB	COQ-541	966 Fresno	2025-05-06 07:13	-	0.29	-	0.34	13.4	<1	20	<1
GRAB	COQ-541	966 Fresno	2025-05-13 08:01	-	0.12	-	0.25	14.5	<1	20	<1
GRAB	COQ-541	966 Fresno	2025-05-14 07:18	-	0.2	-	0.42	14.4	<1	22	<1
GRAB	COQ-541	966 Fresno	2025-05-21 07:20	-	0.15	-	0.31	13.7	<1	54	<1

GRAB	COQ-541	966 Fresno	2025-05-26 08:10	-	0.13	-	0.58	14.7	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-06-16 09:30	-	0.16	-	0.27	18.2	<1	100	<1
GRAB	COQ-541	966 Fresno	2025-06-19 12:42	-	0.12	-	0.70	18.4	<1	54	<1
GRAB	COQ-541	966 Fresno	2025-06-21 12:36	-	0.15	-	0.11	18.4	<1	50	<1
GRAB	COQ-541	966 Fresno	2025-06-25 07:15	-	0.34	-	0.25	17.3	<1	54	<1
GRAB	COQ-541	966 Fresno	2025-06-27 07:09	-	0.15	-	0.25	17.3	<1	180	<1
GRAB	COQ-541	966 Fresno	2025-07-03 07:02	-	0.15	-	0.23	18	<1	130	<1
GRAB	COQ-541	966 Fresno	2025-07-09 07:09	-	0.2	-	0.21	19.1	<1	310	<1
GRAB	COQ-541	966 Fresno	2025-07-17 07:59	-	0.14	-	0.2	20.3	<1	76	<1
GRAB	COQ-541	966 Fresno	2025-07-18 12:56	-	0.11	-	0.21	21.4	<1	94	<1
GRAB	COQ-541	966 Fresno	2025-07-24 07:32	-	0.16	-	0.28	21.8	<1	300	<1
GRAB	COQ-541	966 Fresno	2025-07-25 07:44	-	0.18	-	0.17	20.4	<1	150	<1
GRAB	COQ-541	966 Fresno	2025-07-30 09:51	-	0.18	-	0.03	21.2	<1	500	<1
GRAB	COQ-541	966 Fresno	2025-08-14 07:52	-	0.13	-	0.08	21.8	<1	590	<1
GRAB	COQ-541	966 Fresno	2025-08-18 12:09	-	0.1	-	0.15	20.3	<1	46	<1
GRAB	COQ-541	966 Fresno	2025-08-20 07:16	-	0.1	-	0.3	20.5	<1	48	<1
GRAB	COQ-541	966 Fresno	2025-08-21 12:15	-	0.13	-	0.25	20.6	<1	LA	<1
GRAB	COQ-541	966 Fresno	2025-09-26 07:14	-	0.11	-	0.38	21.3	<1	44	<1
GRAB	COQ-541	966 Fresno	2025-08-27 07:05	-	0.12	-	0.15	21.5	<1	94	<1
GRAB	COQ-541	966 Fresno	2025-09-04 07:07	-	0.1	-	0.23	21.5	<1	38	<1
GRAB	COQ-541	966 Fresno	2025-09-09 07:05	-	0.11	-	0.14	21	<1	100	<1
GRAB	COQ-541	966 Fresno	2025-09-18 07:18	-	0.11	-	0.17	20.1	<1	110	<1
GRAB	COQ-541	966 Fresno	2025-09-25 08:03	-	0.19	-	0.13	19.4	<1	190	<1
GRAB	COQ-541	966 Fresno	2025-09-26 07:18	-	0.17	-	0.19	19.1	<1	280	<1
GRAB	COQ-541	966 Fresno	2025-09-27 06:47	-	0.11	-	0.23	19.9	<1	270	<1
GRAB	COQ-541	966 Fresno	2025-09-29 06:59	-	0.11	-	0.19	19.1	<1	140	<1
GRAB	COQ-541	966 Fresno	2025-10-07 07:26	-	0.11	-	0.11	17.1	<1	440	<1
GRAB	COQ-541	966 Fresno	2025-10-14 07:03	-	0.12	-	0.49	16	<1	130	<1
GRAB	COQ-541	966 Fresno	2025-10-17 11:39	-	0.09	-	0.29	15.1	<1	40	<1
GRAB	COQ-541	966 Fresno	2025-10-18 07:06	-	0.14	-	0.37	15	<1	120	<1
GRAB	COQ-541	966 Fresno	2025-10-22 07:12	-	0.18	-	0.55	14.5	<1	98	<1
GRAB	COQ-541	966 Fresno	2025-10-28 07:14	-	0.13	-	0.65	13.6	<1	20	<1
GRAB	COQ-541	966 Fresno	2025-11-04 07:21	-	0.13	-	0.21	12.5	<1	12	<1
GRAB	COQ-541	966 Fresno	2025-11-08 10:40	-	0.09	-	0.31	12.1	<1	20	<1
GRAB	COQ-541	966 Fresno	2025-11-12 07:49	-	0.1	-	0.21	11.9	<1	12	<1
GRAB	COQ-541	966 Fresno	2025-11-15 07:54	-	0.09	-	0.23	11.9	<1	32	<1
GRAB	COQ-541	966 Fresno	2025-11-18 07:34	-	0.11	-	0.23	11.9	<1	6	<1
GRAB	COQ-541	966 Fresno	2025-11-19 13:27	-	0.18	-	0.21	11.5	<1	6	<1
GRAB	COQ-541	966 Fresno	2025-11-25 07:27	-	0.17	-	0.37	11.1	<1	10	<1
GRAB	COQ-541	966 Fresno	2025-12-03 07:47	-	0.14	-	0.26	9.4	<1	12	<1
GRAB	COQ-541	966 Fresno	2025-12-04 12:56	-	0.14	-	0.36	9.3	<1	8	<1
GRAB	COQ-541	966 Fresno	2025-12-10 08:06	-	0.21	-	0.28	9.2	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-12-11 07:23	-	0.14	-	0.23	9.1	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-12-13 07:35	-	0.09	-	0.36	9.1	<1	2	<1
GRAB	COQ-541	966 Fresno	2025-12-15 12:19	-	0.15	-	0.35	10.6	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-12-16 11:34	-	0.18	-	0.32	9.3	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-12-17 08:00	-	0.11	-	0.4	8.8	<1	<2	<1
GRAB	COQ-541	966 Fresno	2025-12-24 07:24	-	0.12	-	0.39	8.4	<1	NA	<1
GRAB	COQ-542	590 Orkeny	2025-01-03 11:54	-	0.17	-	0.54	8.3	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-01-08 11:25	-	0.15	-	0.35	7.8	<1	4	<1
GRAB	COQ-542	590 Orkeny	2025-01-09 12:16	-	0.22	-	0.41	7.5	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-01-10 10:48	-	0.15	-	0.41	7.8	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-01-15 12:36	-	0.16	-	0.37	7.3	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-01-16 08:54	-	0.15	-	0.44	7.6	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-01-22 12:37	-	0.16	-	0.59	6	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-01-30 12:51	-	0.19	-	0.42	5.8	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-02-05 12:26	-	0.31	-	0.54	5.1	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-02-10 11:21	-	0.18	-	0.38	4.8	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-02-11 11:45	-	0.19	-	0.55	4.7	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-02-20 11:52	-	0.17	-	0.59	5.1	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-02-21 10:31	-	0.18	-	0.68	5.4	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-02-23 09:35	-	0.17	-	0.4	5.9	<1	8	<1
GRAB	COQ-542	590 Orkeny	2025-02-25 07:57	-	0.23	-	0.35	6.5	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-02-26 12:06	-	0.16	-	0.52	5.9	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-03-05 10:24	-	0.18	-	0.46	7.7	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-03-06 12:06	-	0.18	-	0.54	7.5	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-03-07 08:13	-	0.21	-	0.53	8	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-03-12 12:24	-	0.18	-	0.52	5.8	<1	4	<1
GRAB	COQ-542	590 Orkeny	2025-03-19 13:12	-	0.23	-	0.37	7.8	<1	10	<1
GRAB	COQ-542	590 Orkeny	2025-03-20 08:56	-	0.17	-	0.47	7.6	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-03-27 08:28	-	0.15	-	0.52	8.3	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-03-28 07:07	-	0.15	-	0.55	8.6	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-04-03 08:46	-	0.19	-	0.58	9	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-04-05 12:14	-	0.18	-	0.3	9.8	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-04-10 12:21	-	0.21	-	0.4	9.9	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-04-14 12:43	-	0.15	-	0.49	10.4	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-04-24 07:55	-	0.22	-	0.37	12	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-04-27 09:15	-	0.13	-	0.44	12.5	<1	8	<1
GRAB	COQ-542	590 Orkeny	2025-04-29 11:26	-	0.16	-	0.32	12.9	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-05-04 11:56	-	0.14	-	0.43	12.6	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-05-09 12:03	-	0.13	-	0.37	12.2	<1	8	<1
GRAB	COQ-542	590 Orkeny	2025-05-14 11:34	-	0.2	-	0.54	14.8	<1	12	<1
GRAB	COQ-542	590 Orkeny	2025-05-21 08:09	-	0.14	-	0.45	13.9	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-05-26 12:40	-	0.31	-	0.41	14.2	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-06-12 11:51	-	0.18	-	0.24	18.2	<1	10	<1
GRAB	COQ-542	590 Orkeny	2025-06-19 10:05	-	0.14	-	0.16	17.4	<1	34	<1
GRAB	COQ-542	590 Orkeny	2025-06-21 09:08	-	0.15	-	0.22	16.5	<1	16	<1
GRAB	COQ-542	590 Orkeny	2025-06-26 07:19	-	0.17	-	0.45	15.9	<1	14	<1
GRAB	COQ-542	590 Orkeny	2025-06-27 07:42	-	0.14	-	0.39	15.8	<1	190	<1
GRAB	COQ-542	590 Orkeny	2025-07-04 08:35	-	0.14	-	0.14	14.9	<1	330	<1
GRAB	COQ-542	590 Orkeny	2025-07-11 07:44	-	0.1	-	0.49	17.5	<1	28	<1
GRAB	COQ-542	590 Orkeny	2025-07-17 11:57	-	0.16	-	0.27	18.2	<1	14	<1
GRAB	COQ-542	590 Orkeny	2025-07-18 11:15	-	0.17	-	0.26	18.7	<1	14	<1
GRAB	COQ-542	590 Orkeny	2025-07-24 08:07	-	0.13	-	0.36	18.2	<1	36	<1
GRAB	COQ-542	590 Orkeny	2025-07-26 12:07	-	0.26	-	0.18	19.7	<1	220	<1
GRAB	COQ-542	590 Orkeny	2025-08-08 10:28	-	0.17	-	0.18	19.7	<1	330	<1
GRAB	COQ-542	590 Orkeny	2025-08-14 11:58	-	0.13	-	0.17	19.8	<1	42	<1

GRAB	COQ-542	590 Orkeny	2025-08-20 08:03	-	0.1	-	0.32	19.4	<1	40	<1
GRAB	COQ-542	590 Orkeny	2025-08-21 11:16	-	0.09	-	0.32	19.4	<1	LA	<1
GRAB	COQ-542	590 Orkeny	2025-08-22 08:53	-	0.14	-	0.24	19	<1	16	<1
GRAB	COQ-542	590 Orkeny	2025-08-26 07:52	-	0.1	-	0.39	20.3	<1	20.3	<1
GRAB	COQ-542	590 Orkeny	2025-08-27 07:42	-	0.09	-	0.44	18.2	<1	12	<1
GRAB	COQ-542	590 Orkeny	2025-08-28 10:28	-	0.11	-	0.32	20.7	<1	16	<1
GRAB	COQ-542	590 Orkeny	2025-09-04 07:58	-	0.11	-	0.43	20	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-09-09 08:55	-	0.1	-	0.21	19.3	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-09-18 07:53	-	0.1	-	0.33	18.8	<1	30	<1
GRAB	COQ-542	590 Orkeny	2025-09-25 11:39	-	0.11	-	0.12	19	<1	12	<1
GRAB	COQ-542	590 Orkeny	2025-09-29 07:29	-	0.1	-	0.39	18.4	<1	12	<1
GRAB	COQ-542	590 Orkeny	2025-10-09 08:00	-	0.12	-	0.34	16.8	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-10-14 11:00	-	0.13	-	0.24	16.3	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-10-17 09:53	-	0.15	-	0.1	14.9	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-10-18 11:00	-	0.14	-	0.21	16	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-10-21 12:03	-	0.2	-	0.31	15.2	<1	4	<1
GRAB	COQ-542	590 Orkeny	2025-10-22 10:51	-	0.2	-	0.39	15	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-10-24 06:48	-	0.15	-	0.41	15.1	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-10-25 12:13	-	0.12	-	0.21	14.5	<1	4	<1
GRAB	COQ-542	590 Orkeny	2025-10-28 11:39	-	0.15	-	0.21	14.2	<1	2	<1
GRAB	COQ-542	590 Orkeny	2025-10-30 11:56	-	0.13	-	0.25	13.4	<1	8	<1
GRAB	COQ-542	590 Orkeny	2025-10-31 11:02	-	0.13	-	0.36	11.2	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-11-04 08:38	-	0.13	-	0.27	11.9	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-11-06 11:50	-	0.13	-	0.22	12.9	<1	6	<1
GRAB	COQ-542	590 Orkeny	2025-11-12 10:31	-	0.1	-	0.24	12.4	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-11-15 11:12	-	0.09	-	0.22	12.5	<1	12	<1
GRAB	COQ-542	590 Orkeny	2025-11-18 11:13	-	0.11	-	0.22	12.4	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-11-21 11:49	-	0.11	-	0.21	12	<1	8	<1
GRAB	COQ-542	590 Orkeny	2025-11-25 11:41	-	0.16	-	0.31	11.3	<1	<2	<1
GRAB	COQ-542	590 Orkeny	2025-12-03 10:42	-	0.13	-	0.24	10.2	<1	4	<1
GRAB	COQ-542	590 Orkeny	2025-12-05 12:08	-	0.12	-	0.3	9.9	<1	8	<1
GRAB	COQ-542	590 Orkeny	2025-12-10 10:58	-	0.16	-	0.27	10	<1	24	<1
GRAB	COQ-542	590 Orkeny	2025-12-13 11:11	-	0.14	-	0.4	9.4	<1	9.4	<1
GRAB	COQ-542	590 Orkeny	2025-12-15 10:37	-	0.13	-	0.4	10.6	<1	16	<1
GRAB	COQ-542	590 Orkeny	2025-12-24 08:04	-	0.12	-	0.3	9.1	<1	NA	<1
GRAB	COQ-543	1150 Howse	2025-01-07 08:16	-	0.14	-	0.37	8.6	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-01-16 10:41	-	0.13	-	0.43	8.4	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-01-21 12:31	-	0.16	-	0.38	8	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-02-01 07:43	-	0.1	-	0.31	6.8	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-02-10 13:18	-	0.2	-	0.72	6	<1	6	<1
GRAB	COQ-543	1150 Howse	2025-02-14 12:21	-	0.18	-	0.66	5.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-02-18 09:39	-	0.15	-	0.53	5.5	<1	LA	<1
GRAB	COQ-543	1150 Howse	2025-02-20 12:54	-	0.15	-	0.59	6.8	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-02-21 11:44	-	0.14	-	0.52	5.3	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-02-23 09:10	-	0.2	-	0.58	6.4	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-02-25 10:43	-	0.42	-	0.66	6.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-02-26 09:53	-	0.15	-	0.21	6.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-02-27 11:57	-	0.18	-	0.4	6.6	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-03-03 09:36	-	0.15	-	0.62	7.1	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-03-07 10:37	-	0.2	-	0.58	7.3	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-03-12 10:10	-	0.17	-	0.51	7.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-03-13 07:40	-	0.15	-	0.59	7.9	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-03-14 12:08	-	0.18	-	0.5	7	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-03-17 09:20	-	0.14	-	0.8	7.8	<1	7.8	<1
GRAB	COQ-543	1150 Howse	2025-03-21 12:00	-	0.15	-	0.53	7.6	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-03-25 12:19	-	0.14	-	0.39	7.9	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-03-27 07:57	-	0.11	-	0.62	8.2	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-03 08:31	-	0.19	-	0.56	8.7	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-04 12:18	-	0.12	-	0.43	8.6	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-05 11:31	-	0.13	-	0.61	8.7	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-09 09:27	-	0.18	-	0.51	9	<1	9	<1
GRAB	COQ-543	1150 Howse	2025-04-10 07:58	-	0.13	-	0.51	9.4	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-11 11:50	-	0.15	-	0.47	9.2	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-16 08:54	-	0.12	-	0.58	9.4	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-17 11:04	-	0.13	-	0.44	9	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-23 09:57	-	0.23	-	0.44	10.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-25 11:56	-	0.17	-	0.48	10.7	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-04-26 09:42	-	0.13	-	0.5	8.7	<1	LA	<1
GRAB	COQ-543	1150 Howse	2025-04-30 09:50	-	0.14	-	0.41	11.3	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-05-01 10:04	-	0.43	-	0.35	11.1	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-05-07 10:06	-	0.25	-	0.33	11.7	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-05-14 10:42	-	0.28	-	0.35	12.3	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-05-21 09:32	-	0.16	-	0.28	13	<1	34	<1
GRAB	COQ-543	1150 Howse	2025-05-28 09:38	-	0.16	-	0.32	13.6	<1	190	<1
GRAB	COQ-543	1150 Howse	2025-06-02 12:19	-	0.19	-	0.16	17.8	<1	26	<1
GRAB	COQ-543	1150 Howse	2025-06-10 09:10	-	0.22	-	0.28	15	<1	15	<1
GRAB	COQ-543	1150 Howse	2025-06-18 09:38	-	0.12	-	0.27	16.5	<1	16	<1
GRAB	COQ-543	1150 Howse	2025-06-20 10:01	-	0.16	-	0.2	16.4	<1	6	<1
GRAB	COQ-543	1150 Howse	2025-06-21 11:27	-	0.44	-	0.23	16	<1	30	<1
GRAB	COQ-543	1150 Howse	2025-06-25 09:36	-	0.61	-	0.29	16	<1	12	<1
GRAB	COQ-543	1150 Howse	2025-06-27 10:11	-	0.14	-	0.25	16	<1	30	<1
GRAB	COQ-543	1150 Howse	2025-07-03 13:32	-	0.12	-	0.18	17.9	<1	180	<1
GRAB	COQ-543	1150 Howse	2025-07-11 11:49	-	0.14	-	0.14	17.4	<1	17.4	<1
GRAB	COQ-543	1150 Howse	2025-07-18 09:01	-	0.12	-	0.12	18.8	<1	66	<1
GRAB	COQ-543	1150 Howse	2025-07-24 10:26	-	0.2	-	0.2	19.4	<1	110	<1
GRAB	COQ-543	1150 Howse	2025-07-25 11:57	-	0.18	-	0.21	19	<1	260	<1
GRAB	COQ-543	1150 Howse	2025-07-31 10:01	-	0.19	-	0.16	18.7	<1	470	<1
GRAB	COQ-543	1150 Howse	2025-08-07 09:57	-	0.12	-	0.06	20.2	<1	760	<1
GRAB	COQ-543	1150 Howse	2025-08-08 11:40	-	0.16	-	0.09	20	<1	1000	<1
GRAB	COQ-543	1150 Howse	2025-08-13 12:05	-	0.14	-	0.14	21.1	<1	280	<1
GRAB	COQ-543	1150 Howse	2025-08-17 07:25	-	0.12	-	0.23	20.7	<1	8	<1
GRAB	COQ-543	1150 Howse	2025-08-20 08:50	-	0.82	-	0.39	17.5	<1	24	<1
GRAB	COQ-543	1150 Howse	2025-08-27 08:56	-	0.14	-	0.36	19.4	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-08-28 12:22	-	0.12	-	0.26	19.7	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-08-31 07:35	-	0.11	-	0.31	20.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-09-07 12:47	-	0.11	-	0.39	20.5	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-09-12 09:19	-	0.11	-	0.21	20.1	<1	12	<1

GRAB	COQ-543	1150 Howse	2025-09-19 08:50	-	0.1	-	0.29	20.1	<1	6	<1
GRAB	COQ-543	1150 Howse	2025-09-29 13:08	-	0.08	-	0.28	19.1	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-10-08 09:49	-	0.1	-	0.11	17.6	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-10-11 08:46	-	0.12	-	0.33	17.2	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-10-15 11:20	-	0.12	-	0.41	16.7	<1	4	<1
GRAB	COQ-543	1150 Howse	2025-10-16 08:46	-	0.15	-	0.24	16.6	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-10-19 10:28	-	0.11	-	0.28	15.9	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-10-22 10:10	-	0.13	-	0.34	14.3	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-10-30 10:10	-	0.12	-	0.48	14.1	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-11-02 09:42	-	0.12	-	0.55	13.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-11-07 10:06	-	0.12	-	0.11	13.3	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-11-09 10:28	-	0.11	-	0.55	13.2	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-11-12 11:40	-	0.12	-	0.35	12.7	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-11-14 11:47	-	0.1	-	0.3	12.6	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-11-19 08:49	-	0.1	-	0.37	12.1	<1	2	<1
GRAB	COQ-543	1150 Howse	2025-11-28 10:12	-	0.17	-	0.43	11.3	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-12-09 09:26	-	0.1	-	0.42	11	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-12-05 12:18	-	0.13	-	0.51	10.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-12-06 10:04	-	0.09	-	0.43	10.3	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-12-09 09:56	-	0.14	-	0.71	10.5	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-12-11 09:25	-	0.15	-	0.34	10.4	<1	<2	<1
GRAB	COQ-543	1150 Howse	2025-12-17 09:33	-	0.13	-	0.46	10.2	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-01-07 07:26	-	0.17	-	0.47	8.4	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-01-16 09:46	-	0.14	-	0.69	8.1	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-01-18 07:25	-	0.11	-	0.37	7.8	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-01-21 08:05	-	0.16	-	0.16	7.5	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-01 07:00	-	0.14	-	0.55	5.3	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-10 13:38	-	0.15	-	0.38	5.9	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-13 08:44	-	0.15	-	0.59	5.6	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-18 08:44	-	0.19	-	0.43	5.7	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-20 13:09	-	0.15	-	0.51	6.4	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-02-21 12:07	-	0.13	-	0.4	5.7	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-23 08:46	-	0.15	-	0.55	6.5	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-25 11:05	-	0.22	-	0.58	6.3	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-26 09:08	-	0.47	-	0.5	6.5	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-03-03 08:46	-	0.17	-	0.6	7.4	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-03-05 08:25	-	0.15	-	0.42	7.4	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-03-12 09:23	-	0.17	-	0.52	7.5	<1	4	<1
GRAB	COQ-544	721 Pembroke	2025-03-18 07:16	-	0.13	-	0.63	7.7	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-03-17 08:17	-	0.14	-	0.14	7.7	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-03-26 08:59	-	0.14	-	0.43	7.8	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-04-03 07:13	-	0.13	-	0.62	8.9	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-04-09 08:54	-	0.18	-	0.32	9.2	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-04-10 07:09	-	0.13	-	0.53	8.3	<1	LA	<1
GRAB	COQ-544	721 Pembroke	2025-04-16 08:05	-	0.12	-	0.44	9.7	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-04-17 08:58	-	0.13	-	0.5	9.7	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-05-23 09:07	-	0.17	-	0.44	10.1	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-04-26 11:22	-	0.35	-	0.5	8.7	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-04-30 09:05	-	0.15	-	0.42	10.7	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-05-01 09:15	-	0.12	-	0.52	10.9	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-05-07 09:13	-	0.17	-	0.54	11.7	<1	12	<1
GRAB	COQ-544	721 Pembroke	2025-05-14 09:38	-	0.15	-	0.57	11.9	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-05-21 08:28	-	0.12	-	0.49	12.3	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-05-23 13:41	-	0.17	-	0.64	12.9	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-05-28 08:41	-	0.19	-	0.45	12.7	<1	10	<1
GRAB	COQ-544	721 Pembroke	2025-06-03 07:59	-	0.21	-	0.34	11.9	<1	4	<1
GRAB	COQ-544	721 Pembroke	2025-06-10 08:24	-	0.2	-	0.36	14.5	<1	12	<1
GRAB	COQ-544	721 Pembroke	2025-06-18 08:44	-	0.15	-	0.39	15	<1	26	<1
GRAB	COQ-544	721 Pembroke	2025-06-20 11:20	-	0.18	-	0.41	14.9	<1	24	<1
GRAB	COQ-544	721 Pembroke	2025-06-25 08:45	-	0.19	-	0.31	14.8	<1	46	<1
GRAB	COQ-544	721 Pembroke	2025-06-27 09:41	-	0.16	-	0.34	15	<1	15	<1
GRAB	COQ-544	721 Pembroke	2025-07-04 07:24	-	0.2	-	0.26	16.1	<1	36	<1
GRAB	COQ-544	721 Pembroke	2025-07-09 08:24	-	0.12	-	0.33	16	<1	18	<1
GRAB	COQ-544	721 Pembroke	2025-07-18 08:09	-	0.14	-	0.21	17	<1	100	<1
GRAB	COQ-544	721 Pembroke	2025-07-24 07:37	-	0.13	-	0.48	14.3	<1	76	<1
GRAB	COQ-544	721 Pembroke	2025-07-31 09:20	-	0.18	-	0.35	17.5	<1	72	<1
GRAB	COQ-544	721 Pembroke	2025-08-07 08:50	-	0.1	-	0.25	18.3	<1	80	<1
GRAB	COQ-544	721 Pembroke	2025-08-14 12:17	-	0.19	-	0.45	18.7	<1	40	<1
GRAB	COQ-544	721 Pembroke	2025-08-14 13:36	-	0.11	-	0.25	18.6	<1	32	<1
GRAB	COQ-544	721 Pembroke	2025-08-20 07:46	-	0.11	-	0.24	18.1	<1	24	<1
GRAB	COQ-544	721 Pembroke	2025-08-27 08:11	-	0.12	-	0.4	18.4	<1	170	<1
GRAB	COQ-544	721 Pembroke	2025-08-28 13:02	-	0.15	-	0.37	18.7	<1	20	<1
GRAB	COQ-544	721 Pembroke	2025-09-03 12:33	-	0.09	-	0.41	19	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-09-05 12:56	-	0.1	-	0.4	19	<1	6	<1
GRAB	COQ-544	721 Pembroke	2025-09-12 08:52	-	0.13	-	0.17	18.8	<1	30	<1
GRAB	COQ-544	721 Pembroke	2025-09-19 08:32	-	0.16	-	0.27	18.1	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-09-29 11:51	-	0.13	-	0.28	18	<1	LA	<1
GRAB	COQ-544	721 Pembroke	2025-09-30 11:15	-	0.11	-	0.27	17.8	<1	30	<1
GRAB	COQ-544	721 Pembroke	2025-10-08 08:13	-	0.15	-	0.39	16.5	<1	20	<1
GRAB	COQ-544	721 Pembroke	2025-10-09 13:34	-	0.15	-	0.35	16.8	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-10-10 08:35	-	0.13	-	0.59	16.6	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-10-15 08:19	-	0.12	-	0.56	16	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-10-15 07:46	-	0.13	-	0.19	15.8	<1	15.8	<1
GRAB	COQ-544	721 Pembroke	2025-10-19 08:25	-	0.09	-	0.32	15.5	<1	6	<1
GRAB	COQ-544	721 Pembroke	2025-10-21 08:07	-	0.18	-	0.42	15.3	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-10-22 08:33	-	0.2	-	0.46	15.2	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-10-29 09:04	-	0.19	-	0.63	14.4	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-10-30 08:58	-	0.12	-	0.45	14.2	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-11-02 08:43	-	0.13	-	0.49	13.7	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-11-07 08:42	-	0.12	-	0.12	13.3	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-11-09 11:57	-	0.11	-	0.47	13.1	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-11-14 10:56	-	0.23	-	0.27	12.6	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-11-17 12:37	-	0.12	-	0.4	12	<1	6	<1
GRAB	COQ-544	721 Pembroke	2025-11-19 08:27	-	0.14	-	0.38	10	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-11-28 08:51	-	0.14	-	0.39	11.4	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-12-02 07:42	-	0.11	-	0.61	10.9	<1	2	<1
GRAB	COQ-544	721 Pembroke	2025-12-06 08:48	-	0.11	-	0.19	10.5	<1	2	<1

GRAB	COQ-544	721 Pembroke	2025-12-09 08:59	-	0.12	-	0.6	10.6	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-12-11 08:24	-	0.11	-	0.68	10.5	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-12-17 08:46	-	0.14	-	0.5	10.2	<1	<2	<1
GRAB	COQ-544	721 Pembroke	2025-02-24 13:56	-	0.14	-	0.62	9.2	<1	NA	<1
GRAB	COQ-545	Blue Jay Way	2025-01-02 08:10	-	0.29	-	0.33	7.5	<1	2	<1
GRAB	COQ-545	Blue Jay Way	2025-01-07 08:12	-	0.25	-	0.22	7.4	<1	2	<1
GRAB	COQ-545	Blue Jay Way	2025-01-10 07:47	-	0.21	-	0.19	7.8	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-01-14 07:36	-	0.19	-	0.23	7.3	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-01-21 07:59	-	0.29	-	0.2	6.5	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-03-13 11:24	-	0.18	-	0.17	6	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-01-29 07:54	-	0.19	-	0.24	5.7	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-02-19 08:09	-	0.2	-	0.35	5.5	<1	2	<1
GRAB	COQ-545	Blue Jay Way	2025-02-21 07:37	-	0.16	-	0.26	5.3	<1	4	<1
GRAB	COQ-545	Blue Jay Way	2025-02-26 07:57	-	0.74	-	0.17	5.4	<1	6	<1
GRAB	COQ-545	Blue Jay Way	2025-02-27 08:25	-	0.51	-	0.21	6.4	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-03-04 07:55	-	0.24	-	0.2	7.3	<1	2	<1
GRAB	COQ-545	Blue Jay Way	2025-03-11 08:21	-	0.36	-	0.12	7.5	<1	2	<1
GRAB	COQ-545	Blue Jay Way	2025-03-21 08:52	-	0.43	-	0.07	7.1	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-03-26 07:57	-	0.37	-	0.27	7.5	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-04-01 07:44	-	0.32	-	0.24	8.2	<1	12	<1
GRAB	COQ-545	Blue Jay Way	2025-04-08 08:02	-	0.22	-	0.22	9.2	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-04-15 07:43	-	0.27	-	0.15	9.8	<1	6	<1
GRAB	COQ-545	Blue Jay Way	2025-04-17 07:52	-	0.2	-	0.21	9.9	<1	8	<1
GRAB	COQ-545	Blue Jay Way	2025-04-24 09:25	-	0.21	-	0.06	11.3	<1	20	<1
GRAB	COQ-545	Blue Jay Way	2025-04-29 08:10	-	0.19	-	0.15	9	<1	30	<1
GRAB	COQ-545	Blue Jay Way	2025-05-06 07:57	-	0.19	-	0.19	13.3	<1	12	<1
GRAB	COQ-545	Blue Jay Way	2025-05-09 10:54	-	0.18	-	0.14	13.4	<1	24	<1
GRAB	COQ-545	Blue Jay Way	2025-05-15 09:23	-	0.22	-	0.09	13.7	<1	4	<1
GRAB	COQ-545	Blue Jay Way	2025-05-23 10:59	-	0.27	-	0.09	13	<1	4	<1
GRAB	COQ-545	Blue Jay Way	2025-05-30 12:46	-	0.2	-	0.14	14.7	<1	22	<1
GRAB	COQ-545	Blue Jay Way	2025-06-03 11:56	-	0.23	-	0.13	15.1	<1	30	<1
GRAB	COQ-545	Blue Jay Way	2025-06-18 07:37	-	0.16	-	0.16	12.7	<1	4	<1
GRAB	COQ-545	Blue Jay Way	2025-05-19 10:01	-	0.15	-	0.15	17.7	<1	34	<1
GRAB	COQ-545	Blue Jay Way	2025-06-25 08:09	-	0.17	-	0.17	16.7	<1	6	<1
GRAB	COQ-545	Blue Jay Way	2025-07-08 10:57	-	0.15	-	0.13	17.7	<1	170	<1
GRAB	COQ-545	Blue Jay Way	2025-07-16 10:30	-	0.16	-	0.14	18.1	<1	22	<1
GRAB	COQ-545	Blue Jay Way	2025-07-22 09:40	-	0.16	-	0.15	19	<1	50	<1
GRAB	COQ-545	Blue Jay Way	2025-07-29 08:18	-	0.21	-	0.17	19.4	<1	20	<1
GRAB	COQ-545	Blue Jay Way	2025-08-13 11:38	-	0.16	-	0.12	19.7	<1	48	<1
GRAB	COQ-545	Blue Jay Way	2025-08-19 09:24	-	0.22	-	0.22	20.4	<1	18	<1
GRAB	COQ-545	Blue Jay Way	2025-08-21 08:11	-	0.21	-	0.03	20.3	<1	1A	<1
GRAB	COQ-545	Blue Jay Way	2025-08-26 10:33	-	0.18	-	0.11	19	<1	40	<1
GRAB	COQ-545	Blue Jay Way	2025-08-28 07:54	-	0.19	-	0.13	20.4	<1	14	<1
GRAB	COQ-545	Blue Jay Way	2025-08-29 08:46	-	0.18	-	0.04	20.4	<1	56	<1
GRAB	COQ-545	Blue Jay Way	2025-09-03 10:20	-	0.18	-	0.12	16.5	<1	36	<1
GRAB	COQ-545	Blue Jay Way	2025-09-10 11:21	-	0.19	-	0.1	21	<1	38	<1
GRAB	COQ-545	Blue Jay Way	2025-09-14 09:25	-	0.17	-	0.17	20.4	<1	17	<1
GRAB	COQ-545	Blue Jay Way	2025-09-21 09:53	-	0.17	-	0.03	19.7	<1	12	<1
GRAB	COQ-545	Blue Jay Way	2025-10-06 07:38	-	0.21	-	0.11	18	<1	8	<1
GRAB	COQ-545	Blue Jay Way	2025-10-14 08:01	-	0.22	-	0.14	16.7	<1	14	<1
GRAB	COQ-545	Blue Jay Way	2025-10-20 08:07	-	0.2	-	0.14	13.7	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-10-30 10:18	-	0.26	-	0.15	13.5	<1	20	<1
GRAB	COQ-545	Blue Jay Way	2025-11-03 08:13	-	0.22	-	0.12	13.1	CG	NA	CG
GRAB	COQ-545	Blue Jay Way	2025-11-04 12:38	<1	0.23	<1	0.07	12.5	<1	60	<1
GRAB	COQ-545	Blue Jay Way	2025-11-14 09:15	-	0.18	-	0.04	11.9	<1	4	<1
GRAB	COQ-545	Blue Jay Way	2025-11-19 09:24	-	0.19	-	0.08	11.6	<1	6	<1
GRAB	COQ-545	Blue Jay Way	2025-11-24 07:52	-	0.26	-	0.24	9.6	<1	4	<1
GRAB	COQ-545	Blue Jay Way	2025-12-01 07:34	-	0.22	-	0.15	10.2	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-12-08 07:52	-	0.23	-	0.15	8.6	<1	2	<1
GRAB	COQ-545	Blue Jay Way	2025-12-10 08:08	-	0.26	-	0.15	8.5	<1	<2	<1
GRAB	COQ-545	Blue Jay Way	2025-12-15 07:46	-	0.21	-	0.14	9.1	<1	2	<1
GRAB	COQ-545	Blue Jay Way	2025-12-22 07:38	-	0.2	-	0.15	8.6	<1	NA	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-01-07 09:58	-	0.43	-	1.09	6.2	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-01-08 12:29	-	0.35	-	1.12	6.2	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-01-16 08:41	-	0.27	-	1.07	6.1	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-01-18 08:06	-	0.24	-	0.89	5.9	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-01-21 08:52	-	0.32	-	0.95	5.5	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-01-31 11:14	-	0.23	-	1.13	5	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-02-10 12:09	-	0.23	-	0.99	4.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-03 08:01	-	0.4	-	1.11	6.1	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-04 11:22	-	0.39	-	0.93	5.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-05 07:03	-	0.33	-	1.17	6	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-09 09:42	-	0.33	-	1.01	5.9	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-10 07:22	-	0.27	-	0.98	6	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-16 09:28	-	0.44	-	0.96	6.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-01-19 08:46	-	0.15	-	1.14	7.1	<1	18	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-23 10:19	-	0.31	-	0.93	6.7	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-04-30 10:16	-	0.29	-	0.73	8.5	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-01 10:41	-	0.34	-	0.98	6.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-07 11:08	-	0.29	-	1.1	7.5	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-09 12:10	-	0.29	-	0.98	8.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-14 11:10	-	0.35	-	1.08	8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-21 10:01	-	0.29	-	0.96	9.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-21 09:59	-	0.38	-	0.96	9.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-23 13:28	-	0.38	-	1.55	7.9	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-26 13:15	-	0.35	-	1.15	8.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-05-28 09:59	-	0.47	-	1.07	8.5	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-06-03 08:18	-	0.36	-	1.11	8.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-06-10 09:38	-	0.25	-	0.96	10.6	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-06-18 10:03	-	0.22	-	1.12	11.7	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-06-20 10:35	-	0.22	-	0.94	11.1	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-06-21 08:06	-	0.24	-	1.03	11.6	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-06-25 10:01	-	0.28	-	0.88	11.7	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-07-04 07:42	-	0.34	-	0.98	13.1	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-07-09 09:39	-	0.19	-	0.88	13	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-07-18 09:26	-	0.27	-	0.95	12.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-07-24 07:54	-	0.18	-	1.1	14.6	<1	<2	<1

GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-07-25 11:13	-	0.18	-	0.95	13.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-07-31 10:29	-	0.18	-	0.94	13.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-07 10:27	-	0.18	-	0.91	13.1	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-15 09:37	-	0.2	-	1.19	15.2	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-17 07:54	-	0.56	-	0.82	14	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-20 08:02	-	0.36	-	1.11	15.2	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-22 11:33	-	0.38	-	0.86	14.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-27 07:04	-	0.38	-	1.08	15.5	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-29 10:55	-	0.37	-	1.11	15.4	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-08-31 08:06	-	0.26	-	0.84	15.9	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-09-05 13:20	-	0.3	-	0.77	15.4	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-09-12 09:32	-	0.28	-	0.79	14.6	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-09-19 09:02	-	0.34	-	1.05	14.9	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-09-27 12:43	-	0.27	-	0.86	15.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-09-28 12:51	-	0.34	-	1.16	15.8	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-08 09:18	-	0.35	-	1.13	14.4	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-12 09:16	-	0.28	-	0.91	14.8	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-15 10:52	-	0.33	-	1.07	14.7	<1	4	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-16 08:04	-	0.3	-	1.05	14.5	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-19 10:00	-	0.31	-	0.64	14.3	<1	4	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-21 09:08	-	0.99	-	1.19	13.7	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-22 09:38	-	0.57	-	1.04	13.2	<1	8	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-23 11:55	-	0.52	-	1.39	13.2	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-29 10:43	-	0.43	-	1.03	11.7	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-10-30 09:47	-	0.39	-	0.78	11.4	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-02 10:10	-	0.42	-	0.42	12.1	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-05 11:31	-	0.24	-	0.59	11.6	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-07 09:42	-	0.21	-	0.49	10.7	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-09 09:54	-	0.24	-	0.74	11	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-12 12:19	-	0.35	-	0.8	9.9	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-14 12:25	-	0.43	-	0.81	9.6	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-19 09:00	-	0.23	-	0.72	10.1	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-11-28 09:48	-	0.32	-	0.8	9.8	<1	2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-12-02 07:52	-	0.35	-	1.19	8.6	<1	1A	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-12-06 09:37	-	0.24	-	1.02	8.4	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-12-09 10:34	-	0.35	-	1.13	8.2	<1	<12	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-12-11 09:58	-	0.39	-	0.95	8.2	<1	<2	<1
GRAB	COQ-546	Mackin Park (Nelson & Brunette)	2025-12-17 09:55	-	0.29	-	1.44	7.4	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-01-07 08:17	-	0.57	-	0.69	5.8	<1	8	<1
GRAB	COQ-547	Harper Reservoir	2025-01-15 07:57	-	0.28	-	1.04	5.9	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-01-22 13:03	-	0.24	-	1.06	5.6	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-02-20 07:48	-	0.31	-	0.52	4.5	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-02-21 09:42	-	0.51	-	0.56	5.5	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-02-24 07:53	-	0.61	-	0.62	5	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-02-26 08:30	-	1	-	0.42	5.2	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-03-03 13:42	-	0.42	-	0.36	5.4	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-03-05 07:36	-	0.32	-	0.69	5.8	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-03-12 07:51	-	0.54	-	0.52	5.5	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-03-18 08:08	-	0.42	-	0.45	5.3	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-03-26 08:08	-	0.34	-	0.51	5.8	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-04-04 07:30	-	0.47	-	0.32	6.2	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-04-07 07:48	-	0.32	-	0.62	6.8	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-04-16 08:06	-	0.24	-	0.46	6.8	<1	4	<1
GRAB	COQ-547	Harper Reservoir	2025-04-23 08:07	-	0.36	-	0.36	7.5	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-04-28 07:47	-	0.25	-	0.4	7.9	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-05-06 08:07	-	0.43	-	0.6	8.7	<1	6	<1
GRAB	COQ-547	Harper Reservoir	2025-05-13 07:46	-	0.31	-	0.75	8.9	<1	8	<1
GRAB	COQ-547	Harper Reservoir	2025-05-20 07:59	-	0.31	-	0.57	9	<1	10	<1
GRAB	COQ-547	Harper Reservoir	2025-05-27 07:46	-	0.3	-	0.47	9.5	<1	6	<1
GRAB	COQ-547	Harper Reservoir	2025-06-03 09:23	-	0.39	-	0.44	10.4	<1	6	<1
GRAB	COQ-547	Harper Reservoir	2025-06-11 08:07	-	0.32	-	0.48	11.4	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-06-17 07:58	-	0.3	-	0.58	11.7	<1	20	<1
GRAB	COQ-547	Harper Reservoir	2025-06-26 08:04	-	0.54	-	0.76	11.7	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-07-03 08:23	-	0.22	-	0.24	11.9	<1	8	<1
GRAB	COQ-547	Harper Reservoir	2025-07-09 08:11	-	0.7	-	0.4	13.1	<1	20	<1
GRAB	COQ-547	Harper Reservoir	2025-07-16 08:20	-	0.64	-	0.73	13.2	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-07-30 08:08	-	0.27	-	0.71	13.6	<1	6	<1
GRAB	COQ-547	Harper Reservoir	2025-08-11 08:06	-	0.28	-	0.52	14.4	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-08-18 07:42	-	0.56	-	0.27	14.9	<1	18	<1
GRAB	COQ-547	Harper Reservoir	2025-08-25 08:13	-	0.3	-	0.48	15.3	<1	10	<1
GRAB	COQ-547	Harper Reservoir	2025-09-03 08:04	-	0.3	-	0.3	16.1	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-09-09 08:03	-	0.35	-	0.53	16.1	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-09-18 08:03	-	0.32	-	0.62	16.1	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-09-22 08:05	-	0.22	-	0.51	15	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-10-02 08:40	-	0.45	-	0.35	14.8	<1	10	<1
GRAB	COQ-547	Harper Reservoir	2025-10-06 08:10	-	0.27	-	0.48	14	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-10-15 08:05	-	0.32	-	0.47	14.1	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-10-22 08:22	-	0.43	-	0.71	12.2	<1	14	<1
GRAB	COQ-547	Harper Reservoir	2025-10-30 08:24	-	0.34	-	0.95	10.6	<1	<2	<1
GRAB	COQ-547	Harper Reservoir	2025-11-04 09:20	-	0.29	-	0.56	10.6	<1	2	<1
GRAB	COQ-547	Harper Reservoir	2025-11-10 09:44	-	0.24	-	0.92	10.1	<1	12	<1
GRAB	COQ-547	Harper Reservoir	2025-11-13 08:18	-	0.24	-	0.74	10.1	<1	10	<1
GRAB	COQ-547	Harper Reservoir	2025-11-17 08:17	-	0.28	-	0.88	9.6	<1	8	<1
GRAB	COQ-547	Harper Reservoir	2025-11-26 08:31	-	0.32	-	0.48	9.7	<1	44	<1
GRAB	COQ-547	Harper Reservoir	2025-12-01 07:47	-	0.35	-	0.67	8.2	<1	14	<1
GRAB	COQ-547	Harper Reservoir	2025-12-08 07:55	-	0.27	-	0.58	8	<1	22	<1
GRAB	COQ-547	Harper Reservoir	2025-12-11 08:25	-	0.3	-	0.45	7.9	<1	22	<1
GRAB	COQ-547	Harper Reservoir	2025-12-15 07:53	-	0.32	-	0.55	8	<1	12	<1
GRAB	COQ-547	Harper Reservoir	2025-12-23 08:24	-	0.41	-	0.41	6.8	<1	NA	<1
GRAB	COQ-547	Harper Reservoir	2025-12-30 08:00	-	0.3	-	0.3	6.3	<1	14	<1
GRAB	COQ-548	Rochester School	2025-01-07 08:30	-	0.2	-	0.5	7.4	<1	2	<1
GRAB	COQ-548	Rochester School	2025-01-08 12:41	-	0.18	-	0.48	7.3	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-01-10 11:55	-	0.15	-	0.67	7.4	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-01-16 10:51	-	0.15	-	0.58	7.1	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-01-20 13:26	-	0.18	-	0.58	6.5	<1	4	<1
GRAB	COQ-548	Rochester School	2025-01-21 11:29	-	0.14	-	0.48	6.6	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-01 07:51	-	0.09	-	0.57	5.9	<1	<2	<1

GRAB	COQ-548	Rochester School	2025-02-07 12:33	-	0.24	-	0.82	5.2	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-10 11:48	-	0.26	-	0.89	4.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-14 10:19	-	0.36	-	0.45	4.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-18 09:52	-	0.16	-	0.16	4.3	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-20 12:34	-	0.19	-	0.57	6	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-21 11:32	-	0.16	-	0.51	4.5	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-23 09:19	-	0.15	-	0.58	5	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-25 10:29	-	0.21	-	0.68	5.9	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-02-26 10:07	-	0.2	-	0.56	4.7	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-03-03 09:46	-	0.22	-	0.63	5.3	<1	2	<1
GRAB	COQ-548	Rochester School	2025-03-11 10:23	-	0.24	-	0.57	5.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-03-13 09:12	-	0.16	-	0.62	6.1	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-03-17 09:29	-	0.16	-	0.58	6.4	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-03-26 09:50	-	0.14	-	0.49	6.3	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-03-27 08:07	-	0.14	-	0.61	6.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-03-28 12:09	-	0.13	-	0.55	6.6	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-03 08:10	-	0.14	-	0.55	6.9	<1	4	<1
GRAB	COQ-548	Rochester School	2025-04-04 12:55	-	0.18	-	0.56	7.9	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-05 11:52	-	0.14	-	0.63	7	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-08 13:17	-	0.15	-	0.44	7.7	<1	6	<1
GRAB	COQ-548	Rochester School	2025-04-09 07:59	-	0.17	-	0.28	7.5	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-10 08:08	-	0.24	-	0.59	7.4	<1	2	<1
GRAB	COQ-548	Rochester School	2025-04-11 12:24	-	0.16	-	0.56	7.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-16 09:12	-	0.13	-	0.56	7.5	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-23 10:08	-	0.25	-	0.48	8.1	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-26 09:28	-	0.8	-	0.57	8.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-04-30 10:03	-	0.16	-	0.5	9.5	<1	4	<1
GRAB	COQ-548	Rochester School	2025-05-01 10:24	-	0.28	-	0.49	8.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-05-07 10:19	-	0.33	-	0.39	8.7	<1	4	<1
GRAB	COQ-548	Rochester School	2025-05-14 10:54	-	0.37	-	0.41	9	<1	16	<1
GRAB	COQ-548	Rochester School	2025-05-21 09:44	-	0.28	-	0.35	9.9	<1	420	<1
GRAB	COQ-548	Rochester School	2025-05-26 12:13	-	0.39	-	0.39	10.8	<1	60	<1
GRAB	COQ-548	Rochester School	2025-05-29 09:47	-	0.26	-	0.48	11.5	<1	270	<1
GRAB	COQ-548	Rochester School	2025-06-02 12:07	-	0.33	-	0.35	11.1	<1	160	<1
GRAB	COQ-548	Rochester School	2025-06-10 09:21	-	0.25	-	0.44	11.8	<1	12	<1
GRAB	COQ-548	Rochester School	2025-06-18 09:49	-	0.19	-	0.44	12.6	<1	76	<1
GRAB	COQ-548	Rochester School	2025-06-20 10:14	-	0.28	-	0.37	12.6	<1	78	<1
GRAB	COQ-548	Rochester School	2025-06-21 08:22	-	0.24	-	0.53	14	<1	64	<1
GRAB	COQ-548	Rochester School	2025-06-25 09:46	-	0.19	-	0.51	12.3	<1	4	<1
GRAB	COQ-548	Rochester School	2025-06-27 10:22	-	0.21	-	0.56	12.5	<1	6	<1
GRAB	COQ-548	Rochester School	2025-07-03 13:23	-	0.12	-	0.35	13.9	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-07-09 09:25	-	0.16	-	0.48	13.4	<1	560	<1
GRAB	COQ-548	Rochester School	2025-07-12 12:17	-	0.33	-	0.58	14	<1	210	<1
GRAB	COQ-548	Rochester School	2025-07-18 09:13	-	0.19	-	0.35	14.7	<1	280	<1
GRAB	COQ-548	Rochester School	2025-07-24 08:28	-	0.27	-	0.39	15	<1	370	<1
GRAB	COQ-548	Rochester School	2025-07-26 07:15	-	0.27	-	0.41	15.5	<1	230	<1
GRAB	COQ-548	Rochester School	2025-07-31 10:15	-	0.18	-	0.45	14.9	<1	350	<1
GRAB	COQ-548	Rochester School	2025-08-07 10:10	-	0.14	-	0.33	16	<1	1300	<1
GRAB	COQ-548	Rochester School	2025-08-14 11:53	-	0.2	-	0.47	16.4	<1	1600	<1
GRAB	COQ-548	Rochester School	2025-08-17 07:42	-	0.12	-	0.57	16.5	<1	28	<1
GRAB	COQ-548	Rochester School	2025-08-20 08:40	-	0.12	-	0.51	16.9	<1	10	<1
GRAB	COQ-548	Rochester School	2025-08-27 08:33	-	0.12	-	0.67	16.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-08-31 07:52	-	0.13	-	0.48	16.6	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-09-03 13:53	-	0.13	-	0.56	16.5	<1	4	<1
GRAB	COQ-548	Rochester School	2025-09-06 09:30	-	0.14	-	0.51	17.1	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-09-12 09:55	-	0.12	-	0.46	17.2	<1	4	<1
GRAB	COQ-548	Rochester School	2025-09-19 09:21	-	0.14	-	0.35	18	<1	2	<1
GRAB	COQ-548	Rochester School	2025-09-27 12:55	-	0.14	-	0.56	17.8	<1	14	<1
GRAB	COQ-548	Rochester School	2025-09-28 13:33	-	0.12	-	0.21	17.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-09-29 07:48	-	0.09	-	0.45	17	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-09-30 10:45	-	0.11	-	0.49	17.4	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-10-08 10:03	-	0.13	-	0.58	15	<1	4	<1
GRAB	COQ-548	Rochester School	2025-10-12 09:01	-	0.14	-	0.57	14.6	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-10-15 11:30	-	0.12	-	0.62	14.1	<1	4	<1
GRAB	COQ-548	Rochester School	2025-10-16 09:21	-	0.17	-	0.47	14.4	<1	4	<1
GRAB	COQ-548	Rochester School	2025-10-19 10:43	-	0.14	-	0.47	13.8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-10-21 09:33	-	0.21	-	0.56	13.3	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-10-21 10:54	-	0.17	-	0.71	13.2	<1	2	<1
GRAB	COQ-548	Rochester School	2025-10-23 07:11	-	0.17	-	0.47	13.3	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-10-29 10:27	-	0.17	-	0.65	11.4	<1	2	<1
GRAB	COQ-548	Rochester School	2025-10-30 10:23	-	0.12	-	0.52	11.1	<1	2	<1
GRAB	COQ-548	Rochester School	2025-11-02 09:54	-	0.14	-	0.69	11	<1	2	<1
GRAB	COQ-548	Rochester School	2025-11-07 10:18	-	0.14	-	0.36	10.5	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-11-09 10:12	-	0.12	-	0.54	10.5	<1	4	<1
GRAB	COQ-548	Rochester School	2025-11-12 11:52	-	0.11	-	0.46	9.9	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-11-14 12:04	-	0.13	-	0.48	9.9	<1	20	<1
GRAB	COQ-548	Rochester School	2025-11-17 12:54	-	0.11	-	0.5	9.3	<1	6	<1
GRAB	COQ-548	Rochester School	2025-11-19 09:23	-	0.13	-	0.66	9.6	<1	14	<1
GRAB	COQ-548	Rochester School	2025-11-28 10:23	-	0.1	-	0.61	8.7	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-12-02 09:38	-	0.11	-	0.59	8.4	<1	4	<1
GRAB	COQ-548	Rochester School	2025-12-06 10:13	-	0.09	-	0.53	8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-12-09 10:12	-	0.12	-	0.24	8	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-12-11 09:41	-	0.13	-	0.68	7.9	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-12-15 12:51	-	0.13	-	0.51	10.6	<1	<2	<1
GRAB	COQ-548	Rochester School	2025-12-17 09:43	-	0.13	-	0.44	7.9	<1	<2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-01-02 07:12	-	0.39	-	1.29	6.5	<1	2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-01-07 07:12	-	0.51	-	0.81	6.4	<1	10	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-01-10 07:12	-	0.25	-	0.8	6.5	<1	6	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-01-14 06:50	-	0.3	-	0.9	6.3	<1	2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-01-21 07:05	-	0.23	-	0.78	5.9	<1	6	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-02-10 07:30	-	0.26	-	0.8	5.3	<1	10	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-02-27 07:01	-	0.62	-	0.82	5.9	<1	18	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-03-04 06:57	-	0.42	-	0.88	6	<1	8	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-03-11 07:06	-	0.45	-	0.81	6	<1	40	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-03-21 07:37	-	0.37	-	0.9	6	<1	4	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-03-26 06:58	-	0.54	-	1.07	6.8	<1	28	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-04-01 06:54	-	0.44	-	0.79	6.6	<1	<2	<1

GRAB	COQ-549	Scott Creek Pump Station	2025-04-08 07:08	-	0.29	-	0.66	6.5	<1	4	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-04-15 06:54	-	0.31	-	0.63	7.4	<1	30	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-04-17 06:52	-	0.32	-	0.69	7.9	<1	<2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-04-24 07:47	-	0.38	-	0.73	7.2	<1	2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-04-29 07:09	-	0.23	-	0.65	8.6	<1	2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-05-06 07:03	-	0.24	-	0.77	8.7	<1	<2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-05-15 07:53	-	0.32	-	0.86	8.6	<1	14	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-05-23 09:40	-	0.41	-	1.26	8.8	<1	22	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-06-03 10:51	-	0.36	-	0.51	10.2	<1	24	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-06-18 06:51	-	0.2	-	0.59	11.1	<1	40	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-06-20 08:07	-	0.2	-	0.72	12	<1	12	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-06-25 07:19	-	0.23	-	0.97	11	<1	28	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-07-08 10:39	-	0.21	-	0.71	12.4	<1	50	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-07-16 07:19	-	0.3	-	0.9	12.7	<1	90	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-07-22 06:32	-	0.24	-	0.51	13.1	<1	40	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-07-29 06:34	-	0.22	-	0.69	13.9	<1	2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-08-14 06:32	-	0.17	-	0.7	15.6	<1	28	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-08-19 06:46	-	0.3	-	0.93	14.8	<1	14	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-08-26 07:00	-	0.29	-	0.91	15.3	<1	2	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-08-29 10:58	-	0.25	-	0.74	15.2	<1	24	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-09-03 06:46	-	0.2	-	0.9	15.7	<1	16	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-09-10 10:17	-	0.25	-	0.71	15.4	<1	32	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-09-14 07:46	-	0.22	-	0.62	15.5	<1	14	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-09-21 08:04	-	0.27	-	1.23	15.6	<1	20	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-10-06 06:54	-	0.3	-	0.62	14.5	<1	18	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-10-14 07:08	-	0.33	-	0.91	14.7	<1	50	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-10-20 06:59	-	0.47	-	0.69	14	<1	52	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-10-24 11:55	-	0.29	-	0.8	13.6	<1	76	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-10-27 06:48	-	0.39	-	0.72	11.5	<1	30	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-10-30 11:45	-	0.27	-	0.69	11.9	<1	14	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-11-03 07:08	-	0.29	-	0.69	11.3	<1	46	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-11-14 08:02	-	0.25	-	0.36	10	<1	14	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-11-19 07:56	-	0.29	-	0.79	9.7	<1	10	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-11-24 06:45	-	0.33	-	0.94	9.4	<1	10	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-12-01 06:40	-	0.3	-	0.9	8.7	<1	10	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-12-08 06:44	-	0.32	-	0.91	8.4	<1	14	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-12-15 07:03	-	0.41	-	0.77	8.4	<1	8	<1
GRAB	COQ-549	Scott Creek Pump Station	2025-12-22 06:53	-	0.25	-	0.83	7.3	<1	NA	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-01-07 08:55	-	0.35	-	0.21	6.9	<1	<1	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-01-09 12:25	-	0.24	-	0.18	8	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-01-15 08:36	-	0.22	-	0	8	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-01-22 12:32	-	0.2	-	0.26	7.5	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-01-23 08:53	-	0.2	-	0.22	7	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-01-31 09:49	-	0.19	-	0.62	5.8	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-03 08:12	-	0.34	-	0.15	6.2	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-10 10:24	-	0.24	-	0.2	5.6	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-18 08:14	-	0.32	-	0.16	5.8	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-21 08:39	-	0.19	-	0.27	6.3	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-24 08:13	-	0.81	-	0.24	6.5	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-25 08:43	-	0.85	-	0.22	6.8	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-26 08:42	-	0.67	-	0.25	6.4	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-03-05 08:01	-	0.51	-	0.13	7.8	<1	80	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-03-11 07:46	-	0.46	-	0.41	6.6	<1	50	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-03-18 08:25	-	0.42	-	0.28	7.5	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-03-18 08:35	-	0.41	-	0.29	7.7	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-03-19 10:43	-	0.37	-	0.3	8	<1	4	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-03-26 08:38	-	0.37	-	0.21	7.9	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-04-04 07:46	-	0.3	-	0.23	8.8	<1	56	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-04-07 08:20	-	0.34	-	0.22	9.6	<1	32	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-04-09 07:46	-	0.24	-	0.21	9.2	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-04-15 08:32	-	0.24	-	0.24	9.8	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-04-23 09:01	-	0.24	-	0.03	11	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-04-28 08:24	-	0.26	-	0.21	11.5	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-05-06 08:32	-	0.49	-	0.28	12	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-05-13 08:19	-	0.24	-	0.37	12.4	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-05-20 08:18	-	0.3	-	0.27	12.1	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-05-27 08:07	-	0.39	-	0.32	12.7	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-06-03 09:42	-	0.33	-	0.29	13.5	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-06-11 08:32	-	0.26	-	0.12	15	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-06-17 08:21	-	0.2	-	0.27	16.2	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-06-26 08:26	-	0.32	-	0.36	14.8	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-07-03 08:38	-	0.16	-	0.19	16.6	<1	210	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-07-09 08:35	-	0.23	-	0.24	17	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-07-11 12:11	-	0.17	-	0.22	17.2	<1	4	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-07-16 08:41	-	0.26	-	0.24	17	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-07-23 07:45	-	0.27	-	0.17	17.9	<1	4	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-07-30 08:33	-	0.21	-	0.26	18.1	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-08-11 08:26	-	0.19	-	0.09	18.4	<1	4	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-08-18 08:05	-	0.45	-	0.25	18.4	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-08-25 08:34	-	0.22	-	0.16	19.2	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-08-27 07:47	-	0.24	-	0.15	19.7	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-09-03 08:24	-	1.4	-	0.32	19.1	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-09-09 08:30	-	0.29	-	0.11	19.2	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-09-18 08:35	-	0.26	-	0.16	18.4	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-09-19 12:35	-	0.31	-	0.32	18.8	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-09-22 08:28	-	0.23	-	0.11	18.7	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-10-02 09:03	-	0.28	-	0.17	17.2	<1	8	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-10-09 06:41	-	0.35	-	0.09	17	<1	6	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-10-11 11:04	-	0.27	-	0.1	17	<1	18	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-10-15 08:29	-	0.3	-	0.19	15.1	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-10-22 09:02	-	0.32	-	0.18	14.8	<1	2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-10-30 08:52	-	0.29	-	0.14	13.3	<1	10	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-11-04 11:48	-	0.37	-	0.31	13	<1	10	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-11-06 08:29	-	0.29	-	0.01	13.1	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-11-10 09:10	-	0.26	-	0.23	12.8	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-11-13 08:59	-	0.25	-	0.33	12.4	<1	8	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-11-17 08:48	-	0.24	-	0.21	12.1	<1	2	<1

GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-11-19 12:05	-	0.21	-	0.25	11.8	<1	10	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-11-24 08:56	-	0.26	-	0.25	11.5	<1	6	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-12-01 08:06	-	0.24	-	0.25	10.5	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-02-05 10:22	-	0.22	-	0.22	9.9	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-12-08 08:18	-	0.25	-	0.11	9.9	<1	4	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-12-15 08:15	-	0.26	-	0.15	9.1	<1	<2	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-12-23 08:44	-	0.32	-	0.41	9.2	<1	NA	<1
GRAB	COQ-600	Leigh Elementary School, Victoria Dr.	2025-12-30 08:28	-	0.26	-	0.16	8.1	<1	NA	<1
GRAB	COQ-601	2085 Concord	2025-01-07 10:32	-	0.3	-	0.16	8.7	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-16 11:18	-	0.22	-	0.2	8.6	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-01-21 09:34	-	0.33	-	0.33	6.3	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-01 08:37	-	0.16	-	0.22	6.7	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-07 12:17	-	0.19	-	0.27	6	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-10 11:34	-	0.17	-	0.19	5.9	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-13 10:25	-	0.18	-	0.27	5.6	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-18 10:36	-	0.17	-	0.19	5.7	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-20 12:14	-	0.17	-	0.23	6	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-21 11:12	-	0.19	-	0.29	6.3	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-02-23 10:03	-	0.26	-	0.22	7	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-02-25 10:15	-	1.3	-	0.66	6.2	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-02-26 10:42	-	0.68	-	0.19	7.2	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-03-03 10:31	-	0.25	-	0.21	7.9	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-03-05 09:25	-	0.22	-	0.21	7.9	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-03-12 11:11	-	0.35	-	0.21	8.3	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-03-13 08:38	-	0.32	-	0.24	8.5	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-03-17 10:50	-	0.24	-	0.15	8.4	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-03-26 10:44	-	0.37	-	0.26	8.4	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-03 09:30	-	0.35	-	0.27	9.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-08 13:01	-	0.25	-	0.27	8.3	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-09 10:14	-	0.27	-	0.08	10	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-10 08:35	-	0.34	-	0.31	10.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-11 12:05	-	0.23	-	0.22	10	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-14 09:58	-	0.26	-	0.2	8.2	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-17 12:26	-	0.23	-	0.07	10.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-23 10:52	-	0.25	-	0.19	10.8	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-04-26 09:07	-	0.24	-	0.28	8.1	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-04-30 10:51	-	0.22	-	0.47	10	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-05-01 11:37	-	0.22	-	0.11	11.4	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-05-07 11:36	-	0.25	-	0.14	12.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-05-14 12:04	-	0.36	-	0.2	11.7	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-05-21 10:28	-	0.33	-	0.41	11	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-05-26 12:00	-	0.3	-	0.22	12.4	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-05-27 13:12	-	0.54	-	0.38	11.7	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-05-28 10:25	-	0.34	-	0.21	13.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-06-02 11:46	-	0.25	-	0.16	13.3	<1	16	<1
GRAB	COQ-601	2085 Concord	2025-06-10 10:04	-	1.3	-	0.5	12.2	<1	24	<1
GRAB	COQ-601	2085 Concord	2025-06-18 10:51	-	0.18	-	0.18	15	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-06-20 12:29	-	0.18	-	0.28	14.7	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-06-21 11:52	-	0.2	-	0.24	15.2	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-06-25 10:33	-	0.32	-	0.18	15	<1	6	<1
GRAB	COQ-601	2085 Concord	2025-06-27 11:16	-	0.22	-	0.23	15.2	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-07-04 08:07	-	1	-	0.51	14.9	<1	12	<1
GRAB	COQ-601	2085 Concord	2025-07-09 10:12	-	0.16	-	0.3	15.9	<1	10	<1
GRAB	COQ-601	2085 Concord	2025-07-18 09:59	-	0.17	-	0.29	16.8	<1	6	<1
GRAB	COQ-601	2085 Concord	2025-07-24 09:44	-	0.18	-	0.24	17.3	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-07-31 10:49	-	0.22	-	0.42	17	<1	24	<1
GRAB	COQ-601	2085 Concord	2025-08-07 11:05	-	0.16	-	0.34	17.9	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-08-14 11:22	-	0.19	-	0.36	18.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-08-17 08:38	-	0.26	-	0.52	18.4	<1	18	<1
GRAB	COQ-601	2085 Concord	2025-08-20 09:25	-	0.22	-	0.15	17.9	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-08-27 09:32	-	0.21	-	0.16	18.3	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-08-29 10:41	-	0.24	-	0.31	18.2	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-08-31 08:47	-	0.2	-	0.22	18.2	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-09-06 10:00	-	0.2	-	0.25	19	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-09-12 10:13	-	0.21	-	0.22	18.8	<1	10	<1
GRAB	COQ-601	2085 Concord	2025-09-19 09:44	-	0.2	-	0.15	18	<1	6	<1
GRAB	COQ-601	2085 Concord	2025-09-25 12:43	-	0.22	-	0.15	18.7	<1	4	<1
GRAB	COQ-601	2085 Concord	2025-09-29 07:39	-	0.2	-	0.22	18.1	<1	6	<1
GRAB	COQ-601	2085 Concord	2025-09-30 10:28	-	0.19	-	0.14	18.2	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-10-08 10:45	-	0.3	-	0.11	16.9	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-10-12 09:59	-	0.25	-	0.13	16.6	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-10-15 11:56	-	0.27	-	0.14	16.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-10-16 09:06	-	0.24	-	0.14	16	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-10-19 11:37	-	0.3	-	0.34	15.3	<1	4	<1
GRAB	COQ-601	2085 Concord	2025-10-21 09:59	-	0.33	-	0.08	15.2	<1	22	<1
GRAB	COQ-601	2085 Concord	2025-10-21 11:07	-	0.33	-	0.26	15.1	<1	8	<1
GRAB	COQ-601	2085 Concord	2025-10-23 07:37	-	0.31	-	0.22	15.1	<1	8	<1
GRAB	COQ-601	2085 Concord	2025-10-29 11:36	-	0.63	-	0.22	13	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-10-30 10:52	-	0.25	-	0.01	13.8	<1	4	<1
GRAB	COQ-601	2085 Concord	2025-11-02 10:43	-	0.2	-	0.12	13.7	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-11-07 10:47	-	0.18	-	0.01	13.4	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-11-09 09:03	-	0.25	-	0.05	13.1	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-11-19 09:45	-	0.6	-	0.35	11.5	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-11-28 10:47	-	0.24	-	0.02	11.6	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-12-02 08:48	-	0.29	-	0.11	11.2	<1	2	<1
GRAB	COQ-601	2085 Concord	2025-12-06 10:34	-	0.2	-	0.03	10.6	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-12-09 11:28	-	0.56	-	0.35	10.2	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-12-11 10:40	-	0.24	-	0.1	10.7	<1	<2	<1
GRAB	COQ-601	2085 Concord	2025-12-15 12:39	-	0.23	-	0.14	10.6	<1	14	<1
GRAB	COQ-601	2085 Concord	2025-12-17 10:20	-	0.18	-	0.18	10.6	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-01-07 08:04	-	0.33	-	0.52	6.6	<1	24	<1
GRAB	COQ-603	1323 Glenbrook	2025-01-15 07:43	-	0.26	-	0.6	6.5	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-01-22 13:13	-	0.18	-	0.6	5.9	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-01-23 11:01	-	0.21	-	0.62	5.8	<1	6	<1
GRAB	COQ-603	1323 Glenbrook	2025-01-31 09:24	-	0.18	-	0.72	5.4	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-02-20 07:36	-	0.21	-	0.65	5	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-02-21 09:49	-	0.26	-	0.57	5.1	<1	<2	<1

GRAB	COQ-603	1323 Glenbrook	2025-02-24 07:39	-	1.2	-	0.67	5.5	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-02-26 08:15	-	0.64	-	0.75	5.3	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-03 13:24	-	0.38	-	0.49	6.3	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-05 07:24	-	0.3	-	0.82	6.4	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-06 07:54	-	0.31	-	0.44	5.9	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-12 07:37	-	0.48	-	0.9	6.3	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-18 07:32	-	0.34	-	0.52	6.2	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-19 11:08	-	0.37	-	0.46	7.1	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-26 07:32	-	0.42	-	0.64	6.3	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-03-28 11:03	-	0.4	-	0.57	7.3	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-04-04 07:08	-	0.34	-	0.34	6.9	<1	4	<1
GRAB	COQ-603	1323 Glenbrook	2025-04-07 07:36	-	0.3	-	0.66	7.7	<1	38	<1
GRAB	COQ-603	1323 Glenbrook	2025-04-08 10:59	-	0.22	-	0.45	7.8	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-04-16 07:35	-	0.21	-	0.59	7	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-04-23 07:37	-	0.25	-	0.5	7.3	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-04-28 07:35	-	0.33	-	0.58	8.2	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-05-02 10:01	-	0.24	-	0.59	9.3	<1	4	<1
GRAB	COQ-603	1323 Glenbrook	2025-05-06 07:27	-	0.29	-	0.56	8.6	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-05-13 07:34	-	0.25	-	0.76	9.5	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-05-20 07:33	-	0.28	-	0.6	10.2	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-05-27 07:22	-	0.3	-	0.65	10.3	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-06-03 08:59	-	0.38	-	0.48	10.5	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-06-11 07:37	-	0.25	-	0.63	10.6	<1	18	<1
GRAB	COQ-603	1323 Glenbrook	2025-06-17 07:47	-	0.2	-	0.9	12.7	<1	10	<1
GRAB	COQ-603	1323 Glenbrook	2025-06-26 07:31	-	0.39	-	0.79	12	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-07-03 08:14	-	0.22	-	0.15	12.9	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-07-09 07:59	-	0.19	-	0.78	12.8	<1	10	<1
GRAB	COQ-603	1323 Glenbrook	2025-07-11 09:40	-	0.18	-	0.47	13.5	<1	10	<1
GRAB	COQ-603	1323 Glenbrook	2025-07-16 07:45	-	0.22	-	0.5	13	<1	4	<1
GRAB	COQ-603	1323 Glenbrook	2025-07-23 07:26	-	0.19	-	0.62	15.3	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-07-30 07:34	-	0.19	-	0.49	15.7	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-08-11 07:37	-	0.17	-	0.5	16	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-08-18 07:26	-	0.22	-	0.56	15	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-08-25 07:42	-	0.25	-	0.53	15.7	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-08-27 07:27	-	0.24	-	0.49	16	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-08-29 08:05	-	0.23	-	0.53	15.7	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-09-03 07:53	-	0.25	-	0.82	15.9	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-09-09 07:32	-	0.24	-	0.5	16.3	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-09-16 07:31	-	0.26	-	0.67	16	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-09-15 12:43	-	0.24	-	0.24	16.8	<1	4	<1
GRAB	COQ-603	1323 Glenbrook	2025-09-22 07:34	-	0.22	-	0.24	16	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-09-26 08:44	-	0.22	-	0.47	16.5	<1	20	<1
GRAB	COQ-603	1323 Glenbrook	2025-10-02 08:28	-	0.27	-	0.59	16.5	<1	2	<1
GRAB	COQ-603	1323 Glenbrook	2025-10-06 07:58	-	0.27	-	0.52	14.3	<1	14	<1
GRAB	COQ-603	1323 Glenbrook	2025-10-15 07:55	-	0.28	-	0.51	15	<1	12	<1
GRAB	COQ-603	1323 Glenbrook	2025-10-22 08:06	-	0.34	-	0.42	13.1	<1	6	<1
GRAB	COQ-603	1323 Glenbrook	2025-10-30 07:51	-	0.27	-	0.27	11	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-11-04 12:09	-	0.26	-	0.28	11.1	<1	14	<1
GRAB	COQ-603	1323 Glenbrook	2025-11-06 07:53	-	0.24	-	0.19	11.5	<1	<2	<1
GRAB	COQ-603	1323 Glenbrook	2025-11-10 10:02	-	0.23	-	0.67	10.9	<1	4	<1
GRAB	COQ-603	1323 Glenbrook	2025-11-13 08:06	-	0.22	-	0.54	10.6	<1	4	<1
GRAB	COQ-603	1323 Glenbrook	2025-11-17 07:45	-	0.22	-	0.51	10.3	<1	10	<1
GRAB	COQ-603	1323 Glenbrook	2025-11-26 08:17	-	0.3	-	0.5	9.6	<1	40	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-01 07:23	-	0.25	-	0.59	8.9	<1	36	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-04 11:53	-	0.28	-	0.45	8.8	<1	68	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-08 07:27	-	0.29	-	0.36	8.7	<1	34	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-11 08:11	-	0.28	-	0.52	8.6	<1	48	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-15 07:26	-	0.23	-	0.54	8.7	<1	36	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-18 08:18	-	0.28	-	0.44	8.2	<1	64	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-23 08:13	-	0.32	-	0.52	7.6	<1	NA	<1
GRAB	COQ-603	1323 Glenbrook	2025-12-30 07:47	-	0.3	-	0.5	6.6	<1	NA	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-01-02 07:51	-	0.41	-	1.11	6.3	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-01-07 07:49	-	0.33	-	0.78	7	<1	6	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-01-10 09:38	-	0.26	-	0.65	6.6	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-01-14 07:06	-	0.56	-	0.94	5.8	<1	4	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-01-21 07:44	-	0.25	-	0.74	5.8	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-03-04 07:32	-	0.38	-	0.81	6.2	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-03-05 13:35	-	0.42	-	0.38	6.9	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-03-11 08:01	-	0.32	-	0.5	6.1	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-03-21 09:08	-	0.49	-	0.47	6	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-03-26 07:39	-	0.66	-	0.74	6.9	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-04-01 07:26	-	0.45	-	0.74	6.7	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-04-08 07:34	-	1.1	-	0.7	7.5	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-04-15 07:25	-	0.37	-	0.77	7.3	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-04-29 07:53	-	0.22	-	0.66	8.7	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-05-06 07:31	-	0.31	-	0.31	9	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-05-15 09:43	-	0.32	-	0.55	11	<1	6	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-05-23 11:23	-	0.37	-	0.65	10.8	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-06-03 12:10	-	0.39	-	0.35	13	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-06-18 07:20	-	0.23	-	0.69	13.2	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-06-19 11:55	-	0.37	-	0.39	13.8	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-06-25 07:51	-	0.32	-	0.79	12.7	<1	LA	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-07-08 12:05	-	0.75	-	0.61	17	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-07-16 10:10	-	0.3	-	0.91	15.7	<1	4	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-07-22 09:19	-	0.21	-	0.61	15.7	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-08-13 12:00	-	0.24	-	0.94	14.7	<1	56	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-08-19 09:05	-	0.36	-	0.78	14.7	<1	28	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-08-21 08:24	-	0.35	-	0.26	14.1	<1	LA	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-08-26 10:05	-	0.28	-	0.8	15.3	<1	6	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-09-25 10:01	-	0.28	-	0.71	15.1	<1	24	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-09-03 09:50	-	0.18	-	0.74	15.6	<1	<2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-09-10 10:52	-	0.25	-	0.74	15.2	<1	6	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-09-14 09:38	-	0.24	-	0.68	15.3	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-09-21 10:07	-	0.27	-	0.69	14.5	<1	2	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-10-06 07:20	-	0.39	-	0.65	14.3	<1	10	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-10-14 07:43	-	0.31	-	0.88	14.5	<1	20	<1
GRAB	COQ-605	Hay Creek Reservoir	2025-10-20 07:45	-	0.44	-	0.72	13.7	<1	10	<1

GRAB	COQ-605	Hoy Creek Reservoir	2025-10-24 12:11	-	0.34	-	0.74	13.4	<1	8	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-10-27 07:11	-	0.38	-	0.75	11.3	<1	2	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-10-30 11:31	-	0.32	-	0.52	11.4	<1	8	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-11-03 07:56	-	0.32	-	0.77	10.9	<1	10	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-11-14 09:28	-	0.31	-	0.55	9.4	<1	<2	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-11-19 09:37	-	0.29	-	0.48	9	<1	<2	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-11-24 07:29	-	0.37	-	0.78	9	<1	22	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-12-01 07:07	-	0.28	-	0.89	8.4	<1	66	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-12-08 07:21	-	0.32	-	0.89	8.1	<1	12	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-12-15 07:32	-	0.24	-	0.85	7.9	<1	14	<1
GRAB	COQ-605	Hoy Creek Reservoir	2025-12-22 07:07	-	0.3	-	0.74	7	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-01-07 11:00	-	0.3	-	0.79	6.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-01-09 11:55	-	0.29	-	0.9	6.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-01-10 12:01	-	0.28	-	0.77	6.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-01-15 13:20	-	0.23	-	0.95	6.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-01-18 10:24	-	0.23	-	0.84	6	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-01-21 10:01	-	0.29	-	0.76	5.7	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-02-13 10:57	-	0.25	-	0.82	4.4	<1	14	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-02-18 11:08	-	0.19	-	0.74	4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-02-21 08:20	-	0.4	-	0.7	5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-02-25 08:22	-	0.95	-	0.63	5.7	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-02-26 11:14	-	0.63	-	0.83	5.4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-03-03 11:07	-	0.31	-	0.94	5.8	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-03-05 11:43	-	0.35	-	0.79	6	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-03-11 07:24	-	0.46	-	0.99	6	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-03-22 11:36	-	0.57	-	0.57	5.8	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-03-17 11:20	-	0.34	-	0.83	5.9	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-03-24 11:23	-	0.96	-	0.76	7.1	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-03-26 11:14	-	0.46	-	0.97	6.3	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-04-03 10:41	-	0.38	-	0.89	6	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-04-09 10:48	-	0.29	-	0.8	6.3	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-04-10 09:50	-	0.29	-	0.96	6.4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-04-23 10:24	-	0.24	-	0.79	6.7	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-04-23 11:31	-	0.29	-	0.71	7.3	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-04-30 11:29	-	0.25	-	0.7	8	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-05-01 12:10	-	0.25	-	0.61	7.4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-05-07 12:11	-	0.26	-	0.84	6.3	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-05-09 08:38	-	0.28	-	0.78	9.1	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-05-15 07:42	-	0.33	-	0.74	9.5	<1	2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-05-21 10:55	-	0.27	-	0.68	10.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-05-28 11:06	-	0.26	-	0.92	8.8	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-06-02 12:55	-	0.29	-	0.71	10.6	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-06-10 10:30	-	0.33	-	0.8	11.4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-06-18 11:22	-	0.21	-	0.81	12.6	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-06-25 11:09	-	0.21	-	0.76	11.6	<1	8	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-07-03 13:04	-	0.18	-	0.59	13.1	<1	12	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-07-09 10:52	-	0.2	-	0.6	11.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-07-18 10:56	-	0.2	-	0.71	19	<1	2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-07-24 11:23	-	0.17	-	1.04	12.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-07-25 08:17	-	0.23	-	0.91	12.9	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-07-31 11:18	-	0.2	-	0.85	13.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-08-07 11:37	-	0.15	-	0.64	14	<1	2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-08-15 12:40	-	0.18	-	0.94	15.1	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-08-17 09:18	-	0.4	-	0.62	13.6	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-08-20 10:18	-	0.26	-	0.95	14.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-08-27 10:47	-	0.25	-	0.93	14.8	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-08-31 09:25	-	0.28	-	0.81	15.2	<1	6	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-09-12 10:40	-	0.25	-	0.56	16.5	<1	2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-09-19 10:16	-	0.35	-	0.7	15.9	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-09-25 10:31	-	0.24	-	0.89	16.4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-09-27 06:59	-	0.24	-	0.74	16.4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-08 11:23	-	0.28	-	0.73	15.2	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-12 10:40	-	0.5	-	0.81	15.1	<1	2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-15 12:25	-	0.31	-	0.85	15	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-16 10:45	-	0.29	-	1	14.8	<1	6	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-19 12:12	-	0.32	-	0.8	14.1	<1	2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-21 10:27	-	0.48	-	0.88	13.9	<1	8	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-22 11:11	-	0.44	-	0.93	13.7	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-23 11:31	-	0.34	-	0.82	13.5	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-29 12:11	-	0.39	-	0.64	11.9	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-10-30 11:18	-	0.36	-	0.72	11.8	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-11-02 11:12	-	0.4	-	0.75	11.1	<1	4	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-11-07 11:23	-	0.24	-	0.34	10	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-11-09 08:25	-	0.24	-	1.27	10.7	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-11-14 11:45	-	0.2	-	0.82	10	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-11-20 09:40	-	0.27	-	0.99	9.9	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-11-27 07:49	-	0.36	-	0.76	9.8	<1	6	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-11-28 12:07	-	0.26	-	0.93	9.3	<1	38	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-12-02 10:22	-	0.27	-	0.91	8.9	<1	LA	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-12-04 08:46	-	0.32	-	0.9	9.5	<1	58	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-12-06 11:00	-	0.24	-	0.87	8.4	<1	2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-12-09 12:08	-	0.28	-	0.99	8	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-12-10 11:01	-	0.27	-	0.74	8.7	<1	60	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-12-11 11:28	-	0.32	-	0.79	8.4	<1	<2	<1
GRAB	COQ-606	998 Irvine (Irvine & Reese)	2025-12-17 10:46	-	0.32	-	0.89	7.9	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-01-02 07:23	-	0.59	-	0.92	6.5	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-01-07 07:24	-	0.68	-	0.71	6.3	<1	2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-01-10 06:58	-	0.57	-	0.68	6.7	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-01-14 06:40	-	0.32	-	0.79	6.5	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-01-21 06:53	-	0.27	-	0.65	5.7	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-01-23 12:01	-	0.21	-	0.49	5.7	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-01-29 07:12	-	0.21	-	0.72	5.3	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-02-04 11:18	-	0.27	-	0.61	4.9	<1	40	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-02-19 07:24	-	0.3	-	0.71	5.1	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-02-26 07:21	-	1.3	-	0.7	5.4	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-02-27 07:07	-	0.71	-	0.79	5.9	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-03-04 07:13	-	0.53	-	0.79	6.4	<1	2	<1

GRAB	COQ-607	Noons Creek Reservoir	2025-03-05 08:04	-	0.38	-	0.65	6.4	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-03-11 07:23	-	0.67	-	0.74	6.2	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-03-20 07:35	-	0.57	-	0.56	6.1	<1	8	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-03-21 07:48	-	0.36	-	0.63	6	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-03-26 07:11	-	0.46	-	0.78	6.8	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-04-01 07:01	-	0.39	-	0.7	6.8	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-04-08 07:14	-	0.46	-	0.69	6.8	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-04-15 07:05	-	0.28	-	0.44	7.3	<1	2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-04-17 07:18	-	0.26	-	0.67	7.8	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-04-24 07:59	-	0.5	-	0.49	7.6	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-05-26 07:19	-	0.34	-	0.65	8.8	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-04-29 07:21	-	0.21	-	0.6	8.6	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-05-03 10:31	-	0.25	-	0.62	9.1	<1	2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-05-06 07:13	-	0.38	-	0.68	8.7	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-05-09 11:10	-	0.29	-	0.47	9.3	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-05-15 08:13	-	0.34	-	0.63	8.9	<1	2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-05-23 09:57	-	0.35	-	0.63	9.3	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-06-03 11:57	-	0.33	-	0.36	10.6	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-06-17 12:46	-	0.24	-	0.17	12.2	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-06-19 12:12	-	0.27	-	0.63	12.2	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-06-25 07:29	-	0.23	-	0.8	11.7	<1	6	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-07-08 10:29	-	0.21	-	0.62	15.1	<1	40	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-07-16 07:32	-	0.22	-	0.71	13.2	<1	120	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-07-22 06:48	-	0.21	-	0.58	13.2	<1	54	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-07-29 06:41	-	0.2	-	0.61	14.2	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-08-12 11:14	-	0.22	-	0.81	15.6	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-08-19 06:56	-	0.24	-	0.72	15.1	<1	4	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-08-21 07:24	-	0.27	-	0.3	16.9	<1	LA	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-08-26 07:17	-	0.24	-	0.65	16.2	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-08-29 08:27	-	0.27	-	0.59	16	<1	2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-08-29 11:11	-	0.26	-	0.63	15.2	<1	14	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-09-03 07:37	-	0.22	-	0.76	15.8	<1	6	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-09-10 10:32	-	0.27	-	0.67	16.5	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-09-14 08:00	-	0.21	-	0.56	16.5	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-09-21 08:28	-	0.27	-	1.07	16.6	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-10-06 07:05	-	0.32	-	0.57	14.4	<1	42	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-10-14 07:24	-	0.33	-	0.79	14.8	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-10-20 07:23	-	0.38	-	0.62	14	<1	10	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-10-24 11:45	-	0.4	-	0.68	13.7	<1	30	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-10-27 06:57	-	0.41	-	0.66	12	<1	2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-10-30 12:01	-	0.34	-	0.51	12.2	<1	10	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-11-03 07:38	-	0.32	-	0.6	11.7	<1	38	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-11-14 08:12	-	0.28	-	0.37	10.2	<1	16	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-11-19 08:08	-	0.31	-	0.62	9.9	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-11-24 06:56	-	0.27	-	0.69	9.7	<1	22	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-12-01 06:53	-	0.27	-	0.79	8.9	<1	14	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-12-08 06:58	-	0.3	-	0.74	8.6	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-12-10 06:57	-	0.33	-	0.75	8.5	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-12-11 09:53	-	0.32	-	0.5	7.8	<1	<2	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-12-15 06:53	-	0.34	-	0.6	8.5	<1	8	<1
GRAB	COQ-607	Noons Creek Reservoir	2025-12-22 06:41	-	0.28	-	0.61	7.7	<1	NA	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-01-02 09:21	-	0.47	-	0.65	6.8	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-01-07 09:14	-	0.61	-	0.64	7.8	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-01-10 08:57	-	0.29	-	0.51	7.5	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-01-14 08:45	-	0.31	-	0.67	6.4	<1	2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-02-19 09:38	-	0.28	-	0.64	5	<1	12	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-02-27 07:18	-	0.7	-	0.71	5.8	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-03-04 09:03	-	0.38	-	0.59	6	<1	2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-03-11 09:35	-	0.39	-	0.71	6	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-03-21 08:04	-	0.34	-	0.38	5.7	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-03-26 09:13	-	0.39	-	0.68	6.8	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-04-01 08:47	-	0.68	-	0.68	6.6	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-04-08 09:15	-	0.28	-	0.71	6.8	<1	2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-04-15 08:55	-	0.43	-	0.69	8.3	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-04-17 09:30	-	0.29	-	0.71	8.3	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-04-24 08:17	-	0.31	-	0.35	7.6	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-04-29 09:26	-	0.18	-	0.65	8.8	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-05-06 09:28	-	0.23	-	0.64	8.7	<1	10	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-05-23 10:15	-	0.29	-	0.47	9.9	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-06-18 09:00	-	0.2	-	0.47	13.7	<1	150	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-06-19 11:24	-	0.24	-	0.43	14.8	<1	72	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-06-25 09:22	-	0.2	-	0.65	13.9	<1	130	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-07-08 11:48	-	0.26	-	0.44	13.5	<1	100	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-07-16 11:19	-	0.34	-	0.39	13.4	<1	72	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-07-22 10:44	-	0.24	-	0.47	14	<1	60	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-07-29 10:01	-	0.19	-	0.47	14.5	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-08-14 06:47	-	0.17	-	0.59	15.3	<1	52	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-08-19 10:25	-	0.27	-	0.41	15	<1	30	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-08-26 11:46	-	0.21	-	0.65	15	<1	44	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-08-29 10:29	-	0.23	-	0.48	16	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-09-03 11:38	-	0.2	-	0.44	16.1	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-09-10 12:26	-	0.26	-	0.61	16.3	<1	14	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-09-14 08:21	-	0.21	-	0.28	15.8	<1	15	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-09-21 08:45	-	0.26	-	1.01	16	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-10-06 08:52	-	0.25	-	0.48	14.7	<1	26	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-10-14 09:03	-	0.29	-	0.65	14.5	<1	60	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-10-24 10:55	-	0.33	-	0.57	13.3	<1	46	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-10-27 09:58	-	0.36	-	0.52	12	<1	4	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-10-31 10:23	-	0.38	-	0.54	11.7	<1	10	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-11-03 09:38	-	0.29	-	0.52	11.4	<1	14	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-11-14 08:28	-	0.27	-	0.25	10.1	<1	46	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-11-19 08:32	-	0.28	-	0.29	9.8	<1	6	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-11-24 09:06	-	0.26	-	0.58	9.5	<1	4	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-12-01 08:42	-	0.23	-	0.47	8.9	<1	2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-12-08 09:22	-	0.26	-	0.67	8.5	<1	<2	<1
GRAB	COQ-608	Eagle Mountain Reservoir	2025-12-15 09:01	-	0.27	-	0.58	8.5	<1	10	<1
GRAB	COQ-610	550 Thompson	2025-01-07 09:31	-	0.13	-	0.6	7.5	<1	<2	<1

GRAB	COQ-610	550 Thompson	2025-01-08 12:57	-	0.18	-	0.48	8	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-01-10 12:52	-	0.19	-	0.63	7.2	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-01-16 07:42	-	0.14	-	0.72	7.3	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-01-17 13:02	-	0.15	-	0.59	7.1	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-01-21 07:18	-	0.12	-	0.4	6.8	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-01-23 13:11	-	1	-	0.41	6.1	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-01-31 12:51	-	0.15	-	0.55	5.4	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-02-18 07:45	-	0.2	-	0.55	5	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-02-23 07:49	-	0.18	-	0.84	4.6	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-02-26 07:59	-	0.17	-	0.37	5.8	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-03-27 12:27	-	0.15	-	0.28	6	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-03-03 07:58	-	0.17	-	0.6	6.5	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-03-05 07:59	-	0.16	-	0.43	6.6	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-03-12 08:26	-	0.45	-	0.59	6.5	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-03-17 07:36	-	0.17	-	0.7	6.5	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-03-26 08:00	-	0.13	-	0.43	6.8	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-03-27 07:02	-	0.15	-	0.66	7	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-04-03 06:31	-	0.13	-	0.76	7.3	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-04-09 07:06	-	0.2	-	0.48	7.9	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-04-10 06:23	-	0.13	-	0.69	8.3	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-04-16 07:13	-	0.12	-	0.59	7.8	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-04-23 07:59	-	0.18	-	0.48	8.9	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-04-30 07:56	-	0.12	-	0.6	9.7	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-05-01 08:21	-	0.14	-	0.57	7.3	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-05-07 08:12	-	0.17	-	0.64	10.4	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-05-13 13:34	-	0.16	-	0.14	11.1	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-05-14 08:36	-	0.17	-	0.67	4	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-05-21 07:20	-	0.13	-	0.45	11.4	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-05-23 12:13	-	0.21	-	0.45	11.1	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-05-28 07:30	-	0.11	-	0.54	11.5	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-06-03 14:01	-	0.2	-	0.49	12.8	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-06-06 07:31	-	0.14	-	0.46	12.7	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-06-10 07:38	-	0.12	-	0.47	12.6	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-06-25 07:48	-	0.18	-	0.43	13.8	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-06-27 12:00	-	0.2	-	0.52	13.5	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-06-30 08:46	-	0.41	-	0.44	13.9	<1	6	<1
GRAB	COQ-610	550 Thompson	2025-07-02 11:53	-	0.17	-	0.5	13.5	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-07-09 07:24	-	0.11	-	0.37	14.4	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-07-11 12:29	-	0.11	-	0.44	14.5	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-07-13 13:37	-	0.2	-	0.52	14.7	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-07-14 12:24	-	0.18	-	0.4	14.4	<1	78	<1
GRAB	COQ-610	550 Thompson	2025-07-18 07:21	-	0.1	-	0.35	15.5	<1	8	<1
GRAB	COQ-610	550 Thompson	2025-07-24 06:36	-	0.12	-	0.6	15.8	<1	10	<1
GRAB	COQ-610	550 Thompson	2025-07-31 08:46	-	0.11	-	0.28	16.3	<1	18	<1
GRAB	COQ-610	550 Thompson	2025-08-07 07:42	-	0.11	-	0.13	17.2	<1	50	<1
GRAB	COQ-610	550 Thompson	2025-08-14 12:34	-	0.1	-	0.35	17	<1	12	<1
GRAB	COQ-610	550 Thompson	2025-08-16 10:47	-	0.09	-	0.47	17.8	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-08-20 06:33	-	0.1	-	0.61	16.9	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-08-21 12:15	-	0.12	-	0.41	16.8	<1	LA	<1
GRAB	COQ-610	550 Thompson	2025-08-27 12:17	-	0.24	-	0.7	16.8	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-08-28 11:52	-	0.11	-	0.51	17.2	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-08-29 12:28	-	0.15	-	0.39	17.3	<1	4	<1
GRAB	COQ-610	550 Thompson	2025-09-05 12:24	-	0.12	-	0.37	17.5	<1	6	<1
GRAB	COQ-610	550 Thompson	2025-09-12 12:57	-	0.12	-	0.47	18	<1	18	<1
GRAB	COQ-610	550 Thompson	2025-09-18 12:49	-	0.11	-	0.42	18.4	<1	16	<1
GRAB	COQ-610	550 Thompson	2025-10-01 13:24	-	0.12	-	0.44	17.4	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-10-08 06:56	-	0.11	-	0.37	16	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-10-09 13:03	-	0.14	-	0.44	15.9	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-10-10 07:20	-	0.24	-	0.37	15.7	<1	6	<1
GRAB	COQ-610	550 Thompson	2025-10-15 07:06	-	0.16	-	0.44	15.1	<1	30	<1
GRAB	COQ-610	550 Thompson	2025-10-16 06:42	-	0.18	-	0.59	14.2	<1	14.2	<1
GRAB	COQ-610	550 Thompson	2025-10-19 07:26	-	0.12	-	0.26	14.4	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-10-21 07:04	-	0.18	-	0.62	14.2	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-10-22 08:14	-	0.14	-	0.51	13.9	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-10-29 07:40	-	0.15	-	0.34	12.5	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-10-30 07:15	-	0.12	-	0.48	12.4	<1	NA	<1
GRAB	COQ-610	550 Thompson	2025-11-02 07:43	-	0.14	-	0.56	12.3	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-11-07 07:50	-	0.14	-	0.15	11.2	<1	2	<1
GRAB	COQ-610	550 Thompson	2025-11-09 13:05	-	0.1	-	0.2	11.6	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-11-12 07:13	-	0.11	-	0.42	11	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-11-14 10:32	-	1.1	-	0.52	11.5	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-11-20 11:21	-	0.28	-	0.49	10.8	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-11-28 07:56	-	0.17	-	0.39	10	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-12-02 12:12	-	0.12	-	0.56	9	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-12-06 07:59	-	0.1	-	0.45	8.9	<1	<2	<1
GRAB	COQ-610	550 Thompson	2025-12-13 07:18	-	0.11	-	0.61	8.7	<1	8.7	<1
GRAB	COQ-610	550 Thompson	2025-12-17 07:51	-	0.11	-	0.3	8.9	<1	8	<1
GRAB	COQ-610	550 Thompson	2025-12-24 11:55	-	0.1	-	0.42	10.5	<1	NA	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-03 08:43	-	0.42	-	0.48	6.8	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-08 12:22	-	0.27	-	0.5	7	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-09 13:20	-	0.26	-	0.76	6.1	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-15 13:39	-	0.4	-	0.4	6.8	<1	6	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-16 07:41	-	0.25	-	0.49	6.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-20 12:37	-	0.24	-	0.35	6.3	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-22 13:37	-	0.25	-	0.36	6.1	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-01-30 13:38	-	0.31	-	0.52	5.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-02-20 12:52	-	0.39	-	0.31	5.6	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-02-21 10:59	-	0.2	-	0.27	5.7	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-02-23 10:21	-	0.2	-	0.12	6.3	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-02-25 09:52	-	0.3	-	0.13	6.1	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-02-26 13:14	-	0.58	-	0.21	6.6	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-01 12:30	-	0.52	-	0.47	6.9	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-05 12:10	-	1.1	-	0.5	6.9	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-06 13:27	-	0.51	-	0.17	7.2	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-07 08:34	-	0.32	-	0.52	7.5	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-07 12:10	-	0.27	-	0.38	7.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-12 13:42	-	0.39	-	0.32	7.1	<1	<2	<1

GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-20 09:54	-	0.26	-	0.22	7.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-28 07:34	-	0.4	-	0.47	8.2	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-03-28 12:44	-	0.39	-	0.49	7.7	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-04-03 09:38	-	0.32	-	0.26	8.2	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-04-10 11:12	-	0.28	-	0.76	8.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-04-11 11:46	-	0.54	-	0.61	7.9	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-04-14 13:09	-	0.31	-	0.41	8.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-04-24 08:34	-	0.29	-	0.58	8.1	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-04-27 10:10	-	0.16	-	0.04	12.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-04-29 10:36	-	0.39	-	0.44	9.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-05-04 11:04	-	0.18	-	0.18	11.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-05-09 12:21	-	0.24	-	0.28	10.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-05-14 11:45	-	0.34	-	0.34	10.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-05-21 10:41	-	0.29	-	0.47	10.7	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-05-26 13:00	-	0.28	-	0.37	11.8	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-06-12 11:02	-	0.24	-	0.55	12.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-06-16 12:47	-	0.31	-	0.31	12	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-06-21 10:05	-	0.18	-	0.49	13.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-06-27 08:05	-	0.34	-	0.52	13	<1	130	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-07-11 08:00	-	0.24	-	0.44	14.8	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-07-17 12:37	-	0.2	-	0.33	13.7	<1	LA	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-07-23 11:38	-	0.18	-	0.28	14.5	<1	4	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-07-25 10:37	-	0.21	-	0.28	14.6	<1	28	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-08-08 10:46	-	0.21	-	0.33	15.8	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-08-14 12:55	-	0.17	-	0.27	16.4	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-08-20 08:21	-	0.41	-	0.54	16.3	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-08-21 11:45	-	0.33	-	0.42	15.8	<1	LA	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-08-23 10:40	-	0.22	-	0.13	18.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-08-26 08:13	-	0.21	-	0.26	16.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-08-28 11:19	-	0.27	-	0.62	15.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-09-03 12:55	-	0.27	-	0.5	16	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-09-09 07:41	-	0.22	-	0.45	16.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-09-18 08:10	-	0.18	-	0.59	18	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-09-25 12:24	-	0.26	-	0.57	15.9	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-09-29 08:13	-	0.21	-	0.33	17.4	<1	8	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-09 08:32	-	0.34	-	0.51	15	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-14 12:08	-	0.29	-	0.53	15.1	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-17 10:45	-	0.27	-	0.41	14.9	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-18 12:03	-	0.22	-	0.55	14.8	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-21 13:02	-	0.32	-	0.32	14.3	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-22 11:56	-	0.36	-	0.46	14	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-24 08:55	-	0.32	-	0.45	14	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-25 12:55	-	0.26	-	0.37	13.7	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-28 12:55	-	2.7	-	0.51	12.5	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-30 12:15	-	0.35	-	0.39	11.9	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-10-31 11:34	-	0.32	-	0.32	12.1	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-11-06 11:22	-	0.36	-	0.45	11.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-11-12 11:06	-	0.27	-	0.24	11.1	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-11-15 12:25	-	0.2	-	0.33	11.1	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-11-18 12:13	-	0.23	-	0.25	10.5	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-11-19 12:20	-	0.26	-	0.21	10.5	<1	20	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-11-26 11:14	-	0.32	-	0.67	9.7	<1	14	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-12-03 12:05	-	0.29	-	0.48	8.4	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-12-10 12:00	-	0.33	-	0.44	8.4	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-12-11 12:05	-	0.28	-	0.6	8.7	<1	2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-12-15 10:11	-	0.24	-	0.28	10.6	<1	<2	<1
GRAB	COQ-611	Leeders St. & Rogers Ave.	2025-12-17 11:19	-	0.21	-	0.51	8.6	<1	2	<1
GRAB	COQ-612	1762 Hampton Drive	2025-01-02 08:49	<1	8.4	<1	0.23	7.8	-	76	-
GRAB	COQ-612	1762 Hampton Drive	2025-01-03 10:56	-	0.3	-	0.2	6.8	<1	<2	<1
GRAB	COQ-612	1762 Hampton Drive	2025-01-07 08:34	-	0.27	-	0.21	8.4	<1	2	<1
GRAB	COQ-612	1762 Hampton Drive	2025-01-10 08:12	-	0.23	-	0.15	7.8	<1	4	<1
GRAB	COQ-612	1762 Hampton Drive	2025-01-14 08:13	-	0.23	-	0.17	7.6	<1	2	<1
GRAB	COQ-612	1762 Hampton Drive	2025-01-21 08:54	-	0.2	-	0.15	7.3	<1	20	<1
GRAB	COQ-612	1762 Hampton Drive	2025-01-23 11:42	-	0.22	-	0.13	6.6	<1	18	<1
GRAB	COQ-612	1762 Hampton Drive	2025-01-29 08:25	-	0.18	-	0.16	6.8	<1	8	<1
GRAB	COQ-612	1762 Hampton Drive	2025-02-19 08:53	-	0.3	-	0.22	6	<1	80	<1
GRAB	COQ-612	1762 Hampton Drive	2025-02-21 08:09	-	0.2	-	0.18	6	<1	26	<1
GRAB	COQ-612	1762 Hampton Drive	2025-02-26 07:41	-	0.45	-	0.18	5.5	<1	12	<1
GRAB	COQ-612	1762 Hampton Drive	2025-02-27 07:57	-	0.54	-	0.18	6	<1	6	<1
GRAB	COQ-612	1762 Hampton Drive	2025-03-04 08:26	-	0.39	-	0.13	6.6	<1	4	<1
GRAB	COQ-612	1762 Hampton Drive	2025-03-11 09:02	-	0.31	-	0.13	6.7	<1	8	<1
GRAB	COQ-612	1762 Hampton Drive	2025-03-21 08:29	-	0.32	-	0.05	7	<1	70	<1
GRAB	COQ-612	1762 Hampton Drive	2025-03-26 08:26	-	0.3	-	0.16	7.3	<1	4	<1
GRAB	COQ-612	1762 Hampton Drive	2025-04-01 08:01	-	0.36	-	0.15	8.1	<1	12	<1
GRAB	COQ-612	1762 Hampton Drive	2025-04-06 08:40	-	0.23	-	0.14	8.5	<1	24	<1
GRAB	COQ-612	1762 Hampton Drive	2025-04-08 08:15	-	0.36	-	0.19	8.3	<1	4	<1
GRAB	COQ-612	1762 Hampton Drive	2025-04-17 08:30	-	0.21	-	0.17	8.8	<1	10	<1
GRAB	COQ-612	1762 Hampton Drive	2025-04-24 08:51	-	0.29	-	0.12	9.3	<1	6	<1
GRAB	COQ-612	1762 Hampton Drive	2025-04-29 08:43	-	0.22	-	0.14	8.9	<1	8	<1
GRAB	COQ-612	1762 Hampton Drive	2025-05-06 08:42	-	0.23	-	0.14	11.1	<1	24	<1
GRAB	COQ-612	1762 Hampton Drive	2025-05-15 08:56	-	0.23	-	0.09	11.7	<1	30	<1
GRAB	COQ-612	1762 Hampton Drive	2025-05-23 10:37	-	0.21	-	0.12	12	<1	30	<1
GRAB	COQ-612	1762 Hampton Drive	2025-05-30 12:59	-	0.24	-	0.18	13.1	<1	240	<1
GRAB	COQ-612	1762 Hampton Drive	2025-06-03 11:29	-	0.32	-	0.11	13.3	<1	220	<1
GRAB	COQ-612	1762 Hampton Drive	2025-06-18 08:10	-	0.18	-	0.14	15	<1	70	<1
GRAB	COQ-612	1762 Hampton Drive	2025-06-19 10:54	-	0.18	-	0.13	16	<1	84	<1
GRAB	COQ-612	1762 Hampton Drive	2025-06-25 08:49	-	0.18	-	0.13	15.3	<1	250	<1
GRAB	COQ-612	1762 Hampton Drive	2025-07-08 11:27	-	0.2	-	0.14	17.2	<1	340	<1
GRAB	COQ-612	1762 Hampton Drive	2025-07-16 10:51	-	0.19	-	0.14	17.6	<1	510	<1
GRAB	COQ-612	1762 Hampton Drive	2025-07-22 10:11	-	0.17	-	0.14	18.3	<1	18.3	<1
GRAB	COQ-612	1762 Hampton Drive	2025-07-29 09:06	-	0.16	-	0.13	18.2	<1	94	<1
GRAB	COQ-612	1762 Hampton Drive	2025-08-14 07:27	-	0.19	-	0.11	16.3	<1	100	<1
GRAB	COQ-612	1762 Hampton Drive	2025-08-19 09:56	-	0.17	-	0.1	19	<1	84	<1
GRAB	COQ-612	1762 Hampton Drive	2025-08-21 07:44	-	0.2	-	0.03	18.3	<1	LA	<1
GRAB	COQ-612	1762 Hampton Drive	2025-08-26 11:12	-	0.2	-	0.12	19.5	<1	18	<1
GRAB	COQ-612	1762 Hampton Drive	2025-08-28 08:25	-	0.18	-	0.13	19.5	<1	22	<1
GRAB	COQ-612	1762 Hampton Drive	2025-09-03 11:04	-	0.24	-	0.11	19.6	<1	<2	<1

GRAB	COQ-612	1762 Hampton Drive	2025-09-10 11:59	-	0.21	-	0.11	19.7	<1	18	<1
GRAB	COQ-612	1762 Hampton Drive	2025-09-14 08:49	-	0.19	-	0.15	18.3	<1	32	<1
GRAB	COQ-612	1762 Hampton Drive	2025-09-21 09:14	-	0.19	-	0.15	18.3	<1	22	<1
GRAB	COQ-612	1762 Hampton Drive	2025-10-06 08:12	-	0.19	-	0.13	17	<1	38	<1
GRAB	COQ-612	1762 Hampton Drive	2025-10-14 08:33	-	0.31	-	0.13	16.3	<1	200	<1
GRAB	COQ-612	1762 Hampton Drive	2025-10-20 08:47	-	0.2	-	0.15	14.9	<1	54	<1
GRAB	COQ-612	1762 Hampton Drive	2025-10-24 09:58	-	0.25	-	0.14	14.3	<1	200	<1
GRAB	COQ-612	1762 Hampton Drive	2025-10-27 08:47	-	0.23	-	0.13	13.5	<1	40	<1
GRAB	COQ-612	1762 Hampton Drive	2025-10-30 10:54	-	0.3	-	0.14	13.7	<1	110	<1
GRAB	COQ-612	1762 Hampton Drive	2025-11-03 09:04	-	0.26	-	0.14	12.9	<1	NA	<1
GRAB	COQ-612	1762 Hampton Drive	2025-11-14 08:53	-	0.22	-	0.15	11.9	<1	170	<1
GRAB	COQ-612	1762 Hampton Drive	2025-11-19 08:57	-	0.24	-	0.02	11.5	<1	66	<1
GRAB	COQ-612	1762 Hampton Drive	2025-11-24 08:34	-	0.22	-	0.17	11	<1	68	<1
GRAB	COQ-612	1762 Hampton Drive	2025-12-01 08:07	-	0.22	-	0.14	10.3	<1	48	<1
GRAB	COQ-612	1762 Hampton Drive	2025-12-08 08:36	-	0.26	-	0.13	8.9	<1	14	<1
GRAB	COQ-612	1762 Hampton Drive	2025-12-10 08:57	-	0.23	-	0.14	9.1	<1	98	<1
GRAB	COQ-612	1762 Hampton Drive	2025-12-15 08:22	-	0.28	-	0.13	9.5	<1	54	<1
GRAB	COQ-612	1762 Hampton Drive	2025-12-22 08:37	-	0.21	-	0.21	9.3	<1	NA	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-01-02 09:03	-	0.48	-	0.62	7	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-01-07 08:53	-	0.5	-	0.42	7.9	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-01-10 08:33	-	0.35	-	0.31	6.9	<1	18	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-01-14 08:30	-	0.27	-	0.35	6.6	<1	6	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-02-19 09:26	-	0.29	-	0.38	5.1	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-02-21 08:25	-	0.23	-	0.54	6	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-02-27 07:42	-	0.36	-	0.4	6	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-03-04 08:40	-	0.8	-	0.42	6.1	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-03-11 09:22	-	0.31	-	0.43	6.3	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-03-21 08:17	-	0.37	-	0.17	5.8	<1	24	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-03-26 08:48	-	0.41	-	0.54	7.5	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-04-01 08:34	-	0.39	-	0.54	6.9	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-04-08 08:58	-	0.29	-	0.41	8	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-04-15 08:35	-	0.32	-	0.5	8.5	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-04-17 09:07	-	0.27	-	0.54	8.7	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-04-24 08:33	-	0.32	-	0.22	8.9	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-04-29 09:03	-	0.24	-	0.49	9	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-05-06 09:13	-	0.27	-	0.41	11.3	<1	20	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-05-15 08:40	-	0.43	-	0.17	10.9	<1	4	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-05-23 10:27	-	0.75	-	0.22	10.6	<1	34	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-06-18 08:41	-	0.25	-	0.45	17.2	<1	12	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-06-19 11:08	-	0.27	-	0.46	13.9	<1	14	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-06-25 09:06	-	0.26	-	0.38	13.9	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-07-08 11:37	-	0.21	-	0.4	14.9	<1	40	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-07-16 11:03	-	0.34	-	0.45	15.7	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-07-22 10:23	-	0.22	-	0.61	16.3	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-07-29 09:31	-	0.19	-	0.59	16.3	<1	4	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-08-14 07:01	-	0.23	-	0.62	16.9	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-08-19 10:11	-	0.18	-	0.24	16.9	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-08-26 11:30	-	0.26	-	0.37	17.3	<1	28	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-08-28 08:42	-	0.28	-	0.31	16.8	<1	16	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-09-03 11:26	-	0.26	-	0.27	17.7	<1	4	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-09-10 12:12	-	0.24	-	0.17	17.6	<1	4	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-09-14 08:36	-	0.2	-	0.21	16.8	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-09-21 09:03	-	0.22	-	0.28	16.6	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-10-06 08:31	-	0.24	-	0.24	15.5	<1	12	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-10-14 08:48	-	0.3	-	0.43	14.5	<1	4	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-10-24 10:25	-	0.3	-	0.53	13	<1	2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-10-27 09:08	-	0.29	-	0.55	13	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-10-30 11:09	-	0.32	-	0.4	12.3	<1	8	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-11-03 09:27	-	0.31	-	0.33	11.8	<1	18	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-11-14 08:40	-	0.29	-	0.1	10.6	<1	20	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-11-19 08:43	-	0.27	-	0.1	10.2	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-11-24 08:52	-	0.25	-	0.31	10	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-12-01 08:26	-	0.35	-	0.4	9	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-12-08 09:01	-	0.26	-	0.49	8.6	<1	<2	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-12-10 09:16	-	0.27	-	0.55	8.7	<1	6	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-12-15 08:44	-	0.24	-	0.51	8.5	<1	4	<1
GRAB	COQ-613	Eagle Summit Reservoir, Gate	2025-12-22 08:50	-	0.23	-	0.55	8.5	<1	NA	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-01-08 08:24	-	0.24	-	0.16	7.6	<1	3	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-01-09 09:05	-	0.23	-	0.21	7.3	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-01-15 08:57	-	0.32	-	0.22	7.1	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-02-20 08:39	-	0.21	-	0.32	4	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-02-23 11:28	-	0.3	-	0.23	5	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-02-26 08:37	-	0.57	-	0.31	5.5	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-03-05 10:45	-	0.27	-	0.22	6.8	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-03-06 08:33	-	0.27	-	0.2	6.7	<1	4	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-03-13 08:34	-	0.4	-	0.37	6.8	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-03-20 10:09	-	0.26	-	0.25	7.6	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-03-26 08:32	-	0.33	-	0.25	7.9	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-04-04 08:34	-	0.24	-	0.21	7.5	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-04-09 12:05	-	0.24	-	0.23	9.1	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-04-14 08:45	-	0.22	-	0.23	9	<1	4	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-04-26 08:35	-	0.2	-	0.29	8.3	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-05-30 10:18	-	0.19	-	0.25	11	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-05-03 07:42	-	0.2	-	0.24	11.6	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-05-06 07:49	-	0.33	-	0.2	11.8	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-05-13 09:14	-	0.24	-	0.34	12.4	<1	6	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-05-21 11:33	-	0.26	-	0.2	12	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-05-26 08:50	-	0.3	-	0.18	12.8	<1	6	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-06-03 12:57	-	0.26	-	0.26	13.8	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-06-15 10:05	-	0.2	-	0.15	14.9	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-06-19 11:15	-	0.2	-	0.09	15.4	<1	4	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-06-25 07:38	-	0.2	-	0.21	14.4	<1	6	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-06-27 08:34	-	0.19	-	0.22	14.4	<1	20	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-07-11 08:31	-	0.17	-	0.24	16	<1	28	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-07-17 08:36	-	0.18	-	0.18	17.8	<1	28	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-07-24 09:04	-	0.19	-	0.22	16.5	<1	4	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-07-25 09:47	-	0.21	-	0.26	18.3	<1	20	<1

GRAB	COQ-614	Buoy Drive and Quay Place	2025-07-30 10:27	-	0.24	-	0.11	18.5	<1	180	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-08-14 08:45	-	0.16	-	0.16	19	<1	8	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-08-20 09:12	-	0.22	-	0.12	18.6	<1	24	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-09-21 10:56	-	0.27	-	0.11	18.2	<1	16	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-08-27 08:14	-	0.19	-	0.16	18.8	CG	270	CG
GRAB	COQ-614	Buoy Drive and Quay Place	2025-08-28 12:06	<1	0.24	<1	0.25	18.8	-	<2	-
GRAB	COQ-614	Buoy Drive and Quay Place	2025-08-29 09:30	-	0.22	-	0.11	19	<1	8	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-09-05 08:32	-	0.23	-	0.23	19.1	<1	32	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-09-09 10:24	-	0.22	-	0.33	19	<1	8	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-09-18 08:56	-	0.2	-	0.2	18.9	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-09-25 08:41	-	0.27	-	0.13	17.9	<1	4	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-09-26 07:40	-	0.21	-	0.25	18	<1	10	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-10-07 08:52	-	0.23	-	0.51	16.5	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-10-14 08:25	-	0.23	-	0.14	15.6	<1	60	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-10-17 11:11	-	0.21	-	0.29	14.9	<1	90	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-10-18 08:38	-	0.23	-	0.17	14.8	<1	50	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-10-22 08:32	-	0.36	-	0.13	14.1	<1	14	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-10-28 08:29	-	0.24	-	0.4	13.2	<1	10	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-11-04 09:23	-	0.27	-	0.11	12.2	<1	6	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-11-08 12:16	-	0.21	-	0.11	11.7	<1	10	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-11-12 08:25	-	0.19	-	0.13	11.2	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-11-15 09:08	-	0.2	-	0.13	11.4	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-11-18 08:51	-	0.2	-	0.18	11.3	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-11-25 07:52	-	0.21	-	0.15	10.6	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-12-03 08:20	-	0.24	-	0.26	9.2	<1	10	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-12-05 11:32	-	0.22	-	0.16	9.1	<1	2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-12-10 08:47	-	0.28	-	0.13	9.1	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-12-16 12:29	-	0.22	-	0.21	9.1	<1	<2	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-12-24 11:50	-	0.23	-	0.26	8.4	<1	NA	<1
GRAB	COQ-614	Buoy Drive and Quay Place	2025-12-31 12:24	-	0.35	-	0.25	7.5	<1	NA	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-01-07 08:40	-	0.48	-	0.19	6.3	<1	36	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-01-15 08:20	-	0.59	-	0.4	6.8	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-02-23 12:46	-	0.28	-	0.87	6.5	<1	2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-01-23 08:35	-	0.29	-	0.39	5.8	<1	2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-01-31 10:46	-	0.25	-	0.58	5.5	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-02-03 07:34	-	0.46	-	0.21	5	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-02-10 10:39	-	0.28	-	0.21	4.4	<1	4	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-02-20 08:01	-	0.23	-	0.24	4.9	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-02-23 08:51	-	0.29	-	0.69	4.9	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-03-05 07:49	-	0.57	-	0.14	7.3	<1	8	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-03-11 09:07	-	0.51	-	0.25	7.1	<1	8	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-03-12 08:08	-	0.6	-	0.37	6.7	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-03-18 07:47	-	0.52	-	0.06	6.8	<1	2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-03-19 10:58	-	0.51	-	0.29	7	<1	6	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-03-26 07:49	-	0.46	-	0.24	7	<1	14	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-04-04 07:19	-	0.49	-	0.28	8.1	<1	2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-04-07 08:04	-	0.51	-	0.51	9.2	<1	16	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-04-08 08:31	-	0.31	-	0.24	7.9	<1	30	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-04-11 09:48	-	0.39	-	0.22	9.1	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-04-16 07:50	-	0.28	-	0.74	9.2	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-04-23 07:50	-	0.37	-	0.24	10.5	<1	2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-04-28 08:02	-	0.28	-	0.31	11.7	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-01 10:19	-	0.26	-	0.46	10.3	<1	16	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-02 09:32	-	0.26	-	0.44	11.4	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-06 07:51	-	0.49	-	0.2	11.6	<1	10	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-08 10:05	-	0.32	-	0.22	12.5	<1	14	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-09 10:35	-	0.29	-	0.22	12.5	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-13 08:03	-	0.37	-	0.15	12.5	<1	14	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-20 07:48	-	0.34	-	0.11	11.5	<1	20	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-05-27 07:34	-	0.38	-	0.08	12.5	<1	20	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-06-03 09:11	-	0.38	-	0.19	13.3	<1	8	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-06-11 07:51	-	0.28	-	0.09	15.4	<1	28	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-06-17 08:10	-	0.27	-	0.77	15.4	<1	6	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-06-26 07:49	-	0.46	-	0.61	14.3	<1	<2	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-07-09 08:22	-	0.3	-	0.22	17.1	<1	110	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-07-16 08:00	-	0.31	-	0.11	17.4	<1	28	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-07-30 07:47	-	0.3	-	0.23	18.5	<1	62	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-08-11 07:51	-	0.26	-	0.29	17.9	<1	74	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-08-25 07:57	-	0.32	-	0.1	18.8	<1	66	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-09-03 08:14	-	0.28	-	0.24	19.7	<1	20	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-09-09 07:50	-	0.3	-	0.05	18.4	<1	20	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-09-18 07:48	-	0.29	-	0.57	18.2	<1	14	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-09-22 07:49	-	0.25	-	0.19	18	<1	22	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-10-02 08:53	-	0.33	-	0.36	17.2	<1	66	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-10-06 08:26	-	0.31	-	0.19	16.3	<1	54	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-10-15 08:18	-	0.38	-	0.76	14.9	<1	72	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-10-22 08:43	-	0.38	-	0.19	14.2	<1	120	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-10-30 08:06	-	0.38	-	0.38	12.3	<1	32	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-11-05 07:59	-	0.39	-	0.15	11.7	<1	64	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-11-06 08:16	-	0.4	-	0.15	11.9	<1	36	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-11-10 09:29	-	0.69	-	0.76	11.3	<1	10	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-11-13 08:35	-	0.3	-	0.64	11.3	<1	NA	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-11-17 08:01	-	0.24	-	0.12	10.8	<1	12	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-11-26 08:48	-	0.36	-	0.17	9.9	<1	4	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-12-01 07:35	-	0.42	-	0.18	9	<1	24	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-12-08 07:41	-	0.37	-	0.05	8.7	<1	24	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-12-15 07:41	-	0.51	-	0.11	8.8	<1	14	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-12-23 08:35	-	0.39	-	0.21	7.9	<1	NA	<1
GRAB	COQ-615	347 Crouch Ave - Reservoir	2025-12-30 08:18	-	0.36	-	0.16	7.1	<1	NA	<1





City of Coquitlam  
Engineering and Public Works Department

3000 Guildford Way  
Coquitlam, B.C. V3B 7N2

604-927-3500  
epw@coquitlam.ca

coquitlam.ca



Coquitlam