



City of Coquitlam

Contract Documents 77816

Thomas Ave Frontage Improvements



Table of Contents

Contract No. 77816**Thomas Ave Frontage Improvements****Project Construction Documents****Table of Contents**

The complete **Project Construction Documents** consist of the following parts:

1. Standard Documents – supplied	Page
Table of Contents	TC 1 to TC 2
Invitation to Tender	IN 1 to IN 2
Instruction to Tenderers	
▪ Table of Contents:	IT 1
▪ Instructions to Tenderers	IT 2 to IT 12
Form of Tender, including	
▪ Form of Tender Summary	FT 1
▪ Form of Tender	FT 2 to FT 4
▪ Appendix 1 – Schedule of Quantities and Unit Prices	FT 5 to FT 6
▪ Appendix 2 – Preliminary Construction Schedule	FT 7
▪ Appendix 3 – Experience of Superintendent	FT 8
▪ Appendix 4 – Comparable Work Experience	FT 9
▪ Appendix 5 – Subcontractors	FT 10
▪ Appendix 6 – Bid Bond	FT 11
▪ Appendix 7 – Certificate of Compliance for Contract Insurance ..	FT 12
Agreement between Owner and Contractor	AGT 1 to AGT 4
Schedule 1 – Schedule of Contract Documents	AGT 5
Schedule 2 – List of Drawings	AGT 6 to AGT 7
Supplementary General Conditions – Table of Contents	SGC 1 to SGC 2
▪ Supplementary General Conditions, including	SGC 3 to SGC 21
▪ Appendices:	
▪ Appendix I Performance Bond	SGC 16 to SGC 17
▪ Appendix II Labour and Material Payment Bond	SGC 18 to SGC 19
▪ Appendix III Certificate of Insurance	SGC 20
▪ Appendix IV Prime Contractor Designation	SGC 21
Supplementary Contract Specifications	SS 1 to SS 79
Appendix A – Traffic Management Detail Specifications	TMP 1 to TMP 8
Appendix B – Supplementary Detailed Drawings	SDD 1 to SDD 15
Appendix C – As-Built Records	ASB 1 to ASB 39
Appendix D – Street Lighting Inspection Report	SLR 1 to SLR 6
Contract Drawings	Under Separate Cover

2. **Standard Documents – not supplied**

i) (available in the “MMCD – General Conditions, Specifications and Standard Detail Drawings”)

- Instructions to Tenderers
- General Conditions
 - Schedule 17.5.3 – Letter Agreement with Referee
 - Flow Chart – Changes and Extra Work
 - Flow Chart – Dispute Resolution
- Specifications
- Standard Detail Drawings

ii) City of Coquitlam Supplementary Specifications for Contract Documents

Invitation to Tenderers



INVITATION TO TENDER

DATE OF ISSUE: January 19, 2023

Tender No. 77816

Thomas Ave Frontage Improvements

The City of Coquitlam invites tenders for **Contract 77816 – Thomas Ave Frontage Improvements**, generally consisting of the following, but not limited to:

Road improvements on Thomas Avenue between Lebleu Street to Casey Street, approximately 900 meters of Local Road including Concrete Curb & Gutter, Concrete Sidewalk, Storm and Sanitary Connections, Water Service Connections, Street Trees, Pavement Markings, Street Lighting, Retaining Wall, BC Hydro, Shaw & Telus Underground Ducting, and other miscellaneous and incidental works as further described in the Contract Documents.

Tender Documents and Drawings are available for downloading from the City of Coquitlam website: www.coquitlam.ca/BidOpportunities

Printing of Tender documents and drawings is the sole responsibility of the Tenderers.

Tenders submitted must be accompanied by a copy of the original specified 10% Bid Bond and will be received:

On or Before 2:00 pm local time
Thursday, February 9, 2023
(“Closing Date and Time”)

Instructions for Tender Submission

Tender submissions are to be consolidated into one (1) .pdf file and uploaded electronically through QFile, the City’s file transfer service accessed at website: qfile.coquitlam.ca/bid

1. In the “Subject Field” enter: Tender Number and Name
2. **Add consolidated Tender file in PDF format, and Appendix 1 in XLS format**, and Send (Ensure your web browser remains open until you receive 2 emails from Qfile to confirm upload is complete.)

Tenders will not be opened in public. The unevaluated Tender results will be forwarded to all participants by email.

Inquiries

All inquiries are to be submitted in writing by email, no later than 3 full business days prior to Tender Closing Time quoting the Tender Name and Number sent to:

Email: bid@coquitlam.ca

Addenda

Tenderers are required to check the City's website for any updated information and Addenda issued before the Closing Date at: www.coquitlam.ca/BidOpportunities

Any changes to the Tender documentation will be issued by means of written Addenda and posted on the City's website and will form part of the Tender. No amendment of any kind to the Tender is effective unless it is posted in a formal written Addendum on the City website. Upon submitting a Tender, Tenderers will be deemed to have received notice of all Addenda that are posted on the City's website and deemed to have considered the information for inclusion in the Tender submitted.

The City does not retain a bidder's list or bidder's registry. Tenderers are encouraged to register as plan takers and may view the Tender Documents and Drawings by contacting the Vancouver Regional Construction Association (VRCA), website: www.my.vrca.ca, ph: 604-294-3766, or email vrca@vrca.ca, quoting the Coquitlam Tender Reference Number.

Should there be any discrepancy in the documentation provided, the City's original file copy shall prevail.

Tenders shall remain open for acceptance for 60 days following the submission Closing Date.

The City reserves the right to accept or reject any or all Tenders and the lowest or any Tender may not necessarily be accepted. The City also reserves the right to cancel any request for Tender at any time without recourse by the Tenderer.

The City, prior to award of any Tender, may negotiate with the Tenderer presenting the lowest price compliant Tender, for changes in the Work, materials, specifications or conditions without having any duty or obligation to advise any other Tenderers or to allow them to modify their Tenders, and the City will have no liability to any Tenderer as a result of such negotiations or modifications.

The City will not be responsible for any costs incurred by the Tenderer in preparing the Tender.

Procurement of goods and services is conducted in accordance with Chapter 5 of the Canadian Free Trade Agreement (CFTA) and the New West Partnership Trade Agreement (NWPTA).

M. Pain
Purchasing Manager

Instructions to Tenderers

Tender 77816

Thomas Ave Frontage Improvements

INSTRUCTIONS TO TENDERERS

TABLE OF CONTENTS	Page
1 Introduction	IT 2
2 Tender Documents.....	IT 2 to 3
3 Submission of Tenders.....	IT 3
4 Additional Instructions to Tenderers	IT 3 to 5
5 Tender Requirements	IT 5 to 6
6 Qualifications, Modifications, Alternative Tender	IT 6 to 7
7 Approved Equals	IT 7
8 Inspection of the Place of the Work.....	IT 7
9 Interpretation of Contract Documents	IT 7
10 Prices	IT 7 to 8
11 Taxes	IT 8
12 Amendment of Tenders.....	IT 8 to 9
13 Duration of Tenders.....	IT 9
14 Qualifications of Tenders.....	IT 9
15 Award.....	IT 9 to 12
16 Subcontractors.....	IT 12
17 Optional Work	IT 12

INSTRUCTIONS TO TENDERERS

(FOR USE WHEN UNIT PRICES FORM THE BASIS OF PAYMENT - TO BE USED ONLY WITH THE GENERAL CONDITIONS AND OTHER STANDARD DOCUMENTS OF THE UNIT PRICE MASTER MUNICIPAL CONSTRUCTION DOCUMENTS.)

The City of Coquitlam

Contract: **Thomas Ave Frontage Improvements**

Reference No. **77816**

- | | | |
|------------|-------------------------|---|
| 1.0 | Introduction | <p>1.1 These Instructions apply to and govern the preparation of tenders for this <i>Contract</i>. The <i>Contract</i> is generally for the following work:</p> <p>Road improvements on Thomas Avenue between Lebleu Street to Casey Street, approximately 900 meters of Local Road including Concrete Curb & Gutter, Concrete Sidewalk, Storm and Sanitary Connections, Water Service Connections, Street Trees, Pavement Markings, Street Lighting, Retaining Wall, BC Hydro, Shaw & Telus Underground Ducting, and other miscellaneous and incidental works as further described in the Contract Documents.</p> <p>1.2 All inquiries regarding this Tender are to be submitted in writing referencing the Tender Name and Number sent to:</p> <p>E-mail bid@coquitlam.ca</p> <p>All inquiries will be received a minimum of 3 full business days prior to Tender Closing Time.</p> <p>Inquiries received after that time may not receive a response.</p> |
| 2.0 | Tender Documents | <p>2.1 The Tender Documents which a Tenderer should review to prepare a Tender consist of all of the <i>Contract Documents</i> listed in Schedule 1 entitled "Schedule of Contract Documents". Schedule 1 is attached to the Agreement which is included as part of the Tender Package. The <i>Contract Documents</i> include the drawings listed in Schedule 2 to the Agreement, entitled "List of Contract Drawings".</p> <p>2.2 <u>A portion of the Contract Documents are included by reference. Copies of these documents have not been included with the tender package.</u> These documents are the General Conditions, Specifications and Standard Detail Drawings. They are those contained in the publication entitled "Master Municipal Construction Documents - General Conditions, Specifications and Standard Detail Drawings". Refer to Schedule 1 to the Agreement or, if not specified in Schedule 1, then the applicable edition shall be the most recent edition as of the date of the <i>Tender Closing Date</i>. <u>All sections of this publication are by reference included in the Contract Documents.</u></p> <p>2.3 Any additional information made available to Tenderers prior to the Tender Closing Time by the Owner or representative of the Owner, such as geotechnical reports or as-built plans, which is not expressly included in Schedule 1 or Schedule 2 to the Agreement, is not included in the Contract Documents. Such additional information is made available only</p> |

for the assistance of Tenderers who must make their own judgments about its reliability, accuracy, completeness and relevance to the *Contract*, and neither the Owner nor any representative of the Owner gives any guarantee or representation that the additional information is reliable, accurate, complete or relevant.

3.0 Submission of Tenders

- 3.1 Tenders must be submitted on the Tender Form provided, accompanied by a copy of the original 10% Bid Bond quoting the Tender Name and Number, and be uploaded to the City's file transfer website.

Tenders must be received on or before:

***Tender Closing Time:* 2:00 p.m. local time**

***Tender Closing Date:* February 9, 2023**

For the purpose of the Tender submission, digital copies of original documents and signatures sent electronically are accepted. Original documents are required upon request by the City.

Instructions for Tender Submission

- 3.2 **Tender submissions are to be consolidated into one (1) PDF file and uploaded electronically through QFile, the City's file transfer service accessed at website: <http://qfile.coquitlam.ca/bid>**

1. In the "Subject Field" enter: Tender Number and Name

2. Add consolidated Tender file in PDF format and Appendix 1 in XLS format, and Send (ensure your web browser remains open until you receive 2 emails from Qfile to confirm upload is complete and was sent to email: bid@coquitlam.ca)

Tenderers are responsible to allow for ample time to complete the submission process. For assistance, phone 604-927-3060 or Fax 604-927-3035.

- 3.3 Tenders submitted shall be deemed to be received when displayed as a new email in the in-box of the above email address. The City will not be responsible for any delay or for any Tenders not received for any reason, including technological delays or issues by either party's network or email program, and the City will not be liable for any damages associated with Tenders not received.
- 3.4 The City reserves the right to accept late Tenders to allow for technological delays. The City also reserves the right to accept Tenders received by fax (604-927-3035) or email: bid@coquitlam.ca.
- BIDS RECEIVED IN-PERSON OR BY COURIER WILL NOT BE ACCEPTED.**
- 3.5 Tenders will not be opened in public. The unevaluated results will be forwarded to participants by email.
- 3.6 Tender submissions are subject to the Freedom of Information and Protection of Privacy Act and contents may be disclosed if required to do so, pursuant to the Act.

4.0 Additional Instructions to Tenderers

Additional Instructions to Tenderers

**Obtaining
Documents**

- 4.1 The following documents which are referred to and form part of the Contract Document package may be obtained as follows:
- Copies of the Master Municipal Construction Documents Volume II (2009), General Conditions, Specifications and Standard Detail Drawings are available separately from:

Support Services Unlimited
Suite 102
211 Columbia Street
Vancouver, B.C. V6A 2R5
Tel: 604-681-0295
Fax: 604-305-0424
 - City of Coquitlam Supplementary Specifications and Detailed Drawings to the MMCD 2009 Edition.

City of Coquitlam Engineering & Public Works Department
3000 Guildford Way
Coquitlam, B.C. V3B 7N2
Tel: 604-927-3500
Fax: 604-927-3525

Copies of the City of Coquitlam Supplementary Specifications and Detailed Drawings to the MMCD 2009 Edition are available for viewing and downloading off the City of Coquitlam website:

[Supplementary Specifications and Detailed Drawings to MMCD](#)

**Test
Excavations**

- 4.2 Prior to the excavation of test holes on road allowances or privately owned property the Tenderer shall obtain permission from the Municipality or Owner of the property and comply with their requirements for restoration of disturbed surfaces and utilities. Failure to comply with Municipal by-laws restricting this practice may result in prosecution of the offending party.

**Business
License**

- 4.3 The successful Tenderer shall provide evidence of a City of Coquitlam Business License or Tri-Cities Intermunicipal Business License prior to commencement of work or supply of materials. For more information, contact Business License Division Ph: 604-927-3085 or apply online at website: [City of Coquitlam Business License](#)

No Claim

- 4.4 Except as expressly and specifically permitted in these Instructions to Tenderers, no Tenderer shall have any claim for any compensation of any kind whatsoever, as a result of participating in this Tender, including accepting a non-compliant bid and by submitting a Tender, each Tenderer shall be deemed to have agreed that it has no claim.

No Cost

- 4.5 The City will not under any circumstances be responsible for any costs incurred by the Tenderer in preparing the Tender.

	Right to Accept or Reject any Tender	4.6	<p>The City reserves the right to accept or reject any or all Tenders and the lowest or any Tender may not necessarily be accepted. In its sole discretion, the City may reject or retain for its consideration, tenders which are nonconforming because they do not contain the content or form required by the instructions to tenderers or for failure to comply with the process for submission set out in these instructions to tenderers.</p> <p>The City specifically reserves the right to reject all Tenders if none is considered to be satisfactory and, in that event, at its option, to call for additional Tenders.</p>
	Negotiation	4.7	<p>The City, prior to award of any Tender, may negotiate with the Tenderer presenting the lowest price compliant Tender, for changes in the Work, materials, specifications or conditions without having any duty or obligation to advise any other Tenderers or to allow them to modify their Tenders, and the City will have no liability to any Tenderer as a result of such negotiations or modifications.</p>
	Cancellation of Tender	4.8	<p>The City reserves the right to cancel any request for Tender at any time without recourse by the Tenderer. The City has the right to not award this work for any reason including choosing to complete the work with the City's own forces.</p>
	Conflict of Interest	4.9	<p>Tenderers shall disclose any actual or potential conflicts of interest and existing business relationships it may have with the City, their elected or appointed officials or employees.</p>
	Collusion	4.10	<p>Tenderers will not discuss or communicate with one another in regards to the preparation of their Tenders. Each Tenderer will ensure that its participation in the Tender process and that of its team members is conducted without collusion or fraud. Failure to comply with this requirement may lead to disqualification without further notice or warning.</p>
5.0	Instruction to Tenderers – Part II		<p>Delete Instructions to Tenderers – Part II Contained in the Edition of the Publication “Master Municipal Construction Documents 2009” and replace with the following:</p>
	Tender Requirements	5.1	<p>A tender should be on the Form of Tender as provided and be signed by the authorized signatory(s) as follows:</p>
		5.1.1	<p>if the tenderer is a partnership or joint venture then the name of the partnership or joint venturer should be included, and each partner or joint venturer should sign personally; if a partner of joint venture is a corporation then such corporation should sign as indicated in paragraph 5.1.3 below; and</p>
		5.1.2	<p>if the tenderer is a corporation then the full name of the corporation should be included, together with the names and signatures of authorized signatories.</p>
		5.1.3	<p>For the purpose of the Tender submission, digital copies of original documents and electronic signatures are accepted. Original documents are required upon request by the City.</p>

- 5.2 A tender must be accompanied by tender security ("*Bid Security*") in the form of:
- 5.2.1 a copy (digital or Electronic copy is acceptable) of the original bid bond in an amount equal to 10% of the Tender Price, issued by a surety licensed to carry on the business of suretyship in British Columbia in a form reasonably satisfactory to the *Owner*;
- 5.3 Tenderer should be competent and capable of performing the various items of work. Tenderer shall complete the following statement sheets appended to the Form of Tender:
- 5.3.1 Appendix 1 – the Schedule of Quantities and Prices;
 - 5.3.2 Appendix 2 – a "*Preliminary Construction Schedule*", generally in the form attached as Appendix 2 to the Form of Tender, and showing *Substantial Performance* by the date or within the duration, shown in paragraph 2.2 of the Form of Tender.
 - 5.3.3 Appendix 3 – name and brief description of the previous experience of the *Superintendent* the tenderer will use for the *Work*;
 - 5.3.4 Appendix 4 – a list of previous comparable work, including a brief description of that work, approximate contract value, and references (with phone numbers);
 - 5.3.5 Appendix 5 – a complete list of all subcontractors, if any, that the tenderer will use for the *Work* including full names.; and
 - 5.3.6 Appendix 7 – is provided for information only, to indicate the Contract Insurance is to be submitted by the successful Tenderer upon Notice of Award.
- 5.4 The successful tenderer will, within 15 *Days* of receipt of the written *Notice of Award*, be required to deliver to the *Owner* the items listed in FT 5.1.1, including a Performance Bond and a Labour and Material Payment Bond as described in FT 5.1.1(a), failing which the provisions of FT 6.1 will apply.
- 6.0 Qualifications, Modifications, Alternative Tenders**
- 6.1 Tenders which contain qualifications, or omissions, so as to make comparison which other tenders difficult, may be rejected by the *Owner*.
- 6.2 A tenderer may, at the tenderer's election, submit an alternative tender ("*Alternative Tender*") which varies the materials, products, designs or equipment by the *Owner as Approved Equals* as the case may be, but an *Alternative Tender* must be in addition to, and not in substitution for a tender which conforms to the requirements of the *Contract Documents*.
- 6.3 The only *Alternative Tender* that the *Owner* may accept is an *Alternative Tender* submitted by that tenderer whose conforming tender, submitted as required by paragraph 6.2 of these Instructions to Tenderers, would

have been accepted by the *Owners* in the preference to other conforming tenders, if no *Alternative Tenders* had been invited.

**7.0 Approved
Equals**

- 7.1 Prior to the *Tender Closing Time and Date*, a tenderer may request the *Owner* to approve materials, products, or equipment ("*Approved Equal*") to be included in a tender in substitution for items indicated in the Contract Documents.
- 7.2 Applications for an *Approved Equal* must be in writing, and supported by appropriate supporting information, data, specifications, and documentation.
- 7.3 If the *Owner* decides in its discretion to accept an *Approved Equal*, then the *Owner* will issue an addendum to all tenderers.
- 7.4 The *Owner* is not obligated to review or accept an application for an *Approved Equal*.

**8.0 Inspection of
the Place of the
Work**

- 8.1 All tenderers, either personally or through a representative, are responsible to examine the *Place of the Work* before submitting a tender. A tenderer has full responsibility to be familiar with and make allowance in the tender for all conditions at the *Place of the Work* that might affect the tender, including any information regarding subsurface soil conditions made available by the *Owner*, the location of the *Work*, local conditions, topographical soil conditions, weather and access. Unless otherwise specified in the *Contract Documents*, a tenderer is not required to do subsurface investigations. By submitting a tender, a tenderer represents that the tenderer has examined the *Place of the Work*, or specifically elected not to. No additional payments or time extensions shall be claimable or due because of difficulties relating to conditions at the *Place of the Work* which were reasonably foreseeable by a contractor qualified to undertake the *Work*.
- 8.2 Tenderers are referred to GC 11.2.1 regarding **Concealed or Unknown Conditions**.

**9.0 Interpretation
of Contract
Documents**

- 9.1 If a tenderer is in doubt as to the correct meaning of any provision of the *Contract Documents*, the tenderer may request clarification as instructed in paragraph 1.2 of the Instructions to Tenderers.
- 9.2 If a tenderer discovers any contradictions or inconsistencies in the *Contract Documents* or its provisions, or any discrepancies between a provision of the *Contract Documents* and conditions at the *Place of the Work as* observed in an examination under paragraph 8 of the person named in paragraph 1.2 of the Instructions to Tenderers.
- 9.3 If the *Owner* considers it necessary, the *Owner* may issue written addenda to provide clarification (s) of the *Contract Documents*.
- 9.4 No oral interpretation or representations from the *Owner* or any representative of the *Owner* will affect, alter, or amend any provision of the *Contract Documents*.

10.0 Prices

- 10.1 The Tendered Price will represent the entire cost excluding *GST* to the *Owner* of the complete *Work* based on the estimated quantities in the *Schedule of Quantities and Prices* of the Form of Tender. Notwithstanding the generalities of the above, tenderers shall include in the tendered

prices (including unit prices, lump sum prices, or other forms of pricing) sufficient amounts to cover:

- | | | | |
|------|-----------------------------|--------|---|
| | | 10.1.1 | the costs of all labour, equipment and material included in or required for the <i>Work</i> , including all items which, whole not specifically listed in the <i>Schedule of Quantities and Prices</i> , are included in the <i>Work</i> specifically or by necessary inference from the <i>Contract Documents</i> ; |
| | | 10.1.2 | all assessments payable with respect to labour as required by any statutory scheme such as unemployment insurance, holiday pay, insurance, CPP and all employee benefits and the Workers Compensation Act; |
| | | 10.1.3 | all overhead costs, including head office and on-site overhead costs, and all amounts for the <i>Contractor's</i> profit. |
| | | 10.2 | The tendered prices and all subcontracts must allow for compliance with all applicable laws regarding trade or other qualifications of employees performing the <i>Work</i> , and payment of appropriate wages for labour included in or required for the <i>Work</i> . |
| 11.0 | Taxes | 11.1 | The tendered prices shall cover all taxes and assessments of any kind payable with respect to the <i>Work</i> , but shall not include <i>GST</i> . <i>GST</i> shall be listed as a separate line item as required by GC 19.3. |
| 12.0 | Amendment of Tenders | 12.1 | A tenderer may amend or revoke a tender by giving written notice, delivered by Email or fax, to the office referred to in paragraph 3.4 of the Instructions to Tenderers at any time up until the <i>Tender Closing Date and Time</i> . An amendment or revocation that is received after the <i>Tender Closing Date and Time</i> shall not be considered and shall not affect a tender as submitted. |
| | | 12.2 | An amendment or revocation must be signed by an authorized signatory of the tenderer in the same manner as provided by paragraph 5.1 of these Instructions to Tenderers. |
| | | 12.3 | Any amendment that expressly or by inference discloses the tenderer's <i>Tender Price</i> or other material element of the tender such that, in the opinion of the <i>Owner</i> , the confidentiality of the tender is breached, will invalidate the entire tender. |

- 12.4 An acceptable form of a tender amendment which tenderers may, but are not required to, use is as follows:

“Contract: _____
(TITLE OF CONTRACT)
Reference No. _____
(OWNER’S CONTRACT REFERENCE NO.)
TO: _____
(NAME OF OWNER)

We the undersigned wish to amend our tender which we submitted for the above *Contract* by deleting the following tendered prices or items from our tender:

(TENDERED PRICES AND/OR TENDER ITEMS IN THE TENDER THAT ARE TO BE AMENDED)

and substituting the following revised tendered prices or items:

(REVISED TENDERED PRICES OR TENDER ITEMS)

The extensions in our tender should be adjusted accordingly, and our ***Tender Price*** as set out in Appendix 1 of our submitted **Form of Tender**, and on the ***Schedule of Quantities and Prices***, increased / decreased by \$_____, excluding GST. We have not included our revised ***Tender Price*** in order to preserve the confidentiality of our tender.

Signed and delivered the ____ day of _____, 20__.”

- 12.5 If a tender amendment or revocation is sent by fax, the tenderer assumes the entire risk that equipment and staff at the office referred to in paragraph 3.4 of the Instructions to Tenderers will properly receive the fax containing the amendment or revocation before the *Tender Closing Date and Time*. The *Owner* assumes no risk or responsibility whatsoever that any fax will be received as required by paragraph 12.1 of these Instructions to Tenderers, and shall not be liable to any tenderer if for any reason a fax is not properly received.

**13.0 Duration of
Tenders**

- 13.1 After the *Tender Closing Time*, a tender shall remain valid and revocable as set out in paragraph 5.1 of the Form of Tender.

**14.0 Qualifications
of Tenderers**

- 14.1 By submitting a tender a tenderer is representing that it has the competence, qualifications and relevant experience required to do the *Work*.

15.0 Award

- 15.1 In exercising its discretion, the *Owner* will have regard to the information provided in the Appendices to the Form of Tender as described under IT5.3 including the proven experience of the tenderer, and any listed subcontractors, to do the *Work*.

Tenders received will be evaluated to provide the City with greatest value based on quality, service, price and experience. Evaluation Criteria will include but is not limited to:

1. Ability to meet specifications and required completion date
2. Contractor's past experience, references, reputation and compliance to specifications
3. Demonstrated successful experience on similar projects and specific equipment installation
4. Price: purchase price, maintenance costs, availability of parts and service, warranty and compatibility with existing equipment and/or conditions
5. Any other criteria, the City deems, at its sole discretion, necessary to evaluate Tenders;
6. Lowest price will not necessarily be accepted.

The City may, in its absolute discretion, not award to a Tenderer if the Tenderer, or any officer or director of a corporate Tenderer, is or has been engaged, either directly or indirectly through another corporation or legal entity, in a legal action against the City and its elected and appointed officers and employees or any of them in relation to:

- a) any other contract or services; or
- b) any matter arising from the City's exercise of its powers, duties or functions under the *Local Government Act*, the *Community Charter* or any other enactments; within five years of this Tender Offer.

For purposes of this section, the words "legal action" includes, without limitation, mediation, arbitration, hearing before an administrative tribunal or lawsuit filed in any court.

Without limiting the City's sole discretion, in determining whether or not to award to a Tenderer pursuant to this clause, the City will consider such factors as whether the legal action is likely to affect the Tenderer's ability to work with the City and its employees, agents, consultants and representatives or any of them and whether the City's past experience with the Tenderer in the matter that resulted in the legal action indicates that the City is likely to incur increased staff and legal costs or either of them in the administration of this contract if it is awarded to the Tenderer.

In the event that the lowest total Tender Price by two or more Tenderers is the same amount, the City will select a Tenderer with an overall satisfactory performance record in having completed work on previous relevant projects that are provided as references, and on City projects. Information obtained from references will not be disclosed or discussed with any Tenderer. If all references are equal, selection will be determined by a coin toss in a manner to be directed by the City.

Where only one Tender is received the City may reject such and re-tender on a selected basis.

- 15.2 The *Owner* will notify the successful tenderer in writing.
- 15.3 If there are any discrepancies in the *Schedule of Quantities and Prices* between the unit prices and the extended totals then the unit prices shall be deemed correct, and corresponding corrections shall be made to the extended totals. If a unit price or extended total has been omitted, the following shall apply:
- a) If a unit price is given but the corresponding extended total has been omitted, then the extended total shall be calculated from unit price and the estimated quantity, and inserted as the extended total;
 - b) If an extended total is given but the corresponding unit price has been omitted, then the unit price shall be calculated from the extended total and estimated quantity, and inserted as the unit price;
 - c) If both the unit price and the corresponding extended total for a tender item have been omitted, then the following test shall be applied to determine whether the tender shall be rejected as incomplete:
 - (i) the highest of the unit prices tendered by other tenderers for that tender item shall be used as the test unit price, and the corresponding test extended total shall be calculated from the test unit price and the estimated quantity;
 - (ii) if the test extended total for the tender item exceeds 1% of the revised total *Tender Price*, including the test extended total, or if the revised total *Tender Price*, including the test extended total, alters the ranking of the tenderers according to the lowest *Tender Price*, then the omitted unit price for that tender item is deemed to materially affect the *Tender Price* relative to other tenders and the tender shall be rejected;
 - (iii) if the tender is not rejected under subparagraph (ii) of this IT 15.3 (c), then the unit price and the extended total for that tender item shall both be deemed to be, and the costs for that tender item shall be zero deemed to be included in other tender items prices;
 - d) In no event shall page totals in the *Schedule of Quantities and Prices* or the total *Tender Price* be used to calculate missing extended totals or unit prices.
- 15.4 Upon receiving notification of being the successful Tenderer, the Tenderer shall submit a Pandemic Prevention Policy and Procedures (4P) document detailing occupational health and safety policies to prevent

the spread of Covid-19 to the public, the Tenderer's employees, and sub-contractors during construction operations. The Owner reserves the right to require additions or changes to the 4P document prior to the execution of the Contract. After the Contract is in place, the Contractor will be expected to enforce the 4P document to the satisfaction of the Contract Administrator. If the Contract Administrator deems the 4P document is not being satisfactorily followed, the Contract Administrator may stop work at the sole expense of the Contractor until the Contractor's employees and sub-contractors have been provided proper training and orientation in regard to the 4P document.

- | | | | |
|-------------|-----------------------|------|---|
| 16.0 | Subcontractors | 16.1 | The <i>Owner</i> reserves the right to object to any of the subcontractors listed in a tender. If the <i>Owner</i> objects to any of the subcontractor(s) then the <i>Owner</i> will permit a tenderer to, within 5 days, propose a substitute subcontractor(s) acceptable to the <i>Owner</i> provided that there is not resulting adjustment in the <i>Tender Price</i> or the completion date set out in paragraph 2.2 of the Form of Tender. A tenderer will not be required to make such substitution and, if the <i>Owner</i> objects to a listed <i>Subcontractor(s)</i> , the tenderer may, rather than propose a substitute subcontractor(s), consider its tender rejected by the <i>Owner</i> and by written notice withdraw its tender. The <i>Owner</i> shall, in the event, return the tenderer's bid security |
| 17.0 | Optional Work | 17.1 | If the <i>Schedule of Quantities and Prices</i> includes any tender prices for <i>Optional or Provisional Work</i> , as defined in GC 7.4.1, the tenderers must complete all the unit prices for such <i>Optional or Provisional Work</i> . Such tender prices shall not include any general overhead costs, or other costs, or profit, not directly related to the <i>Optional or Provisional Work</i> . |
| | | 17.2 | Notwithstanding that the <i>Owner</i> may elect not to proceed with the <i>Optional or Provisional Work</i> , the tender prices for any <i>Optional or Provisional Work</i> , including the extended totals for <i>Optional or Provisional Work</i> unit prices, shall be included in the <i>Tender Price</i> for the purpose of any price comparisons between tenders. |

Form of Tender



Form of Tender

Tender No. 77816

Thomas Ave Frontage Improvements

Summary

Name of **Contractor**: _____

Tender Price (exclude GST): \$ _____
(FROM APPENDIX 1 OF FORM OF TENDER)

Tender submitted must be accompanied by a copy of the original 10% Bid Bond and will be received

On or before 2:00 pm (local time)
Thursday, February 9, 2023

Instructions for Tender Submission

Tender submissions are to be consolidated into one (1) .pdf file and uploaded electronically through Qfile, the City's file transfer service accessed at website: qfile.coquitlam.ca/bid

- 1. In the "Subject Field" enter:** Tender Number and Name
- 2. Add consolidated Tender file in PDF format, and Appendix 1 in XLS format, and Send** (ensure your web browser remains open until you receive 2 emails from Qfile to confirm upload is complete and was sent to the correct email address: bid@coquitlam.ca)

Tenderers are responsible to allow ample time to complete the Tender submission process. If assistance is required, phone 604-927-3060 or fax 604-927-3035.

February 2023

THE CITY OF COQUITLAM
3000 Guildford Way
Coquitlam, B.C. V3B 7N2

(FOR USE WHEN UNIT PRICES FORM THE BASIS OF PAYMENT - TO BE USED ONLY WITH THE GENERAL CONDITIONS AND OTHER STANDARD DOCUMENTS OF THE UNIT PRICE MASTER MUNICIPAL CONSTRUCTION DOCUMENTS.)

Contract Name: Thomas Ave Frontage Improvements

Reference No. 77816

TO OWNER:

1 WE, THE UNDERSIGNED:

- 1.1 have received and carefully reviewed all of the *Contract Documents*, including the Instructions to Tenderers, the City of Coquitlam Supplementary General Conditions, the City of Coquitlam Supplementary Contract Specifications, the specified edition of the "Master Municipal Construction Documents – General Conditions, Specifications and Standard Detail Drawings" and the following Addenda:

_____;
(ADDENDA, IF ANY)

- 1.2 shall fully disclose any actual or potential conflicts of interest and existing business relationships we may have with the City, their elected or appointed officials or employees:

- 1.3 have full knowledge of the *Place of the Work*, and the *Work* required; and

- 1.4 have complied with the Instructions to Tenderers; and

2 ACCORDINGLY WE HEREBY OFFER:

- 2.1 to perform and complete all of the *Work* and to provide all the labour, equipment and material all as set out in the *Contract Documents*, in strict compliance with the *Contract Documents*; and
- 2.2 to achieve *Substantial Performance* of the *Work* on or before **August 11, 2023**; and
- 2.3 to do the *Work* for the price, which is the sum of the products of the actual quantities incorporated into the *Work* and the appropriate unit prices set out in Appendix 1, the "*Schedule of Quantities and Prices*", plus any lump sums or specific prices and adjustment amounts as provided by the *Contract Documents*. For the purposes of tender comparison, our offer is to complete the *Work* for the "*Tender Price*" as set out on Appendix 1 of this Form of Tender. Our *Tender Price* is based on the estimated quantities listed in the *Schedule of Quantities and Prices*, and excludes *GST*.

3 WE CONFIRM:

- 3.1 that we understand and agree that the quantities as listed in the *Schedule of Quantities and Prices* are estimated, and that the actual quantities will vary.
- 3.2 that we understand and agree that the owner is in no way obliged to accept this Tender.

4 WE CONFIRM:

- 4.1 that the following Appendices are attached to and form a part of this tender:
- 4.1.1 the Appendices as required by paragraph 5.3 of the Instructions to Tenderers - Part II; and
 - 4.1.2 the *Bid Security* as required by paragraph 5.2 of the Instructions to Tenderers - Part II.
 - 4.1.3 the Certificate of Compliance on the form provided in Appendix 7 of this Form of Tender.

5 WE AGREE:

- 5.1 that this tender will be irrevocable and open for acceptance by the *Owner* for a period of **60** calendar days from the day following the *Tender Closing Date and Time*, even if the tender of another Tenderer is accepted by the *Owner*. If within this period the *Owner* delivers a written notice ("*Notice of Award*") by which the *Owner* accepts our tender we will:
- 5.1.1 within **15 Days** of receipt of the written *Notice of Award* deliver to the *Owner*:
 - a) a Performance Bond and a Labour and Material Payment Bond, each in the amount of 50% of the *Contract Price*, issued by a surety licensed to carry on the business of suretyship in the province of British Columbia, and in a form acceptable to the *Owner*;
 - b) a "clearance letter" indicating that the Tenderer is in WCB compliance; and
 - c) a copy of the insurance policies as specified in SGC Section 24 indicating that all such insurance coverage is in place and;
 - d) a letter confirming the *Contractor* as "Prime Contractor" for the Contract as specified in SGC Section 21.2.1.
 - 5.1.2 within **2 Days** of receipt of written "*Notice to Proceed*", or such longer time as may be otherwise specified in the *Notice to Proceed*, commence the *Work*; and
 - 5.1.3 sign the Contract Documents as required by GC 2.1.

6 WE AGREE:

- 6.1 that, if we receive written *Notice of Award* of this *Contract* and, contrary to paragraph 5 of this Form of Tender, we:
- 6.1.1 fail or refuse to deliver the documents as specified by paragraph 5.1.1 of this Form of Tender; or
 - 6.1.2 fail or refuse to commence the *Work* as required by the *Notice to Proceed*,

then such failure or refusal will be deemed to be a refusal by us to enter into the Contract and the *Owner* may, on written notice to us, award the *Contract* to another party. We further agree that, as full compensation on account of damages suffered by the *Owner* because of such failure or refusal, the *Bid Security* shall be forfeited to the *Owner*, in an amount equal to the lesser of:

6.1.3 the face value of the *Bid Security*; and

6.1.4 the amount by which our *Tender Price* is less than the amount for which the *Owner* contracts with another party to perform the *Work*.

7 OUR ADDRESS is as follows:

Phone: _____ - _____ - _____

Fax: _____ - _____ - _____

Email: _____

Attention: _____

This Tender is executed this _____ day of _____, 20_____.

Contractor:

(FULL LEGAL NAME OF CORPORATION, PARTNERSHIP OR INDIVIDUAL)

(AUTHORIZED SIGNATORY)

(AUTHORIZED SIGNATORY)

8 WE CONFIRM:

8.1 our Goods and Services Tax (GST) registration status is as follows:

8.1.1 for information purposes, our GST Registration Number is:

(GST REGISTRATION NUMBER)

or;

8.1.2 by signature hereunder, we certify we are **not required** to provide a registration number:

(AUTHORIZED SIGNATORY)

(AUTHORIZED SIGNATORY)

**APPENDIX 1
FORM OF TENDER****Contract 77816
Thomas Ave Frontage Improvements****SCHEDULE OF QUANTITIES AND PRICES**

(see paragraph 5.3.1 of the Instruction to Tenderers)

(All Tender and Contract Prices shall NOT include GST. GST will apply upon payment)**(Should there be any discrepancy in the information provided, the City's original file copy shall prevail)**

ITEM NO.	MMCD Ref. / (Supplementary Contract Specifications)	DESCRIPTION	UNIT	QTY	UNIT PRICE	EXTENDED AMOUNT
1.00	01 55 00	TRAFFIC CONTROL, VEHICLE ACCESS AND PARKING				
1.01	1.5.1	Traffic Control and Management			Incidental to Contract	
2.00	01 57 01S	ENVIRONMENTAL PROTECTION				
2.01	(1.6.1)	ESC supply & installation, maintenance and removal			Incidental to Contract	
3.00	01 58 01S	PROJECT IDENTIFICATION				
3.01	(1.3.1)	Construction Zone Information Signs	ea.	11		
4.00	03 30 20S	CONCRETE WALKS, CURBS AND GUTTERS				
4.01	(1.4.3)	Concrete Curb & Gutter - Wide Base – MMCD C5	l.m	1,600		
4.02	(1.4.5)	Concrete Sidewalk & Walkway connectors & Wheelchair Letdown - 100mm thick – Broom Finished c/w 100mm Granular base; and as shown and described in the Contract Documents	sq.m	1,400		
4.03	(1.4.5)	Concrete Driveway Letdown, Sidewalk Crossing, and Driveways - COQ-C7 & COQ-C7B - 190mm thick c/w 100mm granular base; and as shown and described in the Contract Documents	sq.m	950		
4.04	(1.4.5)	Concrete Driveway Reinstatement, c/w 100mm granular base, Broom Finish	sq.m	130		
4.05	(1.4.10)	Tactile Strip - 24x60in - Access Tile, Yellow color - removable type	ea.	25		
5.00	03 30 53S	CAST-IN-PLACE CONCRETE				
5.01	(1.5.3)	Concrete Stairs - Back of Sidewalk to Property Line (Provisional)	l.m	70		
6.00	03 40 01S	PRECAST CONCRETE				
6.01	(1.4.6)	Allan Block Retaining Wall (Includes clear crushed gravel, filter fabric, perf pipe, backfill, capstone) segmental retaining wall (Provisional)	sq.m	70		
7.00	26 56 01S	ROADWAY LIGHTING				
7.01	1.9.2	Supply & installation of Roadway and Pedestrian Lighting (ALL) Works including any removal, adjustments and disposal needed to complete the work and as shown on the Contract Drawing	l.s.	1		
7.02	(1.9.4)	Supply and installation of each complete set of joint trench Empty Ducts Crossings (c/w strings, caps on both ends) as shown in the contract documents; Telus & Shaw to supply their own rpvc ducts	ea.	20		
8.00	31 05 17	AGGREGATES AND GRANULAR MATERIALS				
8.01	1.4.1	Clear Crushed, 19mm (Provisional - for top layer covering of boulevard behind sidewalk)	tonne	30		
9.00	31 11 01S	CLEARING AND GRUBBING				
9.01	(1.4.1)	Clearing & grubbing	l.s.	1		
9.02	1.4.2	Tree removal and disposal, 100 to 150 dia	ea.	10		
9.03	1.4.2	Tree removal and disposal, =>300 dia	ea.	2		
10.00	31 11 41S	SHRUB AND TREE PRESERVATION				
10.01	(1.3.1)	Protective fencing - COQ-R26 (supply, install and removal) (Provisional)	l.m	50		
11.00	31 22 16S	RESHAPING GRANULAR ROADBED				
11.01	(1.4.1)	Reshaping	sq.m	7,302		
12.00	31 24 13S	ROADWAY EXCAVATION, EMBANKMENT AND COMPACTION				
12.01	(1.8.4)	Removal and offsite disposal of Existing Asphalt/Concrete (all Depths), including asphalt curb, pathways, letdowns, paver or sidewalks. Brick pavers are to be saved for reinstatement as directed by Contract Administrator.	sq.m	2,600		
12.02	(1.8.5)	Common Excavation including Off Site Disposal(includes retaining wall) (Provisional)	cu.m	2,410		
12.03	1.8.7	Imported Embankment Fill, 75mm SGSB	tonne	1,626		
12.04	(1.8.10)	Overexcavation, Offsite Disposal, Backfilling (Provisional)	cu.m	346		
13.00	32 01 16.7S	COLD MILLING				
13.01	(1.5.1)	Full Depth Milling (up to 125mm Deep)(Including Removal of Granular/Native Materials)	sq.m	6,087		
14.00	32 11 16.1S	GRANULAR SUBBASE				
14.01	(1.4.3)	75mm Crushed Minus Granular Sub Base - variable thickness (Provisional)	tonne	1,027		
15.00	32 11 23S	GRANULAR BASE				
15.01	(1.4.3)	25mm Minus Granular Base, variable thickness (Provisional)	tonne	1,925		
16.00	32 12 16S	HOT-MIX ASPHALT CONCRETE PAVING				
16.01	(1.5.1 / 1.5.9)	Asphaltic Concrete Paving - Upper Course #1, 75mm, 1 lift	tonne	1,510		
16.02	(1.5.3 / 1.5.9)	Asphaltic Concrete Paving - Driveways(60mm), walkways/sidewalks(50mm) - UC#2 , 1 lift	tonne	100		
16.03	1.5.4 / (1.5.9)	Style 1 Asphalt Curb as per MMCD C6 (50mm high, 175mm wide)	l.m	125		

ITEM NO.	MMCD Ref. / (Supplementary Contract Specifications)	DESCRIPTION	UNIT	QTY	UNIT PRICE	EXTENDED AMOUNT
17.00	32 14 015	UNIT PAVING				
17.01	(1.6.4)	Reinstatement of Brick Pavers (Driveway)	sq.m	55		
18.00	32 17 235	PAINTED PAVEMENT MARKINGS				
18.01	(1.5.3)	Supply & Installation Thermoplastic Pavement Markings	l.s.	1		
18.02	(1.5.4)	Supply & Install of Traffic Signage - City to supply all new sign tabs	ea.	8		
18.03	(1.5.4)	Remove, protect and reinstate existing signages	ea.	9		
19.00	32 91 215	TOP SOIL AND FINISH GRADING				
19.01	(1.4.1)	Imported Topsoil - 150mm Thick for Sod	cu.m	443		
19.02	(1.4.1)	Growing Medium - Boulevard Tree Planting Trench - includes excavation, disposal of excavated material, backfill, growing medium and as shown in Contract Drawings and described in Contract Documents	cu.m	108		
20.00	32 92 235	SODDING				
20.01	(1.8.1)	Sodding	sq.m	2,949		
21.00	32 93 015	PLANTING OF TREES, SHRUBS, AND GROUND COVERS				
21.01	(1.9.1)	Japanese Stewartia, 7cm Cal/B&B 2.0m STD. and as described in the contract drawings, c/w Treegator bag, support stakes and 1m bark mulch tree well	ea.	6		
21.02	(1.9.1)	Pink Chimes Japanese Snowbell, 7cm Cal/B&B 2.0m STD. and as described in the contract drawings, c/w Treegator bag, support stakes and 1m bark mulch tree well	ea.	7		
21.03	(1.9.1)	Aurora Dogwood, 7cm Cal/B&B 2.0m STD. and as described in the contract drawings, c/w Treegator bag, support stakes and 1m bark mulch tree well	ea.	8		
21.04	(1.9.1)	Autumn Brilliance Serviceberry, 7cm Cal/B&B 2.0m STD. and as described in the contract drawings, c/w Treegator bag, support stakes and 1m bark mulch tree well	ea.	8		
21.05	(1.9.3)	Root barriers, 400mm - 3m on each side	l.m	200		
22.00	33 11 015	WATERWORKS				
22.01	(1.8.4)	19mm Service Connections - COQ-W2k and as shown in Contract Drawings	ea.	2		
22.02	(1.8.4)	19mm Service Connections - COQ-W2k and as shown in Contract Drawings (Provisional)	ea.	2		
22.03	(1.8.4)	38mm Service Connections - COQ-W2d and as shown in Contract Drawings	ea.	8		
22.04	(1.8.4)	38mm Service Connections - COQ-W2d and as shown in Contract Drawings (Provisional)	ea.	2		
23.00	33 30 015	SANITARY SEWERS				
23.01	(1.6.3)	Service Connections - 150mm SDR28 PVC c/w IC, as described in Contract Documents, COQ - S7A	ea.	31		
24.00	33 40 015	STORM SEWERS				
24.01	(1.6.6)	Boulevard Retention Trench - COQ-SW3 (includes excavation, backfill materials)	l.m	35		
24.02	(1.6.6)	Boulevard Retention Trench - Decant Piping (includes perf pipe, caps, cleanout, trench dam and tie in to C/B)	ea.	1		
24.03	(1.6.5)	Catch Basin/Lawn Basin Lead - 150mm SDR28 PVC (Including wyes)	l.m	102		
24.04	(1.6.3)	Service Connections - 150mm SDR28 PVC c/w IC, as described in Contract Documents, COQ-S8A	ea.	2		
24.05	(1.6.4)	Inspection Chamber - MMCD-S9	ea.	33		
25.00	33 44 015	MANHOLES AND CATCHBASINS				
25.01	(1.5.2)	Supply and installation, Top Inlet Catch Basin MMCD S11	ea.	9		
25.02	(1.5.2)	Supply and installation, Side Inlet Catch Basin - COQ-S11A	ea.	10		
25.03	(1.5.2)	Supply and installation, Lawn Basin - COQ-S12A Type 1, 300mm c/w bottom, as per Appendix B	ea.	1		
25.04	(1.5.3)	Manhole Frame and Lid Replacement & Adjustments (Provisional)	ea.	10		
25.05	(1.5.3)	Manhole Frame and Lid Adjustments Only (Provisional)	ea.	5		
25.06	(1.5.3)	Nelson Box Replacement & Adjustment (Provisional)	ea.	7		
25.07	1.5.4	Removal, Capping & Disposal of Catch Basins	ea.	14		

Total Tendered Price (exclude GST): \$ _____

(Transfer the amount to Form of Tender Summary Page 1)

Name of Contractor: _____

APPENDIX 3

FORM OF TENDER

**Contract 77816
Thomas Ave Frontage Improvements**

EXPERIENCE OF SUPERINTENDENT
(See paragraph 5.3.3 of the Instructions to Tenderers)

Proposed Project Superintendent _____

List of Project Experience

PROJECT:		Dates:	
Work Description:			
Responsibility:			
Owner/Reference:		Phone NO:	

PROJECT:		Dates:	
Work Description:			
Responsibility:			
Owner/Reference:		Phone NO:	

PROJECT:		Dates:	
Work Description:			
Responsibility:			
Owner/Reference:		Phone NO:	

APPENDIX 4

FORM OF TENDER

Contract 77816
Thomas Ave Frontage Improvements

CONTRACTOR'S COMPARABLE WORK EXPERIENCE
(See paragraph 5.3.4 of the Instructions to Tenderers)

PROJECT:		VALUE (\$):	
OWNER:		Phone Number:	
Work Description:			

PROJECT:		VALUE (\$):	
OWNER:		Phone Number:	
Work Description:			

PROJECT:		VALUE (\$):	
OWNER:		Phone Number:	
Work Description:			

PROJECT:		VALUE (\$):	
OWNER:		Phone Number:	
Work Description:			

APPENDIX 5

FORM OF TENDER

Contract 77816
Thomas Ave Frontage Improvements

SUBCONTRACTORS
(See paragraph 5.3.5 of the Instructions to Tenderers)

Trade:		Tender Item:	
Work Description:			
Subcontractor:		Phone No:	

Trade:		Tender Item:	
Work Description:			
Subcontractor:		Phone No:	

Trade:		Tender Item:	
Work Description:			
Subcontractor:		Phone No:	

Trade:		Tender Item:	
Work Description:			
Subcontractor:		Phone No:	

Trade:		Tender Item:	
Work Description:			
Subcontractor:		Phone No:	

APPENDIX 6

FORM OF TENDER

Contract 77816
Thomas Ave Frontage Improvements

Bid Bond

NO. _____

\$ _____

KNOW ALL MEN BY THESE PRESENTS THAT

As Principal, hereinafter called the Principal, and

As Surety, hereinafter called the Surety, are held and firmly bound unto

As Oblige, hereinafter called the Oblige, in the amount of

_____ Dollars (\$_____) lawful money of Canada,
for the payment of which sum, well and truly to be made, the Principal and the Surety bind themselves, their heirs,
executors, administrators, successors and assigns, jointly and severally, firmly by these presents.

WHEREAS, the Principal has submitted a written Tender to the Oblige, dated the _____ day of
_____, 2023, for Contract _____.

NOW, THEREFORE, THE CONDITION OF THIS OBLIGATION is such that if the aforesaid Principal shall have the Tender
accepted within sixty (60) days from the Closing Date of Tender and the said Principal will, within the time required, enter
into a formal contract and give good and sufficient bonds to secure the performance of the terms and conditions of the
Contract, then this obligation shall be null and void; otherwise the Principal and Surety will pay unto the Oblige the
difference in money between the amount of the bid of the said Principal and the amount for which the Oblige legally
contracts with another party to perform the work if the latter amount be in excess of the former.

The Surety shall not be liable for a greater sum than the specified penalty of this Bond.

Any suit under this Bond must be instituted before the expiration of six (6) months from the date of this Bond.

IN TESTIMONY WHEREOF, the Principal has hereto set its hand and affixed its seal, and the Surety has caused these
presents to be sealed with its corporate seal duly attested by the signature of its Attorney-In-Fact,
this _____ day of _____, 2023.

SIGNED, SEALED AND DELIVERED

In the presence of:

)
)
)
)
)

PRINCIPAL

SURETY

APPENDIX 7

FORM OF TENDER

Contract 77816
Thomas Ave Frontage Improvements

CERTIFICATE OF COMPLIANCE for CONTRACT INSURANCE

This is provided for information to certify that the Tenderer does hereby undertake and agree to supply to the City of Coquitlam, upon award, contract insurance listed below for the project requirements indicated:

Contract Number: **77816**

Contract Name: **Thomas Ave Frontage Improvements**

Description of Work:

Road improvements on Thomas Avenue between Lebleu Street to Casey Street, approximately 900 meters of Local Road including Concrete Curb & Gutter, Concrete Sidewalk, Storm and Sanitary Connections, Water Service Connections, Street Trees, Pavement Markings, Street Lighting, Retaining Wall, BC Hydro, Shaw & Telus Underground Ducting, and other miscellaneous and incidental works as further described in the Contract Documents.

Other miscellaneous and incidental work as contained in the Contract Documents

Commercial General Liability: **\$5,000,000 limit**

Special Coverage Required:	YES	NO	<u>Special Coverage Description</u>
	()	(X)	Shoring and Underpinning Hazard
	()	(X)	Pile Driving and Vibrations
	(X)	()	Excavation Hazard
	()	(X)	Demolition
	()	(X)	Blasting

We also certify that the insurance coverage will meet the requirements of the Supplementary General Conditions Section 24 – Insurance, included as part of the Contract Documents, and that the proof of insurance will be provided on the City of Coquitlam Certificate of Insurance form, without amendments, except for the exclusions noted above.

Name of Tenderer (printed)

Authorized Signature

Date

Agreement

AGREEMENT

Between Owner and Contractor

(FOR USE WHEN UNIT PRICES FORM THE BASIS OF PAYMENT - TO BE USED ONLY WITH THE GENERAL CONDITIONS AND OTHER STANDARD DOCUMENTS OF THE UNIT PRICE MASTER MUNICIPAL CONSTRUCTION DOCUMENTS.)

THIS AGREEMENT made in duplicate this ____ day of _____ 2023.

Contract: Thomas Ave Frontage Improvements

Reference No. 77816

BETWEEN:

The City of Coquitlam
3000 Guildford Way
Coquitlam, B.C. V3B 7N2

(the "Owner")

AND:

(the "Contractor")

The *Owner* and the *Contractor* agree as follows:

1 THE WORK - START/COMPLETION DATES

- 1.1 The *Contractor* will perform all *Work* and provide all labour, equipment and material and do all things strictly as required by the *Contract Documents*.
- 1.2 The *Contractor* will commence the *Work* in accordance with the *Notice to Proceed*. The *Contractor* will proceed with the *Work* diligently, will perform the *Work* generally in accordance with the construction schedules as required by the *Contract Documents* and will achieve *Substantial Performance* of the *Work* on or before **August 11, 2023**, subject to the provisions of the *Contract Documents* for adjustments to the *Contract Time*.
- 1.3 Time shall be the essence of the Contract.

2 CONTRACT DOCUMENTS

- 2.1 The “*Contract Documents*” consist of the documents listed or referred to in Schedule 1, entitled “Schedule of Contract Documents”, which is attached and forms a part of this Agreement, and includes any and all additional and amending documents issued in accordance with the provisions of the *Contract Documents*. All of the *Contract Documents* shall constitute the entire *Contract* between the *Owner* and the *Contractor*.
- 2.2 The *Contract* supersedes all prior negotiations, representations or agreements, whether written or oral, and the *Contract* may be amended only in strict accordance with the provisions of the *Contract Documents*.

3 CONTRACT PRICE

- 3.1 The price for the *Work* (“*Contract Price*”) shall be the sum in Canadian dollars of the following:
- a) the product of the actual quantities of the items of *Work* listed in the *Schedule of Quantities and Prices* which are incorporated into or made necessary by the *Work* and the unit prices listed in the *Schedule of Quantities and Prices*; plus
 - b) all lump sums, if any, as listed in the *Schedule of Quantities and Prices*, for items relating to or incorporated into the *Work*; plus
 - c) any adjustments, including any payments owing on account of *Changes* and agreed to *Extra Work*, approved in accordance with the provisions of the *Contract Documents*.
- 3.2 The *Contract Price* shall be the entire compensation owing to the *Contractor* for the *Work* and this compensation shall cover and include all profit and all costs of supervision, labour, material, equipment, overhead, financing, and all other costs and expenses whatsoever incurred in performing the *Work*.

4 PAYMENT

- 4.1 Subject to applicable legislation and the provisions of the *Contract Documents*, the *Owner* shall make payments to the *Contractor*.
- 4.2 If the *Owner* fails to make payments to the *Contractor* as they become due in accordance with the terms of the *Contract Documents* then interest calculated at 2% per annum over the prime commercial lending rate of the Royal Bank of Canada on such unpaid amounts shall also become due and payable until payment. Such interest shall be calculated and added to any unpaid amounts monthly.

5 RIGHTS AND REMEDIES

- 5.1 The duties and obligations imposed by the *Contract Documents* and the rights and remedies available hereunder shall be in addition to and not a limitation of any duties, obligations, rights and remedies otherwise imposed or available by law.
- 5.2 Except as specifically set out in the *Contract Documents*, no action or failure to act by the *Owner*, *Contract Administrator* or *Contractor* shall constitute a waiver of any of the parties’ rights or duties

afforded under the *Contract*, nor shall any such action or failure to act constitute an approval of or acquiescence in any breach under the *Contract*.

6 NOTICES

- 6.1 Communications among the *Owner*, the *Contract Administrator* and the *Contractor*, including all written notices required by the *Contract Documents*, may be delivered by email, by hand or by fax, or by pre-paid registered mail to the addresses as set out below:

The *Owner*:

The City of Coquitlam
3000 Guildford Way
Coquitlam, B.C. V3B 7N2

Tel: 604-927-3500
Fax: 604-927-3505

The *Contractor*:

Tel:
Fax:
Email:
Attention:

The *Contract Administrator*:

The City of Coquitlam
3000 Guildford Way
Coquitlam, B.C. V3B 7N2

Tel:
Fax:
Email:
Attention:

- 6.2 A communication or notice that is addressed as above shall be considered to have been received:
- a) immediately upon delivery, if delivered by hand; or
 - b) immediately upon transmission if sent or received by email or fax; or
 - c) after 5 days from date of posting if sent by registered mail.
- 6.3 The *Owner* or the *Contractor* may, at any time, change its address for notice by giving written notice to the other at the address then applicable. Similarly if the *Contract Administrator* changes its address for notice then the *Owner* will give or cause to be given written notice to the *Contractor*.

- 6.4 The sender of a notice by email or fax assumes all risk that the fax will be received properly, and the provisions of paragraph 12.5 of the Instructions to Tenderers Part II apply to the sender.

7 GENERAL

- 7.1 This *Contract* shall be construed according to the laws of British Columbia.
- 7.2 The *Contractor* shall not, without the express written consent of the *Owner*, assign this *Contract*, or any portion of this *Contract*.
- 7.3 The headings included in the *Contract Documents* are for convenience only and do not form part of this *Contract* and will not be used to interpret, define or limit the scope or intent of this *Contract* or any of the provisions of the *Contract Documents*.
- 7.4 A word in the *Contract Documents* in the singular includes the plural and, in each case, vice versa.
- 7.5 This agreement shall enure to the benefit of and be binding upon the parties and their successors, executors, administrators and assigns

This agreement shall enure to the benefit of and be binding upon the parties and their successors, executors, administrators and assigns.

IN WITNESS WHEREOF the parties hereto have executed this Agreement the day and year first written above.

Contractor:

(FULL LEGAL NAME OF CORPORATION, PARTNERSHIP OR INDIVIDUAL)

(AUTHORIZED SIGNATORY)

(AUTHORIZED SIGNATORY AND POSITION - PRINT)

Owner:

The City of Coquitlam

(MANAGER CAPITAL PROJECTS AND INSPECTIONS)

Representative as Per G.C. 17

(MANAGER DESIGN AND CONSTRUCTION)

Thomas Ave Frontage Improvements

Reference No: 77816

Schedule 1

Schedule of Contract Documents

(INCLUDE IN LIST ALL DOCUMENTS INCLUDING, IF ANY, SUPPLEMENTARY GENERAL CONDITIONS, SUPPLEMENTARY SPECIFICATIONS, SUPPLEMENTARY STANDARD DETAIL DRAWINGS)

The following is an exact and complete list of the *Contract Documents*, as referred to in Article 2.1 of the Agreement.

NOTE: The documents noted with “*” are contained in the “Master Municipal Construction Documents – General Conditions, Specifications and Standard Detail Drawings”, edition dated 2009. All sections of this publication are included in the *Contract Documents*.

1. Agreement, including all Schedules;
2. The following Addenda:
 - As issued
3. Supplementary General Conditions, if any;
4. General Conditions*;
5. Supplementary Specifications, if any;
6. Detail Specifications, if any;
7. Specifications*;
8. Supplementary Detail Drawing, if any;
9. Standard Detail Drawings*;
10. Executed Form of Tender, including all Appendices;
11. Drawings listed in Schedule 2 to the Agreement –“List of Drawings”, if any;
12. Instructions to Tenderers;
13. COQUITLAM “Supplementary Specifications Master Municipal Construction Documents” March 2016

Thomas Ave Frontage Improvements

Reference No: 77816

Schedule 2

LIST OF DRAWINGS

(Complete Listing of all Drawings, Plans, Sketches and Appendices that are part of the Contract Documents)

Bound in this Document:

Appendix A: Traffic Management Plan

Appendix B: Supplementary Detailed Drawings

Appendix C: As-Built Records

Appendix D: Street Lighting Inspection Report

Bound Separately: Full Size Contract Drawings

TITLE	SHEET NUMBER	REVISION DATE	REVISION NUMBER
Frontage Improvements - Thomas Ave - Cover Page	-	-	-
Thomas Ave – Lebleu St to Casey St - General Notes	1 of 34	2022-12-19	4
Thomas Ave – Lebleu St to Casey St - Road Details	2 of 34	2023-01-13	3
Thomas Ave – Lebleu St to Nelson St - Roadworks - Plan & Profile	3 of 34	2023-01-13	5
Thomas Ave – Lebleu St to Nelson St - Roadworks - Plan & Profile	4 of 34	2023-01-13	5
Thomas Ave – Nelson St to Marmont St - Roadworks - Plan & Profile	5 of 34	2023-01-13	5
Thomas Ave – Nelson St to Marmont St - Roadworks - Plan & Profile	6 of 34	2023-01-13	5
Thomas Ave – Marmont St to Therrien St - Roadworks - Plan & Profile	7 of 34	2023-01-13	5
Thomas Ave – 70m West of Begin St to 50m East of Begin St - Roadworks - Plan & Profile	8 of 34	2023-01-13	5
Thomas Ave – 40m West of Teck St to 60m East of Teck St – Roadworks – Plan & Profile	9 of 34	2023-01-13	5
Thomas Ave – Laval St to Millview St – Roadworks – Plan & Profile	10 of 34	2023-01-13	5
Thomas Ave – 70m West Casey to Casey St – Roadworks – Plan & Profile	11 of 34	2023-01-13	5
Thomas Ave – Nelson St to Begin St – Curb Return Details	12 of 34	2022-12-19	2
Thomas Ave – Teck St to Millview St – Curb Return Details	13 of 34	2022-12-19	2
Thomas Ave – Lebleu St to Nelson St – Roadworks – Cross Sections	14 of 34	2022-12-19	5
Thomas Ave – Lebleu St to Nelson St – Roadworks – Cross Sections	15 of 34	2022-12-19	5
Thomas Ave – Nelson St to Marmont St – Roadworks – Cross Sections	16 of 34	2022-12-19	5
Thomas Ave – Nelson St to Marmont St – Roadworks - Cross Sections	17 of 34	2022-12-19	5
Thomas Ave - Nelson St to Marmont St – Roadworks – Cross Sections	18 of 34	2022-12-19	5
Thomas Ave – Marmont St to Casey St – Roadworks – Cross Sections	19 of 34	2022-12-19	5
Thomas Ave – Marmont St to Casey St – Roadworks – Cross Sections	20 of 34	2022-12-19	5

TITLE	SHEET NUMBER	REVISION DATE	REVISION NUMBER
Thomas Ave – Marmont St to Casey St – Roadworks – Cross Sections	21 of 34	2022-12-19	5
Thomas Ave – Marmont St to Casey St – Roadworks – Cross Sections	22 of 34	2022-12-19	5
Thomas Ave – Marmont St to Casey St – Roadworks – Cross Sections	23 of 34	2022-12-19	5
Thomas Ave – Marmont St to Casey St – Roadworks – Cross Sections	24 of 34	2022-12-19	5
Thomas Ave – Marmont St to Casey St – Roadworks – Cross Sections	25 of 34	2022-12-19	5
Thomas Ave – Lebleu St to Nelson St – Service Connection – Plan	26 of 34	2023-01-13	4
Thomas Ave – Nelson St to Marmont St – Service Connection – Plan	27 of 34	2023-01-13	4
Thomas Ave – Marmont St to 50m East of Begin St – Service Connection – Plan	28 of 34	2023-01-13	4
Thomas Ave – 40m West of Teck St to Millview St – Service Connection – Plan	29 of 34	2023-01-13	4
Thomas Ave – 70m West Casey St to Casey St – Service Connection – Plan	30 of 34	2023-01-13	4
Thomas Ave – Lebleu St to Marmont St – Landscaping – Plan	31 of 34	2023-01-13	3
Thomas Ave – Marmont St to Laval St – Landscaping – Plan	32 of 34	2022-12-19	3
Thomas Ave – Laval St to Casey St – Landscaping – Plan	33 of 34	2022-12-19	3
Thomas Ave – Lebleu St to Casey St – Landscaping – Details	34 of 34	2022-12-19	3
Thomas Ave – Lebleu St to Casey St – Street Lighting	1 of 4	2022-12-16	-
Thomas Ave – Lebleu St to Casey St – Street Lighting	2 of 4	2022-12-16	-
Thomas Ave – Lebleu St to Casey St – Street Lighting	3 of 4	2022-12-16	-
Thomas Ave – Lebleu St to Casey St – Street Lighting	4 of 4	2022-12-16	-

Supplementary General Conditions

These Supplementary General Conditions must be read in conjunction with the General Conditions contained in
the Master Municipal Construction Documents, Volume II, Printed 2009

File #: 11-5330-20/77816/1 Doc #: 4695867.v1

SUPPLEMENTARY GENERAL CONDITIONS

TABLE OF CONTENTS

	Page
Supplementary General Conditions to MMCD Volume II, 2009 Issue.....	SGC 1 to SGC 14
Section 1: DEFINITIONS	SGC 3
Section 4: CONTRACTOR	SGC 3 to 6
4.1 Control of Work	SGC 3
4.2 Safety	SGC 4
4.3 Protection of Work, Property and the Public.....	SGC 4
4.6 Construction Schedule	SGC 4
4.7 Superintendent	SGC 5
4.8 Workers.....	SGC 5
4.9 Materials	SGC 5
4.11 Subcontractors	SGC 5
4.12 Tests and Inspections.....	SGC 5 to 6
4.14 Final Clean-up	SGC 6
4.16 Notice of Disruption.....	SGC 6
Section 7: CHANGES	SGC 6 to 7
7.1 Changes.....	SGC 6
7.4 Optional Work.....	SGC 6 to 7
Section 9: VALUATION OF CHANGES AND EXTRA WORK.....	SGC 7
9.2 Valuation Method	SGC 7
9.4 Quantity Variations	SGC 7
Section 10: FORCE ACCOUNTS.....	SGC 7
10.1 Force Account Costs.....	SGC 7
Section 12: HAZARDOUS MATERIALS	SGC 7 to 8
12.2.2 Discovery of Hazardous Materials	SGC 7 to 8
Section 13: DELAYS	SGC 8
13.1.2 Delay by Owner or Contract Administrator	SGC 8
13.8.1 Direction to Stop or Delay.....	SGC 8
13.9.1 Liquidated Damages for Late Completion.....	SGC 8
Section 18: PAYMENT	SGC 8 to 9
18.1.1 Preparation of Payment Certificate	SGC 8
18.4.2 Holdbacks.....	SGC 9
18.6.5 Substantial Performance.....	SGC 9
Section 21: WORKERS COMPENSATION REGULATIONS.....	SGC 9
21.2.1 Contractor is "Prime Contractor"	SGC 9
Section 24: INSURANCE.....	SGC 10 to 14
24.1 General.....	SGC 10
24.2 Required Insurance	SGC 10 to 11
24.3 Physical Loss or Damage with Respect to New Buildings under Construction and/or Major Additions to Existing Structures.....	SGC 11 to 14
24.4 Additional Insured.....	SGC 14

These Supplementary General Conditions must be read in conjunction with the General Conditions contained in
the Master Municipal Construction Documents, Volume II, Printed 2009

Section 25: MAINTENANCE PERIOD	SGC 14
25.1.4 Correction of Defects	SGC 14
Section 27: CONTRACTOR PERFORMANCE EVALUATION	SGC 15
APPENDICES	SGC 16 to SGC 21
Appendix I Performance Bond	SGC 16 to 17
Appendix II Labour and Material Payment Bond	SGC 18 to 19
Appendix III Certificate of Insurance	SGC 20
Appendix IV Prime Contractor Designation Letter	SGC 21

1.0 DEFINITIONS

- 1.1 Abnormal Weather** 1.1.1 ***(Replace clause 1.1.1 as follows):***
“Abnormal Weather” means temperature, precipitation, wind or other weather conditions in which the monthly average, differs from the statistical average for that condition in that period by more than one standard deviation, calculated based on data available from Environment Canada. Coquitlam’s Burke Mountain Rain Gauge will be used to compare the rainfall summary versus the available data from Environment Canada.

City of Coquitlam Rainfall

4.0 CONTRACTOR

- 4.1 Control of the Work** 4.1.1 ***(Add to clause 4.1.1 as follows):***
The *Contractor* is responsible for all survey layout for the construction of the Work to the design specifications and/or elevations as shown on the contract drawings or as amended on site by the Contract Administrator.

- 4.1.2 ***(Add to clause 4.1.2 as follows):***
The Contractor shall not deposit any material upon any street, sidewalk, boulevard or other property, without the Contract Administrator’s or the Owner’s permission, nor shall he allow the same to remain longer than necessary. All surplus spoil and rubbish and other waste material shall be removed from the site so that the area of work is cleaned up and restored to as clean a condition as it was before the Contract started, within four days of the Contract Administrator’s written request to do so, failing which the Owner may carry out the work or have the work carried out by others and recover the costs from the Contractor or may deduct the cost from any monies due or that may become due to the Contractor.

- 4.1.3 ***(Add new clause 4.1.3 as follows):***
Work can be performed during the normal weekday working hours of 0700h to 1900h, unless specified otherwise in Supplementary Specifications - Appendix A: Traffic Management Detail Specifications. Written permission from the Contract Administrator will be required for any works to be performed outside of the normal working days of Monday to Friday.

No Sunday work will be permitted, except in case of emergency and then only with the written permission of the Contract Administrator and to such extent as he deems necessary.

In case the Contractor decides to work on a day which is a Statutory Holiday, he shall provide the Contract Administrator in writing at least (4) days in advance of such holiday, stating those places where said work is to be conducted. In case the Contractor fails to give such notice in advance of any Statutory Holiday, no work within the terms of the contract shall be done on such holiday.

- | | | | |
|-------------|--|---------|---|
| 4.2 | Safety | 4.2.2 | <p><i>(Add new clause 4.2.2 as follows):</i>
<i>In an emergency, gas pipeline rupture or leak, Contact FortisBC's 24 Hour Emergency Line (1-800-663-9911) and Coquitlam Fire (911) immediately and then the City of Coquitlam's Utility Control Centre (604-927-6287).</i></p> |
| 4..3 | Protection of Work, Property and the Public | 4.3.1 | <p><i>(Replace clause 4.3.1 as follows):</i>
In performing the Work the Contractor shall protect the Work and the Owner's property and other person's property from damage. The Contractor shall at the Contractor's own expense make good any such damage which arises as the result of the Contractor's operations. If the Contractor causes damage to private property, the Contactor must obtain a written release from the owner of the damaged property.</p> |
| | | 4.3.5.1 | <p><i>(Add clause 4.3.5.1 as follows):</i>
The Contractor shall notify the Contract Administrator immediately if damage occurs to any City or third party utility or structure.</p> |
| | | 4.3.7 | <p><i>(Add new clause 4.3.7 as follows):</i>
Any lands other than those upon which the work is to be performed, which may be required for temporary facilities, storage purposes or access to the work site, other than those provided by the <i>Owner</i>, shall be provided by the <i>Contractor</i> at his own cost, with no liability to the <i>Owner</i>.</p> |
| 4.6 | Construction Schedule | 4.6.1 | <p><i>(Replace clause 4.6.1 as follows):</i>
The Contractor shall within the time set out in the Form of Tender prepare and submit to the Contract Administrator for his approval a construction schedule (the Baseline Construction Schedule) indicating the planned start and completion dates of major activities of the Work. The Baseline Construction Schedule shall be in more detail than the Preliminary Construction Schedule and shall indicate completion of the Work in compliance with any specified Milestone Dates, including Substantial Performance.</p> |
| | | 4.6.6 | <p><i>(Replace clause 4.6.6 as follows):</i>
The time for the performance of the Work shall commence on the date specified in the Notice to Proceed, or if not so specified, on the date the Notice to Proceed is issued. The Notice to Proceed will not be issued until the documentation required under paragraph 5.1.1 of the Form of Tender has been submitted and the construction schedule has been approved.</p> |
| | | 4.6.8 | <p><i>(Add new clause 4.6.8 as follows):</i>
Any requests to lengthen the work schedule shall be made in writing by the Contractor within five working days of knowledge of the reason for the extension. The Contract Administrator will adjust the schedule at his discretion upon receipt of a written request.</p> |

- | | | | |
|-------------|-----------------------------|--------|---|
| 4.7 | Superintendent | 4.7.4 | <p><i>(Add new clause 4.7.4 as follows):</i></p> <p>The key personnel named in the Contractor's Tender response, shall remain in these key positions throughout the project. In the event that key personnel leave the Contractor's firm, or for any unknown reason are unable to continue fulfilling their role, the Contractor must propose a suitable replacement, and obtain written consent from the Owner. Acceptance of the proposed replacement is at the sole discretion of the Contract Administrator and the Owner.</p> |
| 4.8 | Workers | 4.8.2 | <p><i>(Add new clause 4.8.2 as follows):</i></p> <p>The Contractor shall, upon the request of the Contract Administrator, remove any person employed by him for the purposes of the Contract who, in the opinion of the Contract Administrator, is incompetent or has conducted himself improperly, and the Contractor shall not permit a person who has been removed to return to the Place of Work.</p> |
| 4.9 | Materials | 4.9.3 | <p><i>(Add new clause 4.9.3 as follows):</i></p> <p>The Contractor shall, at his cost,</p> <ul style="list-style-type: none">a) Be responsible for storing all of the materials supplied for the Work either by himself or the Owner, until it has been incorporated into the completed Work;b) Store all materials in a manner which will prevent damage from the weather, dirt, foreign matter, vandalism and theft;c) Arrange for and/or verify the time of delivery of all materials to be supplied by himself or the Owner to ensure that delivery will coincide with his work schedules.d) Examine with the Contract Administrator the quantities and details of all materials supplied by the Owner at the time and place of delivery or those materials already at the Place of Work, and prepare and sign a Statement of Materials Acceptance, specifically noting and rejecting any defective material;e) Replace all materials supplied by himself or the Owner which are found to be stolen, missing or damaged while under his care;f) Replace all materials found to be defective in manufacture which have been supplied by himself. |
| 4.11 | Subcontractors | 4.11.3 | <p><i>(Replace clause 4.11.3 as follows):</i></p> <p>The Contractor shall, upon notice of the Contract Administrator, remove any Subcontractor employed by him for the purposes of the Contract who, in the opinion of the Contract Administrator, is incompetent or has conducted himself improperly, and the Contractor shall not permit the Subcontractor who has been removed to return to the Place of Work. The removal of a Subcontractor under this clause shall not be considered a Change and the Contract Price and the Contract Time shall not be adjusted.</p> |
| 4.12 | Test and Inspections | 4.12.1 | <p><i>(Replace clause 4.12.1 as follows):</i></p> <p>The Contractor shall perform or cause to be performed all tests, inspections and approvals of the Work as described in the</p> |

Contract Documents or as required by the Contract Administrator as part of Quality Control. The Contractor shall complete all the necessary testing at the frequencies described in the Contract Document unless otherwise approved by the Contract Administrator.

Acceptable test and inspection results will not relieve the Contractor of its obligations under the Contract to correct defects or deficiencies in the Work.

4.12.11 ***(Add clause 4.12.11 as follows):***
Failure to follow DFO/FLNRO BMPs and the approved permit for Instream Works or as instructed by Contract Administrator will result in shut-down of the work. The Contractor must take all steps to mitigate impacts to aquatic resources, environment and habitats before work can re-start on site. No claim will be accepted by the Owner for costs associated with this work shut-down.

4.14 **Final Clean-up** 4.14.1 ***(Replace clause 4.14.1 as follows):***
Prior to applying for Substantial Performance, the Contractor shall remove all surplus products, tools, construction machinery and equipment relating to the Work that is not required for the performance of the remaining Work. The Contractor shall also remove waste, debris and waste products other than caused by the Owner or Other Contractors, and leave the Place of Work clean and suitable for occupancy by the Owner unless otherwise specified in the Contract Documents or directed by the Contract Administrator.

4.16 **Notice of Disruption** 4.16.2 ***(Add new clause 4.16.2 as follows):***
Written notice must be provided to all properties which may be physically affected by the construction not less than one week and not more than two weeks prior to construction.

Notify occupants directly affected by the work 48 hours in advance of commencement of construction. Cost of notifying area occupants of ensuing construction and delivery of the notices is incidental to the Contract.

7.0 **CHANGES**

7.1 **Changes** 7.1.3 ***(Replace clause 7.1.3 as follows):***
Additional work that the Owner may wished performed that does not satisfy the requirements of subparagraphs (a) and (b) of GC 7.1.1 is extra work (Extra Work) and is not a Change. Pursuant to GC 8, Extra Work may be declined by the Contractor or may, upon agreement between the parties, be undertaken as Extra Work.

7.4 **Optional Work** 7.4.2 ***(Add new clause 7.4.2 as follows):***
If there are Optional items or Provisional items included in the *Schedule of Quantities and Prices*, those items shall be used only as directed and at the sole discretion of the Contract Administrator. These items will be paid at the contract unit price

as part of regular progress payments. Only quantities used will be eligible for payment. No claim will be accepted for unused Optional or Provisional quantities. Clause 9.4 Quantity Variations will not be applicable for these items.

**9.0 VALUATION OF
CHANGES AND EXTRA
WORK**

9.2 Valuation Method 9.2.4 ***(Replace clause 9.2.4 as follows):***
Once a quotation is accepted by the Contract Administrator, or other agreement reached between the Contract Administrator and the Contractor regarding adjustments to the Contract Price or Contract Time on account of a Change or Extra Work, the Contractor shall not be entitled to claim or receive additional payment, or adjustment to the Contract Time on account of a Change or Extra Work.

9.4 Quantity Variation 9.4.1 ***(Replace clause 9.4.1 as follows):***
If for any reason, including an addition or deletion under GC 7.1.1(1) or 7.1.1(2) respectively, the actual quantity of a unit price item varies by more than plus or minus the Variance Threshold Percentage from the estimated quantity for that unit price item listed in the Schedule of Quantities and Prices (the "Tender Quantity") or as otherwise agreed to pursuant to these Contract Documents, then either the Owner or the Contractor may by written notice request the other party to agree to a revised unit price, considering the change in quantities. A party shall make a request for a revised unit price as soon as reasonably possible after the party concerned becomes aware of the quantity variation.

9.4.2 ***Delete clause 9.4.2(2)***

10.0 FORCE ACCOUNTS

10.1 Force Account Costs 10.1.1(1) ***(Add to clause 10.1.1(1) as follows):***
Costs for the Contractor's Superintendent, Project Managers, Health and Safety Personnel, and Office/Administration Staff are not eligible for labour costs as those costs are considered incidental to the mark up owing for overhead and labour.

10.1.1(4) ***(Replace clause 10.1.1(4) as follows):***
Force Account Work performed by a subcontractor shall be paid for in the lesser of: (i) the amount provided by subparagraphs (1), (2) and (3) of this GC, plus a mark-up of 5%, or (ii) the actual amount the Contractor pays the subcontractor including a mark-up of 10% on such actual costs to cover all overhead and profit.

**12.0 HAZARDOUS
MATERIALS**

**12.2 Discovery of
Hazardous Materials** 12.2.2 ***(Replace clause 12.2.2 as follows):***

If the Contract Administrator observes any materials at the Place of Work that the Contract Administrator knows or suspects may be Hazardous Materials, then the Contract Administrator shall immediately give written notice to the Contractor and the Contractor shall immediately stop the Work or portion of the Work as required by GC 12.2.1(1).

13.0 DELAYS

13.1 Delay by Owner or Contract Administrator

13.1.2

(Add new clause 13.1.2 as follows):

The Owner may at any time suspend the work or any portion thereof provided he gives the Contractor five (5) days' written notice of delay. The Contractor shall resume work upon written notice from the Owner. The Contractor shall be entitled to:

- a) An extension of the Contract time equivalent to the length of suspension of work.
- b) Reimbursement by the Owner for directly related out-of-pocket additional costs, reasonably and necessarily incurred by the Contractor as a result of such suspension. No additional payment will be made to the Contractor for any loss of profits or overhead.

13.8 Direction to Stop or Delay

13.8.3

(Add new clause 13.8.3 as follows):

The Contract Administrator may order the Contractor to stop work if at any time the Contract Administrator is of the opinion that there exists a danger to life or property.

13.9 Liquidated Damages for Late Completion

13.9.1

(Replace clause 13.9.1 as follows):

If the Contractor fails to meet the Milestone Date for Substantial Performance as set out in the Form of Tender, paragraph 2.2 as may be adjusted pursuant to the provisions of the Contract Documents, then the Owner may deduct from any monies owing to the Contractor for the Work:

- (1) An amount of \$1,000.00 for each calendar day the actual *Substantial Performance* is achieved after the Substantial Performance Milestone Date; plus
- (2) All direct out of pocket costs, such as costs for safety, security or equipment rental, reasonably incurred by the Owner as a direct result of such delay.

If the monies owing to the Contractor are less than the total amount owing by the Contractor to the Owner under (1) and (2) then any shortfall shall immediately, upon written notice from the Owner, and upon Substantial Performance, be due and owing by the Contractor to the Owner.

18.0 PAYMENT

18.1 Preparation of Payment Certificate

18.1.1

(Replace clause 18.1.1 as follows):

The Contract Administrator shall prepare and issue a certificate for the period ending the last calendar day of the month.

18.4	Holdbacks	18.4.2	<p><i>(Add to clause 18.4.2 as follows):</i></p> <p>At the sole discretion of the Contract Administrator, an amount equivalent to \$50,000 or 200% of a reasonable estimate, whichever is higher, may be held without interest until all deficiencies have been remedied and accepted by the Contract Administrator.</p>
		18.6	<p>Substantial Performance</p>
18.6	Substantial Performance	18.6.5	<p><i>(Replace clause 18.6.5 as follows):</i></p> <p>The Owner may release any builders lien holdback on the <u>56th day</u> following the date of Substantial Performance, or other date as required by law, but the Owner may hold back the amounts for any deficiencies or filed builders liens as provided in GC 18.4.2, 18.4.3 and 18.4.4.</p>
		18.6.6	<p><i>(Replace clause 18.6.6 as follows):</i></p> <p>The <i>Contract Administrator</i>, as defined herein, shall be the <i>Payment Certifier</i> responsible under Section 7 of the <i>Builders Lien Act</i> for certifying <i>Substantial Performance</i> of the <i>Work</i> of the <i>Contractor</i>, but not the <i>Work</i> of <i>Subcontractors</i>. The <i>Contractor</i> shall cooperate with and assist the <i>Contract Administrator</i> by providing information and assistance in a timely manner as the <i>Contract Administrator</i> considers necessary to carry out the duties of the <i>Payment Certifier</i> for the <i>Contract</i>.</p> <p>The <i>Contractor</i> shall be the <i>Payment Certifier</i> responsible under Section 7 of the <i>Builders Lien Act</i> for certifying <i>Substantial Performance</i> of the <i>Work</i> of each <i>Subcontractor</i>. Prior to certifying completion for a <i>Subcontractor</i>, the <i>Contractor</i> shall consult the <i>Contract Administrator</i> and obtain the <i>Contract Administrator's</i> comments on the status of completion by the <i>Subcontractor</i>, including any deficiencies or defects in the <i>Subcontractor's Work</i> noted by the <i>Contract Administrator</i>. The <i>Contractor</i> will indemnify and save the <i>Owner</i> harmless from any and all liability the <i>Owner</i> may have to anyone arising out of the certification by the <i>Contractor</i> of <i>Substantial Performance</i> for that <i>Subcontractor</i>.</p> <p>Notwithstanding any other provision of the <i>Contract</i>, no payments will be due or owing to the <i>Contractor</i> so long as a Lien filed by anyone claiming under or through the <i>Contractor</i> remains registered against the Project of any lands, or interest therein, on which <i>Work</i> for the project was performed. Failure of the <i>Contractor</i> to remove all Liens promptly will entitle the <i>Owner</i> to damages.</p>
21.0	WORKERS COMPENSATION REGULATIONS		
21.2	Contractor is "Prime Contractor"	21.2.1	<p><i>(Add to clause 21.2.1 as follows):</i></p> <p>Prior to the issuance of the "Notice to Proceed" the Contractor must provide a signed "Prime Contractor Designation" form as provided in Appendix IV of these Supplementary General Conditions.</p>

24.0 INSURANCE

(Replace section 24.0 as follows):

24.1 General

- 24.1.1 Importance of Prompt Attention to Insurance Requirements:**
The Contractor shall provide the Owner with satisfactory evidence that the insurance required to be provided under this GC is in full force and effect.
- 24.1.2 Acceptable Insurance Carriers:**
The insurer issuing any policy, or other document which is evidence of insurance to the Contractor, shall be an insurer licensed by the Superintendent of Insurance in the Province of British Columbia and registered with the Department of Insurance for Canada in Ottawa, except the Insurance Corporation of British Columbia, which is not subject to this condition.
- 24.1.3 Owner's Right to Change Terms:**
Notwithstanding anything contained in the Contract Documents, the Owner will have the right to request a change to the specified terms and conditions respecting insurance at the sole option of the Owner. The Contractor will be notified in writing of any changes required by the Owner and will provide a quotation for such work.
- 24.1.4 Delivery of Insurance Documents:**
All insurance policies or other acceptable specified documents shall be delivered to, and accepted by, the Owner before the Contract Documents are signed. No work shall be commenced by the Contractor or by anyone acting on the instructions of the Contractor, until the required Insurance Documents have been accepted by the Owner and the Contract Documents have been duly signed by the Owner and the Contractor.
- 24.1.5 Owner's Right to Insure:**
Should the Contractor for any reason not comply with the specified requirements with respect to the insurance, the Owner will, at the Owner's option, have the right to purchase all or any part of such insurance which, in the opinion of the Owner, may be required to provide the specified insurance, and, in the event of so doing, the Owner will have the right to pay the premiums for such insurance and to withhold the amount of premiums so paid from any amount due and payable to the Contractor under the Contract.

24.2 Required Insurance

- 24.2.1 General**
Damage to work (excluding Building Contracts where Section 24.3, Paragraph 24.3.1, Further Responsibilities of Contractor, applies).
- The Contractor shall be responsible for any and all loss, or damage, whatsoever which may occur on or to the works, completed or otherwise, until such time as the entire works have been completed and the Notice of Acceptance has been issued by the Owner, except that loss or damage caused solely by an act of

the Owner. In the event of any loss or damage occurring, the Contractor shall, on notice from the Contract Administrator, immediately put the works into the condition it was immediately prior to such loss or damage, all at the

Contractor's expense, except where such loss or damage was caused solely by an act of the Owner.

The Contractor shall be responsible for any and all loss or damage whatsoever which may occur on or to the works, completed or otherwise, arising out of the negligence of the Contractor, any subcontractors, and the employees or agents of any of them.

24.2.2 Public Liability Insurance:
(Other than Automobile Third Party Liability Insurance):

Evidence of Insurance:

The Contractor shall deposit with the Owner, before the work commences, a Certificate of Insurance, signed by an authorized representative of the insurer, such certificate to be as shown in Appendix III.

Effective Dates and Terms:

The effective date of the Certificate of Insurance shall be the date of the execution of the Contract Agreement and the term of this policy shall be from such effective date until a date not less than twelve (12) months after the date of Substantial Performance completion of all work under the Contract.

Limits of Liability:

For bodily injury and for property damage shall be inclusive limits not less than \$5,000,000.

24.2.3 Public Liability Insurance (Automobile):

The Contractor shall deposit with the Owner before the work commences a Certificate of Insurance with respect to owned automobiles on ICBC Form No. APV 47 entitled "Confirmation of Insurance Coverage" and with respect to Non-Owned Automobiles including hired automobiles and Contractual Liability on ICBC non-owned automobile policy Form APV 29 (if non-owned automobile coverage is not included under the comprehensive general liability coverage) each signed by an authorized representative of the Insurance Corporation of British Columbia.

**24.3 Physical Loss or
Damage With Respect
to New Buildings under
Construction and/or
Major Additions to
Existing Structures**

24.3.1 Responsibility for Placing Insurance:

The types of insurance required under this section will be provided and maintained at the expense of the City of Coquitlam during the term of the Contract and will be as follows unless otherwise changed by specific endorsement to these Insurance Specifications.

- 24.3.2 **Insurance Coverage Required:**
Builders Risk Completed Value "All Risks" Course of Construction Insurance. This policy will be written in the names of the City of Coquitlam and the Contractor with loss payable as their respective interests may appear.
- 24.3.3 **Responsibility of Contractor – Limitations of cover and deductibles:**
The insurance provided by the City of Coquitlam as described herein will not provide the Contractor with full protection against any and all kinds of loss or damage which may arise out of the Contract. It is, therefore, the responsibility of the Contractor to fully understand the scope of the cover provided with particular attention to the exclusions, limitations of cover and deductible provisions contained in the Insuring Agreements of the policies and it is further the responsibility of the Contractor to take out at the Contractor's expense, whatever other additional insurance the Contractor may consider necessary or desirable for his protection subject as hereinafter provided. The Contractor shall act in the same manner on insurance made available through the City of Coquitlam as he would if he had arranged such insurance himself.
- 24.3.4 **Responsibility of Contractor – Direct Damage Insurance:**
If the Contractor fails to do all or anything that is required of him concerning insurance, the City of Coquitlam may do what is required and any monies expended by the City of Coquitlam for that purpose shall be repayable and recoverable from the Contractor. Should any action, failure or negligence of the Contractor result in higher insurance costs being incurred by the City of Coquitlam, such additional costs shall be payable or recoverable from the Contractor.
- 24.3.5 **Responsibility of Contractor – Machinery and Equipment Belonging to Others:**
Unless otherwise directed by the City of Coquitlam in writing, the Contractor shall carry insurance covering loss or damage to construction machinery, tools and equipment owned by and/or on bare rental from a third party or parties and used by the Contractor in performing the work, which insurance shall be in a form satisfactory to the City of Coquitlam and having coverage in accordance with the actual cash value of such construction machinery, tools and equipment. Such policies shall also provide for subrogation to be waived against the City of Coquitlam. A certified copy of the policy shall be delivered to the City of Coquitlam not later than thirty days after the commencement of work under the Contract.
- 24.3.6 **Contractor's Waiver of Liability to Coquitlam:**
The Contractor hereby releases the City of Coquitlam from any and all liability for damages to the extent that such damages are covered by the course of construction insurance referred to in Section 24.3 of these specifications.

- 24.3.7 **Liability of Contractor:**
Neither the providing of insurance by the Contractor or the City of Coquitlam in accordance with the requirements hereof, nor the insolvency, bankruptcy, nor failure of any insurance company to pay any claim accruing shall be held to waive any of the provisions of this Contract with respect to the liability of the Contractor or otherwise.
- 24.3.8 **Responsibility of Contractor for protection of work, persons and property:**
The Contractor and all persons employed by the Contractor or under his control, and all employees and subcontractors, shall use due care that no person or property is injured, and that no rights are infringed in the prosecution of the work. Contractors shall take particular care to protect the work against loss or damage caused by riot, vandalism or malicious mischief and shall be at the expense of the Contractor provide all necessary safeguards in the form of watchmen and/or watch dog protection to prevent loss or damage of this type. The payment of deductibles is the responsibility of the Contractor and if not paid by the Contractor such amounts shall be deducted by the City of Coquitlam from payment due to the Contractor. These deductibles will normally be \$250.00 each claim.
- 24.3.9 **Action to be taken in the event of loss or damage to the work covered by the Contract:**
When any loss or damage occurs to the work or to any materials and supplies on the site of the work, the Contractor shall remove any and all damaged or destroyed property and shall rebuild or replace the damaged or destroyed work, materials, or supplies and complete the work to the satisfaction of the Owner. For such removal, rebuilding, or replacing, the Contractor shall be entitled to receive from the Owner the amount of insurance monies received by the Owner pursuant to the said adjustment which amount shall be paid to the Contractor as the work of rebuilding or replacing proceeds, and in accordance with the Agreement. Damage or destruction of the whole or any part of the work shall not affect the rights and obligations of either party under the Agreement, except that in such event the Contractor shall be entitled to such reasonable extension of time to complete the work as the Architect and/or Contract Administrator may decide.
- 24.3.10 **Further responsibility of Contractor:**
Other than with respect to loss or damage arising out of insured risks and herein before specified, the Contractor shall be responsible for all loss or damage whatsoever which may occur on or to the works completed or otherwise, until such time as the entire works have been completed and the Notice of Acceptance has been issued by the Owner, except that loss or damage caused solely by an act of the Owner.
- In the event of any loss or damage occurring, the Contractor shall on notice from the Owner immediately put the works into the

condition it was immediately prior to such loss or damage, all at the Contractor's expense except as previously stated.

24.3.11 Owner Not Responsible for Loss or Damage or Loss of Use of Property of Contractors and their Employees:

The Owner will not be responsible for securing or paying for insurance of any kind other than as specified in Section 24.3 of these specifications nor will the Owner have any responsibility whatsoever for loss or damage from whatever cause occurring to property owned, leased, or otherwise in the possession of the Contractor, subcontractors or their employees including, without restricting the generality of the foregoing, machinery, equipment, tools, supplies, and clothing at the construction site or elsewhere including loss of use of same.

24.4 Additional Insured 24.4.1 The Contractor shall ensure the following are named as "additional insured" on the liability policy for this contract:

- The City of Coquitlam

The City may identify private properties that are directly affected by construction. If so, the Contractor shall include the legal owners of these properties named as "additional insured" on the liability policy for this contract.

25.0 MAINTENANCE PERIOD

25.1 Correction of Defects 25.1.4 *(Add new clause 25.1.4 as follows):*

The Owner is authorized to make repairs to defects or deficiencies if, ten days after giving written notice, the Contractor has failed to make or undertake with due diligence the required repairs. However, in the case of emergency where, in the opinion of the Owner, delay is not reasonable, repairs may be made without notice being sent to the Contractor. All expenses incurred by the Owner in connection with repairs made pursuant to GC 25 shall be paid by the Contractor or may be deducted from the Maintenance Security, or other holdbacks. The Contractor shall promptly pay any shortfall.

**27.0 CONTRACTOR
PERFORMANCE
EVALUATION**

27.1

(Add new clause 27.1 as follows):

After the completion of the Contract, the Contractor will be evaluated on their performance of the Work. The evaluation will provide percentage scores on the following categories:

1. *Contract Administration*
2. *Construction Management*
3. *Schedule Management*
4. *Communications*
5. *Resource Management and Contractor Performance*
6. *Quality Management*

An evaluation summary report may be issued to the Contractor with scores for each of these categories. Upon request, the Contractor may attend a meeting with the City to discuss the evaluation.

This internal evaluation may be reviewed for reference on subsequent tenders with the City. Evaluation scores can form part of the tender analysis and influence contract award decisions.

Evaluation Scores in categories that are below 50% may result in a suspension of tendering privileges with the City.

APPENDIX I

PERFORMANCE BOND

NO. _____ \$ _____

KNOW ALL MEN BY THESE PRESENTS THAT

As Principal, hereinafter called the Principal, and

As Surety, hereinafter called the Surety, are held and firmly bound unto

As Obligee, hereinafter called the Obligee, in the amount of

Dollars
(\$)

lawful money of Canada, for the payment of which sum, well and truly to be made, the Principal and the Surety bind themselves, their heirs, executors, administrators, successors and assigns, jointly and severally, firmly by these presents.

WHEREAS, the Principal has entered into a written contract with the Obligee, dated the _____

day of _____ 20____, for

in accordance with the drawings and specifications submitted, therefore, which contract, drawings and specifications and addenda thereto, to the extent provided for, are by reference made part hereof and are hereinafter referred to as the Contract.

NOW THEREFORE, THE CONDITION OF THIS OBLIGATION is such that, if the Principal shall promptly and faithfully perform said Contract (including any addenda thereto, provided such addenda do not collectively increase the amount to be paid to the Principal by more than twenty per cent (20%) of the amount of the Contract except with the written consent of the Surety) then this obligation shall be null and void; otherwise, it shall remain in full force and effect.

Whenever the Principal shall be, and declared by Obligee to be, in default under the Contract, the Obligee having performed Obligee's obligations thereunder, the Surety may promptly remedy the default, or shall promptly:

1. Complete the Contract in accordance with its terms and conditions, or
2. Obtain a bid or bids for submission to Obligee for completing the Contract in accordance with its terms and conditions, and upon determination by Obligee and Surety of the lowest responsible bidder, arrange for a contract between such bidder and Obligee and make available as work progresses (even though there should be

These Supplementary General Conditions must be read in conjunction with the General Conditions contained in the Master Municipal Construction Documents, Volume II, Printed 2009

a default or a succession of defaults under the contract or contracts of completion arranged under this paragraph) sufficient funds to pay the cost of completion less the balance of the contract price; but not exceeding, including other costs and damages for which the Surety may be liable hereunder, the amount set forth in the first paragraph hereof. The term 'balance of the contract price', as used in this paragraph, shall mean the total amount payable by Obligee to Principal under the Contract less the amount properly paid by Obligee to Principal.

Any suit under this Bond must be instituted before the expiration of two (2) years from date on which the Notice of Acceptance under the Contract is issued.

The Surety shall not be liable for a greater sum than the specified penalty of this Bond.

No right of action shall accrue on this Bond to or for the use of any person or corporation other than the Obligee named herein or the heirs, executors, administrators, or successors of Obligee.

IN TESTIMONY WHEREOF, the Principal has hereto set its hand and affixed its seal, and the Surety has caused these presents to be sealed with its corporate seal duly attested by the signature of its Attorney-in-fact, this _____ day of _____ 20 ____.

SIGNED, SEALED and DELIVERED

In the presence of

)
)
)
)
)

PRINCIPAL

SURETY

APPENDIX II

LABOUR AND MATERIAL PAYMENT BOND

(Private Contracts – Trustee Form)

NO. _____

\$ _____

Note: This Bond is issued simultaneously with another Bond in favour of the Obligee conditioned for the full and faithful performance of the Contract.

KNOW ALL MEN BY THESE PRESENTS THAT

As Principal, hereinafter called the Principal, and

As Surety, hereinafter called the Surety, are, subject to the conditions hereinafter contained, held and firmly bound unto

As Trustee, hereinafter called the Obligee, for the use and benefit of the Claimants, their and each of their heirs, executors, administrators, successors and assigns in the amount of

Dollars
(\$ _____) lawful money of Canada, for the payment of which sum well and truly to be made, the Principal and the Surety bind themselves, their heirs, executors, administrators, successors and assigns jointly and severally, firmly by these presents.

SIGNED AND SEALED this _____ day of _____, 20____.

WHEREAS, the Principal has entered into a written contract with the Obligee dated the _____ day of _____, 20____, for

which contract is by reference made a part hereof, and is hereinafter referred to as the Contract.

NOW, THEREFORE, THE CONDITION OF THIS OBLIGATION is such that, if the Principal shall make payment to all Claimants for all labour and material used or reasonably required for use in the performance of the Contract, then this obligation shall be null and void; otherwise it shall remain in full force and effect, subject, however, to the following conditions:

1. A Claimant for the purpose of this Bond, is defined as one having a direct contract with the Principal for labour, material, or both, used or reasonably required for use in the performance of the Contract, labour and material being construed to include the part of water, gas, power, light, heat, oil, gasoline, telephone service or rental equipment directly applicable to the Contract provided that a person, firm or corporation who rents equipment to the Principal to be used in the performance of the Contract under a contract which provides that all or any part of the rent is to be applied towards the

These Supplementary General Conditions must be read in conjunction with the General Conditions contained in the Master Municipal Construction Documents, Volume II, Printed 2009

purchase price thereof shall only be a Claimant to the extent of the prevailing industrial rental value of such equipment for the period during which the equipment was used in the performance of the Contract. The prevailing industrial rental value of equipment shall be determined, insofar as it is practical to do so, in accordance with and in the manner provided for in the latest revised edition of the publication of the Canadian Construction Association entitled "Rental Rates on Contractors' Equipment" published prior to the period during which the equipment was used in the performance of the Contract.

2. The Principal and the Surety hereby jointly and severally agree with the Oblige as Trustee that every Claimant who has not been paid as provided for under the terms of his contract with the Principal before the expiration of a period of ninety (90) days after the date on which the last of such Claimant's work or labour was done or performed or materials were furnished by such Claimant, may as a beneficiary of the trust herein provided for, sue on this Bond, prosecute the suite to final judgment for such sum or sums as may be justly due to such Claimant under the terms of his said contract with the Principal and have execution thereon. Provided that the Oblige is not obliged to do or take any act, action or proceeding against the Surety on behalf of the Claimants or any of them to enforce the provisions of this Bond. If any act, action or proceeding is taken either in the name of the Oblige or by joining the Oblige as a party to such proceedings then such act, action or proceeding shall be taken on the understanding and basis that the Claimants or any of them who take such act, action or proceeding shall indemnify and save harmless the Oblige against all costs, charges and expense or liabilities incurred thereon and any loss or damage resulting to the Oblige by reasons thereof. Provided still further that subject to the foregoing terms and conditions, the Claimants or any of them may use the name of the Oblige to sue on and enforce the provisions of this Bond.
3. No suit or action shall be commenced hereunder by any Claimant:
 - a) unless such Claimant shall have given written notice within the time limits hereinafter set forth to each of the Principal, Surety and Oblige, stating with substantial accuracy the amount claimed. Such notice shall be served by mailing the same by registered mail to the Principal, Surety and Oblige at any place where an office is regularly maintained for the transaction of business by such persons or served in any manner in which legal process may be served in the Province or other part of Canada in which the subject matter of the contract is located. Such notice shall be given (i) in respect of any claim for the amount or any portion thereof required to be held back from the Claimant by the Principal under either the terms of the Claimant's contract with the Principal or under the Mechanic's Liens Legislation applicable to the Claimant's contract with the Principal whichever is the greater within one hundred and twenty (120) days after such Claimant should have been paid in full under the Claimant's contract with the Principal; (ii) in respect of any claim other than for the holdback or portion thereof referred to above within one hundred and twenty (120) days after the date upon which such claimant did or performed the last of the work or labour or furnished the last of the materials for which such claim is made under the Claimant's contract with the Principal.
 - b) after the expiration of one (1) year following the date on which Principal ceased work on the Contract including work performed under guarantees provided in the Contract.
 - c) Other than in a court of competent jurisdiction in the Province or District of Canada in which the subject matter of the Contract or any part thereof is situated and none elsewhere, and the parties hereto agree to submit to the jurisdiction of such court.
4. The amount of this Bond shall be reduced by and to the extent of any payments made in good further and in accordance with the provisions which may be filed of record against the subject matter of the Contract, whether or not claim for the amount of such lien be presented under and against this Bond.
5. The Surety shall not be liable for a greater sum than the specified penalty of this Bond.

IN TESTIMONY WHEREOF, the Principal has hereto set its hand and affixed its seal, and the Surety has caused these presents to be sealed with its corporate seal duly attested by the signature of its Attorney-in-fact the day and year first above written.

SIGNED, SEALED and DELIVERED

In the presence of

)
)
)
)
)

PRINCIPAL

SURETY

These Supplementary General Conditions must be read in conjunction with the General Conditions contained in the Master Municipal Construction Documents, Volume II, Printed 2009

APPENDIX III

CERTIFICATE OF INSURANCE

This Certificate issued to the City of Coquitlam is to certify that policies of insurance, as described below, have been issued to the Insured named below and are in force at this time. It is understood and agreed that thirty (30) days' prior written notice by registered mail of any material alterations, transfer, assignment or cancellation of any of the policies listed below, either in part or in whole, will be given to the holder of this Certificate.

- A. This Certificate is issued to: **City of Coquitlam**
3000 Guildford Way
Coquitlam, BC V3B 7N2
- Named Insured and Mailing Address:
- B. CONTRACT NUMBER AND/OR NAME Description of the Work:
- C. INSURANCE POLICY
- Name of Insurer: Liability Limit:
Policy Number: Expiry Date:
Effective Date:
- D. INSURANCE COVERAGE
- COMMERCIAL GENERAL LIABILITY** coverage is required to insure against liability from the activities arising out of operations or work in connection with the above-described project, including liability arising out of the use of City property.
- D.1 The minimum limit shall be \$5,000,000.00 inclusive per occurrence against bodily injury, personal injury and property damage.
- D.2 The City of Coquitlam, its employees, officers, agents and volunteers are added as Additional Insureds, but only with respect to operations conducted by or on behalf of the Named Insured in connection with the above-described project, operations or work.
- D.3 This insurance shall be primary as regards the City of Coquitlam, its employees, officers, agents and volunteers as Additional Insureds.
- D.4 Any deductible or reimbursement clause contained in the policy shall not apply to the City of Coquitlam and shall be the sole responsibility of the Named Insured.
- D.5 The insurance shall include the following coverages:
- D.5.1 Cross Liability Clause
- D.5.2 Non-Owned Automobile Liability
- D.5.3 Unlicensed Automobile Liability
- D.5.4 Blanket Contractual Liability
- D.5.5 Broad Form Property Damage Liability
- D.5.6 Owner's & Contractor's Protective Liability
- D.5.7 Products & Completed Operations Liability
- D.6 Indicate provision of special coverage for this project as required by the City:
- | YES | NO | Special Coverage Description |
|-----|-----|---|
| () | (X) | Shoring and Underpinning Hazard |
| () | (X) | Pile Driving and Vibrations |
| (X) | () | Excavation Hazard |
| () | (X) | Demolition |
| () | (X) | Blasting |
| D.7 | () | () PROFESSIONAL LIABILITY INSURANCE for Consultant Service Agreements |

The *Consultant* shall obtain and maintain for the duration of the *Services* as described in the Agreement, at its own cost, Professional Liability Insurance on terms and from an insurer satisfactory to the City of Coquitlam.

The Professional Liability Insurance policy shall insure the *Consultant's* legal liability for errors, omissions and negligent acts, to the extent of no less than \$500,000.00 per Claim and \$1,000,000.00 Aggregate.

Authorized Signature and Stamp

Date

Name and Title

City' broker to return to City Representative

Department

These Supplementary General Conditions must be read in conjunction with the General Conditions contained in the Master Municipal Construction Documents, Volume II, Printed 2009



APPENDIX IV

PRIME CONTRACTOR DESIGNATION

Subject: **Prime Contractor Designation**
Contract #: **77816**
Contract Name: **Thomas Ave Frontage Improvements** (the "Project")

_____ (the "Contractor") represents, acknowledges and agrees that:

1. in accordance with section 118 of the Workers Compensation Act, R.S.B.C. 1996, c. 492 (the "Workers Compensation Act"), the Contractor shall be the "Prime Contractor" and is qualified to act as the "Prime Contractor" in respect of the Project;
2. the Contractor accepts the duties and responsibilities for coordination of health and safety in accordance with the Workers Compensation Act and further agrees that it will do everything necessary to establish and maintain a system or process that will insure compliance with the Workers Compensation Act and the Regulations thereto;
3. the Contractor shall fulfill all the obligations of an "Owner" under section 119 of the Workers Compensation Act in respect of the Project site; and
4. that the City of Coquitlam has fulfilled its obligations as an "Owner" under section 119 of the Workers Compensation Act, in respect of the Project site.

Prime Contractor Name & Address:

Prime Contractor Signature

Date

Print Name

Please return a signed copy of this memo to the City of Coquitlam. If you have any questions, please contact the City's Health and Safety Advisor at 604-927-3068.

Supplementary Contract Specifications

These Supplementary Contract Specifications must be read in conjunction with the Specifications contained in the Master Municipal Construction Documents, Volume II, Printed 2009 and the City of Coquitlam Supplementary Specifications and Detailed Drawings

File #: 11-5330-20/77816/1 Doc #: 4695900.v1

Supplementary Contract Specifications

to the
MASTER MUNICIPAL SPECIFICATIONS
Volume II – Platinum Book

Thomas Ave Frontage Improvements

CONTRACT 77816

TABLE OF CONTENTS

The following Supplementary Specifications are to be considered part of the Specifications. These Supplementary Specifications take precedence over the Master Municipal Specifications.

SUPPLEMENTARY CONTRACT

SPECIFICATIONS INDEX	SS 1
00 72 43S Contract Specific Notations	SS 2 to SS 6
01 33 01S Project Record Documents	SS 7
01 45 00S Quality Control	SS 8 to SS 9
01 55 00S Traffic Control, Vehicle Access and Parking	SS 10 to SS 11
01 57 01S Environmental Protection	SS 12 to SS 13
01 58 01S Project Identification	SS 14
03 30 20S Concrete Walks, Curbs and Gutters	SS 15 to SS 16
03 30 53S Cast-In-Place Concrete	SS 17
03 40 01S Precast Concrete	SS 18
26 56 01S Roadway Lighting	SS 19 to SS 23
31 05 17S Aggregates and Granular Material	SS 24
31 11 01S Clearing and Grubbing	SS 25
31 11 41S Shrub and Tree Preservation	SS 26
31 22 01S Site Grading	SS 27
31 22 16S Reshaping Granular Roadbeds	SS 28
31 23 01S Excavating, Trenching and Backfilling	SS 29
31 24 13S Roadway Excavation, Embankment and Compaction	SS 30 to SS 31
32 01 16.7S Cold Milling	SS 32
32 11 16.1S Granular Subbase	SS 33
32 11 23S Granular Base	SS 34
32 12 13.1S Asphalt Tack Coat	SS 35
32 12 16S Hot-Mix Asphalt Concrete Paving	SS 36 to SS 37
32 14 01S Unit Paving	SS 38
32 17 23S Painted Pavement Markings	SS 39 to SS 40
32 91 21S Top Soil and Finish Grading	SS 41 to SS 48
32 92 23S Sodding	SS 49 to SS 53
32 93 01S Planting of Trees, Shrubs and Ground Covers	SS 54 to SS 64
33 11 01S Waterworks	SS 65 to SS 71
33 30 01S Sanitary Sewers	SS 72 to SS 74
33 40 01S Storm Sewers	SS 75 to SS 77
33 44 01S Manholes and Catchbasins	SS 78 to SS 79

1.00 CONTRACT SPECIFIC INSTRUCTIONS

1.01 Schedule of Work

All work under this Contract is to be completed by the designated Substantial Performance Date as described in the Contract Documents. The Contractor must provide sufficient resources in a continuous effort and site presence to complete all the work within the allotted time. As set out in the MMCD the Contractor must provide updates to the construction schedule biweekly.

1.02 Coordination of Work

The Contractor shall be responsible to consult with all affected businesses, residents, transportation companies regarding delays, detours, and any other works affecting any transit service in the area, and will be responsible to coordinate the works with City crews and other contractors working in the area. If working area is to become a multiple-employer workplace as defined by WorkSafe BC, the Contractor shall remain the Prime Contractor.

1.03 Outside Agency Approval

In accordance with the Contract Documents, the Contractor is responsible to consult with and obtain any approval required to meet and comply with all the conditions required from outside agency such as, but not limited to, BC One Call, Metro Vancouver, BC Hydro, Telus, Kinder Morgan, and Fortis BC in the area of the place of Work.

1.04 Waste Collection Coordination

1. Contractor is responsible to accommodate all waste collection vehicles and cart pick up schedules throughout construction. Collection schedule can be found in <https://www.coquitlam.ca/157/Collection-Calendar-Guidelines>.
2. If waste collection will be impacted the contractor is responsible to:
 - a. Provide advanced notification to:
 - i. The City's Solid Waste staff at 604-927-3500 or wastereduction@coquitlam.ca; and
 - ii. The City's Contract Administrator.
 - b. Provide access for collection trucks to closed streets due to road work; or
 - c. Move waste carts for collection:
 - i. The Contractor is required to ensure each cart is labelled with the property address and returned to the correct address after collection (each cart has its own individual cart identification code and is specifically assigned to each property). **Contractors will be responsible for the costs to replace missing carts.**
3. Contractor's Request for Change in Collection Time (e.g. PM to AM):
 - i. The Contractor must provide residents with as much notice as possible – minimum 5 working days.
 - ii. The contractor must follow all conditions of Clause 1.04 and is responsible to deal with any missed collections. For example, taking garbage to the United Boulevard Recycling and Waste Centre or covering the cost associated for any missed collection to be rescheduled.

Questions: wastereduction@coquitlam.ca

1.05 Cooperation with Emergency and Maintenance Activities

The Contractor will be responsible to cooperate with regular maintenance or emergency vehicles and staff for access to the site when required including:

- Fire, Police, and Ambulance
- Waste Connections / GFL Environmental (garbage/recycling pick-up)
- City Utilities Maintenance (or representatives)
- Other Contractors

1.06 Site Safety

The Contractor is responsible to ensure the construction site is safe at all times for workers, pedestrians, and vehicle traffic. During non-working hours, the Contractor

CONTRACT SPECIFIC NOTATIONS

must ensure that the site has all potentially hazardous areas appropriately identified and protected, and also must provide appropriate signage, lighting, and markings for the direction of vehicle and pedestrian traffic, all to ensure the safety of the public. Supply and use of this equipment is considered incidental to the contract.

Manhole lids, valve boxes and other appurtenances within the roadway that may present a traffic hazard during construction must be clearly marked for traffic.

Manhole lids left raised in preparation for paving must have a rubberized protector ring painted with bright color for traffic safety. Supply and use of this equipment is considered incidental to the contract.

1.07 Lane Closure Restrictions

The contractor shall refer to Contract Supplementary Specifications Section 01 55 00S and to Appendix A: Traffic Management Detail Specifications.

The Contractor must take the above information into account in the preparation and submission of the Tender.

1.08 Survey Layout

Construction layout will be staked out by the Contractor as outlined in Supplementary General Conditions.

1.09 Location of Existing Utilities

The contractor is responsible to verify the depth and location of all utilities (watermains, storm mains, sanitary mains & etc.), including outside agency utilities (i.e. Fortis BC Gas Mains & etc.) and service connections (water, storm & sanitary services at the mains & property lines) by hand digging or by Hydro-Vac in the presence of the Inspector.

Pre-locates must be completed as soon as possible after award of the contract so changes can be completed by the Engineer prior to site construction. Contact Metro Vancouver for location of their utilities and BC One for location of other outside agency utilities. The contractor will not receive any compensation or allowance for delays if work is halted due to utilities & services connections not located prior to commencing construction.

City of Coquitlam does not guarantee water, storm or sanitary services connections are perpendicular to the mains or property lines, the contractor will not receive any compensation for the time to locate these connections or for exposing hidden services at the property lines.

Payment for this work will be treated as incidental to payment for work described in other Sections.

1.10 Manholes & Valves

Access to manholes and valves must be maintained at all time for city utilities crews and external utility companies. In case of an emergency the cost for exposing any buried manhole or valve covers during construction will be paid by the contractor.

1.11 Verification of Dimensions and Quantities

Before proceeding with work the Contractor shall visit the site and check and verify dimensions and quantities. Report variations between drawings and site conditions to the Contract Administrator before proceeding with work. Payment for this work will be treated as incidental to payment for work described in other Sections.

1.12 Precautions

Protect areas under construction from damage caused by excessive erosion, flooding, heavy rains, etc. Repair or replace unprotected damaged areas as directed by the Contract Administrator at no cost to the Owner.

1.13 Work by Others

The Contractor is required to accommodate the City crews, Contractors, Developers and Utility companies in their scheduling and sequencing of work at no cost to the Owner.

CONTRACT SPECIFIC NOTATIONS

- | | |
|---|--|
| 1.14 FORTIS BC Emergency Protocol | In an emergency, gas pipeline rupture or leak, Contact Fortis BC 24 Hour Emergency Line (1-800-663-9911) & Fire Department (911) immediately and then City Coquitlam Utility Control Centre (604-927-6287) |
| 1.15 Temporary Asphalt Pavement Restoration | <p>The Contractor will be required to backfill all trenches (in paved areas) and place a temporary patch (50mm of hot mix asphalt), as per Coquitlam Standard Drawing COQ-G4, the same day excavation is made, unless otherwise approved by the Contract Administrator.</p> <p>Temporary asphalt patch on driveways is not required, but access must be maintained for property owners.</p> |
| 1.16 Order of Construction | <p>The Contractor will be required to conduct the work in the order listed below, unless otherwise approved by the Contract Administrator:</p> <ol style="list-style-type: none"> .1 Underground work .2 Curb and gutter installation .3 Driveway access testing and adjustments .4 Sidewalk adjustments as needed .5 Surface work |
| 1.17 Adjustment in elevation | <p>“Change in Design” is a significant alteration to the original design or for additional work not shown in contract drawings or described in contract documents. Adjustment in elevation of sidewalk/driveway is specified in the contract drawing and described in contract documents, and is not considered a “Change in Design”. The need for a “Change in Design” will be determined by the Contract Administrator.</p> |
| 1.18 Measurement for Payment | <p>Payment for all work performed under this section will be incidental to work in other Sections, unless otherwise described in Schedule of Quantities and Prices.</p> |
| 2.00 CONSTRUCTION ACTIVITY | |
| 2.01 Construction Materials in Sewer Manholes and Pipe | <p>The Contractor is responsible to ensure that construction activities do not deposit construction materials (e.g. gravels) into the storm sewer or sanitary sewer manholes or pipe. The City has a video record of the pipe before construction. Prior to Substantial Performance, the City may again video inspect the lines to ensure no problems exist due to construction activities under this contract. If problems are encountered, the Contractor will be responsible for the cost of the video and all costs associated with the cleaning of the pipe.</p> |
| 2.02 Site Clean-up During Construction and End of Construction | <p>The Contractor will be responsible for the complete clean-up of the work site during construction & at the end of construction and prior to the Substantial Performance review. This work is considered incidental to the Contract.</p> <p>The work will include cleaning of all catch basins periodically or as directed by the Contract Administrator within the Work area, or nearby location as affected by the Work, to the same or better condition of the catch basins prior to starting the Work. All cleaning is to be performed by vacuum truck to the satisfaction of the Contract Administrator and will include off-site disposal of waste material.</p> <p>Payment for this work will be treated as incidental to payment for work described in other Sections.</p> |
| 2.03 Asphalt Milling Operations | <p>Asphalt milling activities shall be done in such manner so as to cause the least disruption and inconvenience to traffic and area residents.</p> <p>The Contractor will be required to provide a plan and schedule for milling sections and the subsequent paving activities and have that approved by the Contract Administrator. This schedule is to be updated as required and take into consideration</p> |

CONTRACT SPECIFIC NOTATIONS

weather conditions and weather forecasts to ensure work subsequent to milling can be completed in appropriate weather.

MILLING OF EXTENSIVE AREAS THAT CANNOT BE PAVED WITHIN 48 HOURS PERIOD (2 DAYS) WILL NOT BE PERMITTED.

**3.00 MANDATORY MEETINGS
AND CONTRACTOR
REPRESENTATIVES AND
SUBCONTRACTORS**

**3.01 Pre-Construction Meeting
Requirements**

After the Award of the Contract, the Contractor (Project Manager & Superintendent) will be required to attend a Pre-Construction Meeting with the Contract Administrator and provide all necessary information required by the Contract Administrator prior to provision of a Notice to Proceed. Items required to be provided at the meeting include:

1. A Detailed Construction Schedule showing the start date & completion date and the durations of major work components showing how all work will be completed within the Contract Duration.
2. Proof of insurance
3. Performance Bond and Labour and Materials Payment Bond
4. WCB Clearance Letter and copy of Notice of Project
5. City of Coquitlam Business License
6. A copy of portions of your Health and Safety Plan including the Title Page, Table of Contents, and portion showing latest revision date.

**3.02 Contract Schedule,
Contract Duration, and
Charges**

A detailed, realistic construction schedule for this project will be required to be presented at the pre-construction meeting. The schedule must show major components and durations.

All work under this project is to be completed within the designated Contract Duration as contained in the signed Contract Agreement, or as formally amended.

**3.03 Contract Superintendent
and Subcontractors**

In compliance with the MMCD General Conditions, Section 4.7, Superintendent, the Contractor shall have a competent senior representative, (the "Superintendent") in FULL TIME attendance at the Place of Work while work is being performed for the duration of the contract.

This (FULL TIME) attendance is also required when work is being performed by Subcontractors.

Work done by Subcontractors is to be directed by the Superintendent and monitored on site ensuring conformance to the Contract Documents and other particular direction to the Superintendent by the Contract Administrator.

The Owner and Contract Administrator are not responsible for the direction of Subcontractors.

**3.04 Pre-Paving
Site Meeting**

The Contractor will be required to have a pre-paving meeting with their paving staff, on-site, just prior to paving to provide instruction regarding the existing grading and requirements for the paving process and the end product.

The Contractor must provide information to the Contract Administrator, for review, regarding proposed paving elevation control method, mat thickness control method, and rolling patterns.

CONTRACT SPECIFIC NOTATIONS

The Contractor Administrator must be in attendance at this meeting. It will be the responsibility of the Contractor's Contract Superintendent to ensure continuity between the base preparation and the paving process.

**3.05 Changes of Contractor
Representatives &
Subcontractors**

The Superintendent and Subcontractors indicated in the Form of Tender shall not be changed unless:

1. The Owner requests a replacement.
2. The Contractor submits an application for a change, in writing, to the Contract Administrator with the change being approved in writing.

**3.06 Mobilization and
Demobilization**

Payment for mobilization and demobilization of all equipment, labour and materials (both from the Contractor and all sub-contractors) shall be incidental.

END OF SECTION

1.0 GENERAL

1.3 Submission

Delete 1.3.2 and
replace with the
following

Submit one copy of an accurate project record document in final form prior to applying for Substantial Performance including any video report. Record documents to include changes in the Issued for Construction Drawings, new elevation, offsets & location of all utilities, manhole rim, catchbasin rim, vaults, valve boxes, inverts walkways/sidewalks, and any unknown/new utilities found on site. Legal holdbacks will not be released until record documents have been submitted and accepted by the Contract Administrator.

Contractor to get sign off letter duly signed by the property owners when private side side is affected by the work. Properties to get the sign off letters will be at the sole discretion of the Contract Administrator.

Payment for all work performed under this section will be incidental to work in other Sections, unless otherwise described in Schedule of Quantities and Prices.

END OF SECTION

QUALITY CONTROL

- 1.0 QUALITY**
- The Contractor shall provide a final product conforming to the Contract Documents and the intent of the work.
- The work is to be accurate to the dimensional and tolerance requirements of the contract.
- Payment will be subject to adjustments based on quality assurance tests performed by the Contract Administrator.
- 1.1 Quality Control (QC) by Contractor**
- The MMCD (2009) definition of “Quality Control” is the process by which the *Contractor* checks specific materials, products, and workmanship to ensure strict conformance with the Contract Documents.**
- The Contractor is fully responsible for quality control of the materials, production, and construction processes.
- Quality control tests shall be performed by the Contractor, at their own expense, to ensure that products meet the contract specifications.
- Failure by the Contractor to conduct adequate quality control testing during production and construction will negate the Contractor’s ability to appeal the quality assurance tests used for acceptance/rejection of the work.
- Under no circumstances will QC test results produced after completion of the Quality Assurance (QA) results be considered for appeal purposes.
- Any changes in the Work with respect to the location, grade, or line shall be approved in advance by the Contract Administrator. Failure to notify the Contract Administrator of changes in writing may result in rejection of Work.
- 1.2 Inspection of Work, Quality Assurance, and Material Testing, by the Owner**
- The MMCD (2009) definition of “Quality Assurance” means the process by which the *Owner* evaluates if the work is being constructed in accordance with the Contract Documents. This definition will be used for this contract**
- The *Contract Administrator* may provide construction review through spot inspections and spot materials testing for Quality Assurance.
- Any materials testing results indicating a non-conformance to the Contract Documents will require construction corrective action by the *Contractor*.**
- All subsequent testing to corrective action to verify conformance to the Contract Documents will be the full responsibility of the *Contractor*.**
- Inspection review by the Owner will not relieve the Contractor from providing a product that meets or exceeds the requirements of the Contract Documents.
- 1.3 Inspection**
- Materials testing shall be as described in MMCD General Conditions, Section 4.12 with the following change:
- Delete Section 4.12.2(a) and insert the following:
- Where the MMCD specification clauses for Inspection and Testing indicate the Contract Administrator will arrange for all testing for work described in this section will be amended to read The Contractor will arrange for and pay for all testing for work described in this section. The testing shall take place at the following prescribed rates and as directed by the Contract Administrator. The Contract Administrator has the authority to call for testing, up to the rates and frequencies specified, at the Contractors cost.
- All testing covered under this item shall be performed by a CCIL certified laboratory and technicians with copies of all test results to be sent directly to the Contract Administrator. Re-testing resulting from failed first tests shall be at the Contractors expense.

- 1.4 Survey Layout** The Contractor shall be responsible for all survey layouts. All Survey Layout will be completed in accordance with the Contract Drawings and Coordinate System set out within them. The Contractor will be provided digital AutoCAD files but shall be responsible to confirm elevations and tie in locations and report any discrepancies prior to construction.
- The Contractor shall be responsible for the preservation of all layout stakes and marks. If at any time during the progress of the work any error shall appear or arise in the position, levels, dimensions or alignment of any part of the work, the Contractor shall stop work on his portion of the project and shall notify the Contract Administrator. The Contractor shall make all the necessary corrections required.
- 1.5 Testing** Contractor shall carry out inspection and testing (QC) to ensure compliance with Contract Documents. Contractor shall submit test results within one week of testing to the Contract Administrator. The Contractor shall provide test results prior to the preparation of the payment certificate.
- 1.6 Contractors Responsibilities** Furnish labour and facilities to:
1. Provide access to work to be inspected
 2. Facilitate inspections and tests
 3. Make good work disturbed by inspection and tests
- 1.7 Access to Work** Allow inspection testing agencies access to Work.
- 1.8 Tests** Test rates and frequencies (excluding failed tests), when not defined in the MMCD or Detail Specifications Sections shall be at the following frequencies:
1. Trench Backfilling and Compaction
 - 1.1 Compaction: 1 test / 10 lm / 300mm lift
 - 1.2 Sieve: 1 test / placed material / 50 m³
 2. Granular Base
 - 2.1 Compaction: 1 test/500m² / 100mm depth of granular base, min. 1 test if < 500m²
 - 2.2 Sieve: 1 test / placed material / 250 TONNES
 3. Granular Subbase
 - 3.1 Compaction: 1 test/500m²/150mm depth of granular subbase, min. 1 test if <500m²
 - 3.2 Sieve: 1 test / placed material / 250 TONNES
 4. Embankment (Subgrade)
 - 4.1 Compaction: 1 test/ 50m² / 0.15m depth of fill, min. 1 test if < 50m²
 - 4.2 Sieve: 1 test / placed material / 100 TONNES
 5. Asphalt
 - 5.1 Marshall test: 1 test per 250 TONNES placed, per mix specified, min. 1 / day
ASTM D1559, D3203, C117, C136
 - 5.2 Superpave: 1 test per 250 TONNES placed, per mix specified, min. 1 / day
CAI-SP2, ASTM D3203, C117, C136
 - 5.3 Cores: 1 per 500 m²/lift
 - 5.4 Continuous asphalt density testing during paving.
 6. Subgrade Preparation
 - 6.1 Compaction & Moisture: 1 test / 500 m², min. 1 test if < 500m²
 7. Concrete Tests
 - 7.1 Air, Slump & 1 Set Cylinders: 1 test / 10 m³, min. 1 set / day
- 1.9 Measurement for Payment** Payment for all work performed under this section will be incidental to payment for work described in other Sections.

END OF SECTION

1.0	GENERAL	Add 1.0.6	<p>The <i>Contractor</i> is responsible for all temporary traffic control on the streets required for completion of the work. The <i>Contractor</i> will be responsible to provide a Traffic Management Plan (TMP) for approval (5) five working days prior to any lane closures taking place. TMP is to be prepared by a qualified professional to the satisfaction of the Contract Administrator.</p> <p>The TMP shall outline the approach to traffic management, show recognition and minimization of risks indicates signing locations, identify Traffic Control Persons (TCP) stations, show lane shifting and proposed closures.</p> <p>The Contractor is responsible to ensure and maintain all business/residential vehicles, cyclists and pedestrian accesses open at all times. The contractor may provide temporary accesses if the affected owner agrees. All costs associated with temporary accesses will be at the contractor's expense.</p>
		Add 1.0.7	<p>A Road and Sidewalk Closure Permit is required from Coquitlam for all work affecting pedestrian and traffic flow related to construction. A permit is required for each specific construction interference with pedestrian and traffic flow. The road and sidewalk closure permit form can be obtained for use from the City's website at http://www.coquitlam.ca. The Contractor must follow the approved TMP. Any changes to this TMP must be submitted to City's Traffic Operations for approval.</p>
		Add 1.08	<p>Refer to Appendix A – Traffic Management Detail Specifications.</p>
		Add 1.09	<p>The Contractor is responsible to maintain all business/residential vehicles and pedestrian accesses open at all times, the contractor may provide temporary accesses if the affected owner agrees. All costs associated with temporary accesses will be at the contractor's expense.</p>
1.4	Traffic Control	Delete 1.4.1 and replace with the following	<p>The Contractor shall conduct his operations so as to cause the minimum obstruction and inconvenience to traffic and to places of business and residences adjacent to the Place of Work. No greater quantity of work shall be undertaken at any one time than can be properly conducted with due regard to the rights and interests of the public as may be determined by the Contract Administrator.</p> <p>The Contractor is to provide at all times safe and convenient means of approach and entrance to adjoining lanes, driveways, buildings and property both for vehicles and pedestrians to the satisfaction of the Contract Administrator. For this purpose, he shall construct and maintain suitable and safe platforms, approaches, structures, bridges, diversions or other works.</p> <p>Where traffic must cross open trenches, the Contractor shall provide suitable bridges. Where trenches have been backfilled or where road improvements are incomplete the Contractor shall take any steps necessary to prevent potholes or other traffic hazards. Where the Contract Administrator so instructs or where Contract Specifications so require, the Contractor shall provide temporary asphalt patching of such hazards.</p>

Add 1.4.9.3.1

The *Contractor*, as required by the *Contract Administrator* and the City, is to supply Construction Zone information signs (stationary), refer to MMCD 01 58 01 for the required identification signage.

The *Contractor* is responsible for the removal of the signs at the completion of the work.

Delete 1.4.10.1.3 and
replace with the
following

When workmen or equipment are employed over travelled way over brow of hills, around sharp curves or at other locations where oncoming traffic would not otherwise have adequate warning.

END OF SECTION

1.0 GENERAL

1.0.3 Erosion and Sediment Control Supervisor

Add 1.03

The Erosion and Sediment Control (ESC) Supervisor is the Qualified Professional who is experienced in implementing ESC Plans and who is responsible for the inspection and monitoring of ESC Facilities to ensure these are installed and maintained in accordance with the ESC Plan, and if necessary, are modified during construction to ensure compliance with the Stream and Drainage System Protection Bylaw No. 4403, 2013.

1.2 Temporary Erosion and Sediment Controls

Delete 1.2.1 and replace with the following

Properly drain all portions of the site. Protect the site and the watercourses to which it drains, directly or indirectly, against erosion and siltation in accordance with a Sediment Control Plan under the City of Coquitlam Stream and Drainage System Protection Bylaw No. 4403, 2013 during construction and until the maintenance period is completed. Ensure no silt, gravel, debris or other deleterious substance resulting from construction activity discharges into existing drainage systems or watercourses or onto highways or adjacent property. The *Contractor* is responsible for all damage that may be caused by water backing up or flowing over, through, from or along any part of the work or otherwise resulting from his operations.

Keep existing culverts, drains, ditches and watercourses affected by the work clear of excavated material at all times. When it is necessary to remove or alter any existing drainage structure, provide suitable alternative measures for handling the drainage. Adequately support culverts and drainpipes across trenches to prevent displacement and interference with the proper flow of water due to trench settlement.

Sweep streets, and clean catch basins, manhole sumps, detention tanks, and maintain siltation controls as often as the *Contract Administrator* and the City deems necessary.

Delete 1.2.2.2 and replace with the following

Do not operate construction equipment in watercourses.

Add 1.2.2.9

All work must be carried out during favorable and low water conditions.

Add 1.2.2.10

Any fill used on this project shall be certified inert and from a source which is confirmed to be free of contaminants.

Add 1.2.2.11

All work within a watercourse must be undertaken and completed in isolation of all flowing water to maintain downstream water quality and unrestricted flows.

1.4 Environmental Protection

Add 1.4.3.5

Immediately contain and clean up any leaks and spills of prohibited materials at the *Place of Work*.

Add 1.4.3.6

Ensure that a well-stocked spill kit is on-site at all times and that the *Contractor's* employees are familiar with appropriate spill response techniques.

Add 1.4.3.7

Immediately notify the *Contract Administrator* and the City of any leaks or spills of prohibited materials that occur at the *Place of Work*.

Add 1.4.3.8

Ensure that any fuel stored on-site is located at least 15 meters from the nearest stream, and is placed within a bermed and lined area, in order to prevent leaks or spills into the environment.

		Add 1.4.3.9	All equipment and machinery must be in good working condition (power washed), free of leaks or excess oil and grease. No equipment refueling or servicing shall be undertaken within a minimum of 15 meters of any water course or surface water drainage.
		Add 1.4.3.10	During all phases of the operation, the Contractor shall take precautions to abate nuisance caused by mud or dust by clean up, sweeping, sprinkling with water or dust control, or other means as necessary to accomplish results satisfactory to the Contract Administrator.
1.6	Measurement and Payment	Delete 1.6.1 and replace with the following	Payment for all work, unless included in the Schedule of Quantities and Prices, performed under this section will be incidental to payment for work described in other Sections.
		Add 1.6.2	Payment for the poly cover or temporary tarps over stock pile materials or exposed road subgrades shall be treated as incidental work.
1.9	Archaeological / Historical Resources	Add 1.9	Immediately cease work and inform the <i>Contract Administrator</i> and the City, if any archaeological or historical resources are encountered during construction. Leave these resources in place and do not disturb them in any way.

END OF SECTION

**1.3 Measurement and
Payment**

Delete 1.3.1 and
replace with the
following

Payment for the installation of 1.2m x 1.2m static construction
Information signs as shown in Appendix A – Traffic Management
Detail Specifications - Clause 6.5 includes supply, placement &
removal and will be incidental to payment for work described in
other Sections, unless shown otherwise in the Schedule of
Quantities and Prices.

END OF SECTION

1.4	Measurement and Payment	Delete 1.4.3 and replace with the following	<p>Payment for machine placed or hand formed C5 wide base concrete curb, excluding granular subbase & base, includes supply and placing of the concrete curb and gutter, tie-ins, transitions, subgrade preparation, compaction, saw cutting, and will cover all straight and curve sections and will be made separately for each specified type.</p> <p>Payment for excavation and disposal of excavated material will be made under payment item, Common Excavation – offsite disposal, in the Schedule of Quantities and Price.</p> <p>Payment for granular subbase and granular base under curb and gutter will be made under payment items in Section 32 11 16.1S and 32 11 23S, Granular Subbase and Granular Base, respectively.</p>
		Delete 1.4.5 and replace with the following	<p>Payment for concrete sidewalks, letdowns, driveways, walkways, stamp concrete, paver stone, infills, concrete exposed aggregate and all concrete ramps includes supply and installation, saw cutting, granular base, regrading of driveways for proper tie-in, field fit and adjustments, subgrade preparation under the concrete sidewalks, in-fills, driveways and walkways, and will be made separately for each specified thickness and type of finish.</p> <p>Payment for excavation and disposal of native excavated material will be made under payment item, Common Excavation – offsite disposal, in the Schedule of Quantities and Price.</p> <p>Payment includes supply, installation and removal of temporary gravel letdown and driveway tie-in at final grade c/w vertical curve to ensure vehicle will not bottom out. Payment includes Quality Control (QC) through test drive by Contractor on letdown and driveway using a standard sedan car. Final grade to be approved and tested by the City as part of Quality Assurance (QA) and to follow Supplementary General Condition, Clause 4.12.</p>
		Add 1.4.10	<p>Payment for Detectable/Tactile Warning Surface Tile includes supply and placing of Access Tile Model # ACC-R-<u> </u>X-<u> </u> (or approved equal) Truncated Dome Detectable Warning Tactile Surface replaceable cast in place - Yellow Color, installation as per the Manufacturer's Specifications and as specified in the Schedule of Quantities and Prices.</p>
2.1	Materials	Delete 2.1.5.1 and replace with the following	<p>Hand-formed and hand-placed concrete:</p> <p>Slump: 80 mm</p> <p>Air entrainment: 5 to 8%.</p> <p>Maximum aggregate size: 20 mm.</p> <p>Minimum cement content: 335 kg/m³.</p> <p>Minimum 28 day compressive strength: 32 MPa.</p>
		Add 2.1.7	<p>Tactile warning surface tile shall be replaceable cast-in-place style. Truncated domes shall be in square grid pattern with a 5 mm nominal raised height, base diameter of 23 mm and top diameter of 11.5 mm. Dome spacing range shall be between 40 mm – 60 mm.</p> <p>Color of the panel shall be Federal Yellow (Y) per US Federal Standard 595B Table IV, Color No. 335.</p> <p>Minimum size of the panel shall be 600 mm by 1200 mm.</p>

3.0 EXECUTION

3.5 Concrete Placement

Delete 3.5.9 and
replace with the
following

The *Contractor* is responsible for adjusting all utility manhole frames and valve boxes, belonging to Coquitlam and/or other agencies that are affected by the road works. All adjustments to utilities must be completed to the satisfaction of the utility owner. Riser rings will not be accepted.

The *Contractor* should note that certain utility owners may decide to complete their own adjustments. The *Contractor* will be required to cooperate with any utility company providing their own adjustments.

The *Contractor* shall be responsible to contact the appropriate utility company within a minimum of seventy-two (72) hours of the work. No adjustment shall be made without the written approval of the utility company. All manholes must be vertically adjusted a minimum of twenty-four (24) hours prior to concrete placement.

3.9 Expansion Joints

Delete 3.9.1 and
replace with the
following

Form transverse expansion joints at both ends of curb returns and at maximum spacing of 9.0 m for sidewalks, 30.0 m of curb and gutter, at each end of driveway crossing, at tangent point of circular work, and on either side of catch basins.

END OF SECTION

- 1.5 Measurement and Payment** Add to 1.5.3 as follows Reinforced cast-in -place stairs to be measured horizontally from landing at back of curb to front of sidewalk, and/or from back of sidewalk to landing at PL. Landing without reinforced bars or poured separately from stairs' rise and run will be paid under Section 03 30 20S, Concrete Walks, Curbs and Gutters.

Handrails (if required at the sole discretion of the Contract Administrator) are to be paid under Force Account.

END OF SECTION

PRECAST CONCRETE

1.4	Measurement and Payment	Add 1.4.6	<p>Payment for an Allan Block Retaining Wall includes all work and incidentals, site preparation, 19mm Clear Crush Drain Rock backfill, SDR28 perforated pipe, weep hole, and capstone but excludes the sidewalk and base. Measurement of height of all for purposes of calculating areas for payment will be taken from the bottom of the installed block to top of cap above the block.</p> <p>Payment will be made at the respective unit prices bid in the Schedule of Quantities and Prices.</p> <p>Payment for excavation and disposal of excavated material for the wall construction and removal of any existing retaining wall will be made under payment item, Common Excavation – offsite disposal, in the Schedule of Quantities and Price.</p>
		Add 1.4.7	<p>Payment includes temporary relocation and re-installation of existing concrete barriers, and all labor, material and equipment necessary to complete the work and as specified and shown on the Contract Drawings or as directed by the Contract Administrator.</p> <p>Payment for removal and offsite disposal of existing concrete barriers not suitable for re-use, as determined by the Contract Administrator, will be made under Section 31 24 13S, Clause 1.8.4.</p>
		Add 1.4.8	<p>Payment includes supply and installation of diamond grade reflective concrete barrier flexibe marker and all labor, material and equipment necessary to complete the work and as specified and shown on the Contract Drawings or as directed by the Contract Administrator.</p>

END OF SECTION

1.0 GENERAL

- | | | | |
|---------------------|----------------------------------|---|---|
| 1.3 | Shop Drawings | Delete 1.3.4 and replace with the following | Shop drawings for pole structures, where required, to be sealed by a Professional Engineer registered in British Columbia. |
| 1.4 | Electrical Energy Supply | Add 1.4.4 | The Electrical <i>Contractor</i> shall process a letter of application to the City of Coquitlam for the Utility Company and attain all required permits. |
| 1.5 | Contractor Qualifications | Add 1.5.3 | All on-site traffic signal installations shall be under the responsibility of a primary journeyman electrician with IMSA Level 1 Roadway Lighting Certification and have a minimum of three (3) years experience maintaining and installing street lighting systems. This primary journeyman electrician is expected to be on the work site and report work progress to City of Coquitlam's Traffic Operations staff, in addition to reporting to the <i>Contract Administrator</i> . |
| 1.6 | Permits and Tests | Add 1.6.4 | <i>Contractor</i> shall provide the BC Safety Electrical Permit, and arrange all inspections with the City. The inspection entails, but not limited to, Coquitlam's Street Lighting Inspection Report, which can be obtained from Coquitlam's Traffic Operations staff. |
| | | Add 1.6.5 | <i>Contractor</i> to obtain approval of all buried portions of the installation from the City Inspector before any backfill is commenced. |
| 1.8 | Record Drawings | Add 1.8.2 | Final payment(s) will be withheld until record drawings are received. |
| 1.9 | Measurement and Payment | Add 1.9.4 | Supply and installation of conduits / ducts to include all labor, equipment and materials required to complete the installation as specified in the contract and/or shown on Contract Drawings. Payment includes coordinating with Third Party Utilities for supply and delivery/pick up of supplied materials. Payment will be for each complete set of joint trench crossing as specified in the contract documents. |
| 2.0 PRODUCTS | | | |
| 2.1 | General | Delete 2.1.2 and replace with the following | All products supplied to be new, in accordance with <i>Contract Documents</i> . All products are to meet Canadian Electrical Code requirements and be certified by either CSA, UL®, or Intertek Testing Systems (Warnock Hersey) and be supplied with the certifier's label. |
| | | Delete 2.1.3 and replace with the following | All products shall be in accordance with the City of Coquitlam's List of Approved Materials and Products List. Any products not listed with in the Approved List shall default to the current BCMOTI specification. |
| | | Delete 2.1.5 and replace with the following | Equipment models listed within the City of Coquitlam's List of Approved Materials and Products shall be confirmed with the City immediately prior to their order to ensure that they are current. Cut-sheets, equipment make, model and serial number list to be provided to the City by the <i>Contractor</i> . |
| 2.2 | Conduit | Add 2.2.1.3 | All exposed metallic surfaces to be hot dip galvanized. |
| 2.3 | Trench marker Tape | Add 2.3.2 | Detectable (Magnetic) marker tape shall be used in all trenches containing interconnection (communications) conduit. |

2.6	Concrete Bases	Add 2.6.2	Maximum of four (4) conduits shall enter the base of a luminaire pole, however more than four (4) may enter a service base.
2.8	Conductors and Cables	Add 2.8.5	.1 Minimum conductor size to be as follows, unless specified otherwise on <i>Contract Drawing</i> : .1 No 6 AWG for feeder conductors in conduit. .2 No 8 AWG for bond conductors in conduit. .3 No 12 AWG for luminaire conductors in poles.
2.9	Conductor Tags	Delete 2.9 and replace with the following	Refer to the City of Coquitlam's List of Approved Materials and Products.
2.11	Fuses and Fuse Holders	Delete 2.11 and replace with the following	Refer to the City of Coquitlam's List of Approved Materials and Products.
2.13	Receptacles	Add 2.13.3	Receptacles shall have a spring loaded cast aluminum covers.
		Add 2.13.4	Refer to the City of Coquitlam's List of Approved Materials and Products.
2.14	Luminaires	Add 2.14.6	Refer to the City of Coquitlam's List of Approved Materials and Products.
2.19	Service Panels	Add 2.19.1	Type 40A 120/240V, 60A 120/240V roadway lighting and 100A 120/240V combination roadway lighting / traffic signal, per <i>Contract Drawing</i> to include items listed within the 2009 MMCD Section 34 41 13 - Traffic Signals - 2.11.2
		Add 2.19.2	Refer to the City of Coquitlam's List of Approved Materials and Products.
2.20	Wire Anti-Theft Devices	Add 2.20.1	Handhole access shall utilize security covers with reinforced backing bars.
3.0	EXECUTION		
3.1	General	Add 3.1.5	During the installation of the lighting system, maintain the existing system as noted on the <i>Contract Drawing</i> . If temporary or permanent relocations of related lighting equipment are required, such equipment shall be reinstated as required under the <i>Contract Documents</i> or as directed by the <i>Contract Administrator</i> .
3.3	Concrete Bases	Add 3.3.7	Concrete service bases detailed on Standard Detail Drawings CE1.3 and CE1.4, Type C1 and C3 service bases shall have five (5) conduits. See Coquitlam Standard Detail Drawing SS-E7.3.
		Add 3.3.8	All concrete bases shall be pre-cast concrete only, unless noted on <i>Contract Drawing</i> or directed by the <i>Contract Administrator</i> .
3.4	Junction Boxes and Vaults	Delete 3.4.1 and replace with the following	Install junction boxes as shown on Standard Detail Drawings E2.2 to E2.4. Install vaults as shown on Coquitlam Standard Detail Drawing SS-E2.5.
		Add 3.4.5	Bell end fittings shall be installed in all conduits entering junction boxes or vaults.

		Add 3.4.6	All junction boxes shall be provided with RPVC bars to support electrical connections and fuse holders. The RPVC bars shall be attached into the junction box side walls with the electrical connections/fuse holders tie-wrapped in place and installed in the up-right position.
		Add 3.4.7	Junction boxes requiring 3 or more sections must be approved by the City of Coquitlam's Traffic Operations staff.
3.5	Underground Conduit	Delete 3.5.2 and replace with the following	Minimum cover over conduits to be 600 mm in boulevard areas and 900 mm in roadway areas.
		Delete 3.5.3 and replace with the following	Place trench marker tape 300 mm above installed conduit in trench. Trench marker tape not required for conduits installed via trenchless technology.
		Delete 3.5.5 and replace with the following	Empty conduits shall have a No. 8 HB Yellow/Green Mk pull string and capped at both ends.
		Add 3.5.6	Conduit run shall contain no more than the equivalent of 4 – 90-degree bends.
		Add 3.5.7	Conduits shall be blown out with compressed air, from both ends if necessary, then swabbed out to remove stones, dirt, water and other material which may have entered during installation.
		Add 3.5.8	All conduits entering poles and cabinets shall be sealed with "Duct Seal".
		Add 3.5.9	Conduit depth of bury to be recorded when a trenchless technology method is used.
		Add 3.5.10	Conduit shall not be bent in the field. Only factory bends will be accepted.
3.7	Electrical	Delete 3.7.2 and replace with the following	Mount electrical service panels in service base or on poles as shown on Standard Detail Drawings E7.2, E7.6 to E7.9, as well as Coquitlam Standard Detail Drawings SS-E7.3 to SS-E7.5.
3.8	Wiring	Delete 3.8.3 and replace with the following	Make conductor splices in handholes. See Standard Detail Drawing E7.11 for splice details.
		Delete 3.8.6 and replace with the following	Wire each luminaire and receptacle separately from the base of pole.
		Delete 3.8.7 and replace with the following	Neatly arrange and bundle wiring in junction boxes, pole handholes and service panels. Conductor connections in all access points to be installed in the up-right position, allowing for easy access
		Delete 3.8.11 and replace with the following	Bond all luminaires and receptacles with No. 12 RW90 green conductor, and steel junction box lids with No. 8 RW90 green conductor.

ROADWAY LIGHTING

3.9	Pole Mounted Receptacle	Delete 3.9.1 and replace with the following	Pole mounted receptacles to be installed as detailed on the <i>Contract Drawing</i> and Coquitlam Standard Detail Drawings SS-E7.19 to SS-E7.23.
3.10	Luminaires and Photocells	Add 3.10.4	NEMA wattage label shall be visible at the bottom of the luminaire on all fixtures.
3.11	Grounding & Bonding	Add 3.11.5	Ground plates and grounding conductors are to have a minimum of 5 meters clearance between them and other utility grounding.
		Add 3.11.6	Remove all paint around bonding studs on inside of pole to expose the galvanized or metal surface prior to bonding equipment.
3.13	Pole Finish Application	Delete 3.13 and replace with the following	<p>.1 Prior to producing a powder finish product the supplier must provide a Certificate of Compliance indicating that they have met or exceeded the following specifications. The supplier will name their independent testing agency and this information will be submitted to the City for their files.</p> <p>.2 The application process will be as follows:</p> <p>.1 The pole or product will be hot dip galvanized.</p> <p>.2 Powder will only be applied after the product is completely fabricated. No welding or bending will take place after the powder is applied.</p> <p>.3 The pole or product will be thoroughly cleaned by brush blasting in accordance with SSPC-SP7. The brush blast will maintain a minimum profile of 0.5 mils. If brush blasting is done off site then the product will be covered and shielded from any dirt or moisture during its return to the powder applicators facility. Where poles or products are not kept clean and dry or have any signs of flash rust they will be returned for further brush blasting.</p> <p>.4 Once at the applicators facility the pole or product will be thoroughly cleaned and dried with an air gun. All hand marks or grease spots will be cleaned with a mild solvent.</p> <p>.5 After brush blasting the entire pole or product will be pre-baked in an oven at 220 degrees C for at least 30 minutes to 1 hour, depending on steel thickness. The pre-baking must be done to prevent out-gassing during the curing cycle.</p> <p>.6 The base powder coat will then be applied electrostatically while the pole or product is cooling from the 220 degrees C pre-bake period to allow the powder to melt and fuse to the surface. The base coat will be a minimum of 3 mils in thickness.</p> <p>.7 After base coat is applied and set the topcoat will be applied to a thickness of 3 to 5 mils. The pole or product will be returned to the oven and heated to 190 to 220 degrees C (temperature will not exceed pre-bake) for a minimum of 25 minutes, depending on steel thickness. Thicker product material may require longer bake cycles to fully cure. Upon removal of the pole or product from the oven it will be left to rest until the pole or product is cool enough to the touch.</p> <p>.8 Once the topcoat has cured and the poles or product cooled, they will then be individually wrapped (min 4" overlapping method) with 1/8" foam wrap over the entire pole or product. The poles or product will be bundled together and separated with suitable wood dunnage to</p>

avoid contact between the poles, product or other bundles. All bundles themselves will be fully wrapped with foam and with stretch-wrap as noted above. The poles or products will be handled and shipped with great care to prevent damage; damaged product will be cause for rejection of the item(s).

- .3 Testing process will be as follows:
 - .1 Each run of product in an oven will have at least one sample tested for:
 - .2 Adhesion – The finished powder surface will have minimum pull-off strength exceeding 1000 PSI as tested in accordance with ASTM D4541.
 - .3 Quality – The finished powder surface will be free from any holidays (skips or misses) as tested in accordance with ASTM D4541. The product will also be free from wrinkles, orange peel, cracking, pinholes, fish eyes, blisters, etc by visual inspection.
 - .4 Color – The color will be verified to be within 3 DE of specialized color.
 - .5 An independent firm such as CanSpec Testing who are qualified to test powder finish will do the testing at the supplier's expense. The result of tests must accompany the Certificate of Compliance and will be made available to the City or their representative upon request. A supplier who fails to test product as noted above will have their product rejected until the testing is completed and the product deemed acceptable by the testing agency.
 - .6 Where the tested product fails on a given production run then a minimum of 30 % of the entire production run will be tested. If no other failures are found then the individual failed product will be stripped, reapplied and re-tested until it passes. If any of the 30% of product tested fails then the entire order will be stripped, reapplied and retested until it passes.
- .4 Field repairs will be undertaken as required to fix any scratches or imperfections in the final finish. Field repairs will be done as follows:
 - .1 Feather the damaged area with sandpaper.
 - .2 Clean area with solvent.
 - .3 Let dry.
 - .4 Neatly brush on an application of Aliphatic Urethane Acrylic Semi-Gloss High Build applied at 2-4 mils DFT over the entire sanded and damaged area. The ambient conditions will be dry and over 10 degrees C when the paint is applied.
 - .5 The pole supplier will warranty the integrity of the surface for a minimum of 1 year from the date of installation. The warranty will include all labour and materials required to provide replacement product if required. The powder finish will be the responsibility of the pole supplier. The warranty will apply to fading, blistering, cracking or chipping of the surface.

END OF SECTION

2.0 PRODUCTS

2.3 Pit Run Gravel

Add to 2.3.2

The use of recycled concrete shall be approved by the *Contract Administrator* and the City prior to use.

Add 2.3.3

Asphalt millings free from contaminated and other extraneous material, conforming to the specified gradations may be used as pit run gravel. The use of asphalt millings shall be approved by the *Contract Administrator* and the City prior to use.

2.7 Granular Pipe Bedding and Surround Material

Add to 2.7.1

All recycled or other extraneous materials shall be approved by *Contract Administrator* and the City prior to use.

2.10 Granular Base

Delete 2.10.2

Add 2.10.3

All 25 mm minus granular base is to conform to the following gradation specifications for Collector / Arterial Roads:

Sieve Designation (mm)	Percent Passing (%)
25	100
19	80-100
12.5	75-90
9.5	50-85
4.75	35-70
2.36	25-50
1.18	15-35
0.30	5-20
0.075	0-5

Add 2.10.4

The intention of the Gradation Chart is to identify the desired mix of size of aggregate in the granular base. The Target Percentage Passing is the middle of the shown Range.

Tests that show sieve values of Percent Passing that are consistently low or consistently high in two (2) or more consecutive tests will be considered to be non-conforming.

2.11 Recycled Aggregate Material

Delete 2.11.1 and replace with the following

Aggregates containing recycled material may be utilized if approved by the *Contract Administrator* and the City. In addition to meeting all other conditions of the specifications, recycled material should not reduce the quality of the construction achievable with quarried materials. Recycled material shall consist only of aggregates, crushed portland cement concrete, or asphalt that is free of impurities.

END OF SECTION

CLEARING AND GRUBBING

**1.4 Measurement and
Payment**

Delete 1.4.1 and
replace with the
following

Payment for all clearing and grubbing will be made at lump sum price and include removal and disposal of all branches, stumps, trees, debris, hedges, timbers, logs and vegetation to complete the work and as shown on the Contract Drawings or as directed by the Contract Administrator. Works include cutting of branches & falling of trees affected by Work to create the necessary clearance to accommodate the construction and intended function of the Work, and as shown on Contract Drawing. Trimming to have minimum 2.5m vertical and 0.5m horizontal clearance from sidewalk and MUP, unless otherwise directed by the Contract Administrator.

Payment includes trimming of small branches from trees or hedges as required, branch cutting/pruning to have a clean cut flush to branch collar and use of an approved tree paint to repair damage to surviving vegetation where branches have been removed.

Existing grass and top soil removal will be paid under Common Excavation, less the portion under Grubbing as defined in Clause 1.2.

END OF SECTION

1.3	Measurement and Payment	Delete 1.3.1 and replace with the following	Payment for all work, unless included in the Schedule of Quantities and Prices, performed under this section will be incidental to payment for work described in other Sections.
2.0	PRODUCTS		
2.1	Materials	Add 2.1.10	Protective Fencing: Posts - Pressure treated wood 100 mm dia.; Post to be 1.8 m to 2.0m in height at 2.0 m O.C. Snow fence as per Coquitlam Approved Products List; Flagging Tape - 4" Orange glow - 'Tree Retention Area'.
3.0	EXECUTION		
3.1	Existing Trees	Add 3.1.7	The <i>Contractor</i> is responsible to minimize damage to all trees which are to remain.
		Add 3.1.8	The <i>Contractor</i> will be responsible for all claims and costs including the cost of examination by an Arborist, repair, removal and replacement of trees, as required by the Arborist, the <i>Contract Administrator</i> and the City for tree damage where proper notification was not received from the <i>Contractor</i> . Damage will be assessed based on the International Society of Arboriculture Guidelines. The term shall be for a period of one year following the date of Substantial Performance of the <i>Work</i> .
		Add 3.1.9	Place protective fencing/barricades as per Coquitlam Standard Detail Drawings COQ-R26, where identified on the Contract Drawings. <i>Contractor</i> shall maintain fence in good condition during construction.
		Add 3.1.10	When work is to be performed inside fenced areas, <i>Contractor</i> shall take care to avoid damage to existing vegetation. Work to be done inside areas of existing vegetation to be retained includes: <ul style="list-style-type: none"> .1 Removal of isolated trees as directed by the <i>Contract Administrator</i> and the City. .2 Selective pruning and tree removal at edges to create tidy and well-shaped forest edge. .3 Placing planting soil and planting of trees.
		Add 3.1.11	Do not park, service or fuel vehicles within the vegetation retention areas.
3.4	Pruning	Add 3.4.2	Do not cut roots or branches of retained trees without approval of the <i>Contract Administrator</i> and the City.

END OF SECTION

**1.4 Measurement and
 Payment**

Delete 1.4 in its
entirety and
replace with the
following

Payment for all work performed under this Section will be incidental
to payment for work described in other Sections unless shown
otherwise in the Schedule of Quantities and Prices.

END OF SECTION

- | | | | |
|------------|------------------------------------|---|---|
| 1.4 | Measurement and
Payment | Delete 1.4.1 to 1.4.4
and replace with 1.4.1
with the following | Payment for all work performed under this Section will be incidental
to payment for work described in other Sections unless shown
otherwise in the Schedule of Quantities and Prices. |
|------------|------------------------------------|---|---|

END OF SECTION

1.0 GENERAL

1.8 Limitations of Open Trench

1.8.1
Replace last sentence
with the following

If circumstances do not permit complete backfilling of all trenches, and where permitted by the *Contract Administrator* and the City, adequately protect all open trenches or excavations with approved fencing or barricades and, where required, with flashing lights.

2.0 PRODUCTS

2.2 Use of Specified Materials

Delete 2.2.1.2

Delete Pit Run Sand

Delete 2.2.3.3

Delete Pit Run Sand

3.0 EXECUTION

3.3 Excavation

Delete 3.3.1.2 and
replace with the
following

Connections to existing waterworks systems are to be made by the *Contractor* under the inspection / supervision of the *Contract Administrator* and the City.

3.6 Surface Restoration

Delete 3.6.2.4 and
replace with the
following

Restore lawns with approved topsoil and sod to match existing lawn.

Delete 3.6.3.1 and
replace with the
following

Restore surface with a minimum 100 mm of 19 mm granular road base material.

Delete 3.6.7.5 and
replace with the
following

Restore Pavement as detailed on Coquitlam Standard Detail Drawing COQ-G4. Temporary patch shall be a minimum thickness of 50 mm thickness. Permanent restoration to existing asphalt thickness (minimum of 75 mm) with a 35 mm key where existing thickness permits. A 50 mm key is required on Arterial and Collector Roadways. Dry if necessary and paint clean, dry edge with asphalt emulsion (tack coat).

END OF SECTION

1.8 Measurement and Payment

Delete 1.8.4 and replace with the following

Payment under this item will only apply to removal of the components included in this item under a separate operation as shown on the Contract Drawings or as directed by the Contractor Administrator. No payment will be made under this item for removal of these components as part of the operation for common excavation, and such removal will be treated as common excavation.

Payment will be made at the respective unit prices bid in the Schedule of Quantities and Prices and will include all labour, and equipment required to complete the work, including offsite disposal. It is the responsibility of the contractor to locate and verify all utilities.

Delete 1.8.5 and replace with the following

Payment for Common Excavation includes:

1. Unless noted in the Schedule of Quantities and Prices as removal in square meters, common excavation will be measured in cubic meters calculated from measurements taken by the Contract Administrator in the areas of excavation for road widening areas.
2. Cross-sections will be taken after clearing and grubbing and after stripping of existing topsoil immediately prior to excavation of material to be incorporated into work.
3. Where determined by the Contract Administrator that truck box volume will be used to determine excavation quantities the volume per load shall be determined using 75% of the truck load quantity. The following is to be used for payment:

Truck Type	Material Type	Volume (cu.m)
Tandem	ordinary material	7
Tandem	asphalt/concrete/pipe	4
Triaxle	ordinary material	8
Triaxle	asphalt/concrete/pipe	5
Tandem and Pony	ordinary material	11
Tandem and Pony	asphalt/concrete/pipe	7.5
Triaxle and Pony	ordinary material	13
Triaxle and Pony	asphalt/concrete/pipe	9
Tandem and Transfer	ordinary material	19
Tandem and Transfer	asphalt/concrete/pipe	13

4. Contractor to provide truck slips detailing location type of common excavation, time loaded and location of dump site. The slips are to be given to Contract Administrator by the end of shift or Contract Administrator can deny quantities subsequently submitted.
5. Payment for on site re-use includes excavation, transport, temporary stockpiling, placement, compaction, boning, adjustment of moisture content, spreading and grading of material anywhere on site or within the work zone, as needed, to establish the roadway & pathway cross-section.

Payment will be made at the respective unit prices bid in the Schedule of Quantities and Prices and will include all labour, and equipment required to complete the work, including offsite disposal. It is the responsibility of the contractor to locate and verify all utilities.

Delete 1.8.10 and
replace with the
following

Payment for replacement of areas of unsuitable granular base, granular subbase or sub-grade revealed during proof rooling will include excavation with off-site disposal, installation & compaction of granular base material (25 mm minus), and all remedial work required to achieve a suitable base. Payment will be based on the cubic metre volume removed.

Add 1.8.14

Payment by allowance for Hydro Excavation includes all labor, material, equipments, removal and disposal to complete the work as shown on the Contract Drawings or as directed by the Contract Administrator. Payment includes coordinating the work of all locations requiring hydro excavation to maximize the use of the hydro excavation machine.

Payment shall be made for the actual cost on a Force Account basis as defined in GC 10.0.

2.0 PRODUCTS

2.2 Specified Materials

Delete 2.2.1.3

Pit Run Sand

Delete 2.2.1.4

River Sand

Delete 2.2.2

END OF SECTION

COLD MILLING

**1.5 Measurement and
 Payment**

Delete 1.5.1 to 1.5.3
and replace with 1.5.1
with the following

Payment for cold milling is incidental to work described in Section 31
24 13S, Clause 1.8.4, and includes cost of mobilization,
demobilization and demonstration milling test section, unless shown
otherwise in Schedule of Quantities and Prices.

END OF SECTION

GRANULAR SUBBASE

1.4	Measurement and Payment	Delete 1.4.1 and replace with the following	Measurement for granular subbase of variable thickness will be for actual quantity placed based on weigh tickets provided to Contract Administrator as loads are delivered.
		Delete 1.4.2 and replace with the following	Measurement for granular subbase for each specified thickness will be for the actual area placed.
		Delete 1.4.3 and replace with the following	Payment for Subsection 1.4.1 & 1.4.2 above includes supply, placement and compaction of granular subbase material, adjustment of moisture content, and boning to establish the road cross-section, shall be included in the unit price bid in the Schedule of Quantities and Prices.
		Delete 1.4.4 and replace with the following	Payment for removal of unsuitable subgrade including disposal off-site prior to direct placement of granular subbase will be made under Section 31 24 13 – 1.8.5 Common Excavation.
2.0	PRODUCTS		
2.1	Specified Materials	Delete	2.1.1.1: Select Granular Subbase 2.1.1.2: 75 mm Pit Run Gravel 2.1.1.4: Pit Run Sand 2.1.1.5: Approved Native Material 2.1.1.7: River Sand

END OF SECTION

GRANULAR BASE

1.4	Measurement and Payment	Delete 1.4.1 and replace with the following	Measurement for granular base of variable thickness will be for actual quantity placed based on weigh tickets provided to Contract Administrator as loads are delivered.
		Delete 1.4.2 and replace with the following	Measurement for granular base for each specified thickness will be for the actual area placed.
		Delete 1.4.3 and replace with the following	Payment for Subsection 1.4.1 & 1.4.2 above includes supply, placement and compaction of granular base material, adjustment of moisture content, and boning to establish the road cross-section, shall be included in the unit price bid in the Schedule of Quantities and Prices.
		Delete 1.4.4 and replace with the following	Payment for removal of unsuitable subgrade including disposal off-site prior to direct placement of granular subbase will be made under Section 31 24 13 – 1.8.5 Common Excavation.
2.0	PRODUCTS		
2.1	Granular Base	Add 2.1.1.3	25 mm minus crushed gravel conforming to the gradation specifications for Collector/Arterial Roads under Section 31 05 17S – 2.10.3.
3.0	EXECUTION		
3.5	Proof Rolling	Delete 3.5.1 and replace with the following	For proof rolling, use fully loaded single axle, to 80 KN (18, 000 lb) minimum, dump truck.
		Add 3.5.7	<p>Prior to paving with asphalt concrete, the base surface shall be checked by the <i>Contract Administrator</i> and the City, for deflections utilizing a Benkelman Beam, in order to insure that the final rebound requirements can be obtained with the asphalt pavement. In the event that such deflection is in excess of those required to produce the final standards, then the base shall be adequately strengthened by additional gravel or asphalt concrete to insure that final deflections as follows are not exceeded.</p> <p>The Benkelman spring rebound value of the completed pavement surface shall not at any point exceed 0.75 mm for arterial industrial roads and lanes, 1.15 mm for collector roads, and 1.5 mm for local roads and lanes as determined in the procedures outlined in the Transportation Association of Canada publication “Pavement Management Guide.”</p>

END OF SECTION

ASPHALT TACK COAT

- | | | | |
|------------|--------------------------------|---|---|
| 1.5 | Measurement and Payment | Delete 1.5.1 and replace with the following | Payment for all work performed under this Section will be incidental to payment for work described in other Sections unless shown otherwise in the Schedule of Quantities and Prices. |
| | | Delete 1.5.2 and replace with the following | Pavement surface cleaning, as per section 32 01 11, and all other work incidental to the application of tack coat is deemed to be incidental to payment for work described in other Sections unless shown otherwise in the Schedule of Quantities and Prices. |
| 3.0 | EXECUTION | | |
| 3.2 | Application | Add to 3.2.3 | Asphalt tack coat to be applied using a truck mounted spray bar unless otherwise approved by the <i>Contract Administrator</i> and the City. Contractor shall demonstrate, to the <i>Contract Administrator</i> and the City, prior to application that all spray nozzles are operational and providing a consistent application. |

END OF SECTION

1.0 GENERAL

1.4 Submission of Mix Design

Delete 1.4.1 and replace with the following

Submit asphalt concrete mix design, including RAP content and trial mix test results to Contract Administrator for review at least two weeks prior to commencing work.

1.5 Measurement and Payment

Delete 1.5.1 and replace with the following

Payment for asphaltic concrete paving includes all construction joint preparation, surface cleaning and preparation, asphaltic surface milling to tie into existing asphalt, saw cutting, supply and placing of the asphaltic concrete, tack coat, compaction and cleaning frames, covers and lids of castings affected and taped temporary pavement markings.

Measurement for asphaltic concrete paving for the specified design mixes will be made at the respective unit prices bid in the Schedule of Quantities and Prices and incorporated into Work will be asphalt concrete actually based on weigh tickets provided to the Contract Administrator as loads are delivered.

The contractor will not receive any additional compensation above the respective unit prices bid in the Schedule of Quantities and Prices for Hand Work, Special Equipment & Machinery to complete the Hot Mix Asphaltic Paving Work as shown on the Contract Drawings or as directed by the Contract Administrator.

For measurement and payment purposes, Contract Administrator may calculate payment on actual area paved to the thickness specified in in the Schedule of Quantities and Prices and as shown on the Contract Drawings.

Delete 1.5.3 and replace with the following

Payment for asphaltic concrete sidewalks, pathways, driveways, and infill strips paving includes all construction joint preparation, surface cleaning and preparation, saw cutting, supply and placing of the asphaltic concrete, tack coat, compaction and cleaning frames, covers and lids of castings affected.

Measurement for asphaltic concrete paving for the specified design mixes for will be made at the respective unit prices bid in the Schedule of Quantities and Prices and incorporated into Work will be asphalt concrete actually based on weigh tickets provided to the Contract Administrator as loads are delivered.

Payment for this item includes all applicable materials and work described in 1.5.1. Work includes all necessary adjustments on site during construction to achieve proper tie-in to existing driveways as directed by Contract Administrator. Adjustments performed under this section shall be incidental to payment for work described in other Sections.

Add 1.5.9

The *Contractor* or the *Owner* may request adjustment of the unit prices submitted for Asphalt Pavement if the Composite Rack Posting (CRP) varies by more than 5.0% from Tender Closing Date to the time the asphalt paving is actually performed.

The CRP is a composite of the available Rack Postings for PG 64-22 FOB Langley BC.

Requests for asphalt pavement unit price adjustment must be made prior to commencing asphalt paving. Payment for asphalt

paving performed prior to a request for price adjustment will be made at the unit price submitted.

Unit prices will be increased or decreased as applicable using the following formula:

$$\text{Adjustment} = (\text{CRP}_{\text{work}} - \text{CRP}_{\text{tender}}) \times \text{AC}_{\text{volume}}$$

Adjustment is the amount in dollars per tonne the unit price is modified. *CRP_{work}* is the CRP at the time paving is performed. *CRP_{tender}* is the CRP at the Tender Closing Date. *AC_{volume}* is the mixture design percent asphalt content, by volume.

1.6	Inspection and Testing	Add 1.6.3	Test cores will be taken by the <i>Contract Administrator</i> in the areas of new paving and will include cores along construction joints to ensure compliance with the required design and compaction.
2.0	PRODUCTS		
2.1	Materials	Add 2.1.2.1	Usage of recycled asphalt shingles will not be permitted.
		Add 2.1.2.2	Usage of softening agents, rejuvenators, or recycling agents will not be permitted.
2.2	Mix Design	Delete 2.2.2 and replace with the following	Mix may contain up to a maximum of 15 % by mass of RAP for Upper Course Asphalt and 20 % by mass of RAP for Lower Course Asphalt without a special mix design. The <i>Contract Administrator</i> and the City may approve higher proportion of RAP if <i>Contractor</i> demonstrates ability to produce mix meeting requirements of the specification.
		Delete 2.2.3.2 Marshall Stability and replace with the following	Marshall Stability at 60°C for both lower and upper courses to be 10 KN min.
3.0	EXECUTION		
3.3	Preparation	Delete 3.3.3 and replace with the following	<p>The <i>Contractor</i> is responsible for adjusting all utility manhole frames and valve boxes, belonging to Coquitlam and/or other agencies that are affected by the road works. All adjustments to utilities must be completed to the satisfaction of the utility owner. Utility adjustment within the paved surface will be considered incidental to the <i>Work</i> unless otherwise noted in the <i>Contract Documents</i>.</p> <p>The <i>Contractor</i> should note that certain utility owners may decide to complete their own adjustments. The <i>Contractor</i> will be required to cooperate with any utility company providing their own adjustments.</p> <p>The <i>Contractor</i> shall be responsible to contact the appropriate utility company with in minimum of seventy-two (72) hours of the work. No adjustment shall be made without the written approval of the utility company.</p> <p><u>All manholes must be vertically adjusted a minimum of twenty-four (24) hours prior to paving.</u> The use of riser rings for adjusting manhole frames and value boxes will not be permitted.</p>
3.7	Joints	Delete 3.7.5 and replace with the following	Construct butt joints at locations as shown on the <i>Contract Drawing</i> and as directed in the field by the <i>Contract Administrator</i> and the City.

END OF SECTION

UNIT PAVING

1.0 GENERAL

1.1 Related Work Add 1.1.7

Geosynthetics Section 31 32 19
Add 3.2.8

**1.6 Measurement and
Payment** Add 1.6.4

Payment includes all labor, material and equipment required to complete the installation as shown on Contract Drawings and specified under this Section. Payment includes subgrade preparation and reinstatement of brick pavers affected by work or previously removed to accommodate the work.

END OF SECTION

PAINTED PAVEMENT MARKINGS

1.0 GENERAL

1.2 Scope

Delete 1.2.1 and replace with the following

Pavement Markings: Miscellaneous taped temporary and permanent pavement paint markings including pedestrian crosswalk, merge and diverge markings, stop lines, solid and broken line road lane markings including edge lines of merge and diverge markings, bike symbols, etc. to be provided as shown on the *Contract Drawing*.

1.5 Measurement and Payment

Delete 1.5.2 and replace with the following

All permanent markings shall be marked with thermoplastic manufactured by LAFRENTZ ROAD MARKINGS, unless shown otherwise in the Schedule of Quantities and Prices.

Delete 1.5.3 and replace with the following

The lump sum payment for permanent thermoplastic pavement markings covers removal of existing markings, supplying all materials and completing all the permanent thermoplastic pavement markings necessary to provide markings as shown on the Contract Drawings.

NOTE: PAYMENT FOR PERMANENT THERMOPLASTIC PAVEMENT MARKINGS WILL NOT BE MADE UNTIL ALL TEMPORARY PAVEMENT MARKINGS AND REFLECTIVE DEVICES HAVE BEEN REMOVED.

Delete 1.5.4 and replace with the following

Payment for signage includes all sign poles, bases, sleeves, sign relocations, temporary removal, cleaning and re-installation of existing, and sign installations (complete). The City will supply signs to supplement existing signs as required. Payment includes all labor, materials and incidentals to complete the work.

1. Installation of each new sign pole, cap, sleeve and trapezoidal base includes all costs to supply all materials, labour and equipment and incidentals, as shown on Standard Detail Drawings SS-E11.1 & SS-E11.2, necessary to the install sign structure as shown on the Contract Drawings and as directed by the Contract Administrator.

2. Installation of each new sign pole, cap, sleeve, galvanized steel bracket for no post barrier, as per MOT Drawing # SP635-3.8.3, includes all costs to supply all materials, labour and equipment and incidentals necessary to the sign structure as shown on the Contract Drawings and as directed by the Contract Administrator.

3. The unit price payment is for each city supplied aluminum sign installed on a sign pole includes sign mount clamps & all costs to supply all materials, labour and equipment and incidentals necessary to install each sign as directed by the Contract Administrator.

4. Installation of each aluminum sign on a lamp standard pole or sign pole includes sign mount clamps and all costs to supply all materials, labour and equipment and incidentals necessary to install each sign as directed by the Contract Administrator.

Add 1.5.5

Payment for the removal and disposal of all existing signages that are no longer required on site, as described in contract drawings or as directed by the Contract Administrator will include removal and disposal of signs, poles, bases, and all labour and equipment to complete the work.

2.0 PRODUCTS

PAINTED PAVEMENT MARKINGS

2.1	Materials	Delete 2.1.1 and replace with the following	All permanent paint markings shall be marked with thermoplastic manufactured by LAFRENTZ Road Markings, HITEX North America (HiBrite Extrude Thermoplastic), or ENNIS-FLINT (Extruded Thermoplastic).
		Delete 2.1.6 and replace with the following	Pavement Markings:
		Delete 2.1.7 and replace with the following	<p>Thermoplastic material</p> <ol style="list-style-type: none"> .1 Material composition shall be at the discretion of the manufacturer subject to the approval of the Contract Administrator and the City. Each formulation shall be identified by a code number. .2 No retained water when tested by ASTM D-570. .3 Specific gravity of the supplied product shall be within 3 % of that specified for the selected formulation. .4 Material shall not deteriorate upon contact with deicing chemicals, gasoline, diesel fuel or grease dropped by traffic. .5 Material shall not break down, deteriorate, scorch or discolour, if held within the application temperature range specified by the manufacturer for a period of four hours and it must be able to be reheated from room temperature to the application temperature four (4) times without showing any of these detrimental effects. .6 When applied at the temperature recommended by the manufacturer and at a film thickness of 2 to 4 mm, the material shall set solid and show no tracking under traffic after elapsed times as follows: <ol style="list-style-type: none"> .1 Two (2) minutes at an air temperature of 10° C, relative humidity less than 75 %, and road surface temperature from 10° C to 20° C. .2 Five (5) minutes at an air temperature of 32° C, relative humidity less than 75 %, and road surface temperature from 35° C to 50° C. .3 The drying time under conditions intermediate between the two air temperatures shall be interpolated using a straight line model. .7 The quantity, type, and gradation of the component reflecting glass spheres premixed in the thermoplastic material shall be at the discretion of the manufacturer, but shall provide retroreflection levels specified below.
3.0	EXECUTION		
3.3	Application	Add to 3.3.1.3	Temporary raised pavement markings (TRPMs) are to be provided on all multi-lane roadways as directed by the <i>Contract Administrator</i> and the City.
		Delete 3.3.3.3 and replace with the following	Thermoplastic material shall be heated in the melter to a temperature of 382 °F.

END OF SECTION

1.0 GENERAL

1.0 General Requirements

Delete 1.0.1 and replace with the following

- .1 Section 32 91 21 refers to those portions of the *Works* that are unique to the supply, placement and finish grading of *Growing Medium*. This section must be referenced to and interpreted simultaneously with all other sections pertinent to the *Works* described herein.

For the purpose of this specification, the term "*Growing Medium*" shall mean a soil produced offsite by homogeneous blending of mineral particulates, micro-organisms and organic matter which provides suitable medium for supporting intended plant growth and the term "*Topsoil*" shall mean on-site native or surface soil material which may be used as *Growing Medium* provided it meets standards set for imported material *Growing Medium* and can be modified to meet the requirements set out for specified *Growing Medium*.

Add 1.0.3

- .3 For the purpose of this specification, the term '*Soil-Testing Laboratory*' shall mean an independent laboratory, recognized by the landscape nursery industry, with the experience and capability to conduct the testing indicated and that specializes in types of tests to be performed.

1.4 Measurement and Payment

Delete 1.4.1 and replace with the following

Payment includes supply and installation of growing medium, boulevard tree trench and imported top soil that is free from any noxious weeds, fungal growth, mushroom, and any contaminants, and as described in the Schedule of Quantities and Proces. Payment will be made separately and includes supply of material, on-site handling, preparing the landscape area subgrade, placing, grading, raking, compacting top soil and application of fertilizers.

Payment for growing medium boulevard tree planting trench includes excavation, disposal of excavated and unsuitable material, backfill and growing medium.

Payment for imported top soil will be for actual volume placed onsite at specified thickness.

1.5 Inspection and Testing

Delete 1.5 and replace with the following

- .1 The *Contractor* is responsible for testing imported *Growing Medium* and all related cost incurred. Testing shall be carried out by an approved *Soil Testing Laboratory*.
- .2 The sample analysis shall be of tests done on the proposed *Growing Medium* from samples taken at the supply source within a minimum of 14 days in advance of *Growing Medium* placement. Allow 7 days for soil testing by the laboratory for each sample. The sample shall be picked up by the *Soil Testing Laboratory* from the supply source. The *Growing Medium* sample shall be a composite of at least three (3) samplings for the proposed source and shall be at least one (1) litre in volume.
- .3 Forward a copy of all test results directly to the *Contract Administrator* and the City for review. The analysis shall outline the testing laboratory's required amendments such as sand, organic matter, fertilizers and lime to achieve adequate growing conditions.

- | | | |
|---|--|---|
| <p>1.6 Product Handling</p> | <p>Add 1.6</p> | <p>.4 The <i>Contractor</i> shall not deliver any <i>Growing Medium</i> to the site until the test results have been reviewed and approved by the <i>Contract Administrator</i> and the City.</p> <p>.5 All submitted soil analysis must be dated and include supplier name and phone number, project location and submitted to <i>Contract Administrator</i> and the City for approval prior to commencing work. Soil analysis shall include measurements of:</p> <p style="padding-left: 20px;">.1 Percent sand, fines, silt and clay</p> <p style="padding-left: 20px;">.2 Organic matter to 100%</p> <p style="padding-left: 20px;">.3 pH, acidifying additive required to achieve noted herein</p> <p style="padding-left: 20px;">.4 Water soluble salts</p> <p style="padding-left: 20px;">.5 Total carbon to nitrogen ration</p> <p style="padding-left: 20px;">.6 Total nitrogen and available levels of phosphorus, potassium, calcium & magnesium</p> <p>.6 At the discretion of the <i>Contract Administrator</i> and the City submit up to two (2) additional samples, at intervals outlined by the <i>Contract Administrator</i> and the City, of <i>Growing Medium</i> taken from material delivered to the site. Samples shall be taken from a minimum of three (3) random locations and mixed to create a single uniform sample of testing. Results of these tests shall be forwarded to the <i>Contract Administrator</i> and the City for review.</p> <p>.7 The <i>Contractor</i> is responsible for soil analysis and requirements for amendments to supply <i>Growing Medium</i> as specified. Failure to satisfy these contractual requirements could result in the <i>Contractor</i> being required to remove unacceptable <i>Growing Medium</i> at their expense.</p> <p>.8 Notify the Contract Administrator at least forty-eight (48) hours prior to <i>Growing Medium</i> placement for inspection.</p> <p>.9 Refer to General Conditions, Clause 4.12 Tests and Inspections.</p> |
| <p>1.6 Product Handling</p> | <p>Add 1.6</p> | <p>.1 All materials to be handled and adequately protected to prevent damage. Do not handle <i>Growing Medium</i> in an excessively wet, extremely dry, frozen condition or in any manner in which structure may be adversely affected. <i>Growing Medium</i> whose structure has been damaged by handling under these conditions shall be rejected and shall be replaced by the <i>Contractor</i> at their expense.</p> <p>.2 Stockpile materials in bulk form in paved areas or in pre-approved areas of the site. Provide additional protection of storage under roof or tarpaulins.</p> <p>.3 Take all precautions to prevent contamination of <i>Growing Medium</i> and amendments from windblown soil particles, weed seeds and from insects. Contamination of the <i>Growing Medium</i> and amendments may result in their rejection for use.</p> <p>.4 Store fertilizer and chemical amendments in the manufacturer's original containers.</p> <p>.5 All <i>Growing Medium</i> shall be delivered to site <u>premixed</u> from a recognized <i>Growing Medium</i> source ensuring consistency throughout the mix.</p> |
| <p>2.0 PRODUCTS</p> | <p>Delete 2.0 and replace with the following</p> | <p>.1 <i>Growing Medium</i> Preparation</p> |
| <p>2.1 Materials</p> | | |

- .1 Shall be prepared from Compost Material with Sand and other Soil Amendments as required to meet the specifications herein.
- .2 Ensure commercial processing and mixing of *Growing Medium* components are done thoroughly by a mechanized screening process. Do not mix the components by hand. Ensure the resulting product is a homogeneous mixture having the required properties throughout free of stones 25 mm or larger in any dimension, woody plant parts, toxic materials, foreign object and other extraneous materials harmful to plant growth. Provide composted soil free from crabgrass, couch grass, equisetum, convolvulus, or other noxious weeds or seed or parts thereof.

.2 Inorganic Soil Amendments

- .1 Sand: Imported pit sand or river pump sand, free of impurities, chemicals, horsetails, and other noxious weeds. The saturation extract electrical conductivity of salinity shall not be greater than 3.0 millimhos/cm at 25 degrees C.

<u>Sieve Size (mm)</u>	<u>Percent passing (%)</u>
4.75	95-100
0.50	0-40
0.050	0-5

- .2 Fertilizers: Uniform in composition, free flowing and dry, granular, pill form, or pelleted commercial product with 50% of total nitrogen (if applicable) derived from natural organic material in a slowly available form delivered in unopened water proof containers with the manufacturer's guaranteed N-P-K analysis, type and trade name attached to each container. The planting soil test results will specify a formulation and application rate to achieve the levels of nitrogen, phosphorous and potassium required. Fertilizer to meet the requirements of the Canada Fertilizer Act.

- .1 Lime: ASTM C 602, agricultural limestone containing a minimum 80 percent calcium carbonate equivalent and as follows:

- .1 Class: Class T, with a minimum 99 percent passing through No. 8 (2.36 mm) sieve and a minimum 75 percent passing through No. 60 (0.25 mm) sieve.
- .2 Provide lime in form of dolomitic limestone.

- .3 Perlite: Horticultural perlite, soil amendment grade.

.3 Organic Soil Amendments

- .1 Compost: Well-composted, stable, and weed-free organic matter, pH range of 5.5 to 8; moisture content 35 to 55 percent by weight; 100 percent passing through 25 mm sieve; soluble salt content of 5 to 10 decisiemens/m; not exceeding 0.5 percent inert contaminants and free of substances toxic to plantings; and as follows:

- .1 Organic Matter Content: 50 to 60 percent of dry weight containing no cedar, redwood, wood or bark.
- .2 Colour: dark brown to black in colour.

- .2 Peat:

- .1 Finely divided or granular texture, with a pH range of 6 to 7.5, containing partially decomposed moss peat, native peat, or reed-sedge peat and having a water-absorbing capacity of 1100 to 2000 percent.
 - .3 Wood Residual
 - .1 Content of wood residuals such as Fir or Hemlock sawdust present in the *Growing Medium* shall not cause the total carbon to total Nitrogen ration to exceed 40:1.
 - .2 Cedar or redwood sawdust shall not be present in *Growing Medium*.
 - .4 Manure
 - .1 Well-rotted, unleached, stable or cattle manure containing not more than 25 percent by volume of straw, sawdust, or other bedding materials; free of toxic substances, stones, sticks, soil, weed seed, and material harmful to plant growth and free from salt or other harmful chemicals, such as any used to artificially hasten decomposition.
 - .2 All particles in manure to pass a 6.35 mmm sieve.
 - .3 Salt content shall give a reading of less than 0.5 millimhos/cm at 25 degrees C.
- 2.2 Nutrient Requirements
 - .1 Nutrient requirements shall meet the BCSLA/BCNTA Landscape Standard *Growing Medium* requirements for nitrogen, phosphorus, potassium, calcium, magnesium, boron, sodium cation exchange capacity, carbon to nitrogen ratio.
 - .1 Boron: not to exceed 1.0ppm
 - .2 Sodium: Sodium absorption ratio(SAR) not to exceed 8.0
 - .3 Total Nitrogen: to be 0.2-0.4% by weight
 - .4 Available Phosphorous: to be 50-100 ppm
 - .5 Available Potassium: to be 50-70 ppm
 - .6 Cation Exchange Capacity: to be 30 to 50 meq.
 - .7 Carbon to nitrogen ratio: Maximum 40:1.
- 2.3 Salinity
 - .1 The electrical conductivity of the liquid taken from the soil pH evaluation shall not exceed 3.0 millimhos/cm at 25 degrees C before additions of fertilizers and/or liming agents.
- 2.4 Drainage Rate
 - .1 Percolation shall be such that mixing, handling and placement to be done in such a manner that the minimum saturated hydraulic conductivity show on Table – '*Growing Medium Properties for Different Applications*' (found herein these specifications) is achieved and no standing water is visible 60 minutes after at least 10 minutes of moderate to heavy rain or irrigation.
- 2.5 Growing Medium Source
 - .1 Import planting medium or manufactured planting medium from off-site sources. Do not obtain from agricultural land, bogs or marshes.
 - .2 Supplier of Growing Medium shall be as per the Coquitlam Approved Products List.
- 2.6 Bark Mulch
 - .1 Mulch backfilled surfaces of planting beds and other areas indicated on drawings.
 - .1 Organic Mulch: Apply 50 mm average thickness of organic mulch, and finish level with adjacent *Finish Grades*. Do not place mulch against plant stems.

- .2 Supplier of Bark Mulch shall be as per the Coquitlam Approved Products List.
- .3 Dark brown in colour and free of all soil, stones, roots or other extraneous matter, and free of weeds, seeds and spores.

2.7 Growing Medium Properties for Different Applications

Properties	Low Traffic Lawn Areas, Trees and Large Shrubs	High Traffic Lawn Areas	Planting Areas, Planters Shrubs & Groundcover
Texture: Particle size classes by Canadian System of Soil Classification	Percent of Dry Weight Mineral Fraction (%)		
Gravel (greater than 2 mm less than 75 mm)	0-10	0	0
Sand (greater than 0.05 mm and less than 2 mm)	50-70	80-90	50-70
Silt (larger than 0.002 mm and less than 0.5 mm)	10-30	5-20	10-30
Clay (less than 0.002 mm)	7-20	2-5	7-20
Organic Content Percent of Dry Weight	5-10	3-5	25-30
Drainage Minimum saturated hydraulic conductivity (cm/hr) in place	2.0	7.0	2.0
Acidity (pH)	6.0-6.5	6.0-6.5	5.0-6.0

2.8 Miscellaneous Products

- .1 Root Barrier: 400x610 mm linear root barrier, copolymer polypropylene, 50% recycled plastic, black in colour. Supplier of Root Barrier shall be as per the Coquitlam Approved Products List.
- .2 Construction Adhesive shall be as per the Coquitlam Approved Products List.
- .3 Drain Mat: Light duty, uv stable, impermeable cuspated core bonded to a layer of non-woven filter fabric with the following minimum properties:
 - .1 Compressive Strength -718 kN/m2 as per ASTM D-1621
 - .2 Flow Rate – 188 l/min/Metre as per ASTM D-4716
 - .3 Approximate profile thickness of 10 mm.
 - .4 Supplier of Drain Mat shall be as per the Coquitlam Approved Products List.
- .4 Filter Fabric: Install root barriers in accordance with manufacturer's reviewed installation instructions where indicated on reviewed drawings with vertical root directing ribs facing inwards towards trees or plants; connect panels together as required.
 - 1. Supplier of Filter Fabric shall be as per the Coquitlam Approved Products List.

withstand wear and tear during construction without deterioration of its strength and filtering properties.

.1 Supplier of Geotextile shall be as per the Coquitlam Approved Products List.

.7 Ground dolomite limestone containing no less than 85% of its total weight as calcium carbonate and magnesium carbonate shall be used to control ph level. The degree of grind for the limestone shall allow 100% of the total weight to pass a #10 (2 mm) sieve, 90% to pass a #18 (1 mm) sieve and 20% to pass a #40 (0.105 mm) sieve. Spread-easy fertilizer shall be used as a slow release fertilizer source of calcium and magnesium.

.8 Mixing of structural soil:
Blend as per following ratios:

.1 5 metric tones (MT) of aggregate

.2 1 cubic meter of growing media

.3 2 kg soil stabilizer

.9 Moisten mixture with fine spray of clean potable water while mixing to activate soil stabilizer product. Do not over mix. Place mixture in 300 mm lifts through entire area of structural soil mixture. Compact each lift to 95% MPD prior to placement of next lift. Install filter fabric such to ensure a minimum of 60 cm overlap of all fabric seams and beyond edge of structural soil.

3.0 EXECUTION

3.2 Preparation of Subgrade

Delete 3.2.4 and replace with the following

Remove debris, roots, branches, stones in excess of 50 mm diameter and other deleterious materials, soil contaminated with calcium chloride, toxic materials and petroleum products, and debris which protrudes more than 25 mm above the surface. Dispose of all removed material off site to approved offsite disposal area at no additional cost to the *Owner*.

Delete 3.2.5 and replace with the following

Course cultivate entire area which is to receive *Growing Medium* to depth of 250mm. Cross cultivate those areas where equipment used for hauling and spreading has compacted soil.

Add 3.2.6

Grade transitions shall be smooth and even and shall blend into surrounding areas as determined by the *Contract Administrator* and the City.

Add 3.2.7

Provide erosion-control measures to prevent erosion or displacement of soils and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways.

3.3 Processing Growing Medium

Add 3.3.4

Growing Medium shall be imported and stockpiled on site in a location approved by the *Contract Administrator* and the City.

.1 Carry out stock piling operation such that the *Growing Medium* structure is not compromised through compaction, vibration or other actions.

.2 Stock piled *Growing Medium* shall be protected from rain, drying and contaminants.

.3 *Growing Medium* shall be free of subsoil, pests, roots, wood, construction debris, undesirable grasses including crabgrass or couch grass, noxious or weeds and weed seeds or parts thereof foreign objects and toxic materials. Presence of these contaminates shall be grounds for rejection of *Growing Medium* and replacement at no cost to the *Owner*.

3.4	Placing Growing Medium	Delete 3.4.2 and replace with the following	Place <i>Growing Medium</i> to the required finished grades with adequate moisture, in uniform lifts of 100 mm to 150 mm compacted to 80 MPD during dry weather, over dry, unfrozen <i>Sub Grade</i> where planting is indicated free of any standing water.
		Delete 3.4.5 and replace with the following	Minimum depths after settlement and 80% compaction: .1 Trees pits: 900 mm .2 Shrub beds: 450 mm .3 Ground cover areas: 300 mm .4 Lawn areas: 300 mm .5 Blvd. areas: 150 mm
		Add 3.4.6	Increase sand content to 90% in the planting soil below lawns where heavy wear by pedestrians or maintenance equipment is anticipated. Increase sand content in a 1.5m wide strip at the bottom of swales, banks or other wet areas and as directed by the Landscape Architect. On steep south or west facing banks, reduce sand content in lawns and planting beds to 50 - 60% for better moisture retention.
3.5	Applying Fertilizers	Delete 3.5 and replace with the following	.1 Addition of amendment components shall be at the rates indicated in the <i>Growing Medium</i> analysis recommendations via the following methods: .1 Lime: Applied with mechanical spreaders over entire planting areas and contained planters. .1 Do not apply by hand. .2 Mix thoroughly into the top 100 mm of <i>Growing Medium</i> . .3 Do not allow lime to come into direct contact with nitrogen - phosphate - potash fertilizers. .2 Fertilizer: Applied with mechanical spreaders over entire planting areas and contained planters. Do not apply by hand. Do not mix into <i>Growing Medium</i> .
3.6	Finish Grading	Delete 3.6.1 and replace with the following	Manually fine grade <i>Growing Medium</i> installation to contours and elevations shown on drawings or as directed by <i>Contract Administrator</i> and the City. Eliminate rough spots and low areas to ensure positive drainage.
		Add 3.6.3	<i>Finish Grade</i> of <i>Growing Medium</i> shall be 25 mm from finished elevation of adjacent curb or planter wall unless otherwise noted on drawings.
3.9	Clean-up	Delete 3.9 and add the following	.1 Ensure all paved areas, tops of planters, adjacent surfaces have been thoroughly cleaned. Ensure all discoloration of adjacent surfaces as a result of <i>Growing Medium</i> installation have been removed. .2 Dispose of materials not required and repair any damage to adjacent surfaces (as determined by the <i>Contract Administrator</i> and the City) off site at no additional cost to the <i>Owner</i> .
3.10	Weed Control	Add 3.10	.1 Ensure all weeds and weed roots that have germinated during the course of work of this section have been eliminated from <i>Growing Medium</i> . .2 Provide the City Representative and Consultant with a written outline of weed removal methodology seven (7) days prior to starting weed removal operations.
3.11	Structural Soil	Add 3.11	.1 Refer to 2.9 in this specification and as shown on the Contract Drawings.

END OF SECTION

SODDING

1.0	GENERAL	Delete 1.0.2 and replace with the following	This section is based on the "British Columbia Landscape Standards and the B.C. Nursery Trades Association. This standard is intended to set a level of quality which is equalled or bettered in the construction documents.
1.4	Handling and Storage	Delete 1.4.3 and replace with the following	Schedule sod deliveries such that sod installation occurs within twenty-four (24) hours of being lifted from the source sod farm.
		Delete 1.4.4 and replace with the following	Sod shall be neatly stacked or rolled at the source sod farm, delivered and unloaded on sturdy pallets which are no more than 3 pallets high.
1.5	Drainage Control	Delete 1.5.1 and replace with the following	Provide for proper water management and drainage of site during work of this section. Water management shall include silt traps, erosion control measures, temporary water collection ditches, as well as their adequate maintenance to ensure that storm water which may become laden with soil, growing medium or hydraulic seed is detained and cleaned prior to discharge from <i>Place of Work</i> .
1.6	Samples	Add 1.6.2	Submit one (1) square meter of sod to the <i>Contract Administrator</i> and the City for review. Ensure sample is complete with name of sod farm, base soil type, seed mix percentage.
		Add 1.6.3	<i>Contract Administrator</i> and the City shall review sod sample for approval prior to installation. The sample accepted by the review will form the standard by which the project will be supplied.
		Add 1.6.4	Should the <i>Contractor</i> require the source of sod supply to change during the construction a written request must be provided to the <i>Contract Administrator</i> and the City 48 hours in advance. The request shall be followed up by submission of proposed sod substitution sample and include the name of sod farm, base soil type, seed mix percentage for <i>Contract Administrator</i> and the City review prior to the delivery.
1.8	Measurement and Payment	Delete 1.8.1 and replace with the following	Payment for nursery sod includes supply and placing of sod as shown on the Contract Drawings or as directed by the Contract Administrator and grass maintenance to meet Conditions of Total Performance. Payment includes protection from damage caused by any living creature.
2.0	PRODUCTS		
2.1	Sod	Delete 2.1.1 and replace with the following	Sod to be approved by the <i>Contract Administrator</i> and the City and to be nursery grown, true to type, conforming to standards of nursery Sod Growers' Association and their Nursery Sod Specifications. Sod to be quality, cultured turf grass grown from seed approved by Canada Department of Agriculture, free of disease, clovers, stones, pests and debris.
		Add 2.1.1.1	Nursery sod: .1 Shall be No. 1 Premium grade and contain only species of grass indicated on the supplier's certificate. .2 Sod shall be 'non-netted'
		Add 2.1.1.2	Table Guideline of Approved Sod Mix Ratios

Supreme Soil Base Sod	
(Elka II) Perennial Ryegrass	40%
(Shamrock) Kentucky Bluegrass	30%
(Cindy) Chewing Red Fescue	30%

SODDING

Seed Rate: 50g per square metre	
---	--

		Add 2.1.8	All sod shall be completely free of invasive and/or noxious broadleaf weeds, grasses including but not limited to poa annua, disease, fungi, detrimental nematodes and detrimental insects.
2.2	Water	Delete 2.2.1 and replace with the following	Potable, free of impurities that would inhibit seed germination. <i>Contractor</i> to ensure adequate water is available to maintain seeded areas during germination and in a vigorously growing, healthy state until <i>Total Performance</i> of work of this section.
2.3	Fertilizer	Add 2.3.2	Fertilizer shall be complete synthetic slow release fertilizer. Type and application shall be as required by the growing medium analysis report.
2.4	Wooden Pegs	Add 2.4	.1 Wooden Pegs shall be 19 mm x 19 mm x 150 mm long No. 1 grade or better Hem/fir.
2.5	Binder Twine	Add 2.5	.1 Binder Twine shall be hemp based multiple strand string.
2.6	Flagging Tape	Add 2.6	.1 Flagging Tape shall be 30 mm wide, biodegradable ribbon tape made of non-woven cellulosic material, and red color, or an approved equivalent.
3.0	EXECUTION		
3.1	Finish Grade Preparation	Delete 3.1.2 and replace with the following	Prior to the placement of sod <i>Contract Administrator</i> and the City to review and direct minor adjustments and refinements of finish grades prior to the <i>Contractor</i> proceeding. Review includes grades, growing medium depth and condition of finished surface. Subsequent to the <i>Contract Administrator</i> and the City review the <i>Contractor</i> shall re-grade, add growing medium and make adjustments as directed by <i>Contract Administrator</i> and the City.
		Delete 3.1.5 and replace with the following	Fine grade growing medium to lines and levels shown on Contract Drawings. Ensure that all low spots, humps and irregularities are eliminated prior to review by <i>Contract Administrator</i> and the City.
3.2	Sodding	Delete 3.2 and replace with the following	.1 Sod shall not be placed during hot dry summer periods, at freezing temperatures, or over frozen growing medium. .2 Allow sod to dry sufficiently during wet weather to prevent tearing during lifting and handling. .3 Handle sod carefully to minimize tearing and dropping of soil. .4 Placement of Sod: .1 Lay sod in rows smooth and flush to adjoining grass areas and paving and top surfaces of curbs unless shown otherwise on <i>Contract Drawing</i> . Ensure there is a full roll width between the new sod and any adjoining surfaces. Small cut pieces from a full roll will not be accepted. .2 Stagger joints and ensure that sod sections are butted closely together without overlapping or leaving gaps between sections. .3 Cut out irregular or thin sections with a sharp knife. .4 Cut sod to fit tight around landscape elements. .5 Cut sod to create clean, smooth lines along all plant beds.

SODDING

- .5 Placement of Sod on Slopes:
 - .1 Lay sod with the length of each sod section parallel to slope taking extra care to ensure that sod sections are butt tight and each sod section is set in a staggered formation.
 - .2 On slopes exceeding 3:1 gradient ensure sod is secured with wooden pegs at intervals of not more than 450 mm along the center of each section. Ensure wooden pegs are driven flush with the sod.
 - .3 Prior to acceptance of sod areas that have been secured with wooden pegs either remove the wooden pegs or drive each wooden peg at least 50 mm below finished grade.
 - .4 Where required, place erosion control mesh or netting and secure with stakes or staples sunk firmly into ground to a minimum depth of 150 mm at maximum intervals of 4 meters along pitch of slope. Place stakes or staples horizontally across slope at intervals equal to width of mesh or netting minus 150 mm and drive flush with top of sod.
- .6 Use a light roller to ensure that there is full, close contact between sod and growing medium. Use of a heavy roller to correct irregularities in grade is not permitted.
- .7 Ensure all sodded areas are watered immediately after installation. Verify that water applied to has penetrated through sod into top 100 mm of growing medium. Continue watering operations as needed to ensure that adequate moisture content is maintained to encourage deep root growth and healthy, vigorous leaf growth.
- .8 Protect newly placed sod from heavy foot traffic during installation and until acceptance by the *Contract Administrator* and the City. Protection shall include but is not limited to placement of wood planks or plywood of sufficient thickness to bear the imposed weight and prevent damage to sod or displacement and/or compaction of sod/growing medium.
- .9 Sod that has been damaged by construction operation, construction / site personnel or construction traffic shall be replaced at no cost to the *Owner*. Replacement shall include removal of growing medium, regrading of sub grade, replacing growing medium and sod as required.
- .10 Water sod area immediately with sufficient amounts to saturate sod and upper 100 mm of growing medium. Do not allow the sod to dry out so that the joints become visible.

3.4 Grass Maintenance Delete 3.4 and replace with the following

- .1 Maintenance of sodded areas shall begin immediately after sodded operation and shall continue until all deficiencies noted in the *Substantial Performance* review have been rectified to the satisfaction of the *Contract Administrator* and the City and conditions for *Total Performance* have been achieved. The *Contractor* is to notify the *Contract Administrator* and the City in writing forty eight hours (48) prior to stopping maintenance operations.
- .2 Sod Cutting: After the 'first' cut of sodded lawn areas cutting operations shall be carried out on a weekly (seven day) basis until *Total Performance* by *Contract Administrator* and the City:
 - .1 First cut of sodded lawn areas shall occur when a uniform grass height of 75 mm has been attained. First cut shall be to a height of 65 mm.

SODDING

- .2 Continue regular weekly cutting at a height of 65 mm until *Total Performance*.
- .3 Cutting operations shall be such that each cut is at right angles to the previous cut.
- .4 *Contractor* to remove grass clippings after each cut and dispose of offsite.
- .5 Roll when required to remove any minor depressions or irregularities.
- .6 Immediately repair seeded areas that show deterioration or bare spots. Top-dress all areas showing shrinkage due to lack of watering and seed with seed mix that matches the original seed mix.
- .3 Fertilizer analysis shall conform to recommendations provided with growing medium analysis. Application of fertilizer shall follow manufacturers' recommendations noting that after October 1 lawn areas shall not be fertilized until April 15th of the following spring.
- .4 Sodded lawn areas shall be kept free of invasive and/or noxious broadleaf weeds, grasses including but not limited to poa annua, disease, fungi, detrimental nematodes and detrimental insects.
- .5 All maintenance equipment and practices are to conform to the BC Landscape Standard Level 2 'Groomed'.
- .6 Protect all sodded areas against trespassing and from damage at all times clearly marked, staked, string and flagging tape.
- .1 Perimeter Protection: Where directed by the *Contract Administrator* and the City, sodded areas shall be surrounded by a 900 mm high barrier made up of the following components:
 - .1 Wood posts placed at 1.8 meters on centre.
 - .2 Wood Posts to be driven to a depth of 300mm.
 - .3 String two (2) strands of hemp based binder twine (or equal product) between posts. Insure one full wrap of twine around each post.
 - .4 Tie 300 mm strands of 'red' flagging tape at 450 mm intervals along the entire length of both strands of twine.
 - .5 Maintain perimeter protection until *Total Performance* issued. Upon acceptance by *Contract Administrator* and the City, remove perimeter fence and dispose of off site.

3.5 Condition for Total Performance

Delete 3.5.1 and replace with the following

Conditions for *Total Performance* of Sodded areas:

- .1 Sodded areas exhibit fully established root systems.
- .2 No seams are visible between sod sections.
- .3 Sod areas are smooth and evenly graded. No depressions, foot marks or vehicle tracks.
- .4 Sod is free of bare and dead spots and does not have any broadleaf weeds, noxious grasses including but not limited to poa annua.
- .5 No surface growing medium is visible when grass has been cut to height of 65 mm.
- .6 Sodded areas have been cut a minimum of two (2) times, at seven (7) day intervals.
- .7 Sodded areas are a uniform green colour with no discoloured sections or patches.

SODDING

			.8 Sodded areas exhibit a thick, dense, uniform and healthy appearance.
		Add 3.5.2	Lawns sodded after September 30 th will be not be reviewed for <i>Total Performance</i> until April 30 th the next year.
3.6	Guarantee / Maintenance	Delete 3.6.1 and replace with the following	The <i>Contractor</i> hereby guarantees that the sod will remain free of weeds and defects for a period of one (1) year from the date of <i>Substantial Performance</i> . The <i>Contractor</i> shall make all corrections, adjustments and replacements required as a result of failure of all products in this section. During the <i>Maintenance Period</i> , the <i>Contractor</i> will replace sodded areas, determined by <i>Contract Administrator</i> and the City, to be dead or failing at the end of the <i>Maintenance Period</i> . Replacements to be made at next appropriate season and, conditions of guarantee will apply to all replacement seeding for one full growing season.
		Delete 3.6.2 and replace with the following	The Owner reserves the right to extend the <i>Contractor's Maintenance Period</i> and responsibilities for one (1) additional year if, at end of the initial guarantee period, the development and growth of the sod is not sufficient to ensure future survival.

END OF SECTION

PLANTING OF TREES, SHRUBS AND GROUND COVERS

1.0	GENERAL	Delete 1.0.1 and replace with the following	Section 32 93 01 refers to those portions of the Work that are unique to the sourcing, supplying, placing and maintaining the plant material indicated on the <i>Contract Drawing</i> and the Plant List(s). This section must be referenced to and interpreted simultaneously with all other sections pertinent to the Work described herein.
1.2	References	Delete 1.2.2 and replace with the following	Canadian Nursery & Landscape Association (CNLA) Standard for Nursery Stock (current edition).
		Add 1.2.4	The British Columbia Landscape & Nursery Association (BCLNA).
		Add 1.2.5	ANSI A-300 Tree Pruning Guidelines
1.3	Source Quality Control	Delete 1.3 and replace with the following	<p>.1 Seven (7) days prior to the <i>Contract Administrator</i> and the City review of plant material at source the <i>Contractor</i> shall confirm in writing availability of plant material noted on plant list.</p> <p>.2 Plant material will be supplied from nurseries who are certified by the Clean Plants program, Canadian Nursery Certification Institute (CNCI), current certification standard http://cleanplants.ca/. The certification shall include but is not limited to the requirements of the current active module(s), e.g. P. Ramorum module. The certification must extend to all fields and allied nursery operations where plant material is sourced. Only nurseries, fields and allied nursery operations that are certified will be permitted to supply plant material for this project.</p> <p>.1 Prior to the review of plant material by the <i>Contract Administrator</i> and the City the <i>Contractor</i> shall submit written documentation with CNCI certification stamp stating that the nursery has undergone all components of a certification program and has been audited to verify that all components are properly implemented.</p> <p>.2 The documentation submitted shall include but is not limited to the nurseries CNCI Clean Plants certification number.</p> <p>.3 Plant Material Review at the source nursery.</p> <p>.1 <i>Contractor</i> shall request for review of the plant material at source nursery to be a minimum of seven (7) days prior to scheduled review.</p> <p>.2 Shipping of plant material to the <i>Place of Work</i> shall not proceed until <i>Contract Administrator</i> has reviewed the plant material at the source nursery.</p> <p>.3 <i>Contract Administrator</i> and the City shall make one (1) visit to source nursery for review of plant material for entire project.</p> <p>.4 All plant material, including substitutions shall be gathered at one location for review.</p> <p>.5 <i>Contractor</i> shall accompany <i>Contract Administrator</i> during plant material review at the source nursery.</p> <p>.4 Plant Material Review at the <i>Place of Work</i></p> <p>.1 All plant material shall be reviewed at the <i>Place of Work</i> by the <i>Contract Administrator</i> and the City prior to planting.</p> <p>.2 Plant material that is rejected by the <i>Contract Administrator</i> shall be immediately removed from the <i>Place of Work</i> and replaced at the <i>Contractor's</i> expense.</p>

- | | | |
|---|--|--|
| <p>1.4 Submittals and Scheduling</p> | <p>Delete 1.4 and replace with the following</p> | <ul style="list-style-type: none">.5 Imported Plant Material<ul style="list-style-type: none">.1 Plant material imported from out of province and out of country shall be accompanied with necessary federal and provincial permits and import licenses..2 The <i>Contractor</i> shall conform to all federal and provincial laws and regulations with regard to horticultural inspection of domestic and imported plant material..6 Condition of Plant Material<ul style="list-style-type: none">.1 Plant rootballs and containers shall be <u>completely free of noxious weeds and volunteer plants</u> including Horsetail and Morning Glory..2 Plant materials grown or supplied in <u>Fabric Containers</u> are <u>not acceptable</u>..7 All materials and execution to conform to the latest edition of the BCNTA Guide Specifications for Nursery Stock and the BCNTA Guide Specifications for Landscape Construction.
<ul style="list-style-type: none">.1 Submit inspection certificates as required by law for each shipment of plant material..2 <i>Contractor</i> shall provide in writing to the <i>Contract Administrator</i> and the City a minimum of seven (7) days prior to review of plant material at the source nursery a plant list confirming the quantity, botanical name, common name and size of plants specified..3 Substitutions<ul style="list-style-type: none">.1 <i>Contractor</i> shall provide in writing to the <i>Contract Administrator</i> and the City a minimum of seven (7) days prior to review of plant material at the source nursery a list of proposed substitutions for review..2 Plant substitutions shall be of similar genus and species and of equal or greater size as those originally specified. The list shall contain the following information:<ul style="list-style-type: none">.1 Botanical name, common name of the specified plant.2 Botanical name, common name of the proposed substitute plant.3 Pot size and plant size in the nursery.4 Planting Schedule<ul style="list-style-type: none">.1 <i>Contractor</i> shall provide in writing to the <i>Contract Administrator</i> and the City upon award of the <i>Contract</i> a detailed Planting Schedule outlining dates and duration of planting operations..2 Revisions to the Planting Schedule as a result of delays of any kind shall be submitted to the <i>Contract Administrator</i> and the City in a timely manner prior to the start of planting operations..3 Schedule all planting to ensure optimum environmental protection, grading, growing medium placement, planting, seeding, or sodding operations as outlined in these Specifications. Organize scheduling to ensure a minimum duration of on-site storage of plant material, minimum movement and compaction of growing medium, and prompt mulching and watering operations. Coordinate Work schedule with schedule of other trades on-site..4 Coordinate and schedule plating such that no damage occurs to plant material before and after placement. In particular, meet requirements of living plant material..5 Product Data |
|---|--|--|

- | | | | |
|-----|-----------------------------|---|--|
| 1.5 | Handling and Storage | Delete 1.5 and replace with the following | <ul style="list-style-type: none"> .1 <i>Contractor</i> to submit a one (1) litre sample of Composted Mulch to the <i>Contract Administrator</i> and the City for review prior to delivery. .2 <i>Contractor</i> to submit a one (1) litre sample of the Prepared Growing Medium to the <i>Contract Administrator</i> and the City for review prior to delivery. .3 <i>Contractor</i> to submit three (3) copies of the anti-desiccant manufacturer product data and specification for <i>Contract Administrator</i> and the City review. .4 <i>Contractor</i> to submit three (3) copies of the fertilizer manufacturer product data and specification for <i>Contract Administrator</i> and the City review. .5 <i>Contractor</i> to submit three (3) copies of the Guying assembly including clamps, collar, guying wire, anchors and wire tighteners manufacturer product data and specifications for <i>Contract Administrator</i> and the City review.
<ul style="list-style-type: none"> .1 Coordinate shipping of plant material and excavation of planting pits to ensure minimum time lapse between nursery digging and on site planting. .2 Ensure branches of trees and shrubs are bound securely into a confined mass during handling and transport. .3 Do not bind planting stock with rope or wire that would damage bark, break or damage branches or damage the natural shape of the plant. .4 Protect plant material against abrasion, and exposure to extreme temperature change during transit. .5 Cover plant foliage and branches with tarpaulin to prevent loss of moisture during transit. .6 Fully support root ball of large trees during all lifting operations. .7 Do not lift trees or shrub by the trunk or branches. Plant material to be moved by lifting the root ball or container. .8 Remove broken and damaged roots with clean cuts using sharp pruning shears. .9 Temporary Storage/ Heel-In of Plant Material onsite <ul style="list-style-type: none"> .1 Temporarily store trees, shrubs and miscellaneous plant material that cannot be planted immediately by heeling-in. Acceptable heel-in material include approved growing medium or sawdust. .2 Ensure temporary storage/heel-in area is shaded and protected from the wind. .3 Provide sufficient water at regular intervals to ensure health of plant material in the temporary storage/heel-in area. .4 Plant material that has not been properly maintained in the storage/heel-in area and illustrates signs of degradation or stress will be rejected by the <i>Contract Administrator</i> and the City. Rejected plant material shall be replaced by the <i>Contractor</i>. |
|-----|-----------------------------|---|--|

PLANTING OF TREES, SHRUBS AND GROUND COVERS

1.9	Measurement and Payment	Delete 1.9.1 and replace with the following	Payment for trees will be for each tree of size & species specified. Payment for shrubs, grass, perennials, plugs and ground cover will be for each size & species specified. The unit price includes all preparatory work, supply and planting of the trees, support stakes, Treegator, shrubs, bark mulch and as shown on Contract Drawing, and other incidental specified under this Section including watering and maintenance to meet Conditions of Total Performance.
		Add 1.9.3	Payment for 400mm deep Root Barrier includes supply of all materials, labour, and equipment required to complete installations.
1.11	Substitutions	Add 1.11	.1 If it is impossible to obtain the particular plant material listed on the Landscape Drawing, the <i>Contractor</i> may be permitted to suggest substitutions with types and variations possessing the same characteristics. The <i>Contractor</i> must request any substitutions of trees in writing at least one (1) month and shrubs and groundcover at least one (1) month prior to planting. Substitutions must be approved by the <i>Contract Administrator</i> and the City.
1.12	Plant Material Supply and Search Area	Add 1.12	.1 Before substitutions of plant material are proposed, documented proof that materials are not available through search on the west coast of Canada and United States must be provided. Area of supply shall include, but not be limited to, all of Western North America.
1.13	Plant Material Identification	Add 1.13	.1 Plant materials that has been located by the <i>Contract Administrator</i> and the City and tagged for the project is to have the identification tags removed only after inspection and instruction by the <i>Contract Administrator</i> and the City after delivery to the <i>Place of Work</i> .
1.14	Plant Material Replacement	Add 1.14	.1 The <i>Contractor</i> shall remove from the <i>Place of Work</i> and immediately replace any plant material that has been determined by the <i>Contract Administrator</i> and the City to have died or failed to grow in a satisfactory manner during the guarantee or maintenance period. .2 The <i>Contractor</i> shall extend the guarantee on this replacement plant material for one (1) year from the date of replacement. .3 The <i>Contractor</i> shall continue such replacement and guarantee of plant material until the <i>Contract Administrator</i> and the City has determined that the <i>Conditions for Total Performance</i> have been met. .4 All required replacements shall be plants of the same size and species as specified on the plant list and shall be supplied and planted in accordance with the drawings, specifications and change orders thereto. .5 The cost of replacements resulting from theft, accidental damage, vandalism, carelessness, neglect on the part of others, shall be borne by the <i>Contractor</i> until the date of <i>Substantial Performance</i> .
2.0	PRODUCTS		
2.1	Plant Material	Delete 2.1 and replace with the following	.1 Plant Material Size .1 Overall plant spread to be measured when branches are in their natural position. .2 Height and spread dimensions refer to main body of plant and not from branch tip to branch tip.

- .2 Grade of plant material to be No. 1 grade or better.
- .3 Plant material obtained from areas with milder climatic conditions from those of the *Place of Work* is acceptable provided:
 - .1 Plant material is moved to the *Place of Work* prior to the breaking of buds at their original climatic zone.
 - .2 Plant material is heeled-in at a protected area until the climatic conditions are suitable for planting.
- .4 Plant materials shall have structurally sound, strong fibrous root system free of disease, insects, defects or injuries. All plants, typical of their species or variety, have a normal habit of growth and shall be first quality, sound, healthy, vigorous, well branched, and densely foliated, free of disease, insect pests, eggs or larvae.
- .5 Root Pruning at Source Nursery
 - .1 Plant material shall have been root pruned on a regular basis at the source nursery.
 - .2 Plant material shall be root pruned at least one growing season prior to delivery.
 - .3 Large trees shall be half root pruned during each of two successive growing seasons. The second root pruning shall have carried out a minimum of one growing season prior to delivery.
- .6 Shade, Ornamental and Evergreen Trees:
 - .1 Trees shall have straight trunks and a well-formed branch system which is characteristic of the species
 - .2 Trees shall exhibit clear signs of vigorous growth.
 - .3 Trees shall have good twig extension growth, branch spacing and trunk taper.
 - .4 Tree foliage shall be evenly distributed on upper 2/3 of the tree.
 - .5 Trees shall not have upright branches other than leaders.
 - .6 Trees shall have spreading branches with a single trunk and a single leader and, unless otherwise noted on plans or plant list.
 - .7 Tree trunks and branches shall not have any mechanical damage.
 - .8 Trees shall be in good health with no presence of insects or disease.
 - .9 Trees shall not have been 'headed back'.
- .10 Tree root balls shall be solid, kept moist at all times and/or protected from drying.
- .11 Trees shall not exhibit symptoms of root circling or girdling.
- .7 Container Grown Plant Material:
 - .1 Root ball to container relationship shall be of sufficient ratio to ensure room for healthy, vigorous root development.
 - .2 Plant material shall have been container grown for a minimum of one (1) growing season but not longer than two (2) growing seasons.
 - .3 The plant root systems that do not have the ability to "hold" growing medium when removed from the container will be rejected.
 - .4 Root bound plant material will be rejected.
- .8 Balled and Burlapped Plant Material:

			<ul style="list-style-type: none"> .1 Coniferous and broadleaved evergreens over 2.4-meter-tall shall be dug with firm soil root ball. .2 Deciduous trees in excess of 3.0-meter height shall be dug with firm soil root ball. .3 Root ball diameter shall be a minimum of 230 mm (for each 25 mm caliper size). .4 Secure root-balls with burlap, heavy twine and rope. .5 Large tree root balls shall be double layer burlap wrapped. Burlap to be secured with drum laces made up of 10 mm (minimum) diameter rope.
			<ul style="list-style-type: none"> .9 Tree Spade Dug Plant Material <ul style="list-style-type: none"> .1 Plant material shall be dug with mechanized hydraulic spade or clamshell type digging equipment. .2 Root ball diameter shall be a minimum of 230 mm for each 25 mm caliper size. .3 Wire basket shall be lined with burlap. Root ball shall be laced and tied to wire basket with heavy rope. .4 Ensure trunk of tree is not damaged by wire basket, ties or rope.
2.2	Water	Delete 2.2.1 and replace with the following	Potable and free of minerals and impurities which are detrimental to plant growth.
2.3	Fertilizer	Add 2.3.2	Fertilizer shall be prolonged-release fertilizer tablets containing a minimum of 20% nitrogen, 10% phosphoric acid, and 5% potash (20-10-5) as per Approved Products List. Store in weatherproof storage space.
2.4	Mulch	Delete 2.4.1 and replace with the following	Composed mulch shall be 9 mm black/brown in colour with no cedar or redwood bark or wood material as per Approved Products List.
2.5	Stakes	Delete 2.5.1 and replace with the following	Stakes shall be pressure treated Hem/Fir, 75 mm dia. round, 2500 mm long. Stake fasteners shall be hot dipped galvanized or stainless steel.
2.8	Guying Wire	Delete 2.8.1 and replace with the following	Guying wire shall be direct burial or screw type disc guy anchor and guy system as per Approved Products List.
2.11	Anti-Desiccant	Delete 2.11.1 and replace with the following	Anti-Desiccant shall be wax-like emulsion, as per Approved Products List, that will provide a transpiration reducing film over the plant surface.
2.12	Flagging Tape	Delete 2.12.1 and replace with the following	Flagging tape shall be 30mm wide 'Red' PVC flagging tape as per Approved Products List.
2.13	Tree Trunk Protection	Add 2.13	<ul style="list-style-type: none"> .1 Tree trunk protections shall be extrusion mold process, polyethylene with UV protectors as per Approved Products List.
2.14	Burlap	Add 2.14	<ul style="list-style-type: none"> .1 Burlap shall be untreated, free from toxic contaminants and of sufficient strength to hold the rootball in a compact, stable mass that does not move relative to the main stem(s) of the tree or shrub.
2.15	Wire Baskets	Add 2.15	<ul style="list-style-type: none"> .1 Wire baskets shall be non-galvanized metal basket designed and manufactured for the purpose of tree moving. Basket shall be

shaped to ensure that the root ball will allow a stable planting condition in accordance with standards noted.

2.16 Tree Ties Add 2.16

- .1 Tree ties shall be Flat woven polypropylene material. 20 mm wide, 544 Kg, break strength. extrusion mold process, polyethylene with UV protectors as per Approved Products List.

3.0 EXECUTION

3.1 Pre-Planting Operations Delete 3.1 and replace with the following

- .1 Place stakes on site to identify location trees, shrubs and plant beds in accordance to the Landscape Plans.
- .2 *Contract Administrator* and the City to review all tree locations and plant bed layout prior to start of plant bed preparation and planting operation.
- .3 Anti-desiccants shall be applied only as directed by the *Contract Administrator* and the City. Application of anti-desiccant shall be in accordance with manufacturer's instructions.
- .4 Coordinate planting operations with other trades and project schedule.
- .5 All planting operations shall be done in a timely manner in accordance to the Planting Schedule.
- .6 Planting Schedule shall be updated as required by the *Contractor* to coincide with status of site and coordination with other trades. Provide the *Contract Administrator* and the City with updates to the schedule as required throughout the planting process.

3.2 Subgrade Preparation Delete 3.2 and replace with the following

- .1 The *Contractor* is responsible for confirming the location and extent of existing utilities prior to the start of all planting operations. All attempts should be made to ensure that utility services are maintained to all on and off site parties throughout the entire planting operation.
- 2. Tree Pits
 - .1 Tree Pit Depth 900 mm minimum.
 - .2 Width of tree pit shall be a minimum of 450 mm to 600 mm greater than diameter of the root ball.
 - .3 Prior to the placement of growing medium scarify the sides and bottom of tree pits created with a tree spade to eliminate glazed surface.
- .3 Ensure tree pits dug in heavy or compacted soils exhibit the ability to drain freely by filling each tree pit with a minimum of 20 litres of water. Water should freely drain through subsoil within ten (10) minutes.
 - .1 Notify *Contract Administrator* and the City if tree pits in any soil condition do not drain freely or if tree pit fills with ground water.
 - .2 There shall be no standing water in the bottom of tree pit at time of planting.
- .4 Protect bottom of tree pit(s) against freezing.
- .5 Ensure tree pits and plant beds are kept well drained and free of contaminants and construction debris.
- .6 Planting Areas shall be excavated to the following depths:

3.3 Planting

Delete 3.3 and replace with the following

- .1 Shrub beds, perennials, ornamental grasses shall be 450 mm.
 - .2 Ground covers and annual flowers shall be 300 mm.
 - .3 Trees shall be 900 mm.
-
- .1 Planting operations shall be carried out under conditions that are conducive to healthy, vigorous growth of plant material.
 - .2 Plant material shall be planted vertical, straight and plumb at locations staked in field and or noted on landscape plans.
 - .3 Ensure orientation of plant material will give best appearance in relation to views from adjacent buildings, roads, walks or use areas.
 - .4 Ensure planting depth of root ball is equal to the depth of root ball originally established in the nursery. The top of root ball shall be level with adjacent growing medium.
 - .5 Ball and Burlap Plant Material: After plant has been lowered into plant bed or tree pit cut away all root ball ties from around trunk. Loosen burlap from around trunk and cut away minimum top 1/3 without disturbing root ball.
 - .6 Container Grown Plant Material: Remove entire container (including biodegradable containers) without disturbing root ball. Score root ball vertically at six (6) locations evenly spaced around entire root ball to minimize girdling of roots.
 - .7 Tree Spade Dug Root Balls: Cut wire basket around entire perimeter of root ball. Bend down top 2/3 of wire basket without disturbing root ball. Cut away all root ball ties from around trunk. Loosen burlap from around trunk and cut away minimum top 1/3 without disturbing root ball.
 - .8 Backfill planting areas in 150 mm lifts to 2/3 of the depth tamping each lift of growing medium around root system to eliminate air voids. Do not use frozen or saturated growing medium for backfill operation.
 - .9 Prior to placing remaining growing medium, thoroughly water planting areas, fill tree pits with water. Complete backfill operation only after water has completely penetrated into growing medium.
 - .10 Build 100 mm high by 150 mm wide (4" high by 6" wide) saucer around outer edge of tree pit to assist with maintenance watering.
 - .11 Tree Stabilization
 - .1 Guy or stake trees as directed by *Contract Administrator* and the City.
 - .2 Ensure guy pins and stakes are not placed through the root ball.
 - .3 Trees that have had root balls penetrated by guy pins and stakes will be rejected.
 - .4 Tie one (1) to two (2) flagging tape flags to all guy wires at a height that is clearly visible.
 - .12 Place tree trunk protection around base of tree trunk as per manufacturer instructions.
 - .1 Trees 100mm caliper or less shall have one protector. Do not interlock ends of tree protector.

.2 Trees greater than 100mm caliper shall have a minimum of two interlocked protectors. Do not interlock outside ends.

.13 Fertilize as per recommendations based on soil testing and place planting tablets at the following rates in prepared planting holes. Spread the tablets in each hole before planting.

	<u>Plant/Container Size</u>	<u>Table Size</u>	<u>Tablets per Plant</u>
.1	Trees	21g	1 per every 1.25mm of trunk caliper
.2	#15/ 45 cm tub	21g	3
.3	#7/ 35 cm tub	21g	3
.4	#5/ 30 cm pot	21g	2
.5	#3/ 27 cm pot	21g	2
.6	#2/ 21 cm pot	21g	1
.7	#1/ 15 cm pot	21g	1

3.4 Tree Support

Delete 3.4 and replace with the following

- .1 Guy and stake all trees immediately after planting. Plant material not guyed or staked immediately shall be replaced if damaged.
- .2 Drive one (1) stake per tree vertically into the ground to a depth of 750 – 1000 mm, in such a manner so as not to injure the root or root ball.
- .3 Fasten tree to the crotch and midway between the crotch and the ground with galvanized wire protected by hose.
- .4 Trees to stand plumb upon completion of this operation.

3.6 Pruning

Delete 3.6 and replace with the following

- .1 All pruning cuts shall be made with pruning saws or hook and blade pruning tools designed and manufactured for pruning operations. Anvil-type pruning tools shall not be used in any pruning operations.
- .2 Prune trees and shrubs after planting operation as directed by *Contract Administrator* and the City.
- .3 Prune each tree and shrub planted to preserve the natural character of the plant and in a manner appropriate to its particular requirement in the landscape design. Pruning in general shall be heavier on collected than on nursery-grown plants. Remove all soft wood sucker growth and all broken or badly bruised branches with a clean cut.
- .4 Employ clean sharp tools and make cuts without damaging the branch collar.
- .5 Do not damage the leader or lead branches. Plants which have had the main leader or lead branches damaged or removed will be rejected and replaced by the *Contractor* at no cost to the *Owner*.
- .6 Do not remove minor twig branches along the main structural branches.

3.7 Mulching

Delete 3.7 and replace with the following

1. Prior to the application of composted mulch;
 - .1 Manually remove all weeds and weed roots from root balls and adjacent growing medium.
 - .2 Remove all deleterious material and debris from planting areas.

- | | | | | |
|-----|-------------|---|----|--|
| | | | .3 | All fine grading shall be completed, the growing medium shall be loose and friable. |
| | | | .4 | The <i>Contract Administrator</i> and the City has reviewed of all planting areas. |
| | | | .2 | Spread composted mulch to minimum depth of 50 mm. |
| | | | .1 | Ensure finish composted mulch layer is a minimum of 12 mm below adjacent hard landscape surfaces and edges. |
| | | | .2 | Ensure mulch is kept 125 mm away from tree trunks and 75 mm away from stems of shrubs. |
| 3.8 | Clean-up | Delete 3.8 and replace with the following | .1 | Growing medium spilled onto pavement and growing medium stains on pavement or adjacent hard surfaces shall be cleaned up immediately. |
| | | | .2 | Remove from the site all pots, cans, surplus materials, and other debris resulting from planting operations. |
| | | | .3 | Ensure complete removal of planting tags, labels, strings, or other materials prior to substantial completion. |
| | | | .4 | Neatly dress and finish all planting areas and flush all walks and paved areas clean to the satisfaction of the Consultant and <i>Owner</i> . |
| 3.9 | Maintenance | Delete 3.9 and replace with the following | .1 | Maintenance of plants shall begin immediately after planting operation and shall continue in an uninterrupted fashion until all deficiencies noted in the <i>Substantial Performance</i> review have been rectified and the <i>Contract Administrator</i> and the City has provided to the <i>Contractor</i> written confirmation of the date of <i>Total Performance</i> . |
| | | | .2 | If for any reason the <i>Contractor</i> elects, on his own without the written consent of the <i>Contract Administrator</i> and the City to suspend maintenance operations, the <i>Contractor</i> shall provide the <i>Contract Administrator</i> and the City written notice of such action. Any damages or requirement for the replacement of plant material that as a result of the suspension of maintenance operations shall be the borne by the <i>Contractor</i> at no cost to the <i>Owner</i> . |
| | | | .3 | Maintenance of plant material includes but is not limited to watering at intervals sufficient to maintain healthy, vigorous growth, weeding of plant beds and tree pits, cultivating of growing medium, pruning, treatment of insects, molds, fungi or disease to the Level 2 "Groomed" as per the BCNLA Landscape Standard, Current Edition or as directed by consultant. |
| | | | .4 | Plant material shall be deep watered at least once per day when temperatures exceed 25 degrees Celsius. |
| | | | .5 | Water sufficiently to maintain soil moisture conditions for optimum establishment, growth and health of plant material without causing erosion. |
| | | | .6 | Supply equipment such as pumps, portable sprinklers systems, tank trucks, hose and sprinklers required for watering operations. Water trucks, if used for watering operations, must service the site from adjacent roads until irrigation system is operational. |

3.10 Conditions for Total Performance

Delete 3.10 and and replace with the following

- .7 *Contractor* to ensure adequate moisture in plant root zone prior to winter freeze-up.
- .8 Reset all plants that have settled to plant depths approved by the *Contract Administrator* and the City prior to the placement of composted mulch.
- .9 Ensure tree guards, stakes, flagging tape on tree guy wire and tree ties are kept secure, taught and in proper repair.
- .1 Conditions for *Total Performance*:
 - .1 *Substantial Performance* shall have been granted by the *Contract Administrator* and the City and, Final Inspection at the end of the guarantee/warranty period.
 - .2 All plant material is healthy; exhibiting signs of vigorous growth and meets the requirements of this specification.
 - .3 Plant material installed less than ninety (90) days prior to frost will be accepted in following spring, thirty (30) days after start of growing season provided that final acceptance conditions are fulfilled.
 - .4 Unless otherwise indicated in the *Contract Drawing* the original shape and form of the plant as reviewed by the *Contract Administrator* and the City has been maintained, leaders are in tact, there are no wounds or abrasions on trunks or branches.
 - .5 Mulch has been maintained to specified depths.
 - .6 All planting areas continue to be free draining with no signs of standing water.
 - .7 All plant beds are completely free of weeds and noxious grasses.
- .2 The *Contractor* shall continue to maintain the work of this section until the *Contract Administrator* and the City provides written confirmation that *Total Performance* conditions have been met.

END OF SECTION

WATERWORKS

1.8	Measurement and Payment	Delete 1.8.2 and replace with the following	<p>Payment for watermain will include location and exposure of existing utilities, saw cutting and disposal of pavement, trench excavation, disposal of surplus / displaced excavated material, support of utility poles and adjacent piping, supply and installation of all pipe, bends, bolts, gaskets, thrust blocks, couplings, restraints and tie rods, all nuts, bolts and fasteners to be 304 stainless steel or better, application of petrolatum mastic on all metal but non stainless water appurtenances, blind flanges, caps, fittings and related materials, tie-ins, bedding, approved native excavated backfill material compacted in place, import backfill, cleaning, pressure and leakage testing including all labor, material and equipment required to complete the test, flushing, disinfection where required, granular sub-base, granular base, all surface restoration as specified under Section 31 23 01 – Sub-section 3.6, COQ-G4 and all other work and materials necessary to complete installation as shown on Contract Drawings, as described in Schedule of Quantities and Prices, and as specified under this Section; and</p> <p>Payment includes pre-determining of existing watermain OD by Contractor prior to start of work for proper joint restraint sizing.</p> <p>Measurement for watermain will be made along the centerline of the main, through the valves and fittings, with no deduction for length of valve or fittings, over surface after work has been completed; and</p> <p>Native excavated material approved for re-use as trench backfill shall be at the sole discretion of the Contract Administrator. All cobbles greater than 150 mm diameter removed and disposed off-site and shall be granular in nature and free from organic materials. Native excavated material shall not be used as trench backfill where moisture content does not permit compaction to specified density. Where native excavated material is unacceptable for use as trench backfill, imported trench backfill shall be supplied, placed, and compacted to specified density.</p>
		Delete 1.8.3 and replace with the following	<p>Payment for inline gate valves or butterfly valves including Terminal City Nelson Type valve boxes, restraints; and for fittings (crosses, tees, bends, reducers, blind flanges, caps, anchors and etc.) will be made for items identified on Contract Drawings and installed as part of watermain as described under 1.8.2 in this Section.</p> <p>Payment for fittings, unless specified in the Schedule of Quantities and Prices, performed under this section will be incidental to payment for work described in other Sections.</p> <p>Measurement will be for each respective item installed without deduction of length of valves and fittings from length of pipe measured for payment under 1.8.1 and 1.8.2 in this Section.</p>
		Delete 1.8.4 and replace with the following	<p>Payment for new, renewal, transfer and capping of service connection includes locating and cutting the existing service supply, removal and disposal of concrete meter box, curb stop, piping and meter (where applicable), supply and installation by direct tapping, corporation stops, reconnecting to the existing main using a MacDonald compression coupling (“funny nut”), curb stops, service pipes, saddles and all related fittings and appurtenances specified and/or shown on Standard Detailed Drawing COQ-W2a (except where noted), COQ-W2k, COQ-W2d, WM-3, new meter and appurtenances, all labor, material and equipment including use of</p>

WATERWORKS

tapping machine and reconnecting to the existing service at or near property line or as shown on the Contract Drawings including any fittings and repair couplings. Payment also includes all applicable work described in 1.8.2.

Measurement for service connection will be for each complete service installed, including all appurtenances, length of service pipe installed and length of riser.

Payment includes re-use of existing cast iron Terminal City Nelson Type style valve box c/w lid marked "WATER" and supply and installation of new pvc riser.

Delete 1.8.7 and
replace with the
following

Payment for supply and installation of a new blow-off assembly includes supply and installation of all materials, works and appurtenances as shown on the Contract Drawings. Payment includes all applicable work described in 1.8.2.

Measurement will be made at the lump sum price bid for each blow-off assembly installed.

Delete 1.8.13 and
replace with the
following

Payment for all tie-ins to existing watermain will include all pipe materials, tapping tee and valve, fittings, test points, blow off assembly, joint restraints, excavation to expose the existing main to confirm location, grade, size, material & condition and prepare the existing watermain, couplers, caps, restraints, tie-rods, all nuts, bolts and fasteners to be 304 stainless steel or better, application of petrolatum mastic on metal but non stainless water appurtenances, bedding and backfill material on pipe zone, testing and disinfection, cutting and disposal of the existing mains, permanent capping c/w restraints, removal of any decommissioned valves boxes, removal of any decommissioned valves and fittings to accommodate the new and existing main, temporary fittings to provide service changeovers and coordinating all tie-in works with City Staff and as described on the Contract Documents and Drawings. Payment includes all applicable work described in 1.8.1 and 1.8.2.

Add 1.8.14

Payment for hydrant relocation includes re-use of hydrant assembly, new lateral connections from mainline tee off watermain to hydrants, all new pipe, isolation gate valve, valve box & cover, valve stem riser pipe, bends, couplings (Robar 1506), any necessary pipe extensions to achieve the required hydrant height, concrete thrust block, tie rods, bedding material, testing and disinfection, surface restoration as indicated in the requirements in 1.8.2 of this Section, decommissioning of existing hydrant connection and all other incidentals to complete the work and as shown on Standard Detail Drawing W4.

2.0 PRODUCTS

**2.2 Mainline Pipes,
Joints and Fittings**

Add to 2.2.1.1

Pipe: to AWWA C151, and shall meet the following Pressure Class or Thickness Class:

- .1 100 mm – 350 mm – Thickness Class 50
- .2 400 mm & greater – PC 350

Delete 2.2.2.2 and
replace with the
following

Joints: It is mandatory that the push-on integrally thickened bell and spigot type conform to ASTM D3139 Clause 6.2 with single elastomeric gasket to ASTM F477.

WATERWORKS

Delete 2.2.4.13 and
replace with the
following

Joint Restrain Devices: General Requirements:

- .1 Ductil iron castings to ASTM A536.
- .2 Anti-corrosion coating of ductile iron castings to AWWA C219, AWWA C210, AWWA C213 or AWWA C550.
- .3 Bolts and nuts high strength low alloy steel to AWWA C111 or as specified in Contract Documents, stainless steel to ASTM F593 or ASTM F738 for bolts and ASTM F594 or ASTM F836 for heavy hex nuts. Rolled threads, fit and dimensions to AWWA C111.
- .4 Tie rods to 2.2.3.8 of this Section
- .5 Restrainers for ductile iron pipe shall be mechanical joint fittings or push-on joint fittings with tie rod.
- .6 Restrainers for PVC pipe shall be mechanical joint fittings or push-on joint fittings with tie rod lugs.
- .7 Restrained harnesses or integral restrain systems manufactures as part of the pipe joint.
- .8 All joint restraint systems for PVC pipe be approved by the specific PVC pipe manufacturer, and that they do not derate the pipe manufacturer's recommended working pressures.
- .9 Restrainers for PVCO pipe shall be mechanical joint fittings or push-on joint fittings with tie rod lugs.
- .10 All joint restraint systems for PVCO pipe be approved by the specific PVCO pipe manufacturer, and that they do not derate the pipe manufacturer's recommended working pressures.

Add 2.2.7

Oriented Polyvinyl (PVC) Pressure Pipe:

- .1 Pipe:
 - .1 Pipe to be manufactured to specifications for pipe size ranges as follows:
 - .1 Pipes 100 to 600 mm diameter – AWWA C909.
 - .2 Pipes to be certified by Canadian Standards Association for pipe size ranges 100 mm to 600 mm dia. – CSA B137.3.1.
 - .2 Cast iron pipe equivalent outside diameter.
 - .3 To be compatible with specified mechanical joint and push-on joint fittings and valves without use of apecial adapters.
- .2 Joints: Push-on integrally thickened bell and spigot type to AWWA C909 Clause 4.3.3.2 (a.) with single elastomeric gasket to ASTM F477.

**2.3 Valves and Valve
Boxes**

Delete 2.3.1.3 and
replace with the
following

Valves 400 mm and larger shall be butterfly valves.

Delete 2.3.1.4

Delete 2.3.4 and
replace with the
following

Blow-Down or Blow-Off Valves: 50 mm to 300 mm as specified for mainline gate valves.

Delete 2.3.6.1.1

WATERWORKS

		Delete 2.3.6.1.2 and replace with the following	Circular type valve box shall be Nelson style cast iron.
		Delete 2.3.7.1 and replace with the following	Curb stop valve boxes on 19 mm dia. to 38 mm dia. shall be as shown on Coquitlam Standard Detail Drawings COQ-W2b, COQ-W2j.
		Delete 2.3.7.2	
		Delete 2.3.7.3 and replace with the following	Curb stop valve boxes (300 mm from property line) alternative on 19 mm dia. to 38 mm dia. services without operating rods to be assembled as specified for Mainline Valve Boxes 2.3.6.1.2, and shown on Coquitlam Standard Detail Drawings COQ-W2b, COQ-W2j. Service boxes may be Nelson style PVC, except when located in driveways.
		Delete 2.3.7.5 and replace with the following	Corporation stop valve boxes (at mainline tees or tappings) on services 50 mm dia. and larger as specified for Mainline Valve Boxes per Coquitlam Standard Detail Drawings COQ-W2e, COQ-W2f.
2.5	Service Connections, Pipes, Joints and Fittings	Delete 2.5.1 and replace with the following	Pipe diameter 19 mm to 75 mm to be Type K annealed copper to ASTM B88M.
2.6	Hydrants	Delete 2.6.1.6 and replace with the following	Pump nozzle shall be "quick connect" STORZ type. STORZ type nozzle must be painted gloss black.
		Delete 2.6.2 and replace with the following	Colour: Tremclad Rust Paint Body – Fire Red Hose Caps and Bonnet – Bright Yellow
2.8	Granular Pipe Bedding and Surround Material	Add 2.8.3	Bedding and surround material shall be Type 1 under Section 31 05 17 – 2.7 or 19 mm minus clear crushed gravel.
3.0	EXECUTION		
3.6	Pipe Installation	Add 3.6.15	When the watermain crosses a storm or sanitary sewer, the watermain shall be installed a minimum 0.5 m clear above the sewer. Where this is not possible, the watermain shall have a minimum 0.3 m clearance under the sewer with all joints within a 3.0 m horizontal distance from the sewer wrapped with heat shrink plastic or packed and wrapped with petrolatum tape in accordance to the following standards: .1 ANSI/AWWA C214 (factory applied) .2 ANSI/AWWA C209 (field applied) .3 ANSI/AWWA C217-90 (petrolatum tape) .4 All materials used are to have zero health hazard Installation shall be in accordance with the requirements of the Regional Health Engineer under the Health Act.
3.10	Service Connection Installation	Delete 3.10.4	
		Delete 3.10.5 and replace with the following	Tappings in cast iron or ductile iron mains to AWWA CISI pipe to be made using double strap saddles specified in 2.5.3 of this Section.

WATERWORKS

		Add 3.10.13	Water service connections (19 mm and 25 mm) must be installed as one continuous length of pipe.
3.18	Cleaning and Preliminary Flushing	Add 3.18.5	<p>Water mains 400 mm and larger shall be swabbed as per the following procedure:</p> <ol style="list-style-type: none">1. <u>Purpose and Scope</u><ol style="list-style-type: none">.1 To remove any possible contaminants introduced into the water main through pipe storage or installation activities.2. <u>Swab Requirements</u><ol style="list-style-type: none">.1 Swabs are to be of a polyurethane foam construction, minimum 2 lb/ft³ density.2 Swabs are to be new. Used swabs will not be accepted..3 Swab outside diameter must be minimum 1 nominal size larger than the largest diameter main to be swabbed (eg. 150 mm main requires minimum 200 mm diameter swabs).4 Swab length must be minimum 1.5 times the outside diameter.3. <u>Swab Entry Point</u><ol style="list-style-type: none">.1 2 swabs are to be inserted into the beginning of the first length of water main installed into the trench. Swabs are to have a minimum of 1-meter separation between them..2 Minimum 300 grams of calcium hypochlorite granules are to be installed in between the 2 swabs.4. <u>Swab Discharge Point</u><ol style="list-style-type: none">.1 Swabs are to be discharged from the water main at the end of the installation (ie-permanent or temporary dead end).2 A temporary connection for a discharge assembly of minimum 150 mm (100 mm is acceptable for 100 mm water main only) is to be made to the end of the new water main pipe (connection to a blow off assembly is not acceptable)..3 The discharge assembly must consist of a 90-degree elbow and appropriate fittings to adapt to 150 mm "camlock" style layflat hose. The assembly must have adequate thrust protection to avoid blowing off during the swabbing procedure..4 The 150 mm layflat hose must extend above the surface of the existing ground.5. <u>General Swabbing Requirements</u><ol style="list-style-type: none">.1 Swabbing to be performed after the satisfactory completion of all pipe work (as determined by the city inspector), and prior to flushing, pressure testing, and chlorination of the new water main..2 Swabbing of the water main is to be witnessed by the City of Coquitlam..3 Although a minimum of 2 swabs must be used for each run, additional swabs may be required depending on the time required for the water to run clear after swab discharge. This determination will be made by the City of Coquitlam.

- .4 Swabs are to be used once only. Additional new swabs will be required for additional swab runs if deemed necessary by the city.
- .5 Swabs must be stored and handled hygienically.
- .6 The contractor must provide all labour and materials required to carry out the swabbing procedure.
- .7 Swabbing should be completed from a low point to a high point where possible.
- .8 A plan to complete the swabbing must be submitted to the City of Coquitlam prior to the work taking place for approval.
- .9 The contractor must take all necessary action to prevent flooding of the discharge area.

6. Swabbing Procedure

- .1 The length of main within the swabbing run must have all connections larger than 25 mm isolated by closing appropriate valves.
- .2 The new main is to be filled and swabs propelled via a certified backflow prevention device (double check valve assembly) and water meter from the existing system. The connection to the existing system will form part of the plan submitted to the city for approval.
- .3 Appropriate flow is to be used to propel the swabs at approximately .75 meter per second velocity. See following list for appropriate flow:

Main diameter (mm)	Approximate flow required to produce 0.75 m/s velocity (l/s)
100	6.3
150	12.6
200	25.2
250	37.9
300	56.8
600	227.2

- .4 Upon discharge of the swabs, the main must be flushed until the water runs clear.
- .5 The supply point can then be slowly closed.
- .6 Additional swabs must be run through the water main if excessive debris is noted to be discharged from the main or there is excessive clean up time after the swabs are discharged.

3.23 Connection to Existing Mains

Delete 3.23.1 and replace with the following

Connections to existing waterworks systems will be made by the Contractor under the supervision of the Contract Administrator. Make all necessary arrangements with the Contract Administrator and the City to schedule work to prevent construction delays.

Add 3.23.2

Provide written notification to all affected residents a minimum 48 hours prior to service interruption.

Add 3.23.3

Arrange shutdown of the existing valves by the City. *Contractor* shall not operate any valves without prior approval of the *Contract Administrator* and the City.

Add 3.23.4

Provide temporary water service while existing service is interrupted as detailed in *Contract Drawing* or Project Specific Specifications.

WATERWORKS

- Add 3.23.5 Fittings used for tie ins should be cleaned of all foreign material and sprayed with a 1% hypochlorite solution prior to assembly. Disinfect all pipes and fittings installed at the connection.
- Add 3.23.6 *Contractor* shall be responsible for the costs for the City to flush and purge all air from existing mains and services in the area affected by the water service interruption.
- Add 3.23.7 Procedures for Bacteriological Tests shall be as described in AWWA C651-99. No connection to existing water mains will be authorized until final results of coliform bacterial testing have been received and reviewed by the Water Superintendent.
- All samples shall be taken by the City Water Utility.
- All valve operation shall be handled by the City Water crews.
- The *Contractor* shall provide sampling points, one every 366m plus the end of each main segment. The *Contractor* shall provide all labour to temporarily connect and disconnect the new main in order to properly acquire test samples.
- Initial flushing, testing and chlorination will be undertaken by the *Contractor* from a water source approved by the Water Superintendent.
- Coordination for the bacterial testing and tie in shall be coordinated by the project Engineering Inspector and the Water Superintendent prior to final flushing.
- The *Contract Administrator* shall review with the Water Superintendent and the *Contractor* sampling locations and appurtenances.
- The *Contract Administrator* shall check and record chlorine residual prior to final flushing.
- After final flushing the City Water crew will collect two sets of samples 24 hours apart. Samples will be taken at least every 366m of the new main as well as the terminus and all branches.
- Test results will be delivered to the Water Superintendent who will provide a copy to the Contract Administrator.
- The Water Superintendent will judge the adequacy of the test results and issue an authorization to connect.
- City Water crews will provide shutdown and flushing as required.
- 3.25 Permanent Capping of Existing Water Service Connections Add 3.25 Permanent capping of existing water service connections to be completed as per Coquitlam standard Detail Drawings COQ-W2g, COQ-W2h, COQ-W2i.

END OF SECTION

1.0 GENERAL

1.6	Measurement and Payment	Delete 1.6.1 and replace	<p>Payment for sanitary sewer will be made separately for various sections of sanitary sewer consistent with pipe materials, diameters and backfill requirements shown on the Contract Drawings and described under individual payment items in the Schedule of Quantities.</p>
		Delete 1.6.2 and replace with	<p>Payment for sanitary sewers includes asphalt & concrete saw cutting, disposal of pavement, trench excavation, disposal of surplus excavated material, removal and disposal of existing pipes, supply and installation of all pipe, fittings and related materials, tie-ins other than noted in Clause 1.6.7, bedding and all import backfill material, approved native backfill, granular base, granular Subbase, cleaning and flushing, testing (if applicable), all surface restoration under Section 31 23 01 – Sub-section 3.6 including permanent pavement restoration and all other work and materials necessary to complete installation as shown on Contract Drawings and specified under this Section; and</p> <p>Payment for concrete driveway and curb & gutter will be made under Section 03 30 20S.</p> <p>Native excavated material approved for re-use as trench backfill shall be used on boulevard and outside of paved roadway area and shall have all cobbles greater than 150 mm diameter removed and disposed off-site and shall be granular in nature and free of organic materials. Native excavated material shall not be used as trench backfill where the moisture content does not permit compaction to the specified density. Where native excavated material is unacceptable for use as trench backfill, imported trench backfill shall be supplied, placed, and compacted to specified density. Imported trench backfill shall not be used without the prior approval of the Contract Administrator.</p> <p>Payment includes by-pass pumping to include all pumps, labour and materials required to facilitate the work. Payment for the by-pass pumping will be incidental. Payment includes all applicable materials and work described in 1.6.4.1.</p> <p>Measurement for sanitary sewer will be made along the ground from the start of new pvc pipe to the terminus of the new pvc pipe.</p>
		Delete 1.6.3 and replace with	<p>Payment for new service connections includes 150mm SDR28 PVC pipe unless otherwise specified, shear band couplers, bends, increaser, pvc wye, stubs, caps, sanded stubs, manhole preparation for connection, Le-Ron inspection chamber c/w locking collar and red lid and all related fittings and components specified and/or shown on Standard Detail Drawings. Payment includes all applicable service pipes, materials and work described in 1.6.2.</p> <p>Measurement for service connection will be for each complete service installed, including the inspection chamber, length of service pipe installed and length of riser.</p>
		Add 1.6.3.1	<p>Payment for sanitary service connection repair/replacement includes 150mm SDR28 PVC pipe, shear band couplers, bends, increaser, stubs and all related fittings and components specified and/or shown on Standard Detail Drawings. Payment includes all applicable service pipes, materials and work described in 1.6.2.</p> <p>Measurement and payment for sanitary connection repair/replacement will be made at the unit price bid per lineal meter</p>

of service lead installed as measured along the ground from the downstream end of work done in Clause 1.6.4 to the terminus of the repair.

Add 1.6.4

Payment is to supply and install Le-Ron molded sanitary inspection chambers c/w locking collar & red lid including the riser as per COQ-S7A, COQ-S8A and MMCD S9 at each location. The tendered price is to include all labour, shear band couplers, 2m PVC SDR28 pipe stubs and all related fittings and components specified and/or shown on Standard Detail Drawings and all such other items that may be required to complete the work as specified. Payment includes all applicable materials and work described in 1.6.2.

A City crew will be inspecting the service connection by hand video prior to the Contractor's installing the IC. The Contractor shall notify the City inspector once the section of the service connection is ready for hand video. Payment includes assisting City crew in hand videoing the service connection. Based on the hand video result, City assessment or apparent condition of the pipe, repair/replacement is to be done under Clause 1.6.3.1. Repair/replacement shall only be done as approved by Contract Administrator or City inspector.

NOTE: Depth specified on the utility connection record without an IC is typically measured from the top of the clean out wye.

Payment includes work as described in 1.6.4.1

Add 1.6.4.1

Remove and dispose of all trees, roots, vegetation, organic matter and stumps that are located in the right of way and which fall within the work area (including stripping of ditches). Trim small branches from trees or hedges as required and where necessary use an approved tree paint to repair damage to surviving vegetation where branches have been removed. Obtain the Contract Administrator's approval before trees are removed. Replace shrubs and trees that are located on private properties that are damaged during construction.

Materials removed from within the right of way are the property of the private property owner. Materials removed within private property remain the property of the private property owner.

Discard materials obtained from within the right of way and from adjacent private properties that are not suitable for reuse or not wanted by private owners at an approved dump site.

Where possible and as agreed with the *Contract Administrator*, reuse topsoil obtained from within the right of way.

Brooks Boxes with a steel lid are to be provided for inspection chambers located in driveways as necessary. Payment for the Brooks Boxes will be incidental.

Payment includes support of poles if necessary and manhole barrel preparation to accommodate the service connection.

Lump sum to include for all labour, materials, and equipment required to supply and install the work as specified and restore surface to its original conditions or better.

SANITARY SEWERS

Add to Clause 1.6.7

Payment includes all applicable works in Clause 1.6.2.

2.0 PRODUCTS

**2.5 Granular Pipe
Bedding and
Surround Material**

Add 2.5.3

Pipe bedding shall be 19 mm clear crushed rock or as approved by the Contract Administrator. Surround material above the springline within the pipe zone may be Type 2.

3.0 EXECUTION

**3.8 Connections to
Existing Mainline
Pipes**

Delete 3.8.1 and
replace with

Connections with two sizes smaller or less to existing mainlines shall be made by removal of the section of the main and replacement with a manufactured PVC wye complete with stubs and double hub PVC couplings for PVC mains and approved shear band couplings for other mainline materials.

The contractor shall video inspect all connections to existing mains following completion of installation.

END OF SECTION

STORM SEWERS

1.6	Measurement and Payment	Delete 1.6.1 and replace with the following	Payment for storm sewer will be made at the unit price bid for storm sewer (regardless of depth) consistent with pipe materials, diameters and backfill requirements shown on the Contract Drawings and described under individual payment items in the Schedule of Quantities.
		Delete 1.6.2 and replace with the following	<p>Payment for storm sewers includes trench excavation, dewatering, bypass pumping, on-site reuse of surplus/displaced material, removal and disposal of existing pipes, supply and installation of all pipe, wyes, cap, fittings and related materials, tie-ins to existing or new storm pipe or manhole other than noted in Clause 1.6.9, construction joints, bedding, import backfill, native backfill, , granular base, granular Subbase, cleaning and flushing, testing (if applicable), videoing and all other work and materials necessary to complete installation as shown on Contract Drawings and specified under this Section; and</p> <p>Measurement for storm sewer will be made horizontally from manhole centerline to manhole centerline over surface work has been completed.</p> <p>Native excavated material approved for re-use as trench backfill shall be at the sole discretion of the Contract Administrator. All cobbles greater than 150 mm diameter removed and disposed off-site and shall be granular in nature and free from organic materials. Native excavated material shall not be used as trench backfill where moisture content does not permit compaction to specified density. Where native excavated material is unacceptable for use as trench backfill, imported trench backfill shall be supplied, placed, and compacted to specified density.</p> <p>Payment for concrete driveway and curb & gutter will be made under Section 03 30 20S.</p> <p>Payment includes by-pass pumping to include all pumps, labour and materials required to facilitate the work. Payment for the by-pass pumping will be incidental. Measurement for storm sewer will be made along the ground from the start of new pvc pipe to the terminus of the new pvc pipe.</p>
		Delete 1.6.3 and replace with	<p>Payment for new service connections includes 150mm SDR28 PVC pipe, shear band couplers, bends, increaser, pvc wye, stubs, caps, sanded stubs, manhole preparation, inserta tee, Le-Ron inspection chamber c/w locking collar and green lid and all related fittings and components specified and/or shown on Standard Detail Drawings. Payment includes all applicable service pipes, materials and work described in 1.6.2.</p> <p>Measurement for service connection will be for each complete service installed, including the inspection chamber, length of service pipe installed and length of riser.</p>
		Add 1.6.3.1	Payment for storm service connection repair/replacement includes 150mm SDR28 PVC pipe, shear band couplers, bends, sanded stubs, inserta tee, increaser, stubs and all related fittings and components specified and/or shown on Standard Detail Drawings. Payment includes all applicable service pipes, materials and work described in 1.6.2 unless specified otherwise in the Schedule of Quantities and Prices.

STORM SEWERS

		<p>Measurement and payment for storm lead repair/replacement will be made at the unit price bid per lineal meter of service lead installed as measured along the ground from the downstream end of work done in Clause 1.6.4 to the terminus of the repair.</p> <p>The lump sum payment is to supply and install Le-Ron molded storm inspection chambers c/w locking collar & green lid including the riser as per COQ-S7A, COQ-S8A and MMCD S9 at each location. The tendered price is to include all labour, shear band couplers, 2m PVC SDR 28 pipe stubs and all related fittings and components specified and/or shown on Standard Detail Drawings and all such other items that may be required to complete the work as specified. Payment includes all applicable materials and work described in 1.6.2.</p> <p>A City crew will be inspecting the service connection by hand video prior to the Contractor's installing the IC. The Contractor shall notify the City inspector once the section of the service connection is ready for hand video. Payment includes assisting City crew in hand videoing the service connection. Based on the hand video result, City assessment or apparent condition of the pipe, repair/replacement is to be done under Clause 1.6.3.1. Repair/replacement shall only be done as approved by Contract Administrator or City inspector.</p> <p>NOTE: Depth specified on the utility connection record without an IC is typically measured from the top of the clean out wye.</p> <p>Brooks Boxes with a steel lid are to be provided for inspection chambers located in driveways as necessary. Payment for the Brooks Boxes on a driveway will be incidental.</p> <p>Payment includes support of poles if necessary and manhole barrel preparation to accommodate the service connection.</p>
	Delete 1.6.4 and replace with	
	Delete 1.6.5 and replace with the following	<p>Payment for catchbasin or lawn basin leads include all applicable materials and work described in 1.6.2</p> <p>Measurement for catchbasin leads or lawn basin leads will be made horizontally from mainline pipe to centreline of catchbasin or lawn basin for each pipe size installed with no regards to depth range.</p>
	Delete 1.6.6 and replace with the following	<p>Payment for french drain, dispersal trench, retention trench includes all applicable materials and work described in 1.6.2, and will include pvc pipe, excavation, removal and disposal of excavated or displaced material, trench dam, clean out, perforated pipe, growing medium, tie-in into catch basins/lawn basins and/ or storm sewer, drain rock, fittings, filter fabric surround and all other work incidental to complete the work as shown on the Contract Drawing and COQ-SW3 / COQ-SW4.</p> <p>Pyment for catch basins and lawn basins will be made under Section 33 44 01S – Clause 1.5.2.</p>
2.0	PRODUCTS	
2.2	PVC Pipe, Mainline Smooth Wall	<p>Delete 2.2.1 pipe size ranges and replace with the following</p> <p>200 mm dia. – 375 mm dia. to ASTM D3034</p> <p>450 mm dia. – 1,200 mm dia. to ASTM F679</p>
2.3	PVC Pipe, Mainline Profile	Delete 2.3

STORM SEWERS

2.6	Service Connections	<p>Delete 2.6.1 and replace with the following</p> <p>Delete 2.6.8.1</p> <p>Delete 2.6.8.2 and replace with the following</p> <p>Add 2.6.8.3</p>	<p>Storm service connections to be PVC DR 28 150 mm diameter minimum or as specified on <i>Contract Drawings</i>.</p> <p>Connections to PVC pipe to be made with a performed wye fitting where mainline pipe is 300 mm diameter or smaller. For connections to PVC mainline pipe larger than 300 mm diameter an insertable tee for PVC pipe is permitted.</p> <p>Insertable tee fitting shall have a rubber collar which inserts into the mainline pipe to form a tight seal and shall have stainless steel band to secure the tee insert. The tee insert shall be a standard bell end with depth control lugs. The joint shall provide a minimum seal of 90 kPa on concrete and polyethylene pipe, and 190 kPa on PVC pipe.</p>
2.9	Granular Pipe Bedding and Surround Material	Delete 2.9.3	Pipe bedding shall be 19 mm clear crushed rock or as approved by the <i>Contract Administrator</i> and the City.
3.0	EXECUTION		
3.8	Connections to Existing Mainline Pipe	Delete 3.8.3 and replace with the following	<p>For new connections to existing, smooth wall or profile, mainline sewers 300 mm and smaller, shall be made by removal of the section of the main and replacement with a preformed PVC wye fitting complete with stubs and double hub PVC couplings for PVC mains and approved shear band couplings for other mainline materials.</p> <p>For new connections to existing mainline greater than 300 mm, use of insertable tee will be permitted.</p>
3.10	Service Connection Installation	Delete 3.10.3 replace with the following	Inspection chambers shall be provided on all storm service connections as per Standard Detail Drawing S7. If inspection chamber is located in driveway, lane, or paved surface, Series 37 Brooks concrete box with lid shall be installed as per Standard Detail Drawing S9.
3.12	Inspection and Testing		The contractor shall video inspect completed storm sewers under 900 mm in diameter and all service connections following completion of the installation. The video inspection report shall be in a form specified by the Contract Administrator and the City. Copies of the video DVD and written report shall be forwarded to the Contract Administrator and the City. Refer to Section 33 01 30.1 and 33 01 30.1S CCTV Inspection of Pipelines.
3.16	Permanent Capping of Service Connections	<p>Add 3.16.1</p> <p>Add 3.16.2</p>	<p>Permanent capping of existing storm sewer connections to be completed as per Coquitlam Standard Detail Drawing COQ-S18.</p> <p>A trenchless method of permanently capping a service may be required on an arterial road or on a road which has been paved within 5 years, as directed by the Manager.</p> <p>The trenchless technology used to cap the service must be approved by the Manager.</p>

END OF SECTION

MANHOLES AND CATCHBASINS

1.0 GENERAL

1.1	Related Work	Add 1.1.6	Hot Mix Asphalt Concrete Pavement	Section 32 12 16
		Add 1.1.7	Portland Cement Concrete Paving	Section 32 13 13
1.5	Measurement and Payment	Delete 1.5.2 and replace with the following	<p>Payment includes supply and installation of new catchbasin/lawnbasin as described in Schedule of Quantities and Prices including catch basin base, concrete barrel, concrete riser, pvc sanded stub, donut ring, off-set sump, H20 rated concrete frame/lid, metal frame, top inlet and grate, aluminum trapping hood and all labor, material and equipment required to complete the work from specified invert to finishing level and as per Standard Detail Drawing as described in Schedule of Quantities and Prices. Payment includes excavation, disposal of surplus excavated material, base preparation, bedding, import backfill, catchbasin/lawnbasin preparation to accommodate catchbasin/lawnbasin connection, installation of all in-situ concrete work, all labor, material, equipment and necessary work for installing the catchbasin/lawnbasin.</p> <p>Catchbasin/lawnbasin lead work will be made under Section 33 40 01S – Clause 1.6.5.</p>	
		Delete 1.5.3 and replace with the following	<p>Adjustment of tops of existing units will be measured in units adjusted as defined below and paid for under their respective Item in the Schedule of Quantities.</p>	
			<p><u>No payment will be made under these items for cleaning Valve Boxes, Monument Boxes, Manhole Frames & Covers and Lids of Castings as part of the operation for asphaltic concrete paving.</u></p>	
			<p><u>No Payment will be made for adjusting External Utilities Valve Boxes, Monument Boxes, Gas valve boxes, Lawn Drains, Cleanouts and Inspection Chambers, these adjustments will be treated as incidental work unless otherwise specified.</u></p>	
			<p><u>All manholes & valve boxes must be vertically adjusted a minimum of 24 hours prior to paving.</u></p>	
			<ol style="list-style-type: none"> 1. Manhole frames and lids adjustment and replacement will be defined as supplying and installing a new manhole frame and lid and setting to the finished grade. Adjustments and replacements shall include jackhammering, removal and disposal of the existing frame and lid, replacement, removal of concrete bricks, addition or removal of precast concrete riser rings, cement mortar, supply and installation of new manhole frame and lid set to final grade, temporary asphalt ramping and all other incidental work. 	
			<p>Manhole frames and lids adjustments ONLY is the re-use of existing frames and lids and all the necessary work as described above.</p>	
			<ol style="list-style-type: none"> 2. Water Valve Box replacements will be defined as supplying and installing a new Nelson Type Terminal City Water Valve Box frame & lid and setting to the finished grade. Replacements shall include jackhammering, removal and disposal of the existing frame and lid and all other 	

MANHOLES AND CATCHBASINS

incidental work. Adjustment of water valves on existing new watermain

3. Catchbasins frame and lid replacement will be defined as setting as supplying and installing a new catchbasin frame & lid to the correct elevation. Adjustments shall include jackhammering, removal of the existing grating and frame and all other incidental work. Payment includes excavation, disposal, removal of concrete bricks, removal or addition of precast concrete riser rings, cement mortar, disposal of surplus excavated material, cast-in-place concrete, pipes, fittings and related materials together with all labour, materials and equipment required. Catch basin lead work is considered to be incidental to payment for catch basin lead work described in other sections.

The use of Steel/Metal Casting Risers Rings will not be accepted to adjust manholes or water valves to the final asphalt elevation.

2.0 PRODUCTS

- | | | |
|----------------------|--|---|
| 2.1 Materials | Add 2.1.7.3 | Any frame and cover assembly creating a point load on the concrete riser rings will not be permitted. |
| | Delete 2.1.12 and replace with the following | Catchbasin lids manufactured to ASTM C478M |
| | Delete 2.1.16.2 | |
| | Delete 2.1.17 | |

3.0 EXECUTION

- | | | |
|------------------------------------|--|--|
| 3.1 Excavation and Backfill | Add 3.1.2 | For manholes, when base gravels are complete, excavate for grade rings and manhole frame assembly. Do not disturb the compacted road base beyond the excavation requirement. |
| 3.3 Manhole Installation | Delete 3.3.12.2 and replace with the following | Allowable products are precast concrete risers and cast-in-place form system. Individual riser heights shall be 50mm, 75mm, or 100mm. |
| | Delete 3.3.12.5 and replace with the following | Proper layer of grout between the spacers, covering the entire surface of the rings, should be utilized. |
| | Delete 3.3.15 and replace with the following | Install drop structures as shown on the contract drawings to Coquitlam Standard Detail Drawing COQ-S4 and Standard Detail Drawing S3. Maximum allowable inside ramp shall be 250 mm invert to invert. |
| | Delete 3.3.17 and replace with the following | Ensure frames conform to design contour of pavement or existing surface. Manhole lids left raised in preparation for overlay paving shall have a rubberized protector ring or asphalt ramp. The use of riser rings for adjusting manhole frames will not be permitted. |
| 3.5 Catchbasin Installation | Delete 3.5.1 and replace with the following | Install catchbasins as shown on Coquitlam Standard Detail Drawings COQ-S11A, COQ-S11B and Standard Detail Drawing S11, to general standards and installation procedures described under 3.3 of this Section. |

END OF SECTION

Appendix A -

Traffic Management Detail Specifications

1.0	GENERAL	
		.1 This Traffic Management detail specification refers to the Contractor's specific plans to identify project traffic risks affecting the <i>Work</i> , provide Traffic Control Plans, and to implement the traffic control for the safe passage of vehicles and pedestrian through the work zone.
1.1	Related Works	.1 Traffic Control, Vehicle Access and Parking MMCD Section 01 55 00S.
1.2	References	.1 WorkSafe BC, Occupational Health and Safety (OHS) Regulation, Section 18 – Traffic Control. .2 B.C. Ministry of Transportation (MOT) Traffic Control Manual for Work on Roadways
1.3	Project Requirements	.1 A Road and Sidewalk Closure Permit is required by Coquitlam for all work affecting traffic flow related to construction. A permit is required for each specific construction interference with traffic flow. The Road and Sidewalk Closure Permit Request form is attached as Appendix 1 to this document. A digital copy of the Road and Sidewalk Closure Permit form can be obtained for use during the contract from the City's website at: Road and Sidewalk Closure Permit A Road and Sidewalk Closure Permit form application must be submitted to City's Traffic Operation Division 5 working days prior to start of work.
1.4	Measurement and Payment	.1 For this Contract, payment for all work performed under this section, unless included in the Schedule of Quantities and Prices shall be treated as incidental work, including a Traffic Management Plan (TMP), Traffic Control Persons (TMP), traffic markings & all temporary traffic signs, devices as required for traffic & pedestrian safety; and all other items described in the Section 01 55 00S.
2.0	PRODUCTS	
2.1	Traffic Management Plan	.1 The Contractor is required to assign a Traffic Manager for the Contract with the responsibility of preparing the Traffic Management Plan and the Traffic Control Plans, as well as the responsibility for continuing implementation of traffic control for the <i>Work</i> . .2 The Traffic Management Plan (TMP) will consist of the following components: .1 Identification of risks to traffic during the <i>Work</i> . .2 Traffic Control Plans for individual stages of the construction .3 Incident Management Plan for the response to an unplanned event and recording of incident information. .3 Submission of the TMP is to be made to the <i>Contract Administrator</i> within five (5) working days after the <i>Notice of Award of the Contract</i> , and must be approved by the <i>Contract Administrator</i> prior to start of the <i>Work</i> . .4 Review of the TMP will be performed by the Contract Administrator. Comments for revisions to the TMP will be returned to the <i>Traffic Manager</i> for implementations.

These supplementary Specifications must be read in conjunction with the Master Municipal Specifications contained in the Master Municipal Construction Documents (Platinum), Volume II, 2009.

- .5 The Contractor shall comply with all the requirements of applicable laws, rules, regulations, codes and orders of the municipal and other appropriate authorities concerned with work on streets or highways and shall post proper notices and/or signals, and provide necessary barriers, guards, lights, flagmen or watchmen as may be necessary for proper maintenance of traffic and protection of persons and property from injury or damage. All costs involved in respect to the above requirements will be deemed to be included in the Contract Price.
 - .6 The Contractor shall give due notice to local police and fire departments prior to beginning construction and shall comply in all respects with their requirements.
 - .7 The Contractor, during the progress of the work, shall make adequate provision to accommodate the normal traffic along streets and highways immediately adjacent to or crossing the work so as to cause the minimum of inconvenience to the general public.
 - .8 The Contractor is required to maintain local traffic and driveway access during all stages of construction. This includes maintaining a 1.5m width walkway or pathway through the construction site for pedestrians.
 - .9 Where existing streets or roads are not available as detours, all traffic shall be permitted to pass through the work with as little inconvenience and delay as possible unless otherwise provided or authorized. If half the street only is under improvement, the other half shall be conditioned and maintained as detour.
- 2.2 Incident Management and Reporting
- .1 The Contractor shall facilitate incident response vehicles and staff and move traffic safely and expeditiously through or around an incident on site and provide assistance to emergency response personnel as required. An incident includes, but is not limited to, motor vehicle accidents, emergency road repairs, disabled vehicles, and debris on the road. The immediate response to an emergency shall by necessity make use of available devices and equipment.
 - .2 If an incident occurs on site, the Contractor will be required to submit a report to the Contract Administrator documenting details of the incident including event, location, date, time, action taken, duration and restoration of site.
- 2.3 Traffic Control Plans
- .1 The Contractor shall designate a qualified Traffic Control Supervisor for the works, per the requirements of WCB regulations Section 18. The designated Traffic Control Supervisor may be the same individual that is designated as the Traffic Manager, or may be a separate individual qualified for the responsibilities of this function.
 - .2 The Contractor shall prepare weekly the anticipated traffic control activities, locations, and durations for the upcoming week.
 - .3 Permissible delays shall only be considered outside Peak Hours. Permissible delays are categorized as follows:

- a) Minor Delays - Less than two (2) minutes in duration; for occasional interruption due to construction activities. These delays shall be coordinated with available breaks in the traffic flow.
 - b) Major Delays - Maximum ten (10) minutes in duration; for occasional interruption of traffic for construction activities if traffic volumes permit.
- .4 The Contractor is responsible for ensuring that the flow of traffic is unimpeded by construction-related activities.

3.0 EXECUTION

- 3.1 Traffic Control Plan
- .1 A copy of the approved current Traffic Plan must be held on site by both the Site Superintendent as well as the person/company responsible for the traffic control implementation.
 - .2 Failure to produce a valid approved Traffic Plan on site, or having work not follow the Traffic Control Plan will result in immediate shut-down of the work. The Contractor will be required to safely restore facility conditions to allow traffic flow at their expense. The Contractor must take all steps to acquire an approved Traffic Control Plan before work can re-start on site. No claim will be accepted by the Owner for costs associated with this work shut-down.
- 3.2 Road and Sidewalk Closure Permits
- .1 The Contractor must have, on-site, a copy of an approved Road and Sidewalk Closure Permit valid for the work being done. Failure to produce a valid Road and Sidewalk Closure Permit on-site will result in shut-down of the work. Failure to comply on what is stated on the approved permit will result in shut-down of the work. The Contractor will be required to safely restore facility conditions to allow traffic flow at their expense. The Contractor must take all steps to acquire a Road and Sidewalk Closure Permit before work can re-start on site. No claim will be accepted by the Owner for costs associated with this work shut-down.
- 3.3 Traffic Control Personnel & Equipment
- .1 The Contractor shall supply all necessary traffic control devices required to perform traffic control services for the project. Signs and traffic control devices not applying to existing conditions shall be removed. Where operations are carried out in stages, only those traffic control devices that apply to the current stage are to be left in place.
 - .2 There must be sufficient Traffic Control Persons (TCPs) on site to appropriately and safely direct traffic in all sections of the Work.
- 3.4 Signage
- Supply, installation, maintenance and removal of all works-related signs shall be the responsibility of the Contractor. The location and type of each sign shall be indicated on the approved Traffic Control Plan, for each stage of the works.
- Traffic control signs and devices must be positioned and used as specified in the Traffic Control Plan and signs and devices must be located so as to allow traffic to move by or through the work area in a controlled manner and, if necessary, to come to a controlled stop with due regard for the prevailing weather and road conditions.

Signs shall be checked daily for legibility, damage, suitability and location. Signs and delineators shall be cleaned as frequently as necessary to ensure full legibility and reflectance.

3.5 Detours

Any proposed detours must be approved by the Contract Administrator and conducted in accordance with the approved Traffic Plan and the Traffic Control Manual for Work on Roadways.

3.6 Abrupt Changes in Surface Elevations

The Contractor shall minimize any abrupt changes in roadway elevation left exposed to traffic during both working and non-working hours.

A wedge of asphalt must be used as a transition to vertical differences in travelled areas and have a slope of 4:1 or less.

3.7 Cyclist and Pedestrian Access

The Contractor shall make provision for pedestrians, wheel chairs and bicycles to have safe access across the work zone at all times. If this cannot be readily accommodated, then acceptable detours and appropriate signs shall be provided.

3.8 Good Neighbor Practice

The Contractor, crew and subcontractors, shall not park their private vehicles on the same street they will be working on. Contractor is responsible to find alternative parking accommodation to minimize any inconvenience to the residents.

3.9 Temporary Pavement Markings

The Contractor shall be responsible for the application and removal of all temporary pavement markings and reflective devices. All temporary markings must be removed after installation of permanent markings.

4.0 TRAFFIC RESTRICTIONS

4.1 Road and Sidewalk Closure Permits

.1 Minimum of Single Lane Alternating Traffic must be accommodated at all times. If necessary and only at the discretion of the Contract Administrator, Local Traffic Only may also be approved at one block at a time.

.2 A Road and Sidewalk Closure Permit is required for each instance of closure and will be valid for a maximum period of one (1) week and, if still necessary, re-submittal of a Road and Sidewalk Closure Request is required.

A copy of the approved Road and Sidewalk Closure Permit must be held on site by both the Site Superintendent and the person/company responsible for the traffic control implementation.

.3 Total Road Closure Is Not Permitted.

.4 Detours will only be permitted as approved by the Contract Administrator and must have a complete Traffic Control Plan indicating detour route, signing, and duration. Detours will not be allowed

without sufficient lead time for commercial and retail operation to react appropriately to detour information provided to them.

4.2 Lane Closure
Restrictions

.1 **For each of the road sections affected:**

- Road and Sidewalk Closures will be reviewed for appropriateness during the allowable hours of work.
- Access to properties to be maintained
- Sufficient Traffic Control Persons are required for each Road and Sidewalk Closure (or any work activities), including side street intersections, to safely guide traffic through the work site.

5.0 HOURS OF WORK

5.1 Allowable
Hours of Work

.1 **The hours of work shall be from 0700 h to 1900 h inclusive Monday to Friday and 0900 h to 1800 h inclusive Saturdays, unless noted otherwise.**

.2 Some allowances may be made for paving operations, depending on a proposal acceptable to the Contract Administrator.

.3 Line Marking work may be performed at night, (21:00 to 05:00). No work is allowed on Sundays without specific written permission from the Contract Administrator.

**6.0 CONSTRUCTION
OPERATIONS**

6.1 Truck Routes

.1 The Contractor is restricted to the City's designated Truck Routes. The current Truck Route Map is available on the City's website at www.coquitlam.ca and can be found under **Residents, Transit & Transportation, Trucking Routes**.

6.2 Road Specific
Considerations

.1 The Contractor shall ensure safe passage of all pedestrians and all types of vehicles. The Traffic Management Plan must accommodate businesses, school, residences and pedestrian during construction activities.

All City Traffic Counts are available on the City's web site at:
[Coquitlam Traffic Data](#)

6.3 Work Stoppage Due to
Traffic

The City will not control or direct traffic control activities of the Contractor, but may require an immediate stop to any work where, in the sole opinion of the Contract Administrator, the provided traffic management plan is ineffective. Contractor is responsible for the costs associated with this work shut-down.

6.4 Construction Activity
and Signage

The Contractor will be responsible to place other construction information signs as required to inform the public of construction activities, and ensure safe travel through the work site.

6.5 Construction Zone
Information Signs


The Contractor is required to provide, one week prior to start of work and for the duration of the Contract, stationary signs to inform traffic of existing and anticipated conditions at the following locations:

- westbound, NW corner of Thomas Ave St & Nelson St
- eastbound, SE corner of Thomas Ave St & Nelson St
- southbound, SW corner Stewart Ave St & Nelson St
- northbound, NE corner Delestre Ave St & Nelson St
- southbound, SW corner Stewart Ave St & Marmont St
- northbound, NE corner Hachey Ave St & Marmont St
- northbound, NE corner Cartier Ave St & Begin St
- northbound, NE corner Laval Square St & Laval St
- northbound, NE corner Hachey Ave St & Casey St
- southbound, SW corner Rochester Ave St & Laval St
- southbound, SW corner Rochester Ave St & Therrien St

(exact locations to be determined on site by Contract Administrator)

Ensure that signs and locations are addressed in the Traffic Management Plan. All signs are to be removed at the end of the construction period.

Construction Zone Information Signs to follow specifications below:

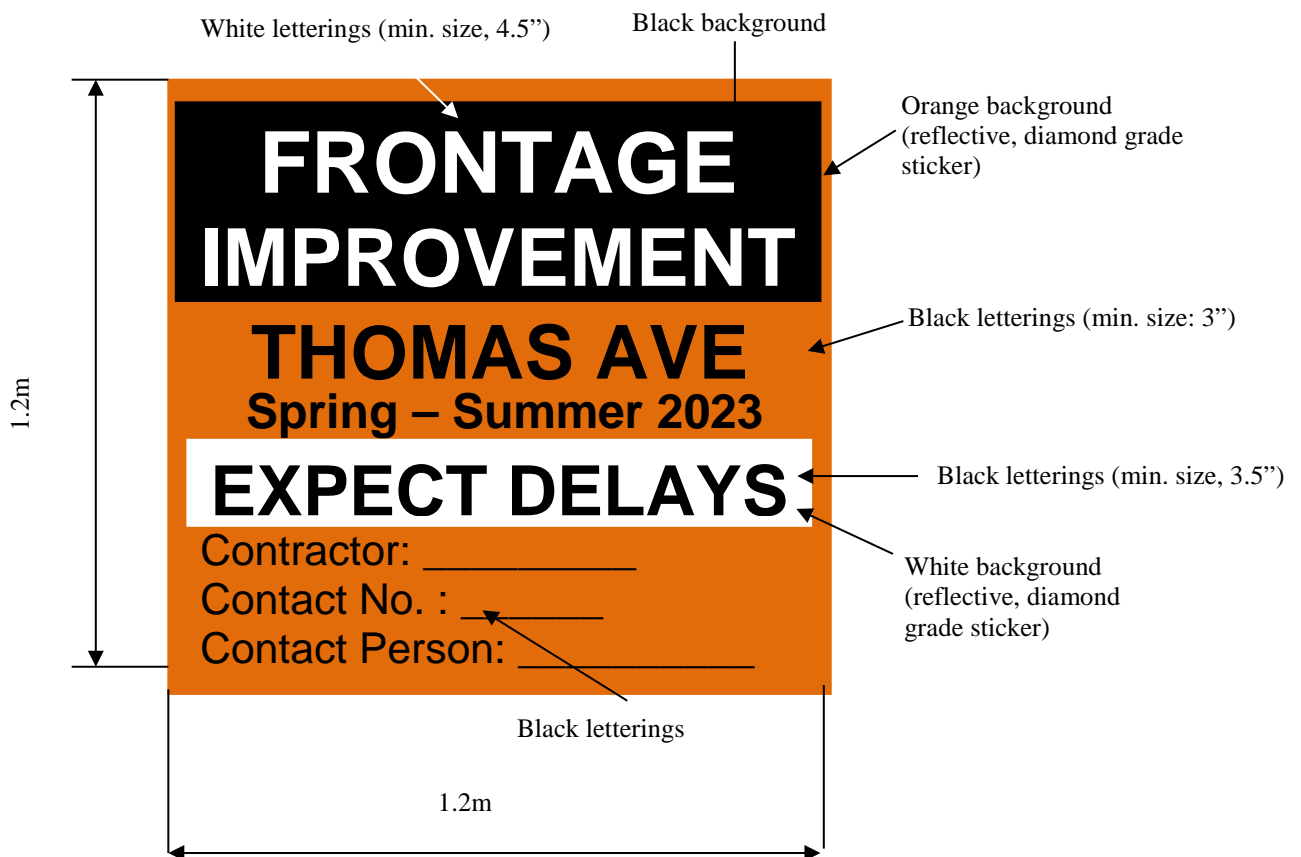

APPENDIX 1



City of Coquitlam Road and Sidewalk Closure Permit Request

Traffic Operations Division
3000 Guildford Way, Coquitlam BC V3B 7N2
Phone: 604-927-6250 Fax: 604-927-6255
Email: trafficoperations@coquitlam.ca

Submit to the Traffic Operations Division a minimum of 5 business days prior to the intended closure date.

~~Permit Fee - \$75.00 (Effective February 1, 2019)~~

Payment Methods – After review, and if approved, payment options will be emailed to the applicant.

Application Date: _____ City Project Number (if applicable): 77816

Contact Information

Company Name: _____

Applicant Name: _____

Name of Contractor doing work for Company/Applicant: _____

Phone: _____ Fax: _____

24 Hour Emergency Phone: _____ Email: _____

Location, date and time, and traffic control plan information

I request approval to close (check all that apply): Direction: ☐ Northbound ☐ Southbound ☐ Eastbound ☐ Westbound

☐ Curb/Outside Lane ☐ Centre/Inside Lane ☐ Right Turn Lane ☐ Left Turn Lane ☐ Cycling Lane ☐ Sidewalk

☐ Single Lane Alternating Traffic ☐ Full Closure

Road/Street Name: _____

Location Description: _____

Date & Time Information: Dates: _____ Starting _____ Ending _____

Hours: _____ Starting _____ Ending _____

Purpose: _____

Will this closure disrupt: Bus Routes or Stops? ☐ Yes ☐ No If yes, the Applicant will need to contact Coast Mountain Bus Company regarding disruptions.

Will this closure disrupt: Garbage/Recycling Routes or Pick Up? ☐ Yes ☐ No If yes, the Applicant will need to assist the contractor and/or contact the City's Environmental Services Group. www.coquitlam.ca/trashtalk

Traffic Control Plan*:

- (a) Traffic Management Manual for Work on Roadways Figure Number _____, or
(b) A Traffic Control Plan (*attach separately*) indicating signage, taper lengths, direction of traffic, work area, and north arrow

Traffic control persons (flag persons) on duty? ☐ Yes ☐ No If yes, specify how many: _____

** Important Notice: All operations within the road right-of-way must comply with Worksafe BC regulations and BC Ministry of Transportation standards for work on roadways.*

Application Checklist

- ☐ Permit Fee
- ☐ Prime Contractor Designation Letter
- ☐ City of Coquitlam Certificate of Insurance
- ☐ Traffic Control Plan or Traffic Management Manual for Work on Roadways Figure Number
- ☐ Coast Mountain Bus Company (Phone: 778-593-5774 | Email: special.events@coastmountainbus.com) contacted regarding impact to bus routes and bus stops
- ☐ City of Coquitlam Environmental Services Group (Phone: 604-927-3500 | Email: wastereduction@coquitlam.ca) contacted regarding impact to garbage/recycling routes and pick up

I HEREBY AGREE to the terms stipulated herein and further agree to indemnify and save harmless the City against any and all claims, actions, or expenses whatsoever or by whomsoever brought against the City by the reason of the City granting us this Road and Sidewalk Closure Permit. I further agree to accept responsibility to ensure proper situation control and street sweeping for the duration of the road or sidewalk obstruction.

Date

Applicant Signature


Office Use Only PERMIT STATUS

- | | | |
|---|--|--|
| <input type="checkbox"/> Permit Fee | <input type="checkbox"/> Prime Contractor Letter | <input type="checkbox"/> Certificate of Insurance |
| <input type="checkbox"/> Traffic Control Plan | <input type="checkbox"/> Impact to bus service | <input type="checkbox"/> Impact garbage and recycling collection |
- ☐ Request is denied for the following reason(s): _____
- _____
- ☐ Request is approved with the following change(s): _____
- _____
- ☐ Request is approved as submitted


Date

Traffic Technologist or Designate

Appendix B - Supplementary Detailed Drawings

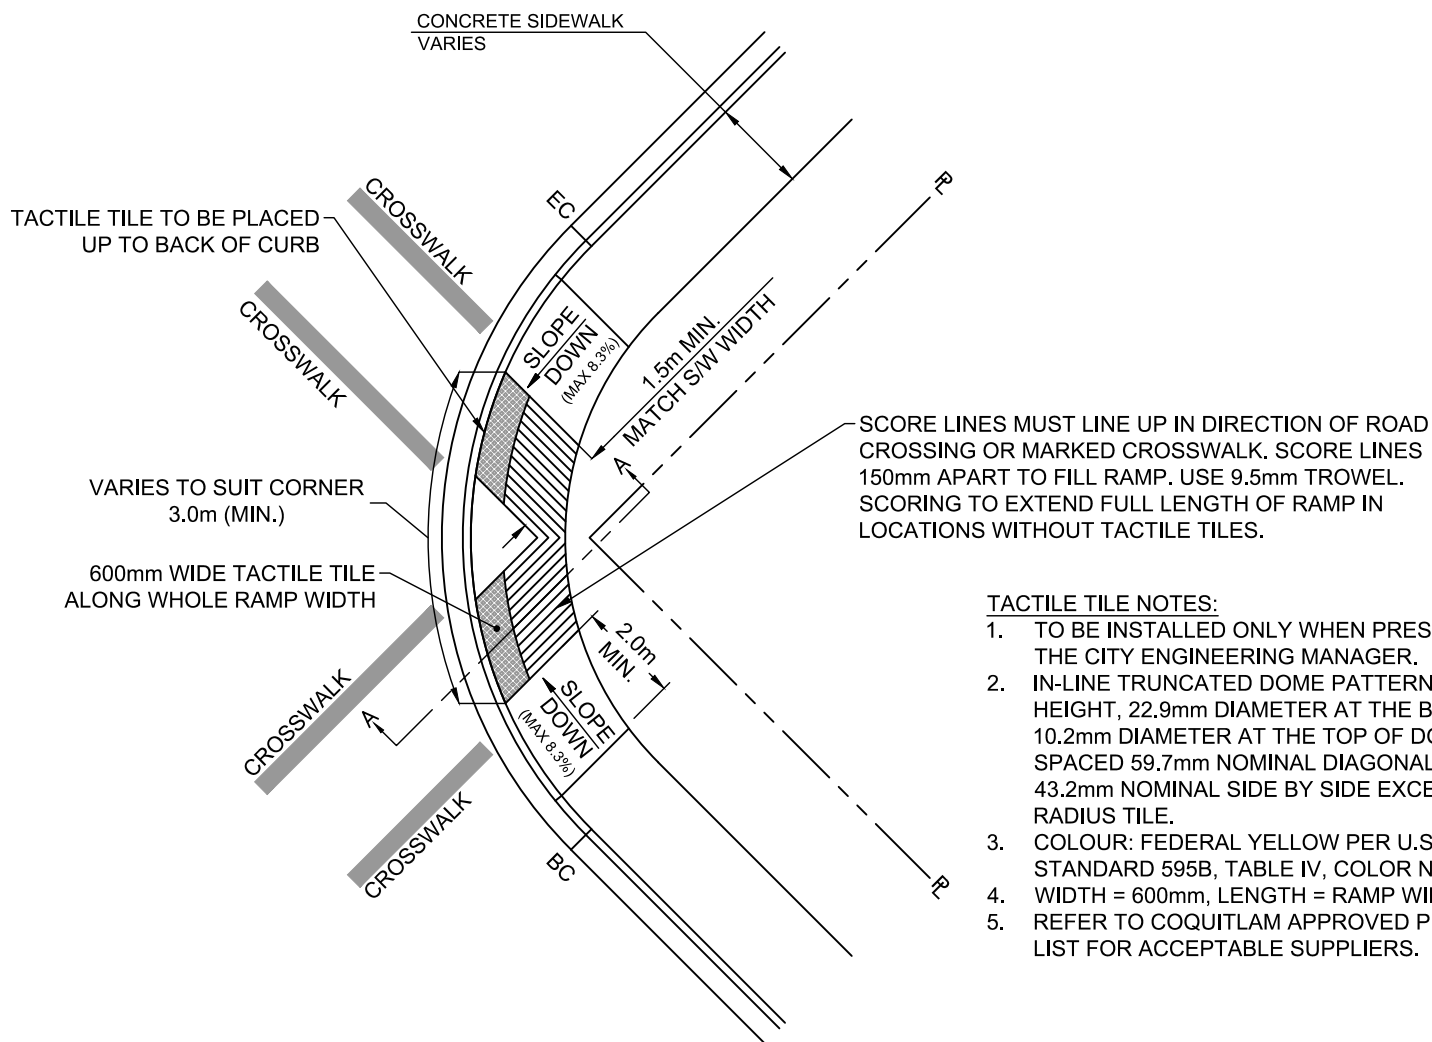**TACTILE TILE NOTES:**

1. TO BE INSTALLED ONLY WHEN PRESCRIBED BY THE CITY ENGINEERING MANAGER.
2. IN-LINE TRUNCATED DOME PATTERN 5.1mm IN HEIGHT, 22.9mm DIAMETER AT THE BASE AND 10.2mm DIAMETER AT THE TOP OF DOME SPACED 59.7mm NOMINAL DIAGONALLY AND 43.2mm NOMINAL SIDE BY SIDE EXCEPT FOR RADIUS TILE.
3. COLOUR: FEDERAL YELLOW PER U.S. FEDERAL STANDARD 595B, TABLE IV, COLOR NO.335.
4. WIDTH = 600mm, LENGTH = RAMP WIDTH
5. REFER TO COQUITLAM APPROVED PRODUCTS LIST FOR ACCEPTABLE SUPPLIERS.

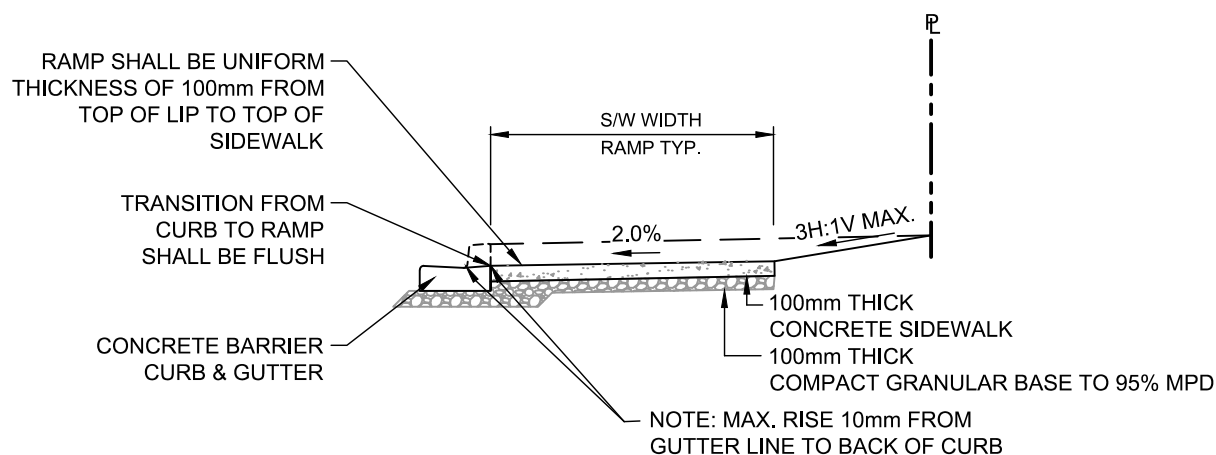COMBINED LETDOWN**SECTION A-A CURB RAMP**

PLOTTED: 19-NOV-20

**PARALLEL CURB RAMP - COMBINED
LETDOWN WITHOUT BOULEVARD**

DATE: NOV/2020


DRAWN: GA

SCALE: N.T.S.

DRAWING NUMBER:

NOTE: STANDARD RAMP LENGTH: 2.4m AT CENTRE OF RAMP. RECOMMENDED RAMP SLOPE: 7.6% (\pm).
MAX. SLOPE 8.3% (1:12) WHERE TOPOGRAPHY PERMITS. WHEN SITE CONDITIONS DO NOT
PERMIT TYPICAL LAYOUT DESIGN TO BE APPROVED BY THE CITY ENGINEERING MANAGER.

SCORE LINES MUST LINE UP IN DIRECTION OF TRAVEL
AND BE PARALLEL WITH THE CROSSING OR MARKED
CROSSWALK. SCORE LINES 150mm APART TO FILL RAMP.
USE 9.5mm TROWEL. SCORING TO EXTEND FULL LENGTH
OF RAMP IN LOCATIONS WITHOUT TACTILE TILES.

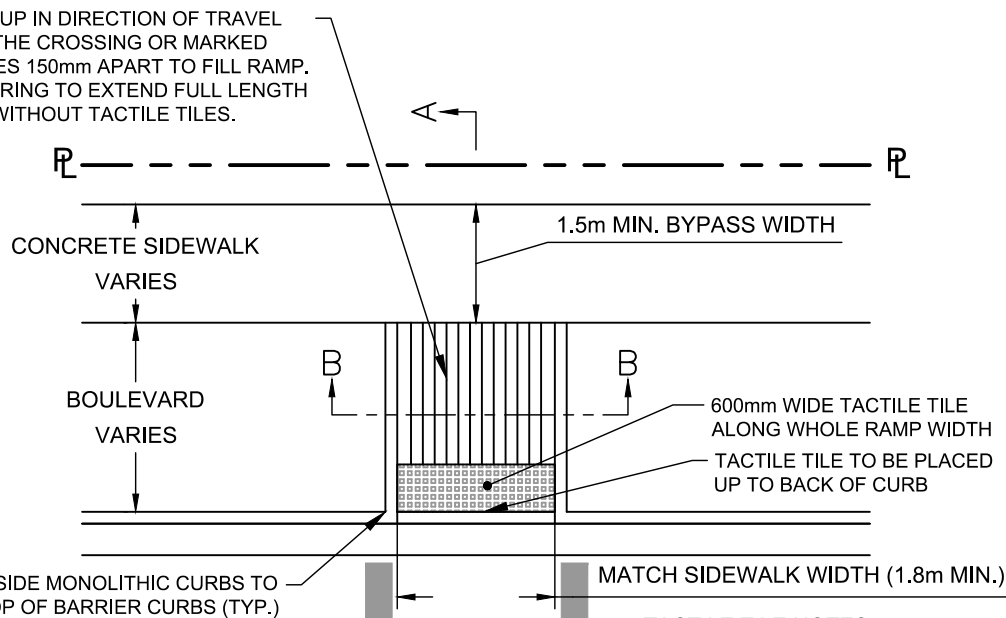


TACTILE TILE NOTES:

1. TO BE INSTALLED ONLY WHEN PRESCRIBED BY THE CITY ENGINEERING MANAGER.
2. IN-LINE TRUNCATED DOME PATTERN 5.1mm IN HEIGHT, 22.9mm DIAMETER AT THE BASE AND 10.2mm DIAMETER AT THE TOP OF DOME SPACED 59.7mm NOMINAL DIAGONALLY AND 43.2mm NOMINAL SIDE BY SIDE EXCEPT FOR RADIUS TILE.
3. COLOUR: FEDERAL YELLOW PER U.S. FEDERAL STANDARD 595B, TABLE IV, COLOR NO.335.
4. WIDTH = 600mm, LENGTH = RAMP WIDTH
5. REFER TO COQUITLAM APPROVED PRODUCTS LIST FOR ACCEPTABLE SUPPLIERS.

SINGLE RAMP

SECTION B-B CURB RAMP

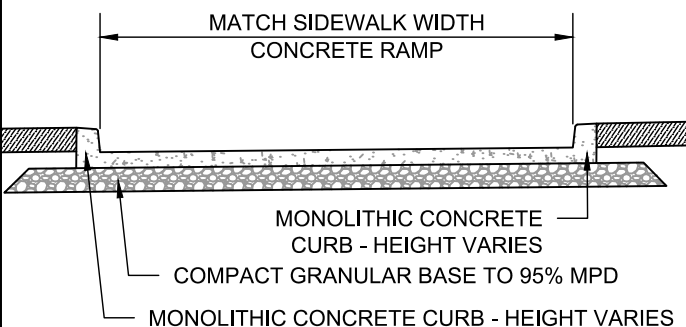

TOP OF MONOLITHIC SIDE CURBS
SLOPE UP AT 2% TO SIDEWALK


RAMP SHALL BE UNIFORM
THICKNESS OF 100mm FROM TOP
OF LIP TO TOP OF SIDEWALK

TRANSITION FROM CURB
TO RAMP SHALL BE FLUSH

CONCRETE BARRIER
CURB & GUTTER

NOTE: MAX. RISE 10mm FROM
GUTTER LINE TO BACK OF CURB

SECTION A-A CURB RAMP

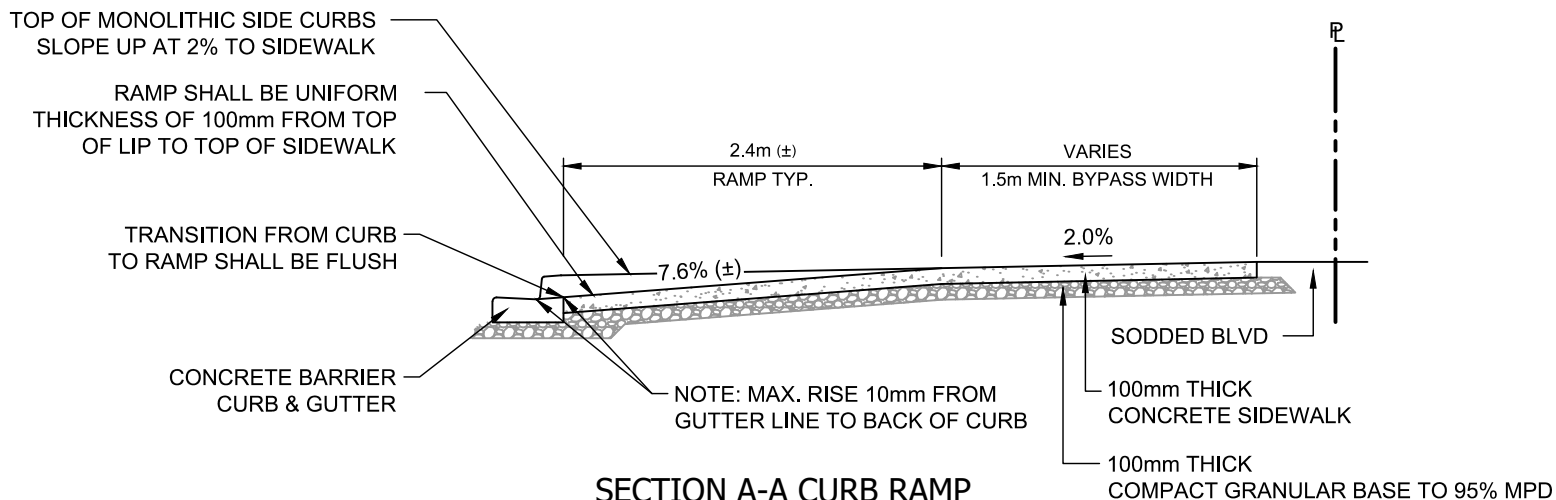


SINGLE CURB RAMP LETDOWN WITH CURB CUT


DATE: NOV/2020

DRAWN: GA

SCALE: N.T.S.

DRAWING NUMBER:



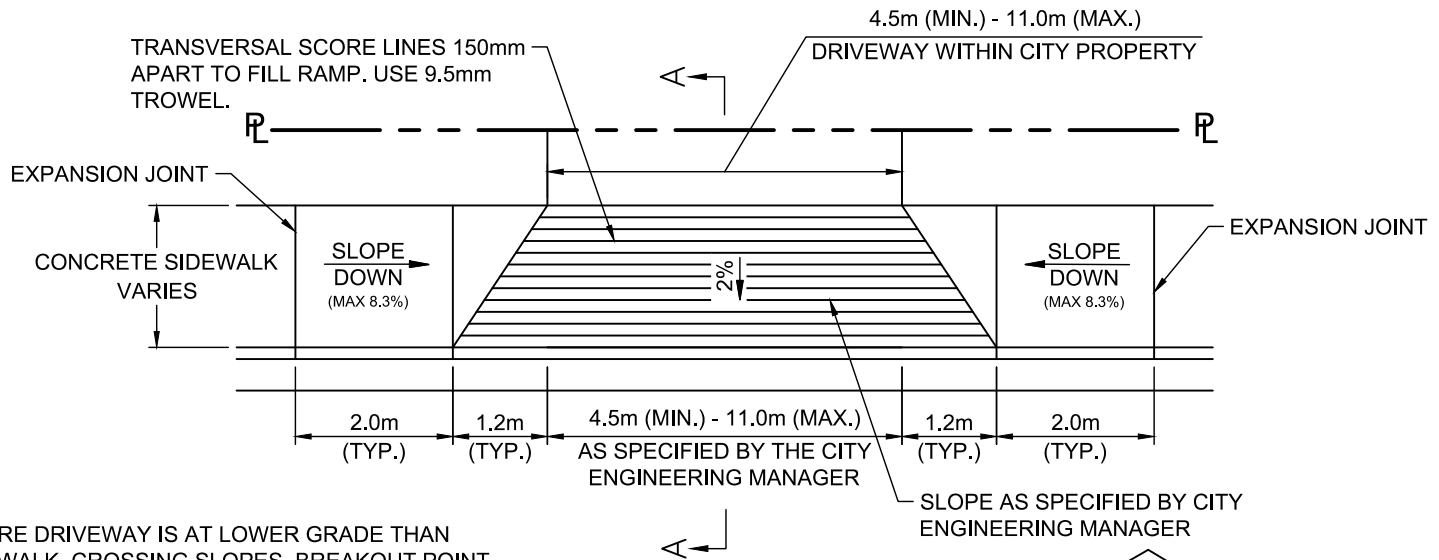


PLAN VIEW


NOTES:

1. WHERE DRIVEWAY IS AT LOWER GRADE THAN SIDEWALK, CROSSING SLOPES, BREAKOUT POINT AND D/W GRADE AS INDICATED BY DASHED LINE IN SECTION IF APPROVED BY THE CITY ENGINEERING MANAGER.
2. WHERE NEW CROSSING IS INSTALLED IN EXISTING SIDEWALK, BREAKOUT TO NEAREST TOOLED TRANSVERSE LINE.
3. WHERE SIDEWALK DOES NOT EXIST, DRIVEWAY MUST START AT TOP OF CURB RAMP AND EXTEND AT 45° TO A MAX WIDTH OF 6.0m ON CITY PROPERTY.
4. DRIVEWAY LETDOWN TO BE CENTRED ON GARAGE.
5. DRIVEWAY WIDTH ON CITY PROPERTY TO MATCH WIDTH OF LETDOWN EXCLUDING FLARES.
6. SLOPE DRIVEWAY AS SPECIFIED BY THE CITY ENGINEERING MANAGER.

SLAB THICKENS TO 190mm
FOR ONE SIDEWALK PANEL
PAST THE CURB RAMP

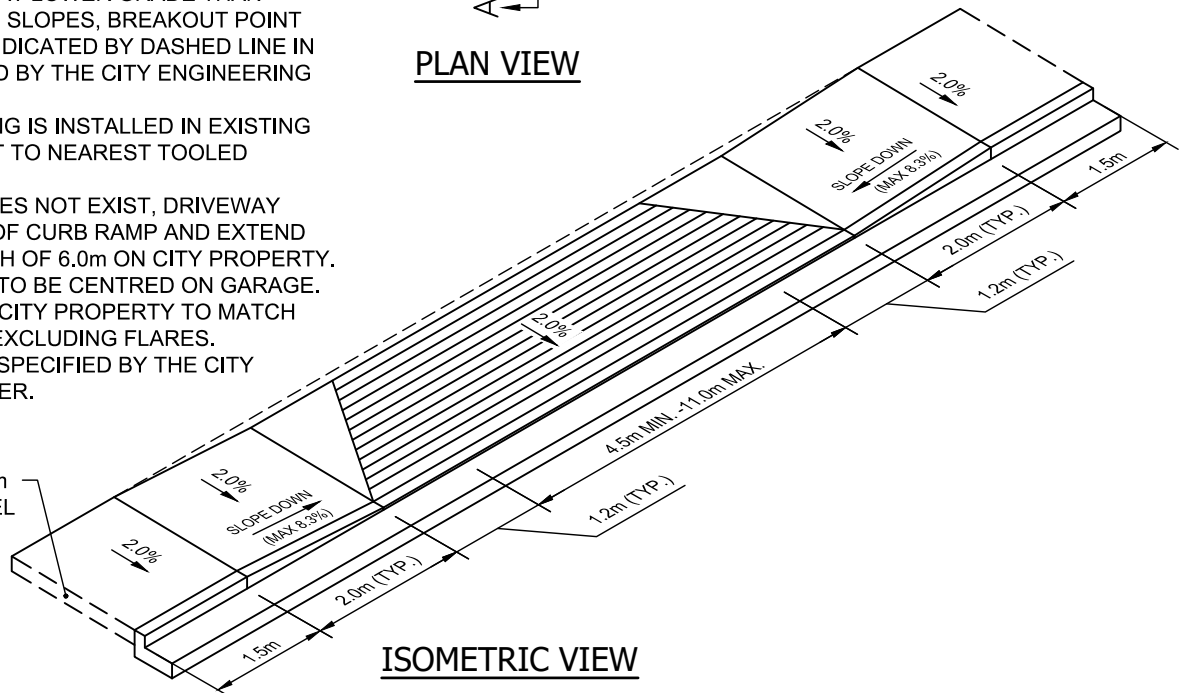

ISOMETRIC VIEW

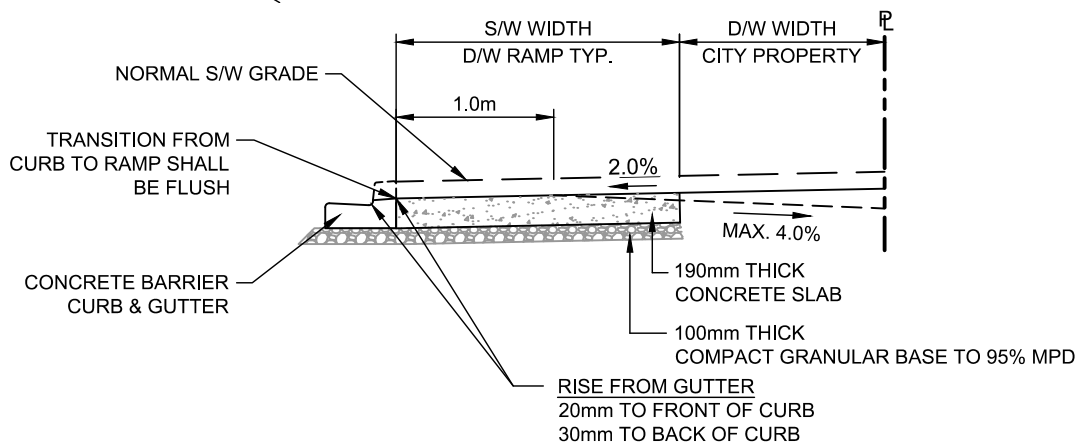

SECTION A-A CURB RAMP

PLOTTED: 19-NOV-20

INDUSTRIAL, COMMERCIAL
DRIVEWAY CROSSING OF
CURB, GUTTER AND SIDEWALK



DATE:	NOV/2020
-------	----------

DRAWN: GA

SCALE: N.T.S.

DRAWING NUMBER:

COQ-C7A

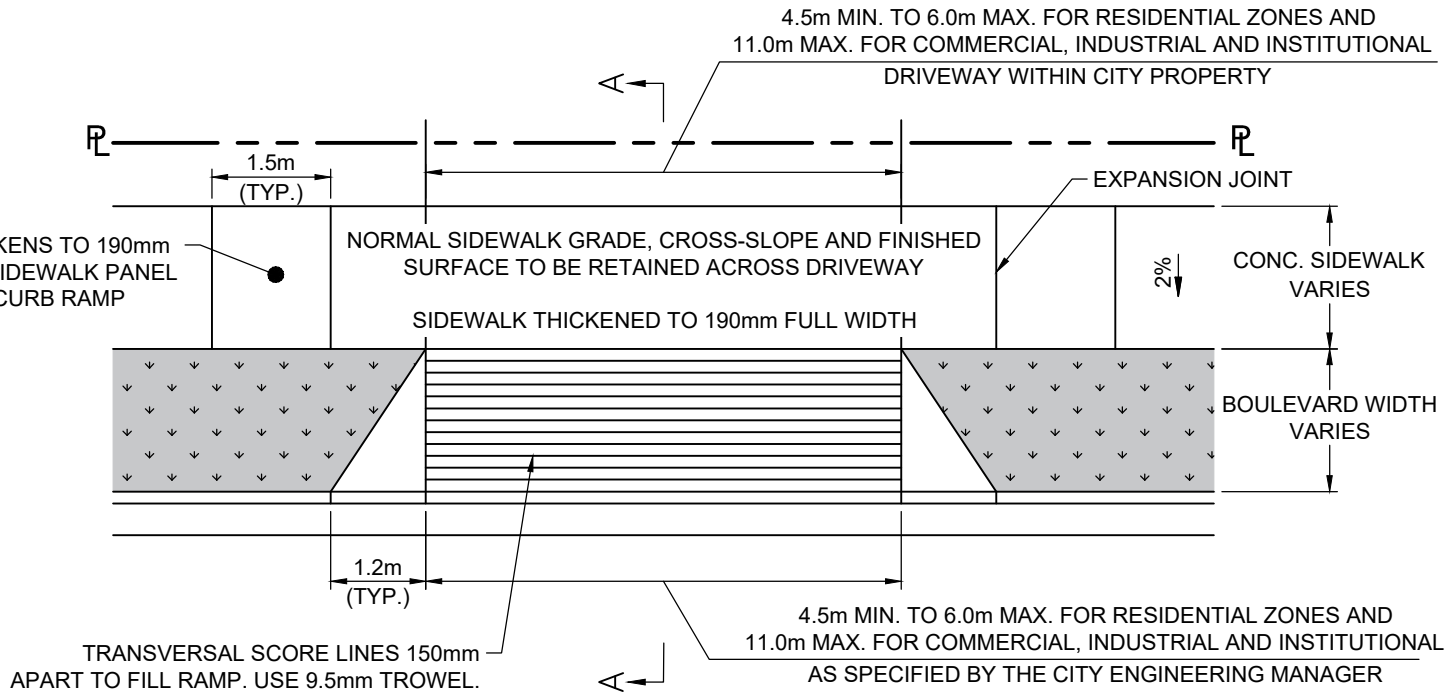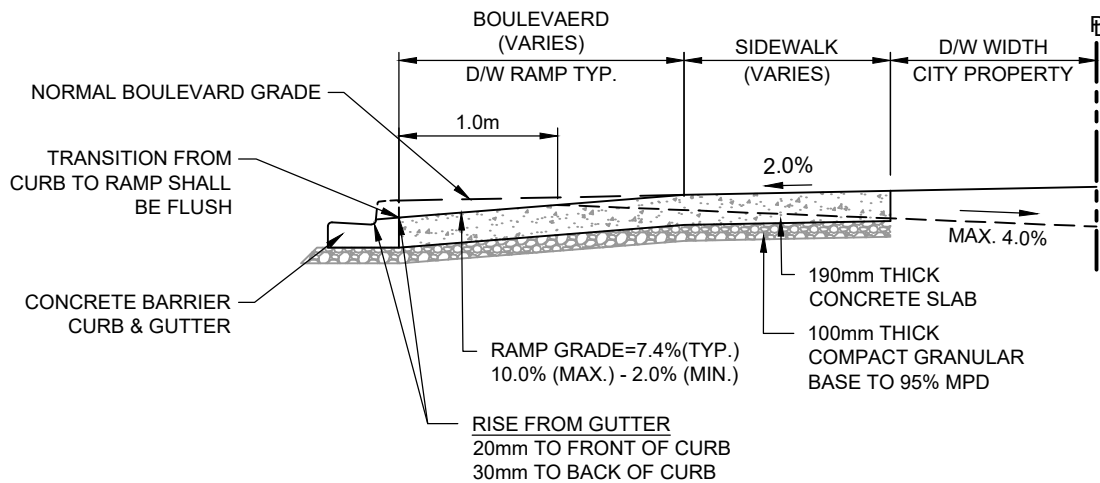PLAN VIEWSECTION A-A CURB RAMPNOTES:

1. DRIVEWAY LETDOWN TO BE CENTERED ON GARAGE.
2. DRIVEWAY WIDTH ON CITY PROPERTY TO MATCH WIDTH OF LETDOWN EXCLUDING THE FLARES.
3. WHERE DRIVEWAY IS AT LOWER GRADE THAN SIDEWALK, CROSSING SLOPES, BREAKOUT POINT AND D/W GRADE AS INDICATED BY DASHED LINE IN SECTION IF APPROVED BY THE CITY ENGINEERING MANAGER.

PLOTTED: 19-NOV-20

**TYPICAL CURB/SIDEWALK DRIVEWAY
LETDOWN - SEPARATED SIDEWALK**


DATE: NOV/2020

DRAWN: GA

SCALE: N.T.S.

DRAWING NUMBER:


COQ-C7B

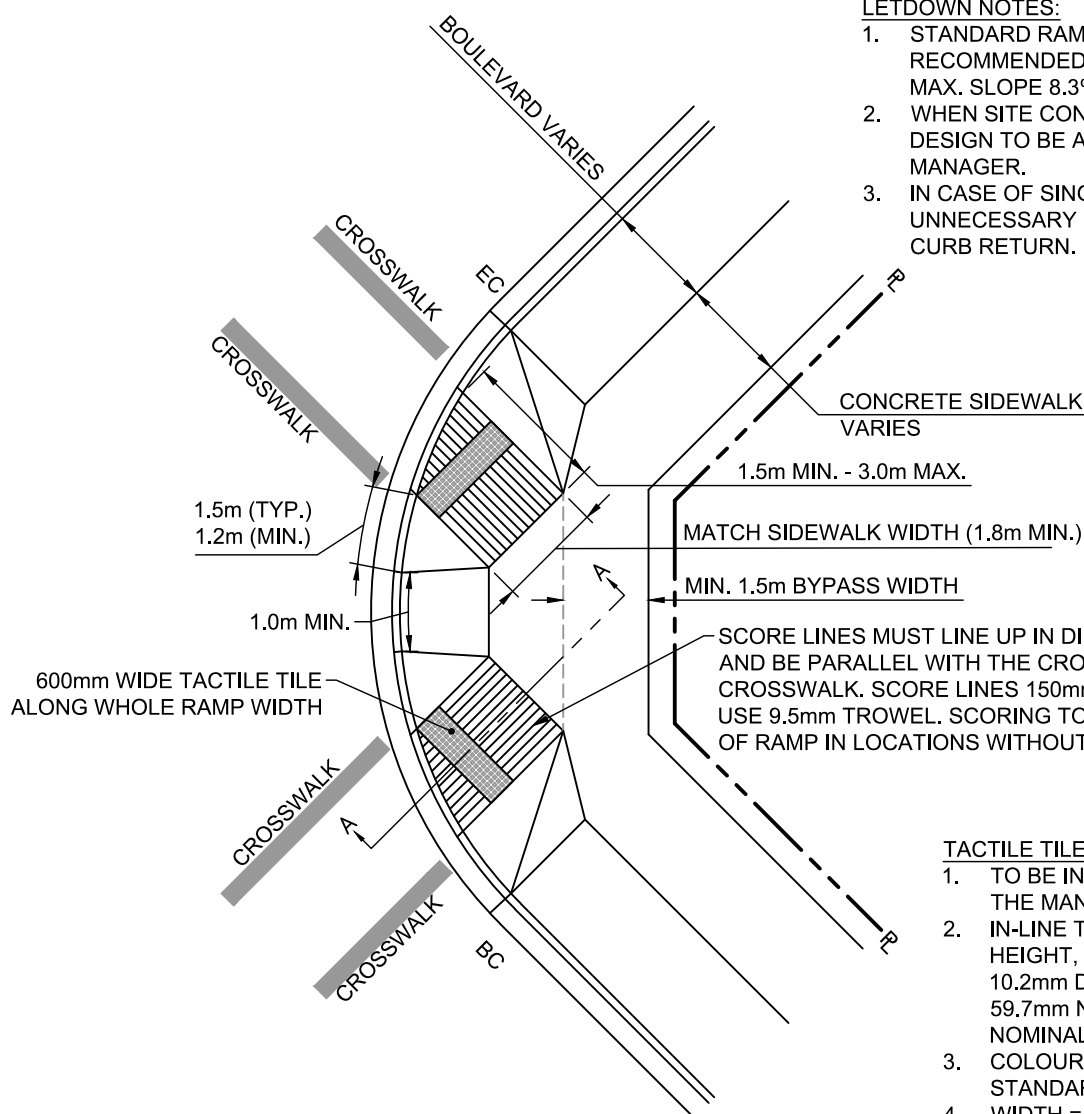**LETDOWN NOTES:**

1. STANDARD RAMP LENGTH: 2.4m AT CENTRE OF RAMP. RECOMMENDED RAMP SLOPE: 7.6% (\pm) MAX. SLOPE 8.3% (1:12) WHERE TOPOGRAPHY PERMITS.
2. WHEN SITE CONDITIONS DO NOT PERMIT TYPICAL LAYOUT DESIGN TO BE APPROVED BY THE CITY ENGINEERING MANAGER.
3. IN CASE OF SINGLE CROSSING: REMOVE UNNECESSARY LETDOWN AND EXTEND BOULEVARD TO CURB RETURN.

TACTILE TILE NOTES:

1. TO BE INSTALLED ONLY WHEN PRESCRIBED BY THE MANAGER.
2. IN-LINE TRUNCATED DOME PATTERN 5.1mm IN HEIGHT, 22.9mm DIAMETER AT THE BASE AND 10.2mm DIAMETER AT THE TOP OF DOME SPACED 59.7mm NOMINAL DIAGONALLY AND 43.2mm NOMINAL SIDE BY SIDE EXCEPT FOR RADIUS TILE.
3. COLOUR: FEDERAL YELLOW PER U.S. FEDERAL STANDARD 595B, TABLE IV, COLOR NO.335.
4. WIDTH = 600mm, LENGTH = RAMP WIDTH
5. REFER TO COQUITLAM APPROVED PRODUCTS LIST FOR ACCEPTABLE SUPPLIERS.

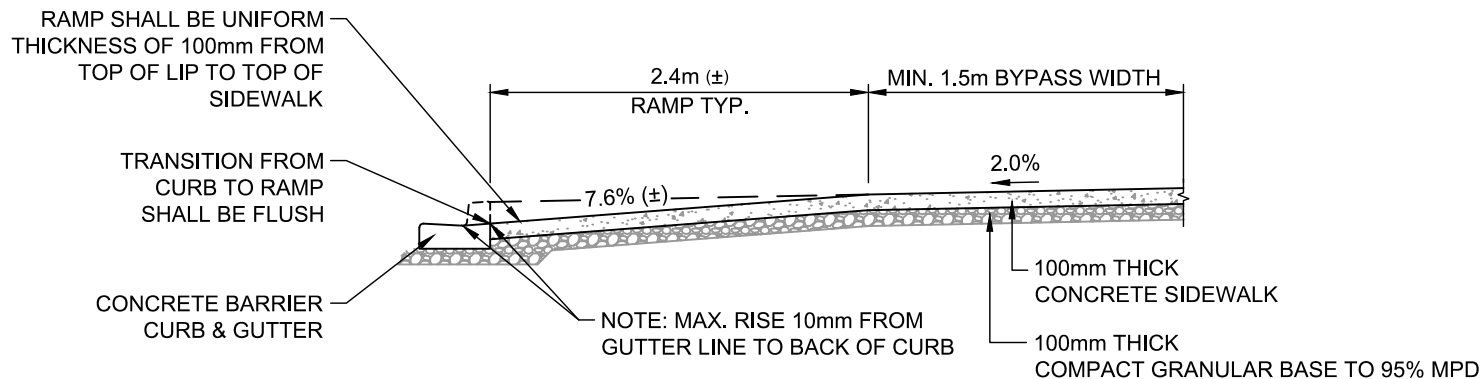SPLIT LETDOWN**SECTION A-A CURB RAMP**

PLOTTED: 19-NOV-20

**SPLIT LETDOWN AT INTERSECTION
WITH BOULEVARD**


DATE: NOV/2020

DRAWN: GA


SCALE: N.T.S.

DRAWING NUMBER:

COQ-C9A

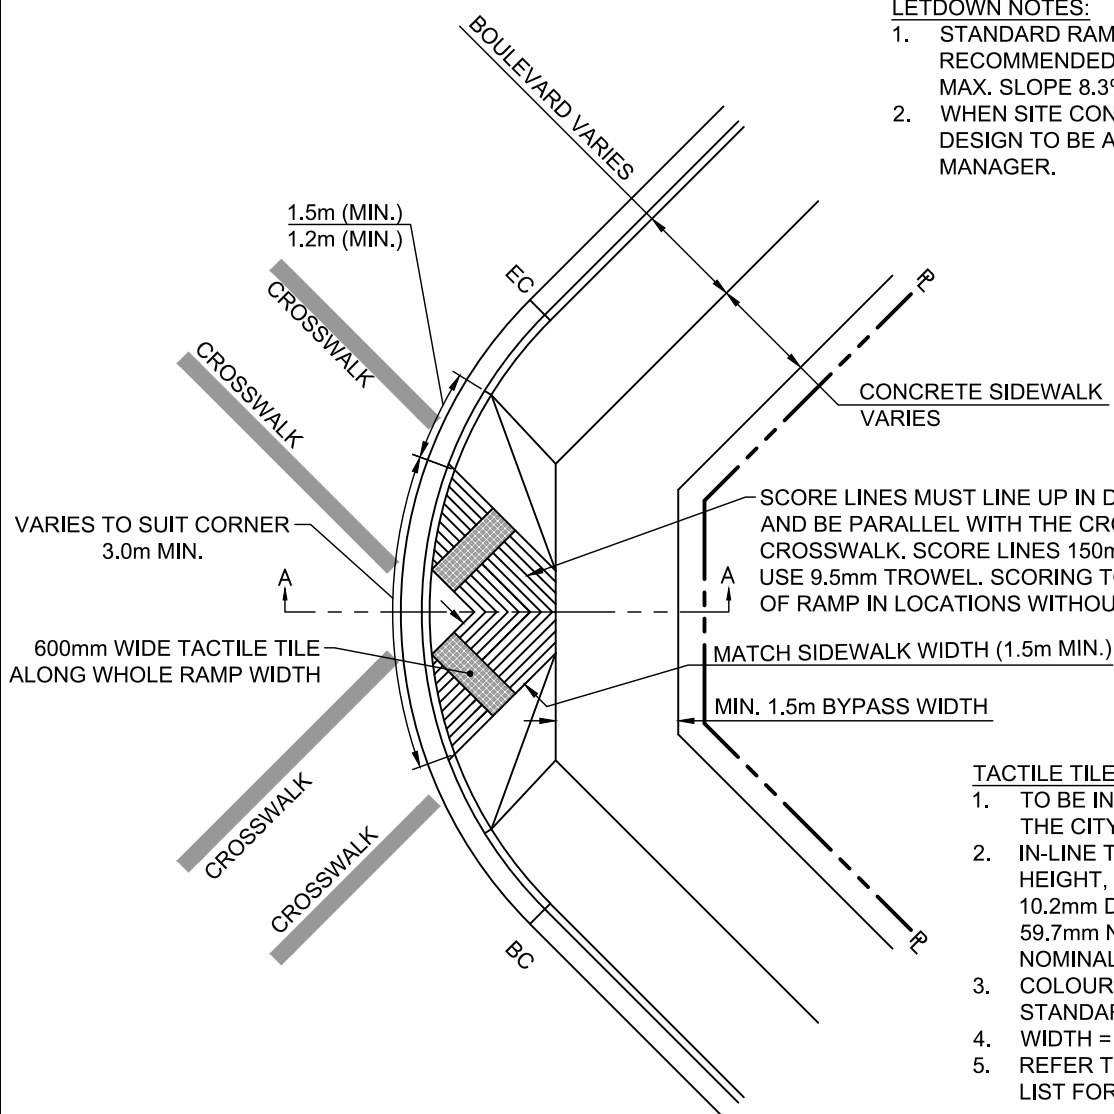

SINGLE LETDOWN

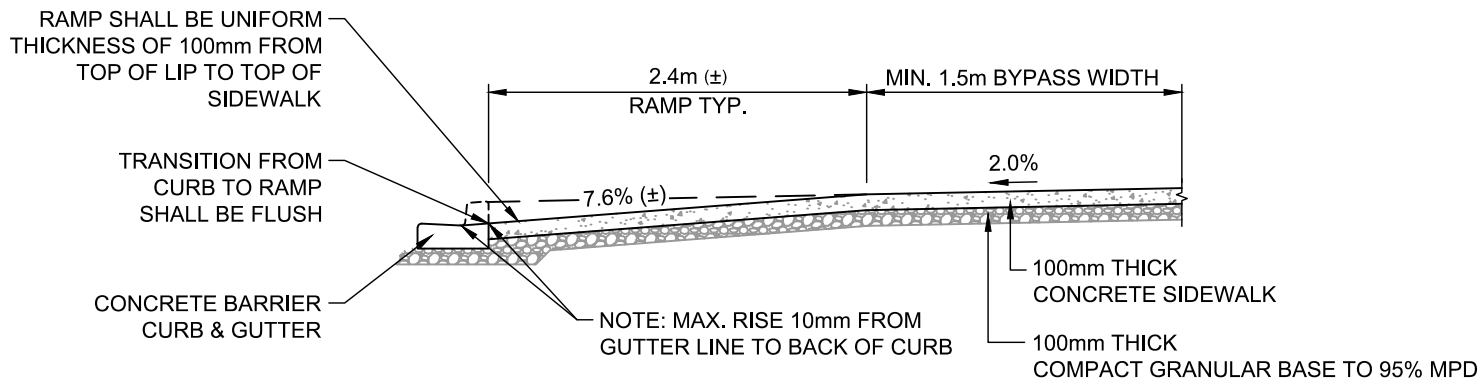

SECTION A-A CURB RAMP

PLOTTED: 19-NOV-20

**SINGLE LETDOWN AT INTERSECTION
WITH BOULEVARD**

DATE: NOV/2020

DRAWN: GA


SCALE: N.T.S.

DRAWING NUMBER:

COQ-C9B

SCORE LINES MUST LINE UP IN DIRECTION OF TRAVEL AND BE PARALLEL WITH THE CROSSING OR MARKED CROSSWALK. SCORE LINES 150mm APART TO FILL RAMP. USE 9.5mm TROWEL. SCORING TO EXTEND FULL LENGTH OF RAMP IN LOCATIONS WITHOUT TACTILE TILES.


NOTE: STANDARD RAMP LENGTH: 2.4m AT CENTRE OF RAMP. RECOMMENDED RAMP SLOPE: 7.6% (\pm). MAX. SLOPE 8.3% (1:12) WHERE TOPOGRAPHY PERMITS. WHEN SITE CONDITIONS DO NOT PERMIT TYPICAL LAYOUT DESIGN TO BE APPROVED BY THE CITY ENGINEERING MANAGER.

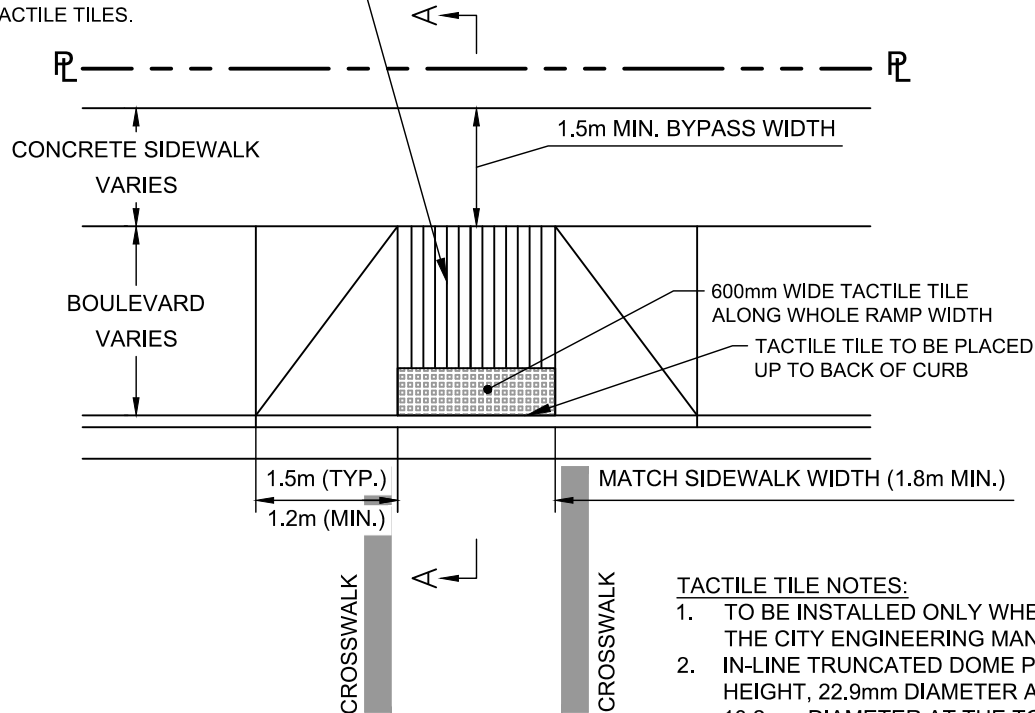

SINGLE RAMP

TACTILE TILE NOTES:

1. TO BE INSTALLED ONLY WHEN PRESCRIBED BY THE CITY ENGINEERING MANAGER.
2. IN-LINE TRUNCATED DOME PATTERN 5.1mm IN HEIGHT, 22.9mm DIAMETER AT THE BASE AND 10.2mm DIAMETER AT THE TOP OF DOME SPACED 59.7mm NOMINAL DIAGONALLY AND 43.2mm NOMINAL SIDE BY SIDE EXCEPT FOR RADIUS TILE.
3. COLOUR: FEDERAL YELLOW PER U.S. FEDERAL STANDARD 595B, TABLE IV, COLOR NO.335.
4. WIDTH = 600mm, LENGTH = RAMP WIDTH
5. REFER TO COQUITLAM APPROVED PRODUCTS LIST FOR ACCEPTABLE SUPPLIERS.

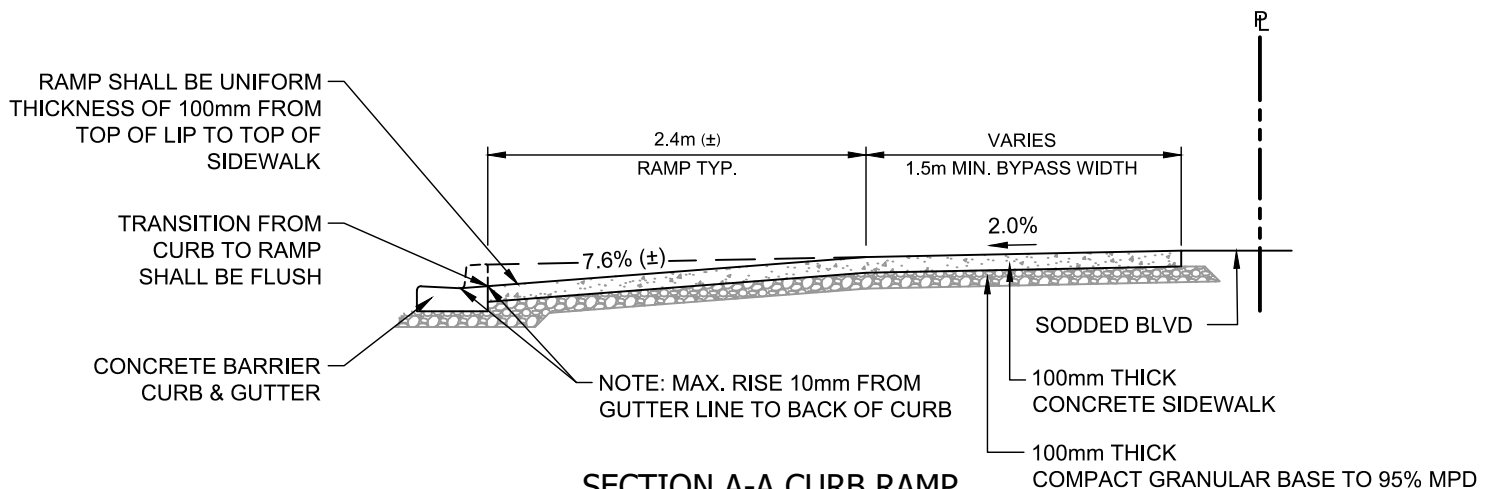

SECTION A-A CURB RAMP

PLOTTED: 19-NOV-20

SINGLE CURB RAMP LETDOWN

DATE:	NOV/2020
-------	----------


DRAWN: GA

SCALE: N.T.S.

DRAWING NUMBER:

COQ-C9C


SCORE LINES MUST LINE UP IN DIRECTION OF TRAVEL AND BE PARALLEL WITH THE CROSSING OR MARKED CROSSWALK. SCORE LINES 150mm APART TO FILL RAMP. USE 9.5mm TROWEL. SCORING TO EXTEND FULL LENGTH OF RAMP IN LOCATIONS WITHOUT TACTILE TILES.

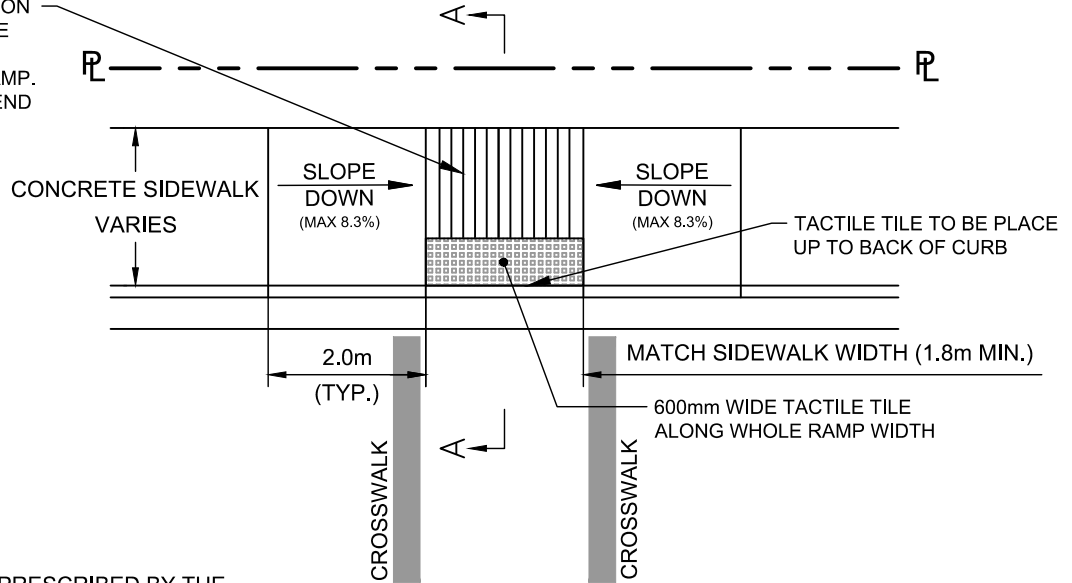


SINGLE RAMP - PLAN VIEW

TACTILE TILE NOTES:

1. TO BE INSTALLED ONLY WHEN PRESCRIBED BY THE CITY ENGINEERING MANAGER.
2. IN-LINE TRUNCATED DOME PATTERN 5.1mm IN HEIGHT, 22.9mm DIAMETER AT THE BASE AND 10.2mm DIAMETER AT THE TOP OF DOME SPACED 59.7mm NOMINAL DIAGONALLY AND 43.2mm NOMINAL SIDE BY SIDE EXCEPT FOR RADIUS TILE.
3. COLOUR: FEDERAL YELLOW PER U.S. FEDERAL STANDARD 595B, TABLE IV, COLOR NO.335.
4. WIDTH = 600mm, LENGTH = RAMP WIDTH
5. REFER TO COQUITLAM APPROVED PRODUCTS LIST FOR ACCEPTABLE SUPPLIERS.

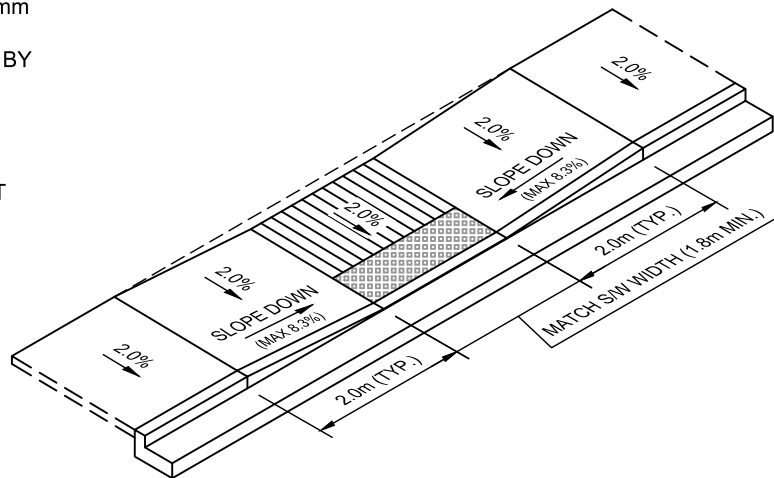

SINGLE RAMP - ISOMETRIC VIEW

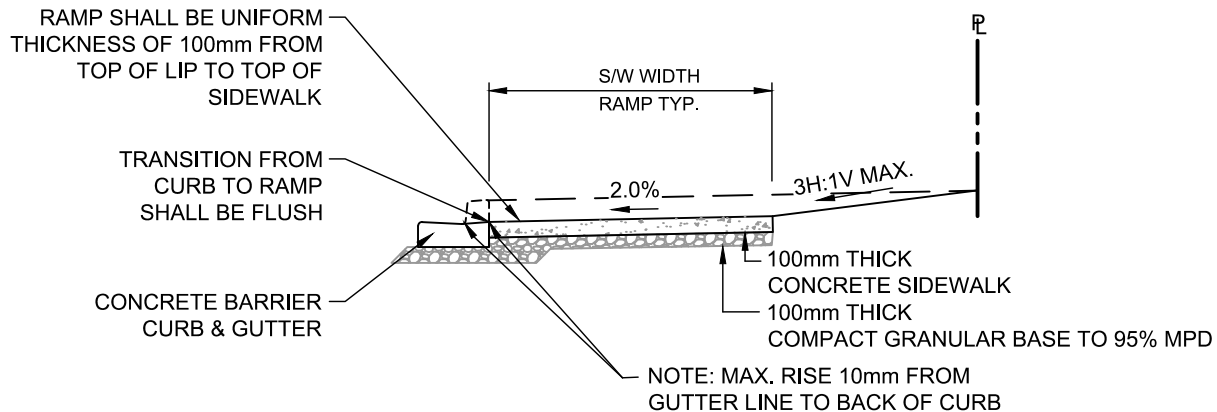


SECTION A-A CURB RAMP

PLOTTED: 19-NOV-20

**PARALLEL CURB RAMP - SINGLE
LETDOWN WITHOUT BOULEVARD**

DATE: NOV/2020
DRAWN: GA
SCALE: N.T.S.

DRAWING NUMBER:
COQ-C9D

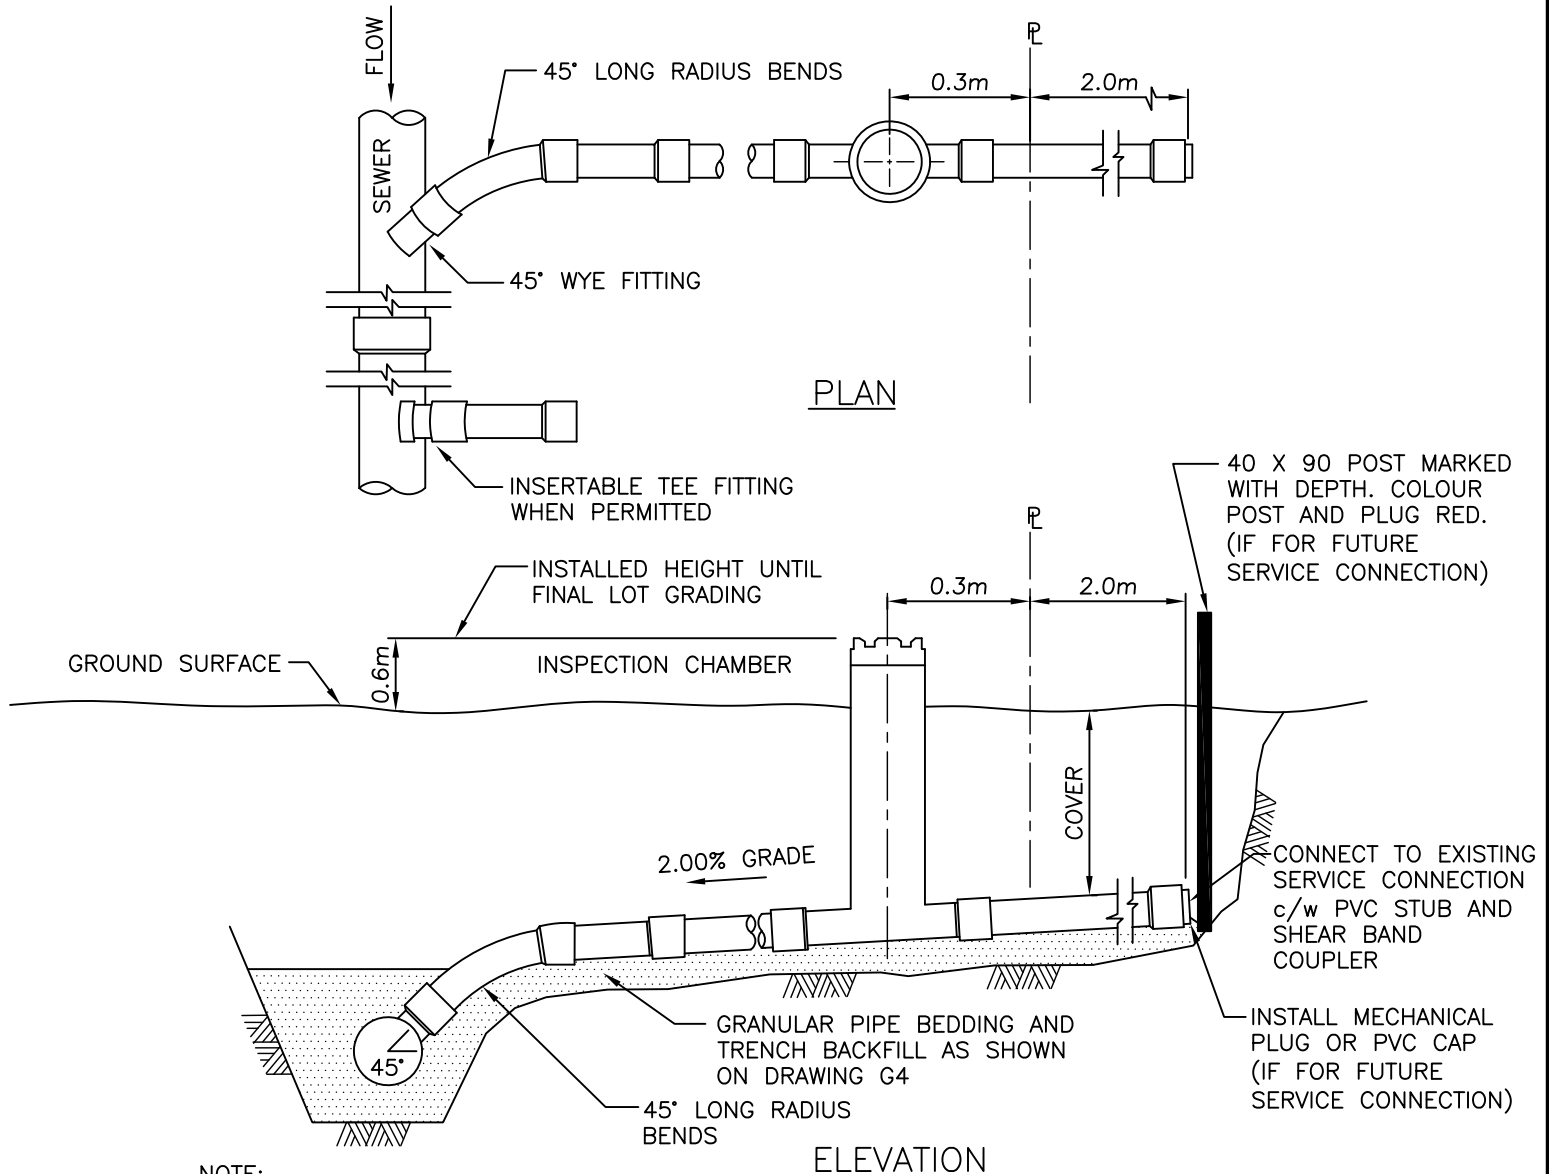

NOTE:

1. CONNECTIONS TO BE 100mm PVC SDR28 OR AS SPECIFIED ON CONTRACT DRAWINGS OR AS DIRECTED BY CONTRACT ADMINISTRATOR.
2. CONNECTION TO BE INSTALLED AT 2% GRADE FROM WYE AT MAIN TO PROPERTY LINE UNLESS OTHERWISE INDICATED ON THE CONTRACT DRAWINGS OR AS APPROVED BY CONTRACT ADMINISTRATOR. ONLY 45 DEGREE LONG RADIUS CAN BE USED FOR BENDS.
3. DISTANCE OF INSPECTION CHAMBER AND MARKER AS SHOWN OR AS SPECIFIED ON CONTRACT DRAWINGS OR AS DIRECTED BY CONTRACT ADMINISTRATOR.
4. SEE DRAWING S9 FOR DETAILS OF INSPECTION CHAMBER AND INSTALLATION REQUIREMENTS.
5. IC LID (RED COLOR) TO BE 25mm BELOW THE BASE OF SOD FINAL ELEVATION.
6. LOCATION OF INSPECTION CHAMBER AND MARKER AS SHOWN OR AS SPECIFIED ON CONTRACT DRAWINGS UNLESS OTHERWISE DIRECTED BY CONTRACT ADMINISTRATOR.
7. IN DRIVEWAYS, INSPECTION CHAMBER IS TO BE INSTALLED WITH BROOKS BOX. BROOKS BOX WITH METAL LID IS TO BE INSTALLED PARALLEL TO THE DIRECTION OF THE FLOW.

PLOTTED: 13-Jul-20


SANITARY SEWER SERVICE CONNECTION

DATE: JULY/2020

DRAWN: REY

SCALE: N.T.S.

DRAWING NUMBER:
COQ-S7A

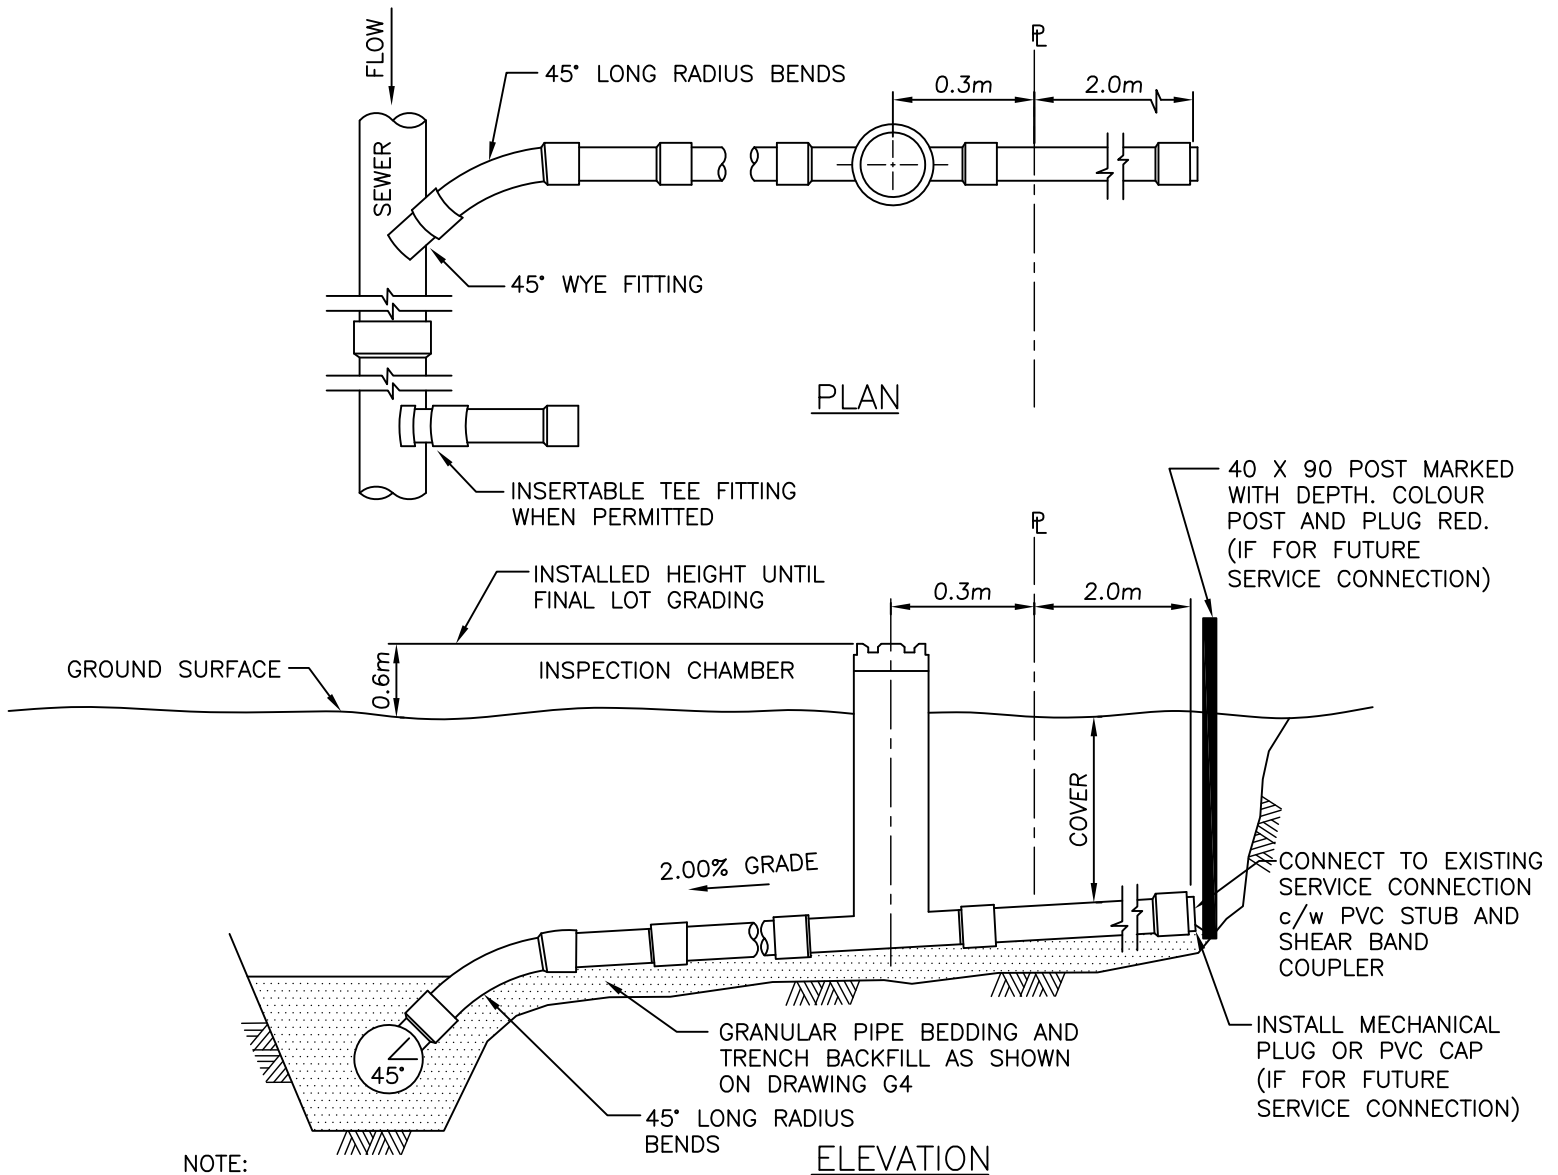

1. CONNECTIONS TO BE 150mm PVC SDR28 MINIMUM OR LARGER AS SPECIFIED ON CONTRACT DRAWINGS OR AS DIRECTED BY CONTRACT ADMINISTRATOR.
2. CONNECTION TO BE INSTALLED AT 2% GRADE FROM WYE AT MAIN TO PROPERTY LINE UNLESS OTHERWISE INDICATED ON THE CONTRACT DRAWINGS OR AS APPROVED BY CONTRACT ADMINISTRATOR. ONLY 45 DEGREE LONG RADIUS CAN BE USED FOR BENDS.
3. DISTANCE FROM PL OF INSPECTION CHAMBER AND MARKER AS SHOWN OR AS SPECIFIED ON CONTRACT DRAWINGS OR AS DIRECTED BY CONTRACT ADMINISTRATOR.
4. SEE DRAWING S9 FOR DETAILS OF INSPECTION CHAMBER AND INSTALLATION REQUIREMENTS.
5. IC LID (GREEN COLOR) TO BE 25mm BELOW THE BASE OF SOD FINAL ELEVATION.
6. LOCATION OF INSPECTION CHAMBER AND MARKER AS SHOWN OR AS SPECIFIED ON CONTRACT DRAWINGS UNLESS OTHERWISE DIRECTED BY CONTRACT ADMINISTRATOR.
7. IN DRIVEWAYS, INSPECTION CHAMBER IS TO BE INSTALLED WITH BROOKS BOX. BROOKS BOX WITH METAL LID IS TO BE INSTALLED PARALLEL TO THE DIRECTION OF THE FLOW.



PLOTTED: 13-Jul-20

STORM SEWER SERVICE CONNECTION

DATE: JULY/2020
DRAWN: REY
SCALE: N.T.S.

DRAWING NUMBER:
COQ-S8A

NOTE:
BACKFILL TO BE DRAIN ROCK
IF BOTTOMLESS TYPE 1 IS
SPECIFIED OR AS DIRECTED BY
CONTRACTR ADMINISTRATOR.

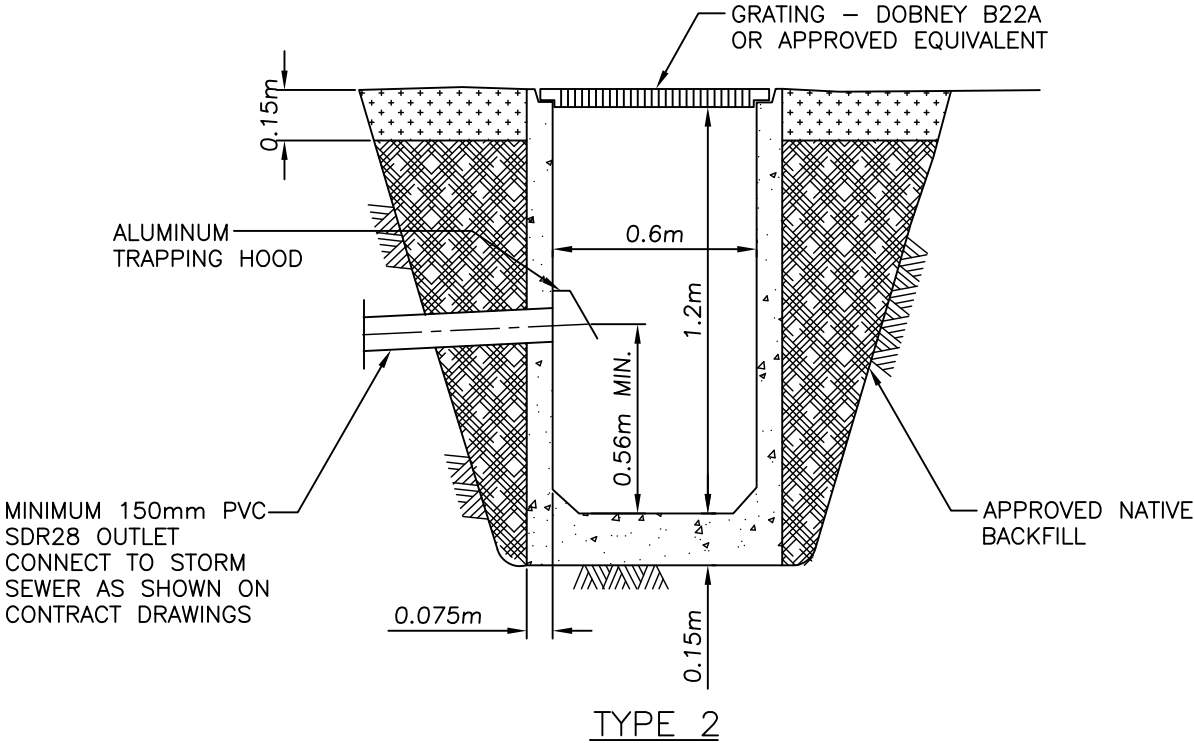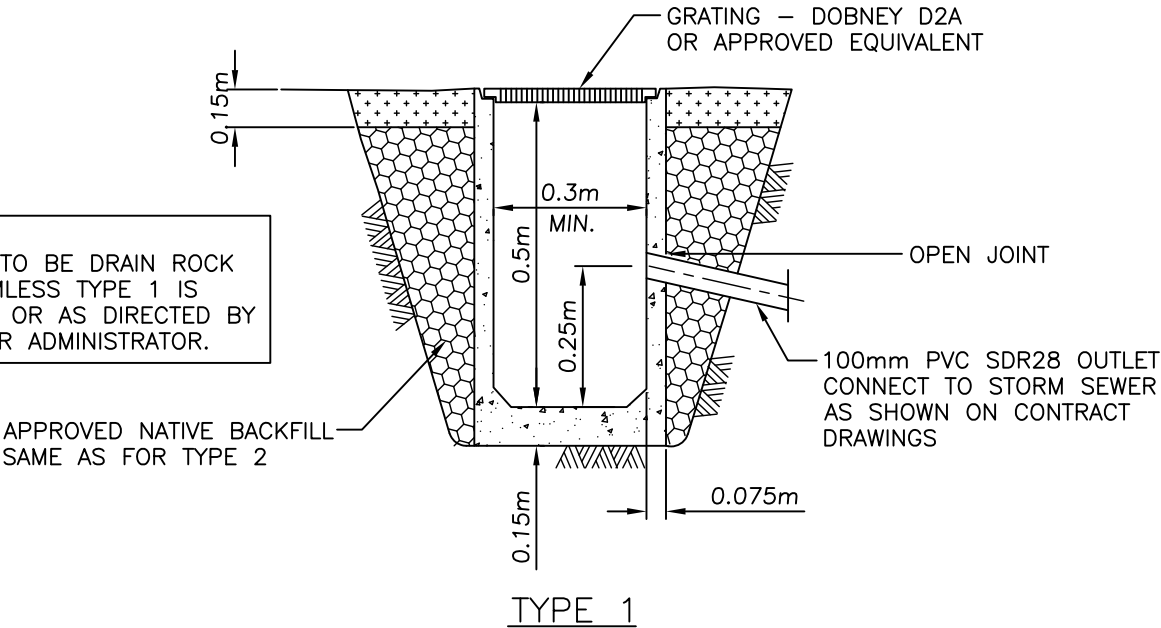


NOTE:
1. REFER TO CONTRACT DRAWINGS, SECTION 33 44 01 FOR DETAILED SPECIFICATIONS.

PLOTTED: 13-Jul-20

LAWN DRAINS

DATE:	JULY/2020
DRAWN:	REY
SCALE:	N.T.S.

DRAWING NUMBER:
COQ-S12A

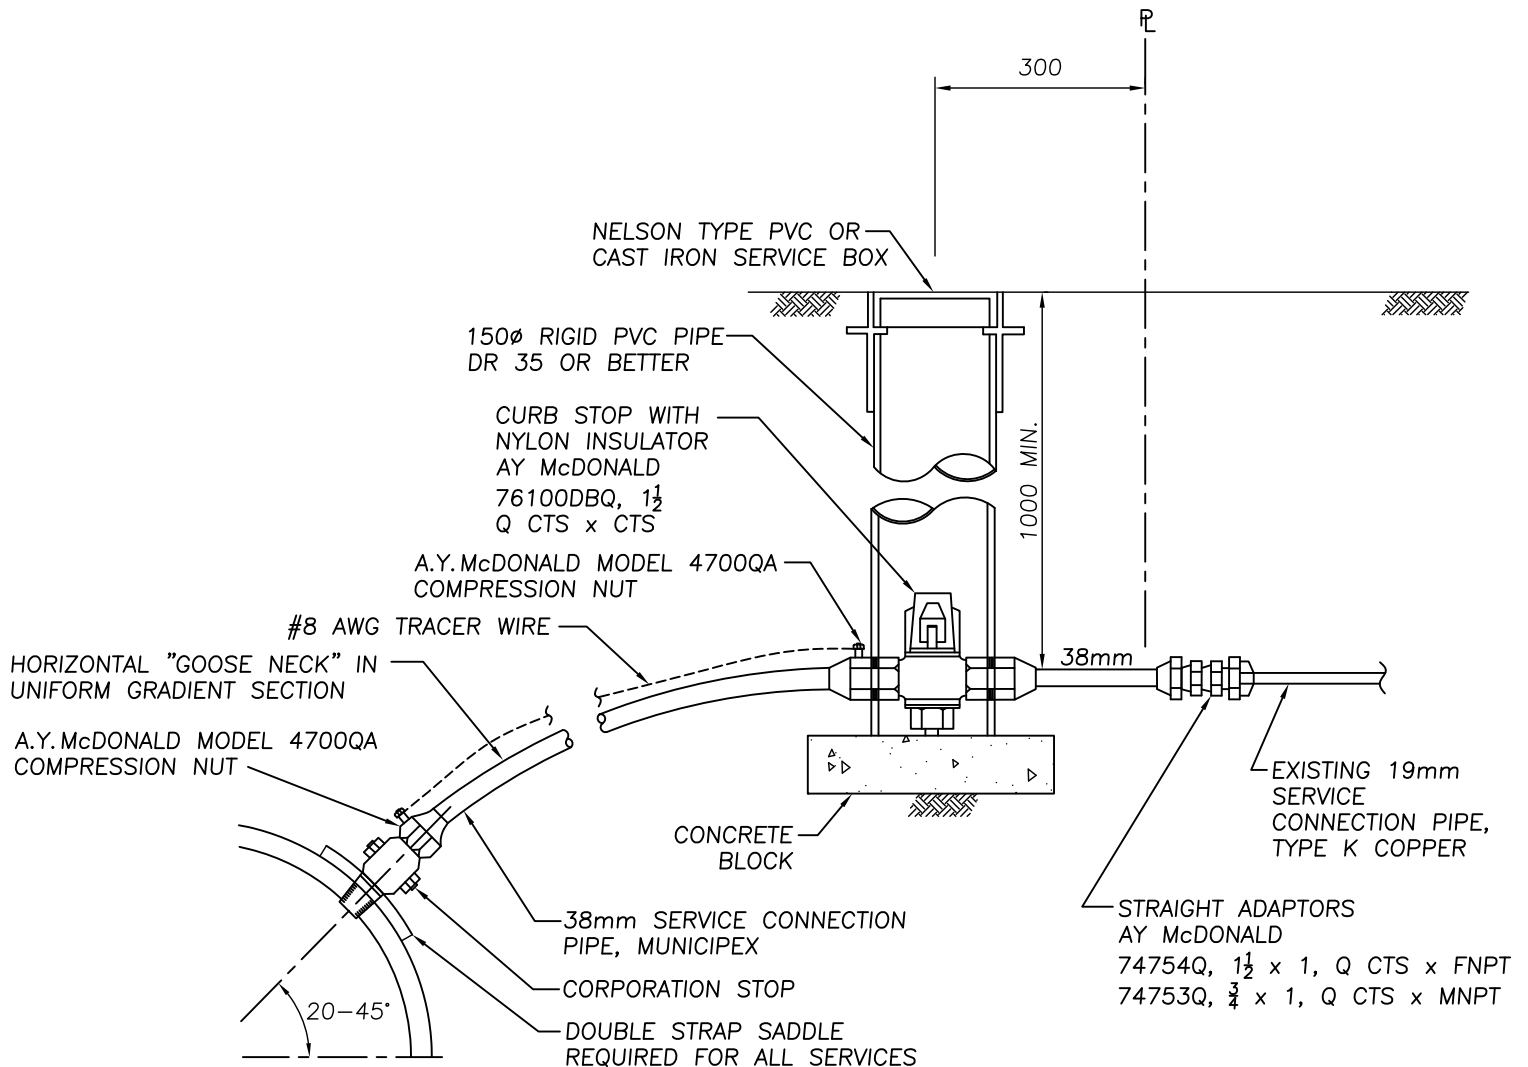

NOTE:

1. THIS DETAIL FOR SERVICES 38mm ONLY.
2. SERVICE SADDLES TO SECTION 33 11 01.
3. INSTALL #8 AWG TRACER WIRE FROM CORPORATION STOP TO CURB STOP.
4. NYLON INSULATOR ON CURB STOP SHALL BE INSTALLED ON THE PROPERTY SIDE OF VALVE.
5. WHEN CURB STOP INSTALLED IN DRIVEWAY A CAST IRON VALVE BOX MUST BE USED.
6. CORPORATION STOPS ARE TO BE POSITIONED UPRIGHT TO ALLOW OPERATION FROM THE SURFACE.
7. REFER TO CONTRACT DRAWINGS AND SECTION 33 11 01 FOR DETAILED SPECIFICATIONS.

PLOTTED: 3-Dec-20


WATER SERVICE CONNECTION 38mm TO 19mm DIAMETER

DATE: DECEMBER/2020

DRAWN: REY

SCALE: N.T.S.

DRAWING NUMBER:
COQ-W2d

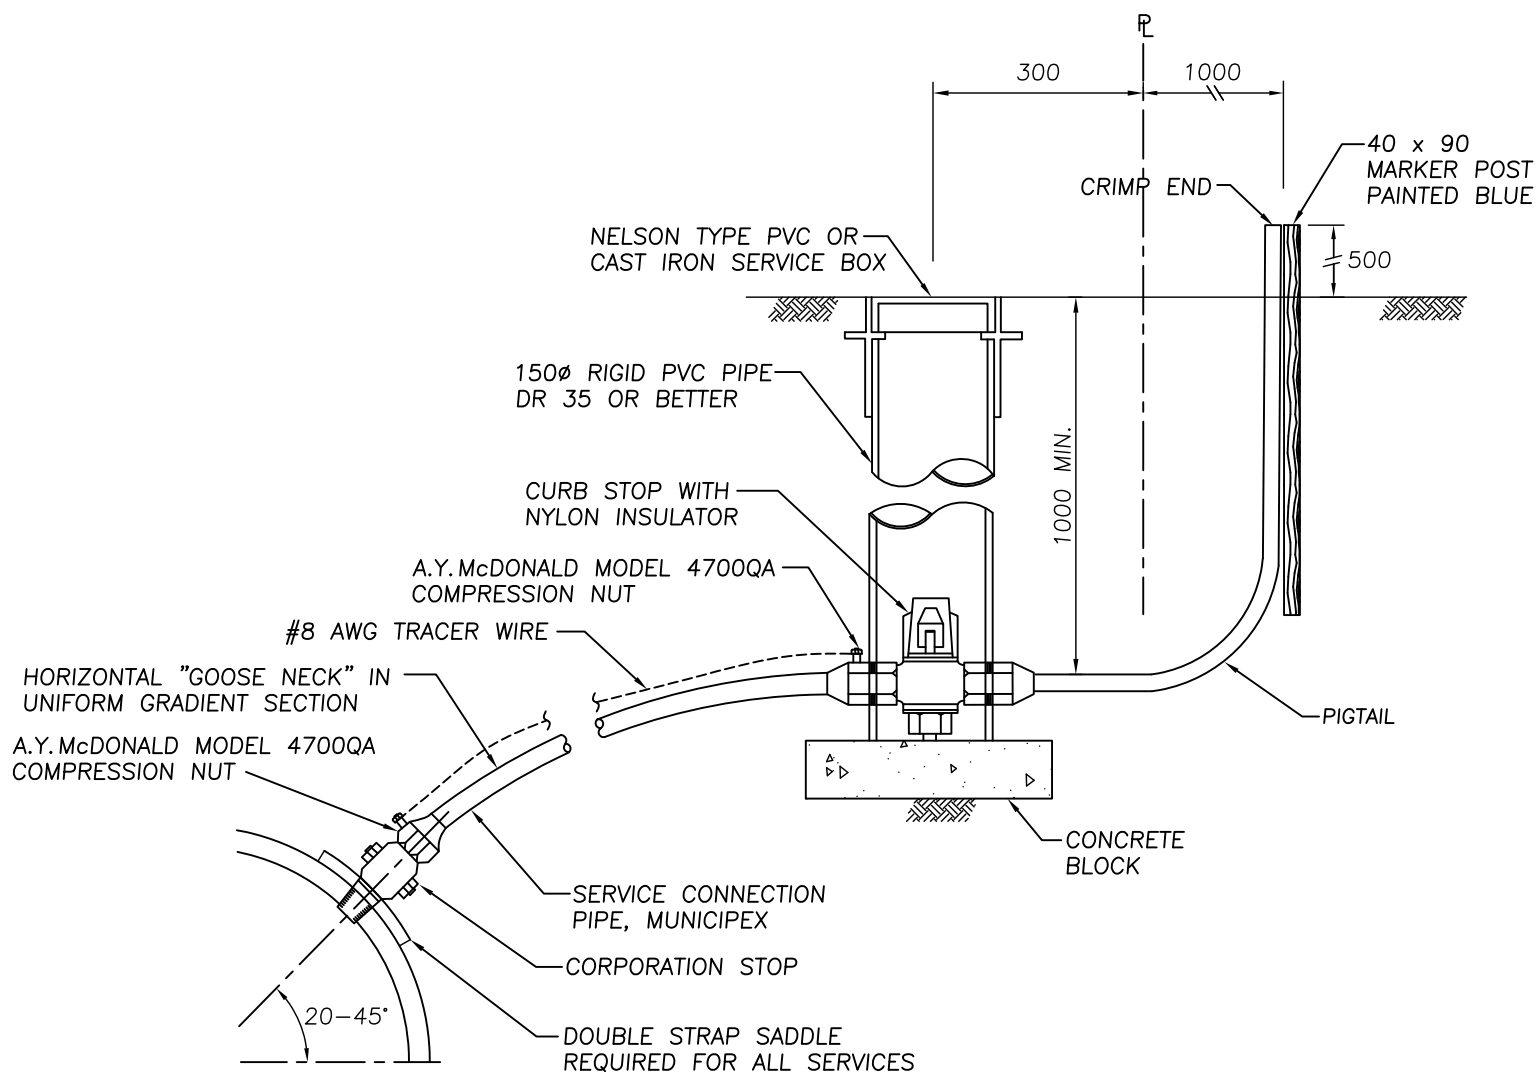

NOTE:

1. THIS DETAIL FOR SERVICES 19 TO 38mm ONLY.
2. SERVICE SADDLES TO SECTION 33 11 01.
3. INSTALL #8 AWG TRACER WIRE FROM CORPORATION STOP TO CURB STOP.
4. NYLON INSULATOR ON CURB STOP SHALL BE INSTALLED ON THE PROPERTY SIDE OF VALVE.
5. WHEN CURB STOP INSTALLED IN DRIVEWAY A CAST IRON VALVE BOX MUST BE USED.
6. CORPORATION STOPS ARE TO BE POSITIONED UPRIGHT TO ALLOW OPERATION FROM THE SURFACE.
7. REFER TO CONTRACT DRAWINGS AND SECTION 33 11 01 FOR DETAILED SPECIFICATIONS.

PLOTTED: 3-Dec-20

WATER SERVICE CONNECTION
19 TO 38mm DIAMETER

DATE: DEC/2020

DRAWN: REY

SCALE: N.T.S.

DRAWING NUMBER:
COQ-W2k

SUBMITTAL DATA SHEET

Service Fitting – 4700QA

CTS Q-Comp Nut with Anode

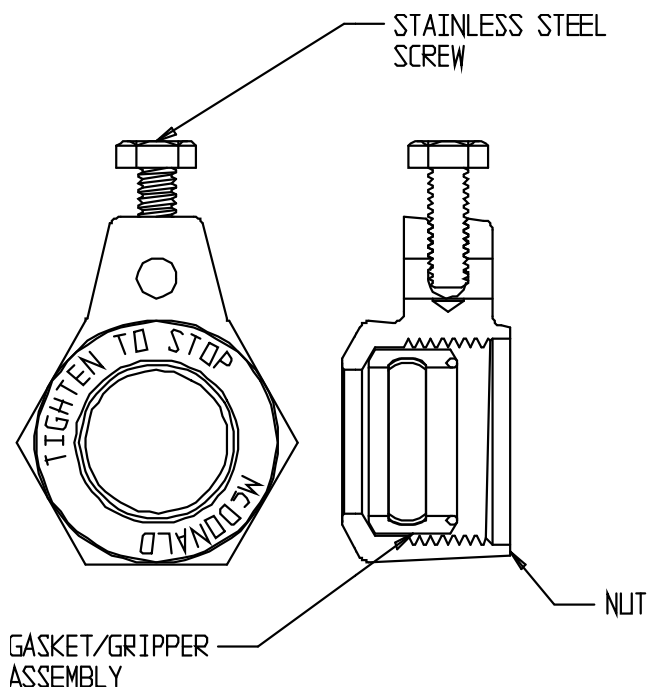


PLATE NO.	SIZE
4700QA 3/4	3/4 CTS
4700QA 1	1 CTS
4700QA 1 1/4	1 1/4 CTS
4700QA-12 1 1/2	1 1/2 CTS
4700QA-12 2	2 CTS
4700QA-16 1 1/2	* 1 1/2 CTS CO
4700QA-16 2	* 2 CTS CO

* NOTE: CORP ASSEMBLY NUTS
MARKED "CO" BY A.Y. McDONALD.

SUBMITTAL INFORMATION

- Manufactured in compliance with ANSI/AWWA C800 (latest revision)
- Brass components conform to ASTM B62 and ASTM B584, UNS C83600 -85-5-5-5 (latest revision)
- Large wrench flats provided for proper installation
- Insert stiffeners required on all flexible plastic connections



A.Y. McDonald Mfg. Co.
P.O. Box 508
Dubuque, IA 52004-508

Toll Free: 1-800-292-2737
Fax: 1-800-832-9296
Hours: 7:00 a.m. – 5:00 p.m., CST


sales@aymcdonald.com
www.aymcdonald.com

A.Y. McDonald considers the information on this assembly drawing correct when published. Item and option availability, including specifications, are subject to change without notice.

Submitted by:

Appendix C - As-Built Records

As-built available at City website, Qmap using Chrome browser:
<http://coquitlam.maps.arcgis.com/apps/webappviewer/index.html?id=2d58aee859754918ae54d30da4bbba49>

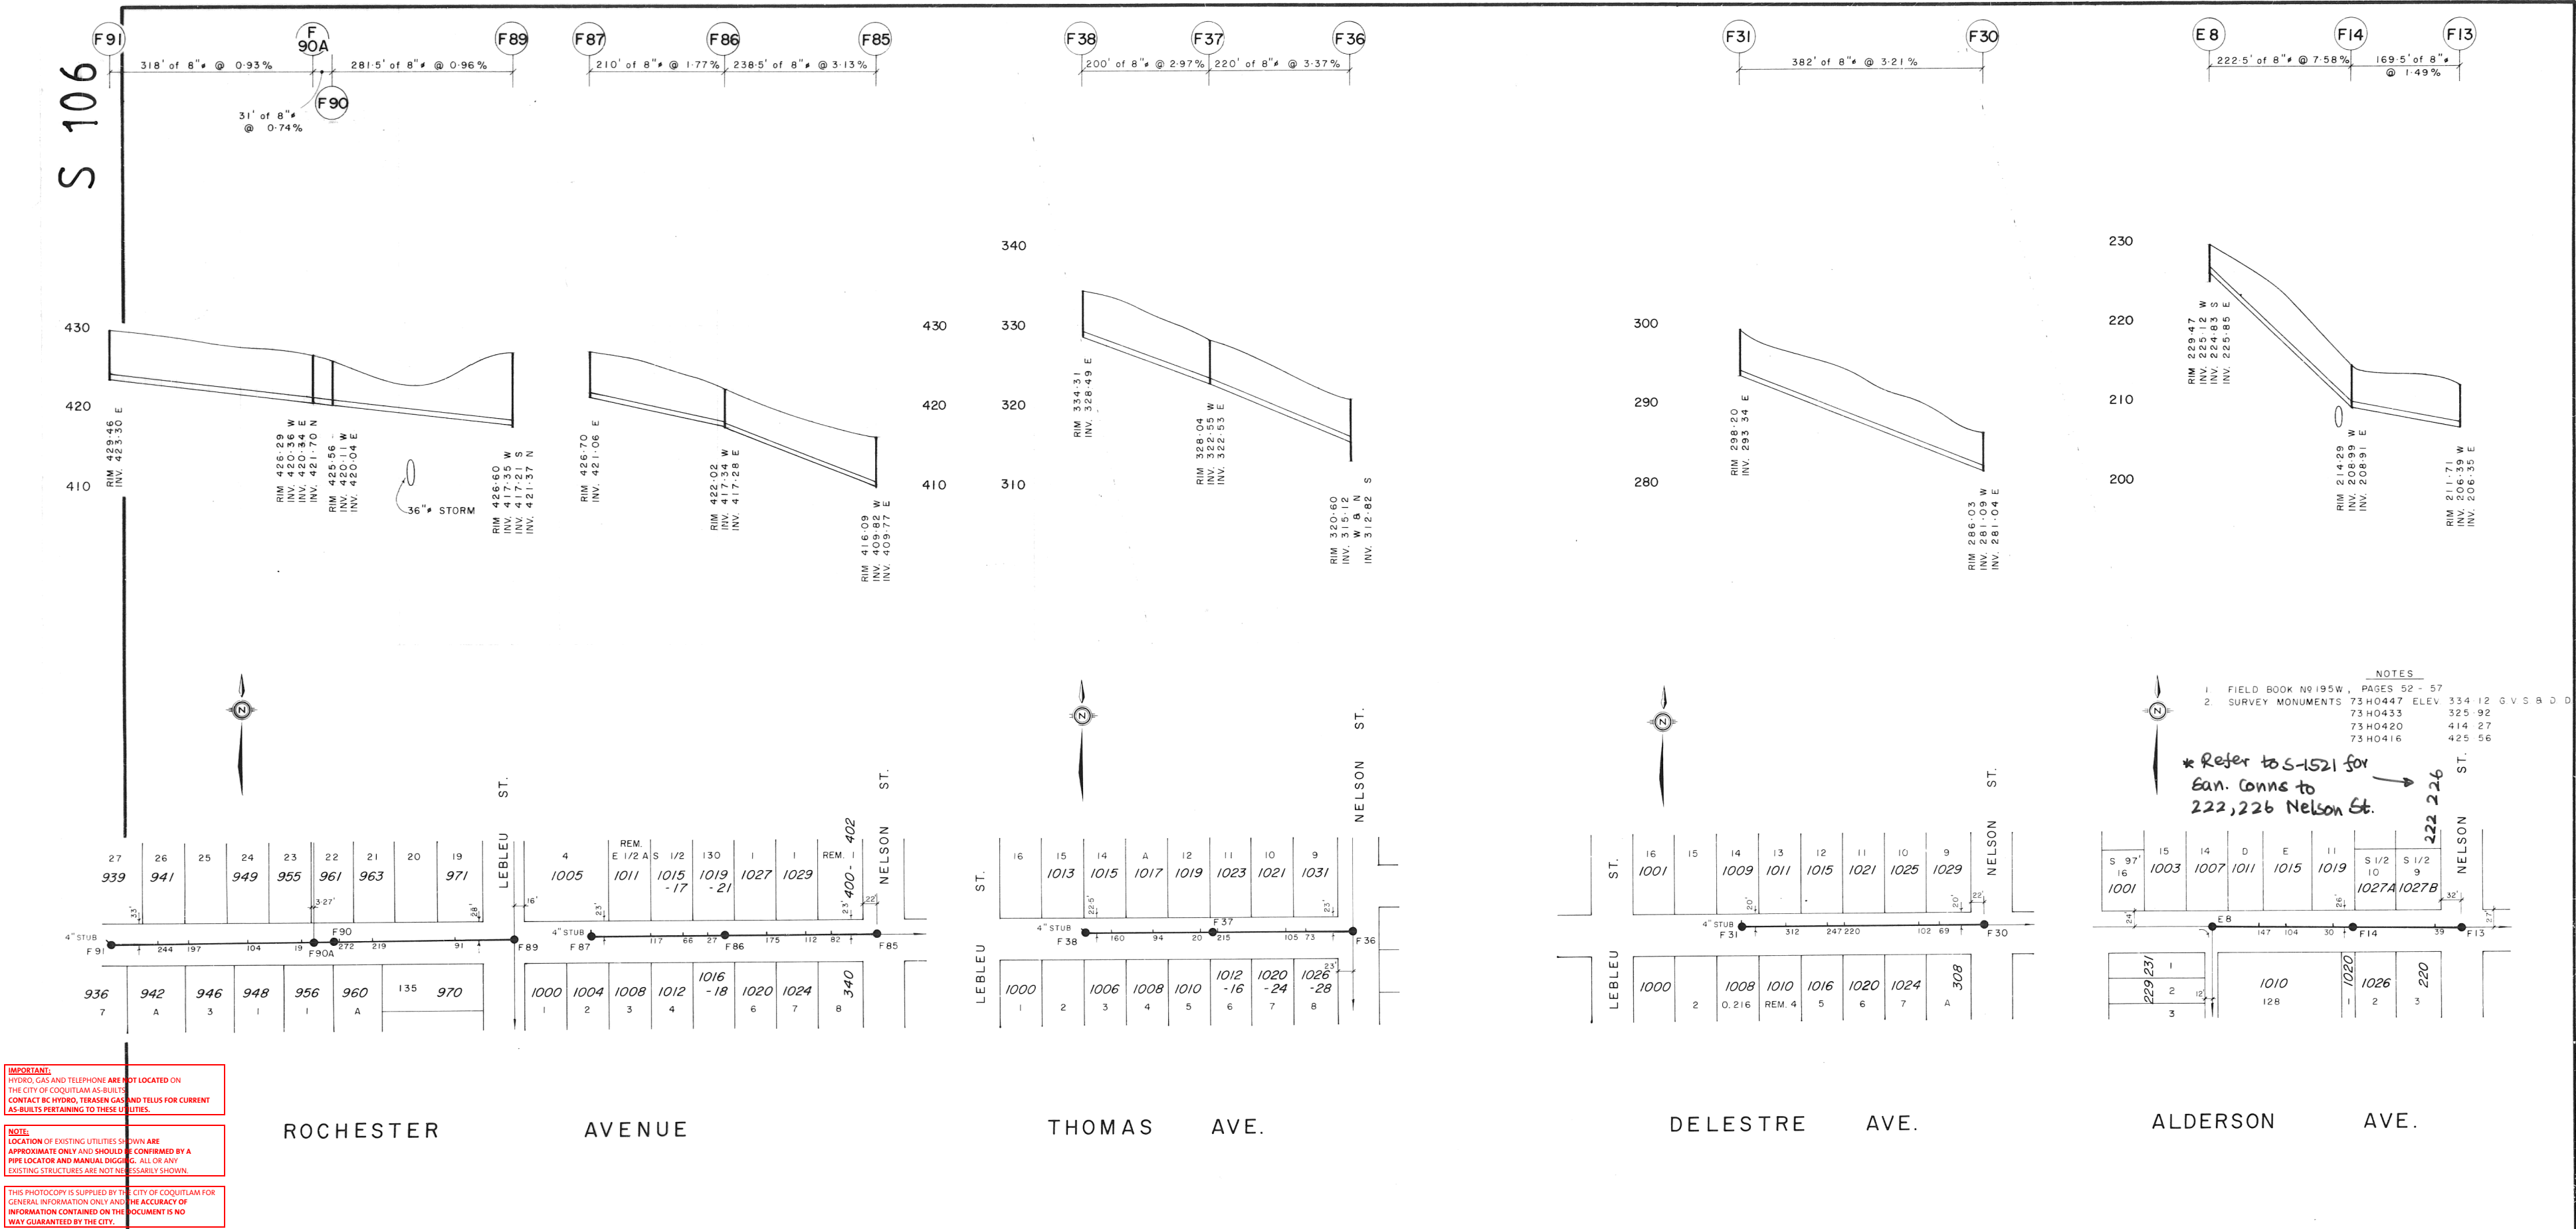

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT LOCATED ON THE CITY OF COQUITLAM AS-BUILT. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NO WAY GUARANTEED BY THE CITY.


					PROPOSED		EXISTING		LEGEND		PROPOSED		EXISTING		DESIGNED - A. E. S. L.		APP'D -		DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT		SANITARY SEWER ROCHESTER, THOMAS, DELESTRE AND ALDERSON RE-SURVEYED 1977, AS CONSTRUCTED		FILE - S - 106 DWG - REF. A. E. S. L. 697 - S - 26 SHEET 1 OF 1	
					ST SEWER - ST		ST		VALVE -		MANHOLE -		DITCH		DRAWN -		DATE -							
					SAN SEWER - SAN		SAN						UTILITY POLE											
					GAS - G		G						FIRE HYDRANT											
					WATER - W		W		STORM INLET TYPES						IRON PN									
RE-DRAWN AS BUILT BY DIST. OF COQUITLAM					U/G ELEC. - BCH		BCH		I -		II -		III -		IV -		BASEMENT ELEV.		SCALE					
REVISION					U/G TEL. - BCT		BCT										EDGE OF PVMT.		HORIZ - 1" = 100'					
																	VERT. - 1" = 8'							



NOTES				
1. FIELD BOOKS 195W	PAGES	12, 31, 50 - 53.		
	195X	1 & 4.		
2. SURVEY MONUMENTS	73 H0420	ELEV. 414-23	G. V. S. & D. D.	
	73 H0433	325-92		
	73 H0443	252.49		
	73 H0448	154-64		

				<div>ST SEWER — PROPOSED — ST</div> <div>SAN SEWER — SAN</div> <div>GAS — G</div> <div>WATER — W</div> <div>UG ELEC. — BCH</div> <div>UG TEL. — BCT</div>				<div>EXISTING — ST</div> <div>SAN</div> <div>G</div> <div>W</div> <div>BCH</div> <div>BCT</div>				<div>LEGEND</div> <div>PROPOSED</div> <div>EXISTING</div> <div>VALVE —</div> <div>MAN-HOLE —</div> <div>STORM INLET TYPES</div> <div>I — II — III — IV —</div> <div>DITCH</div> <div>UTILITY POLE</div> <div>FIRE HYDRANT</div> <div>IRON PIN</div> <div>BASEMENT ELEV.</div> <div>EDGE OF PVMT</div> <div>LL RT</div>				<div>DESIGNED - A. E. S. L.</div> <div>DRAWN -</div> <div>CHECKED -</div> <div>DATE - 1961</div>				<div>APP'D -</div> <div>DATE -</div> <div>SCALE</div> <div>HORIZ - 1" = 100'</div> <div>VERT. - 1" = 8'</div>				<div>DISTRICT OF COQUITLAM</div> <div>ENGINEERING DEPARTMENT</div>				<div>SANITARY SEWER</div> <div>QUADLING AND NELSON</div> <div>RE-SURVEYED 1979, AS CONSTRUCTED</div>				<div>FILE - S - 107</div> <div>DWG - REF. A. E. S. L. 697-S-27</div> <div>SHEET 1 OF 1</div>			
RE-DRAWN AS BUILT BY DIST. OF COQUITLAM				I	80-08	R.W.	CO																												
REVISION				NR	DATE	BY	CHKD																												

S 108

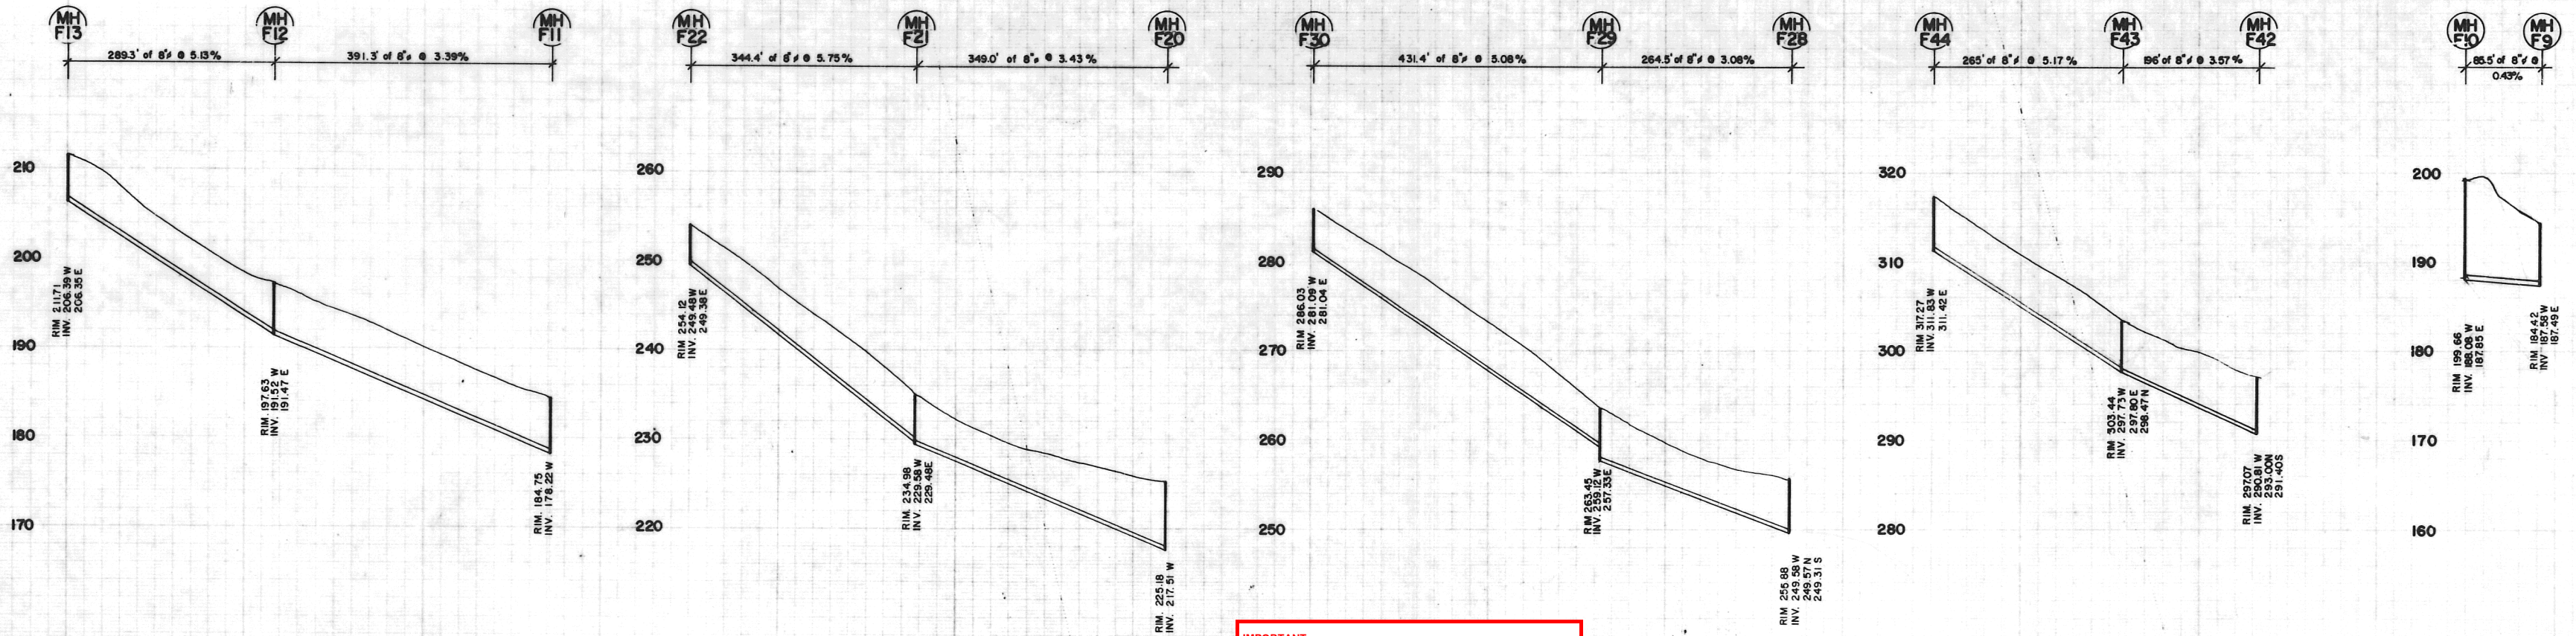

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.


NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

NOTE
FIELD BOOK REFERENCE - BK NO 195

* Refer to S-1521 for San. Conn to 222, 226 Nelson St.
* REFER TO S-1246 FOR SAN. CONN. TO 1065 ALDERSON AVE.

See S-109

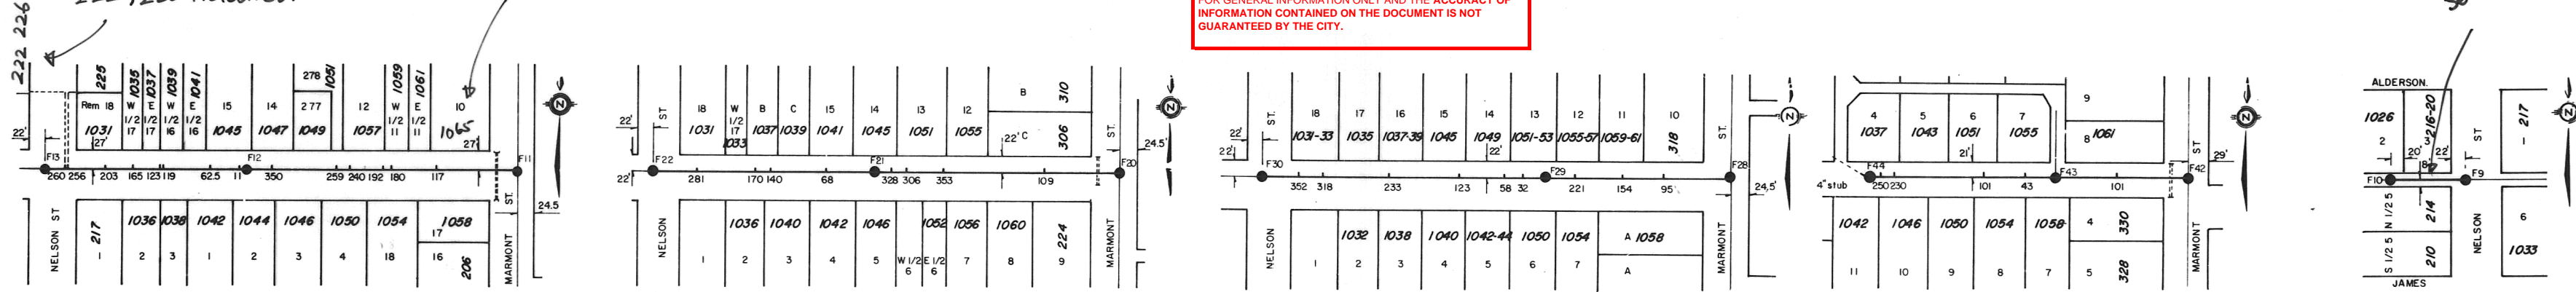


ALDERSON AVENUE

QUADLING AVENUE


DELESTRE AVENUE

THOMAS AVENUE


REVISION NR DATE BY CHK'D				LEGEND PROPOSED EXISTING ST SEWER - ST - ST SAN SEWER - SAN - SAN GAS - G - G WATER - W - W U/G ELEC - BCH - BCH U/G TEL - BCT - BCT VALVE - V - V MANHOLE - M - M STORM INLET TYPES I - I II - II III - III IV - IV DITCH - D - D UTILITY POLE - U - U FIRE HYDRANT - F - F IRON PIN - P - P BASEMENT ELEV. - B - B EDGE OF P.V.M.T. - E - E				DESIGNED - AESL 1960 DRAWN - E.W.H. CHECKED - <i>[Signature]</i> DATE - AUG. 1978		APP'D - DATE - SCALE - HORIZ - 1"=100' VERT - 1"=8'		DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT		SANITARY SEWERS ALDERSON AVE, QUADLING, DELESTRE AVE, THOMAS LANE N. of JAMES, W. of NELSON RE-SURVEYED 1976. AS CONSTRUCTED		FILE - S-108 DWG - DWG. REF. 697-S-28 SHEET OF	
-------------------------------------	--	--	--	---	--	--	--	--	--	--	--	---	--	--	--	--	--

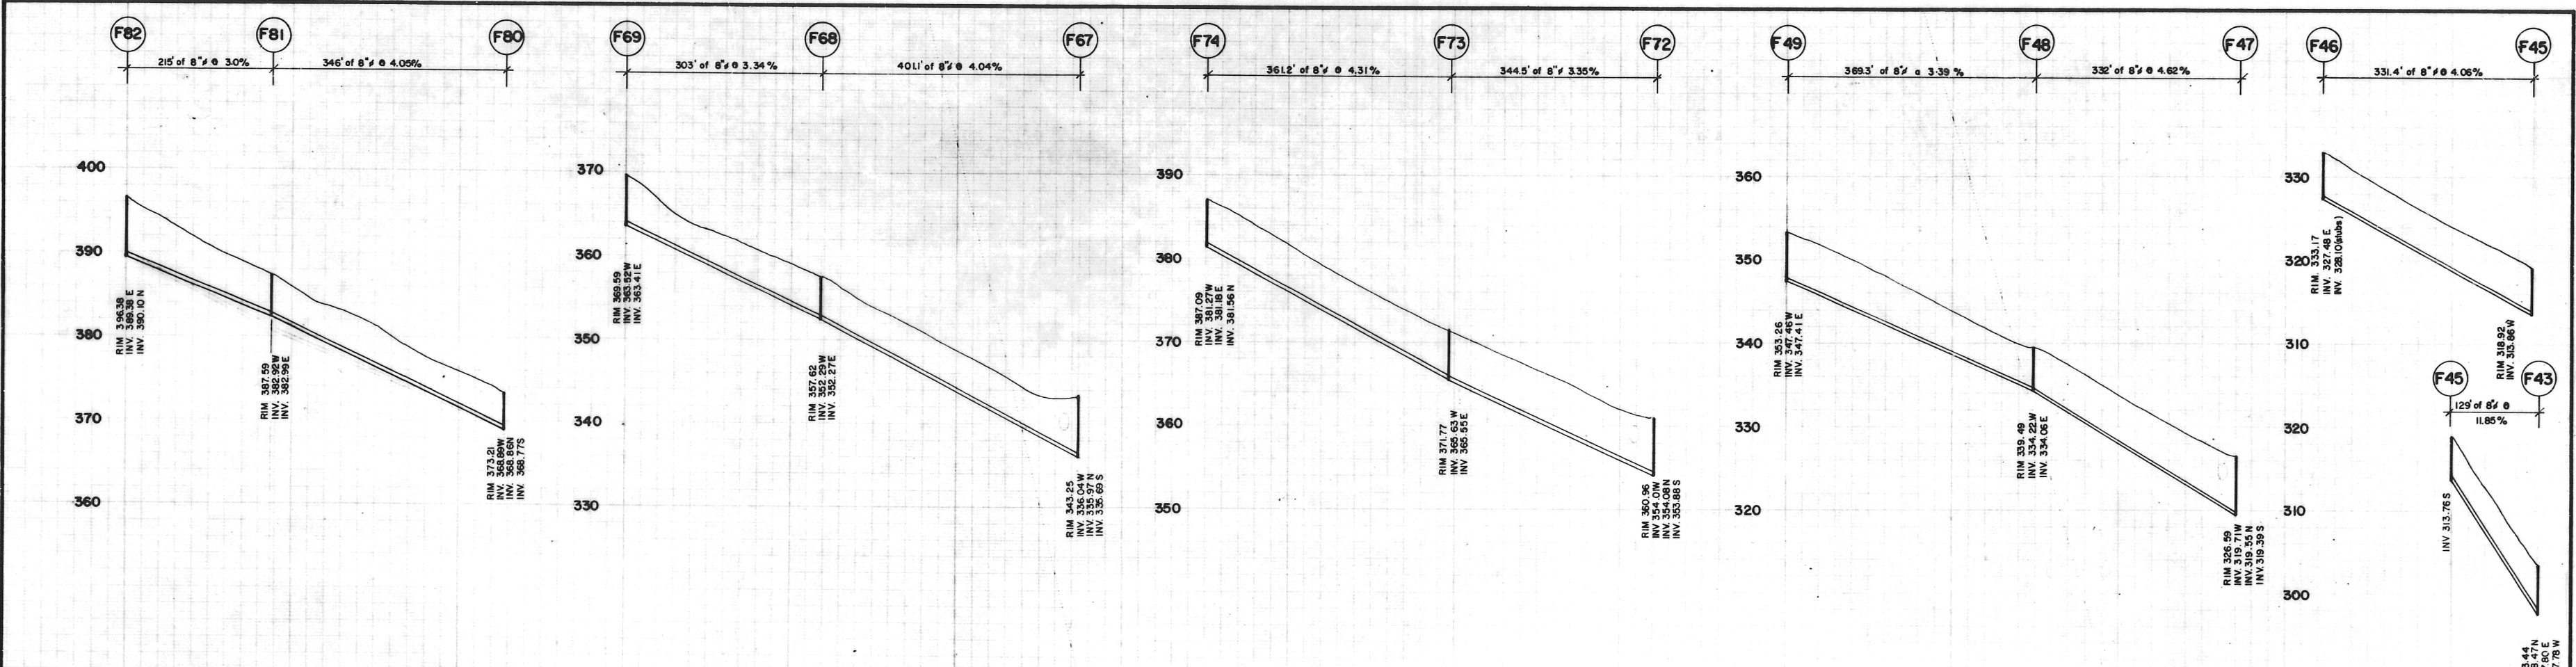


NOTES
FIELD BOOK NO 195 T & 195 W

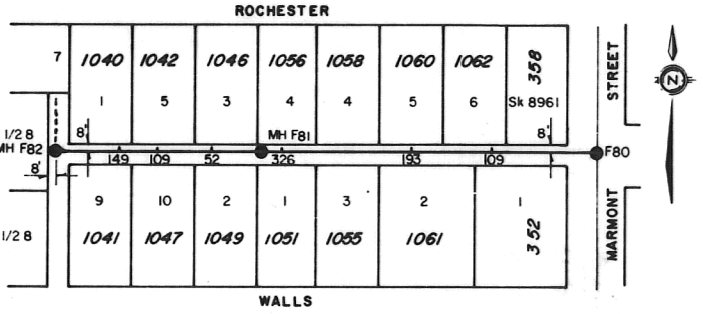


LANE N. of WALLS

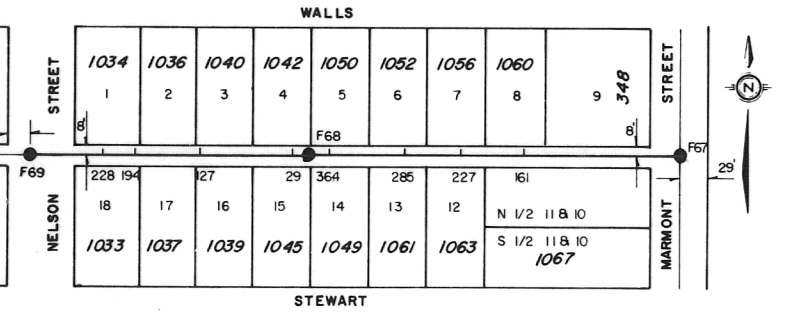


LANE N. of STEWART

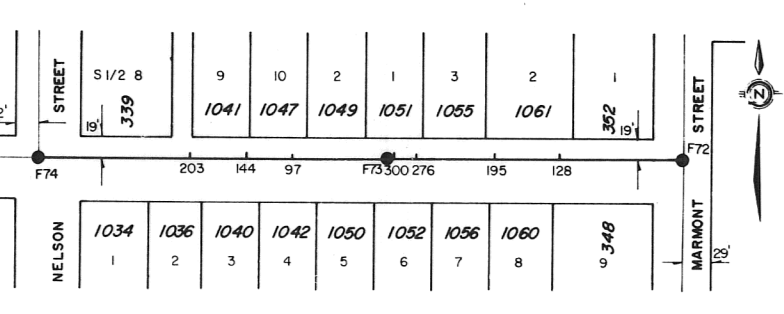

WALLS STREET

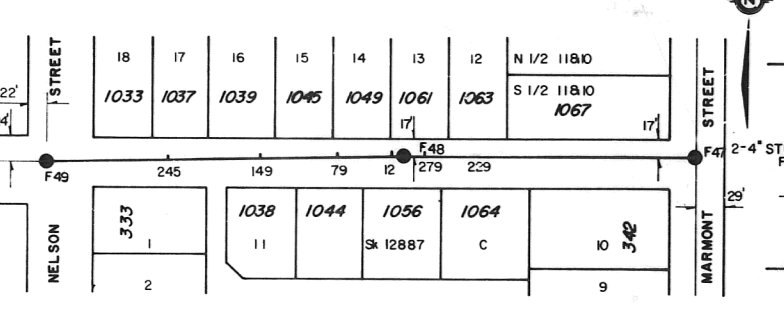

STEWART STREET

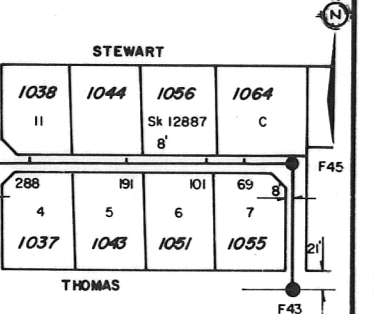

LANE N. of THOMAS

REVISION				DESIGNED - AESL	APP'D -	DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT	SANITARY SEWER WALLS ST; STEWART ST. LANES of WALLS; STEWART & THOMAS RE-SURVEYED 1978, AS CONSTRUCTED	FILE - S-110
				DRAWN - W.H.	DATE -			DWG -
				CHECKED -	SCALE HORIZ - 1" = 100' VERT - 1" = 8'			SHEET 1 OF 1
				DATE - JULY 1978				


LEGEND

PROPOSED	EXISTING
ST SEWER - ST	ST SEWER - ST
SAN SEWER - SAN	SAN SEWER - SAN
GAS - G	GAS - G
WATER - W	WATER - W
UG ELEC - BCH	UG ELEC - BCH
UG TEL - BCT	UG TEL - BCT

STORM INLET TYPES



I	II	III	IV
---	----	-----	----

DITCH -
UTILITY POLE -
FIRE HYDRANT -
IRON PIN -
BASEMENT ELEV. -
EDGE OF P.V.M.T. -

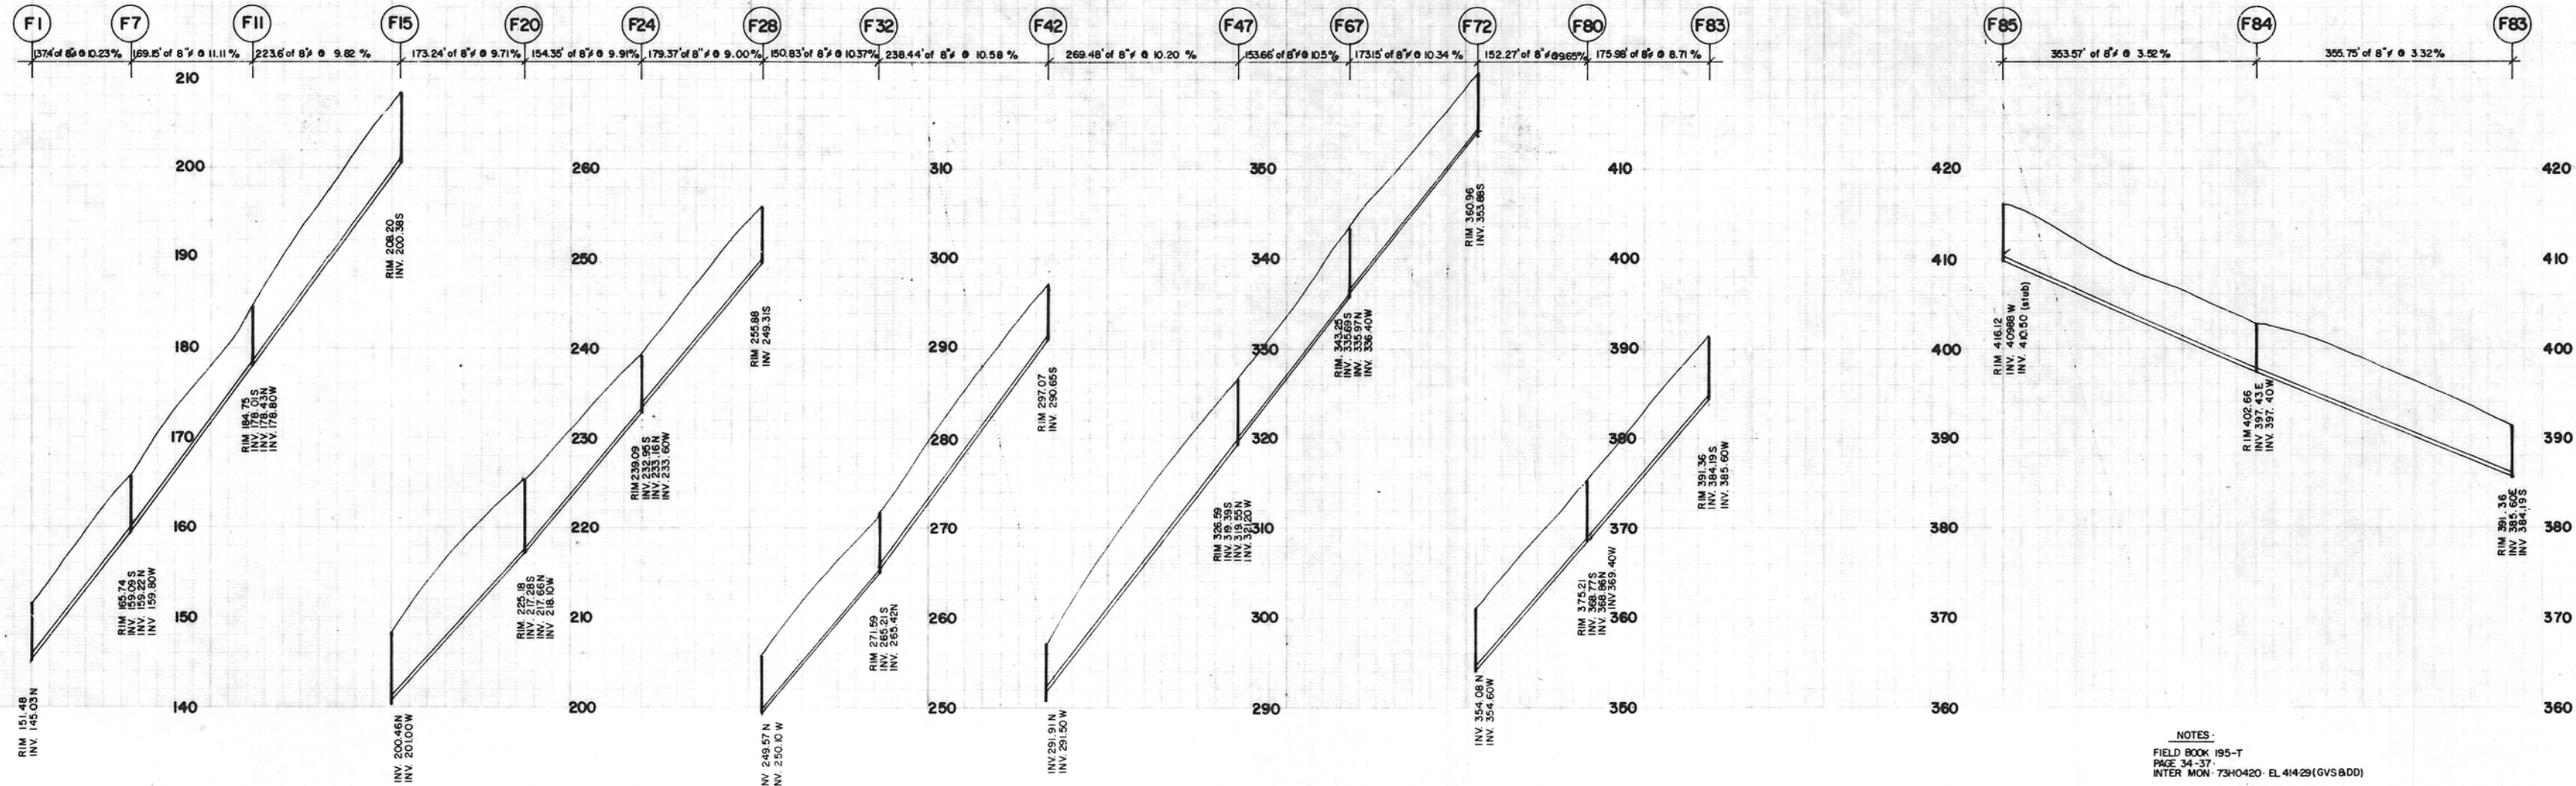

NOTES:
FIELD BOOK 195-T
PAGE 34-37
INTER MON. 73H0420 - EL 414.29 (GVS 800)

* REFER TO S-1246 SAN. CONNS TO
212 & 218 MARMONT ST

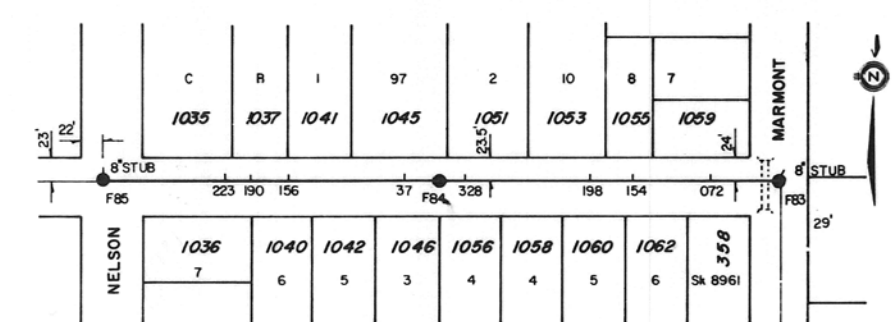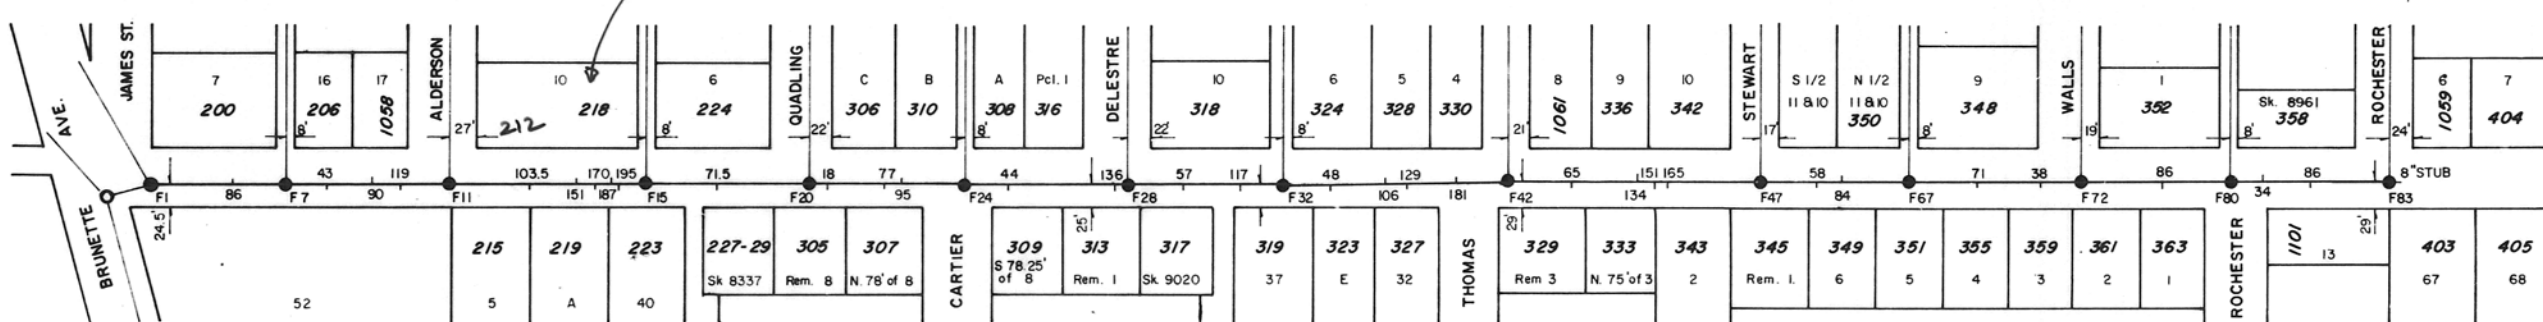

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

REVISION				
Nº	DATE	BY	CHKD	

PROPOSED	EXISTING	LEGEND	PROPOSED	EXISTING
ST SEWER - ST	ST	VALVE -		
SAN SEWER - SAN	SAN	MANHOLE -		
GAS - G	G			
WATER - W	W			
U/G ELEC - BCH	BCH	STORM INLET TYPES	I -	II -
U/G TEL - BCT	BCT		III -	IV -


DITCH -	
UTILITY POLE -	
FIRE HYDRANT -	
IRON PIN -	
BASEMENT ELEV -	
EDGE OF P.V.M.T. -	

DESIGNED - A.E.S.L.	APP'D -
DRAWN - E.W.H. DofC.	DATE -
CHECKED -	SCALE
DATE - JULY 1978	HORIZ - 1" = 100'
	VERT. - 1" = 8'





DISTRICT OF COQUITLAM
ENGINEERING DEPARTMENT

SANITARY SEWERS
MARMONT STREET; ROCHESTER AVENUE
RE-SURVEYED 1977 AS CONSTRUCTED


FILE - S-111
DWG - REF. DWG. A.E.S.L. 697-S-31
SHEET 1 OF 1

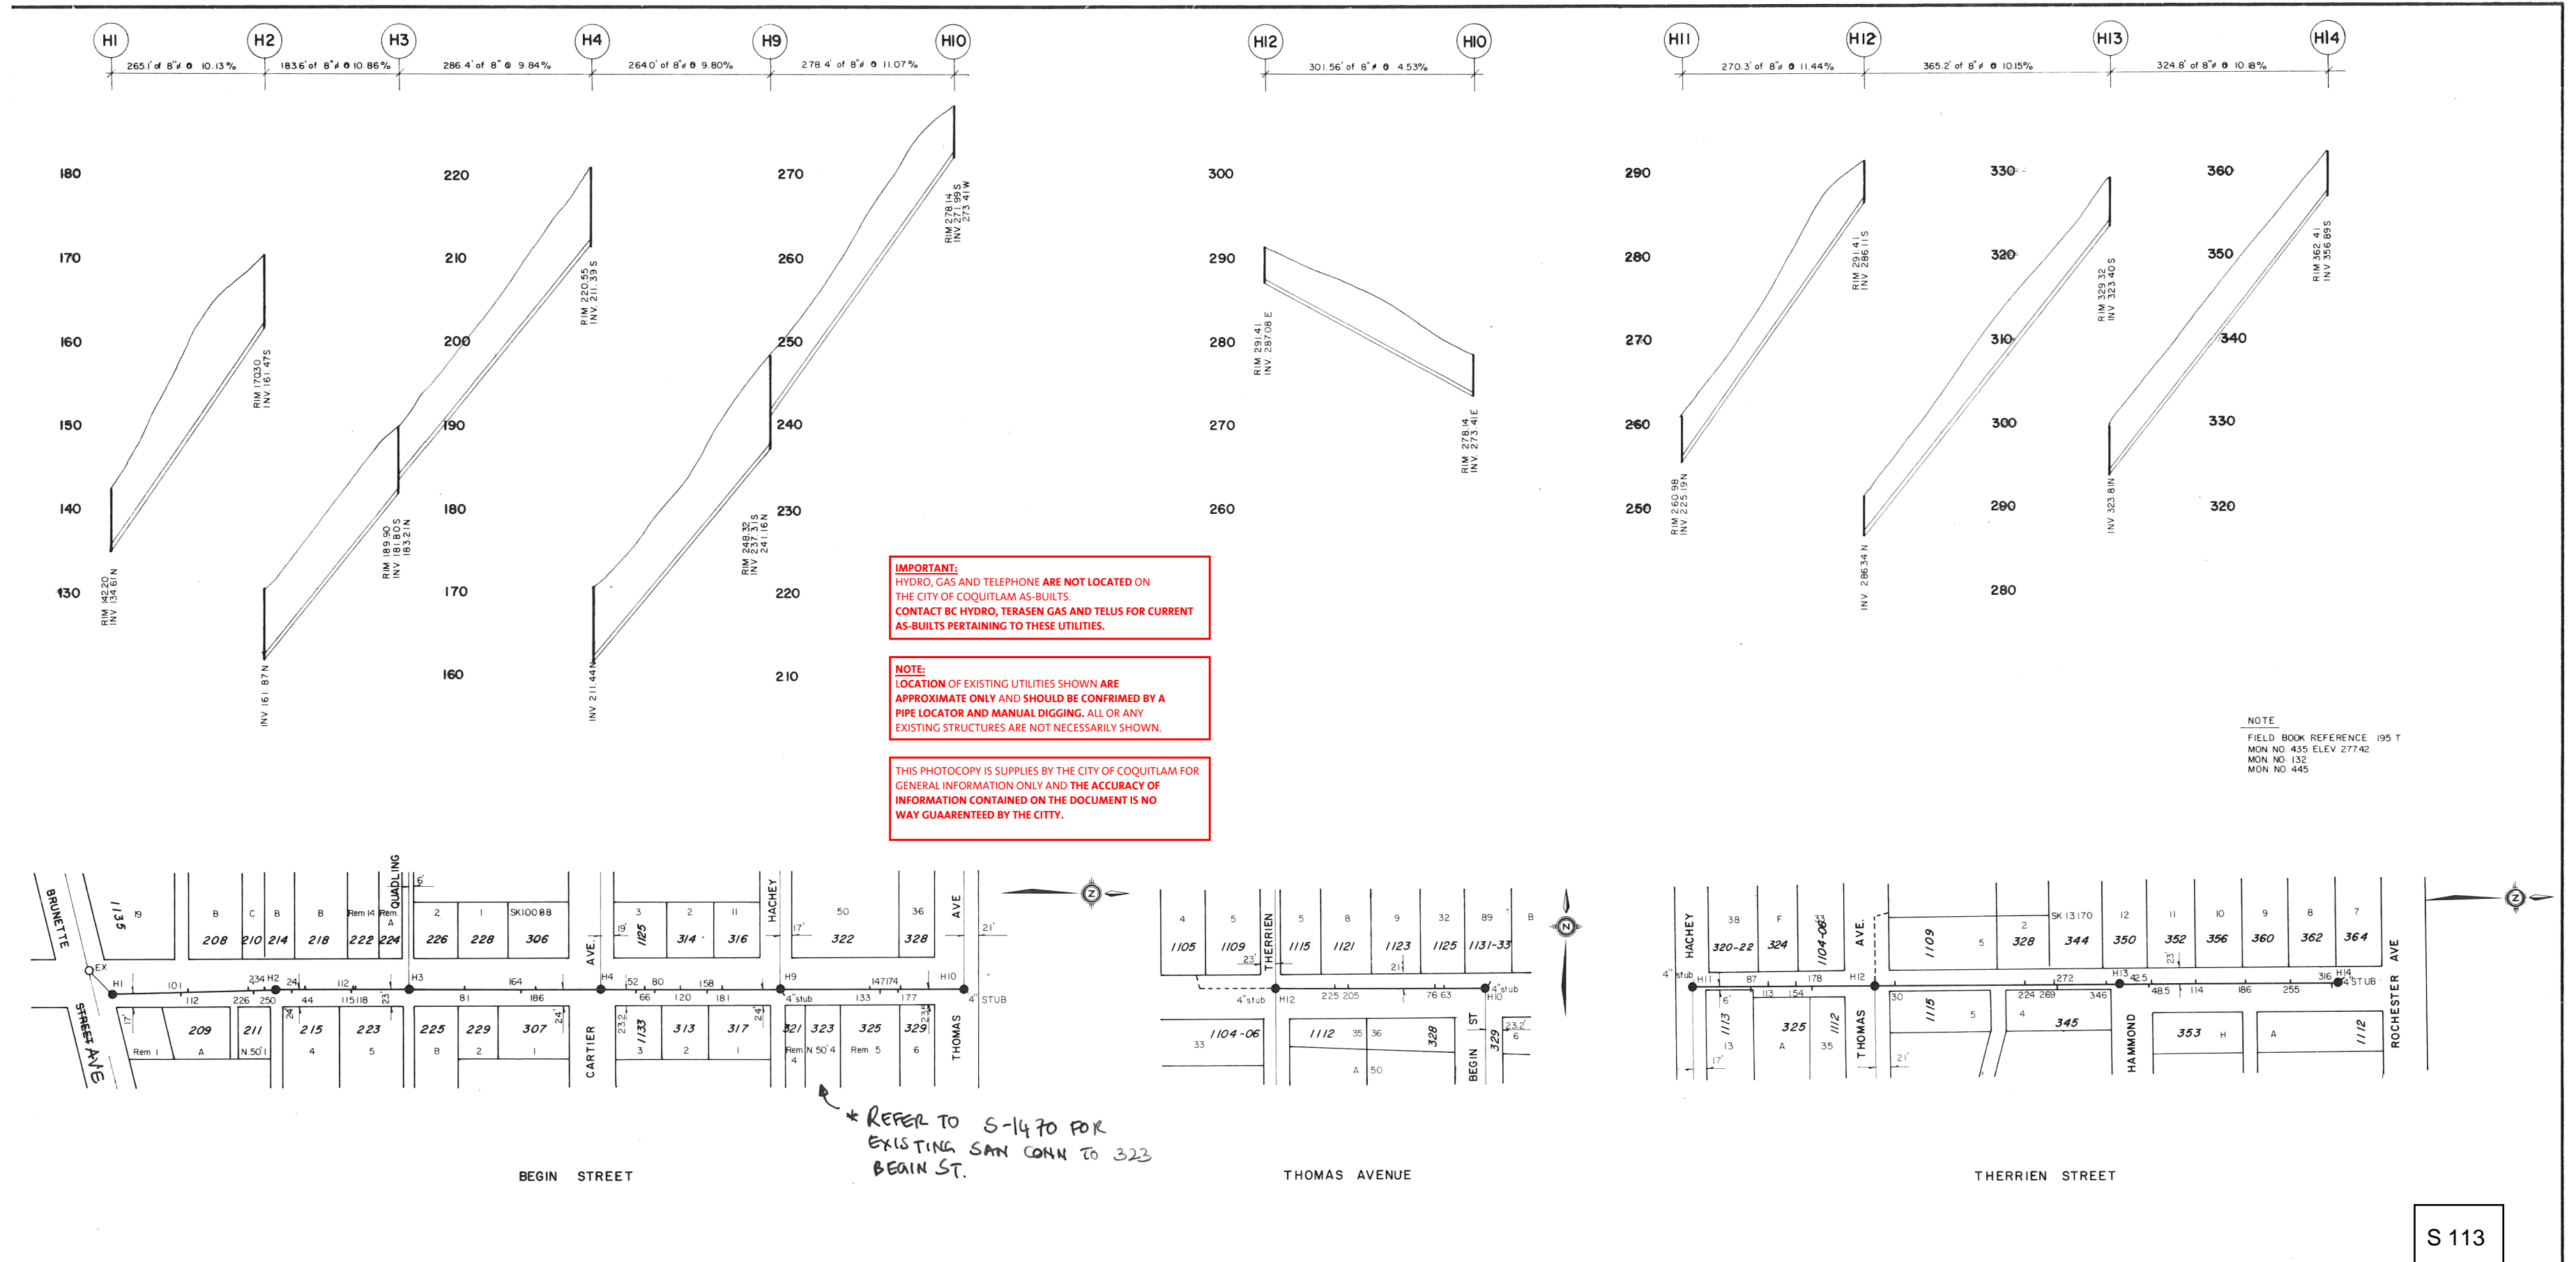

					PROPOSED ST SEWER — ST — SAN SEWER — SAN — GAS — G — WATER — W — U/G ELEC — BCH — U/G TEL — BCT —		EXISTING ST — ST — SAN — SAN — G — G — W — W — BCH — BCH — BCT — BCT —		LEGEND PROPOSED VALVE — MANHOLE — EXISTING VALVE — MANHOLE — STORM INLET TYPES I — II — III — IV —		DITCH — UTILITY POLE — FIRE HYDRANT — IRON PIN — BASEMENT ELEV. — EDGE OF PAVT. —		DESIGNED - A.E.S.L. 1960 DRAWN - W.H. CHECKED - <i>g</i> DATE - SEPT. 1978		APP'D - DATE - SCALE: HORIZ. 1" = 100' VERT. 1" = 8'		DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT		SANITARY SEWERS BEGIN ST., THOMAS AVE., THERRIEN ST. RE-SURVEYED 1976; AS CONSTRUCTED		FILE - S-113 DWG - DWG REF A.E.S.L. 697-S-33 SHEET OF	
--	--	--	--	--	--	--	---	--	--	--	--	--	---	--	---	--	---	--	---	--	---	--

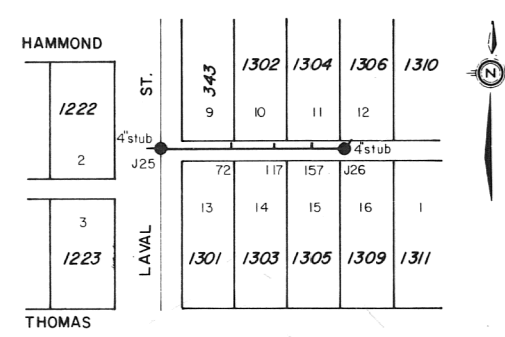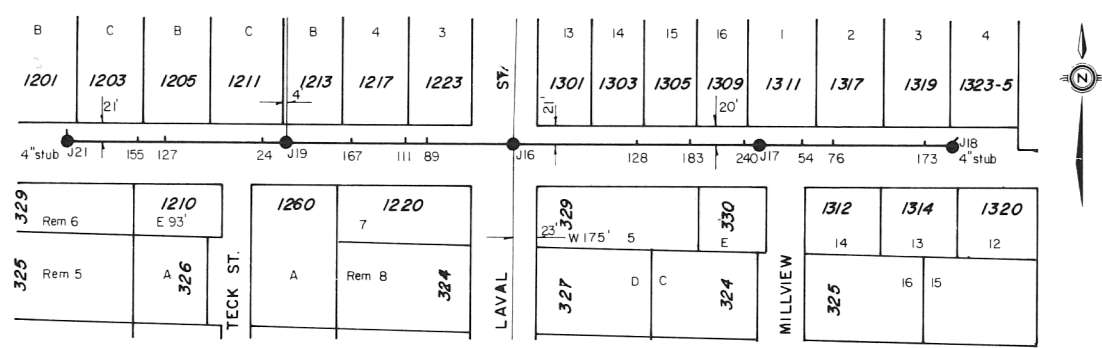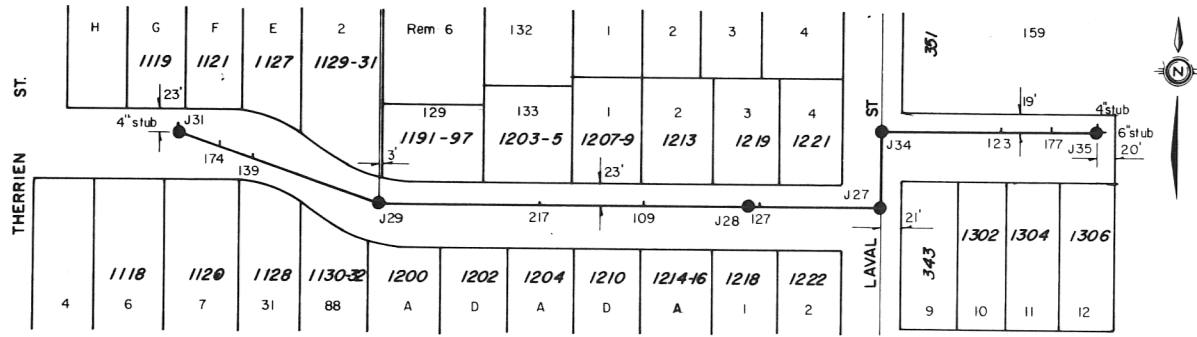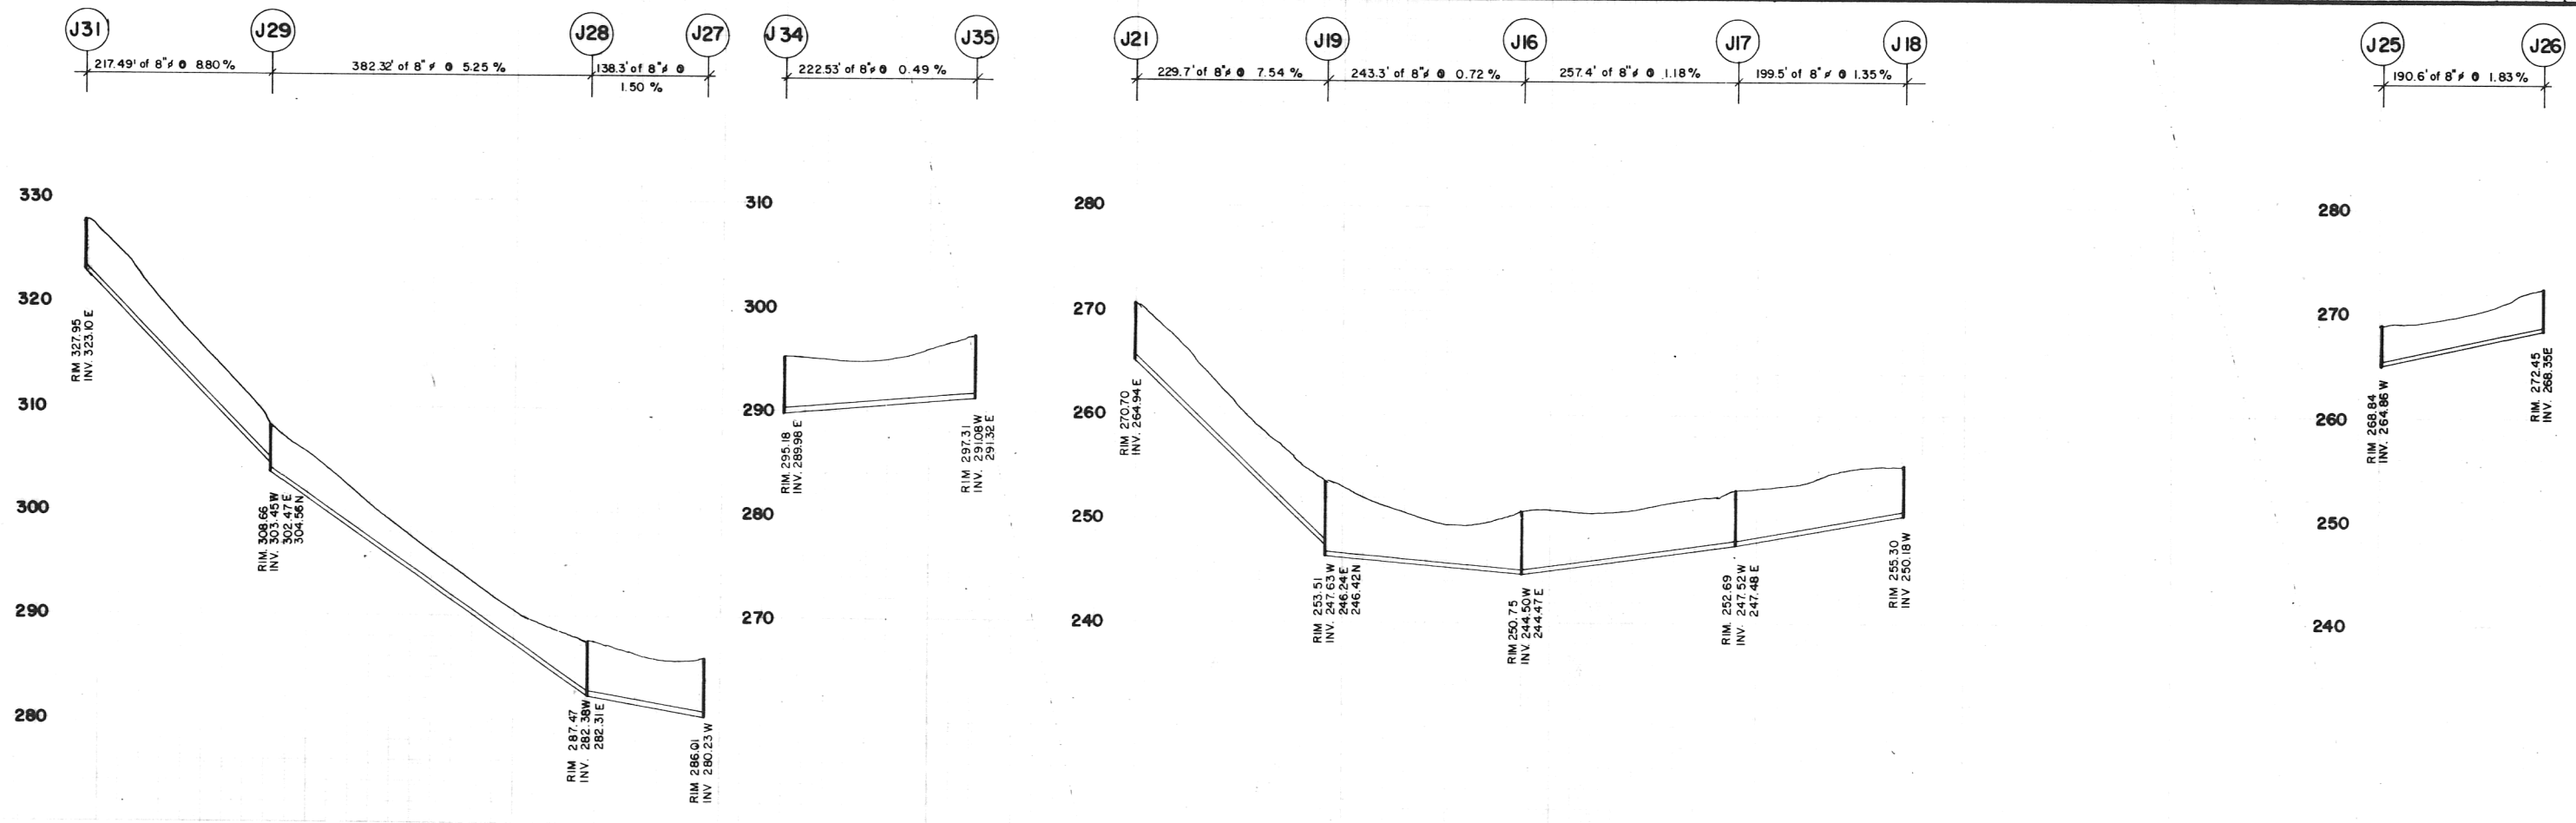



NOTE
FIELD BOOK REFERENCE
MON. NO. 422 ELEV. 343.18

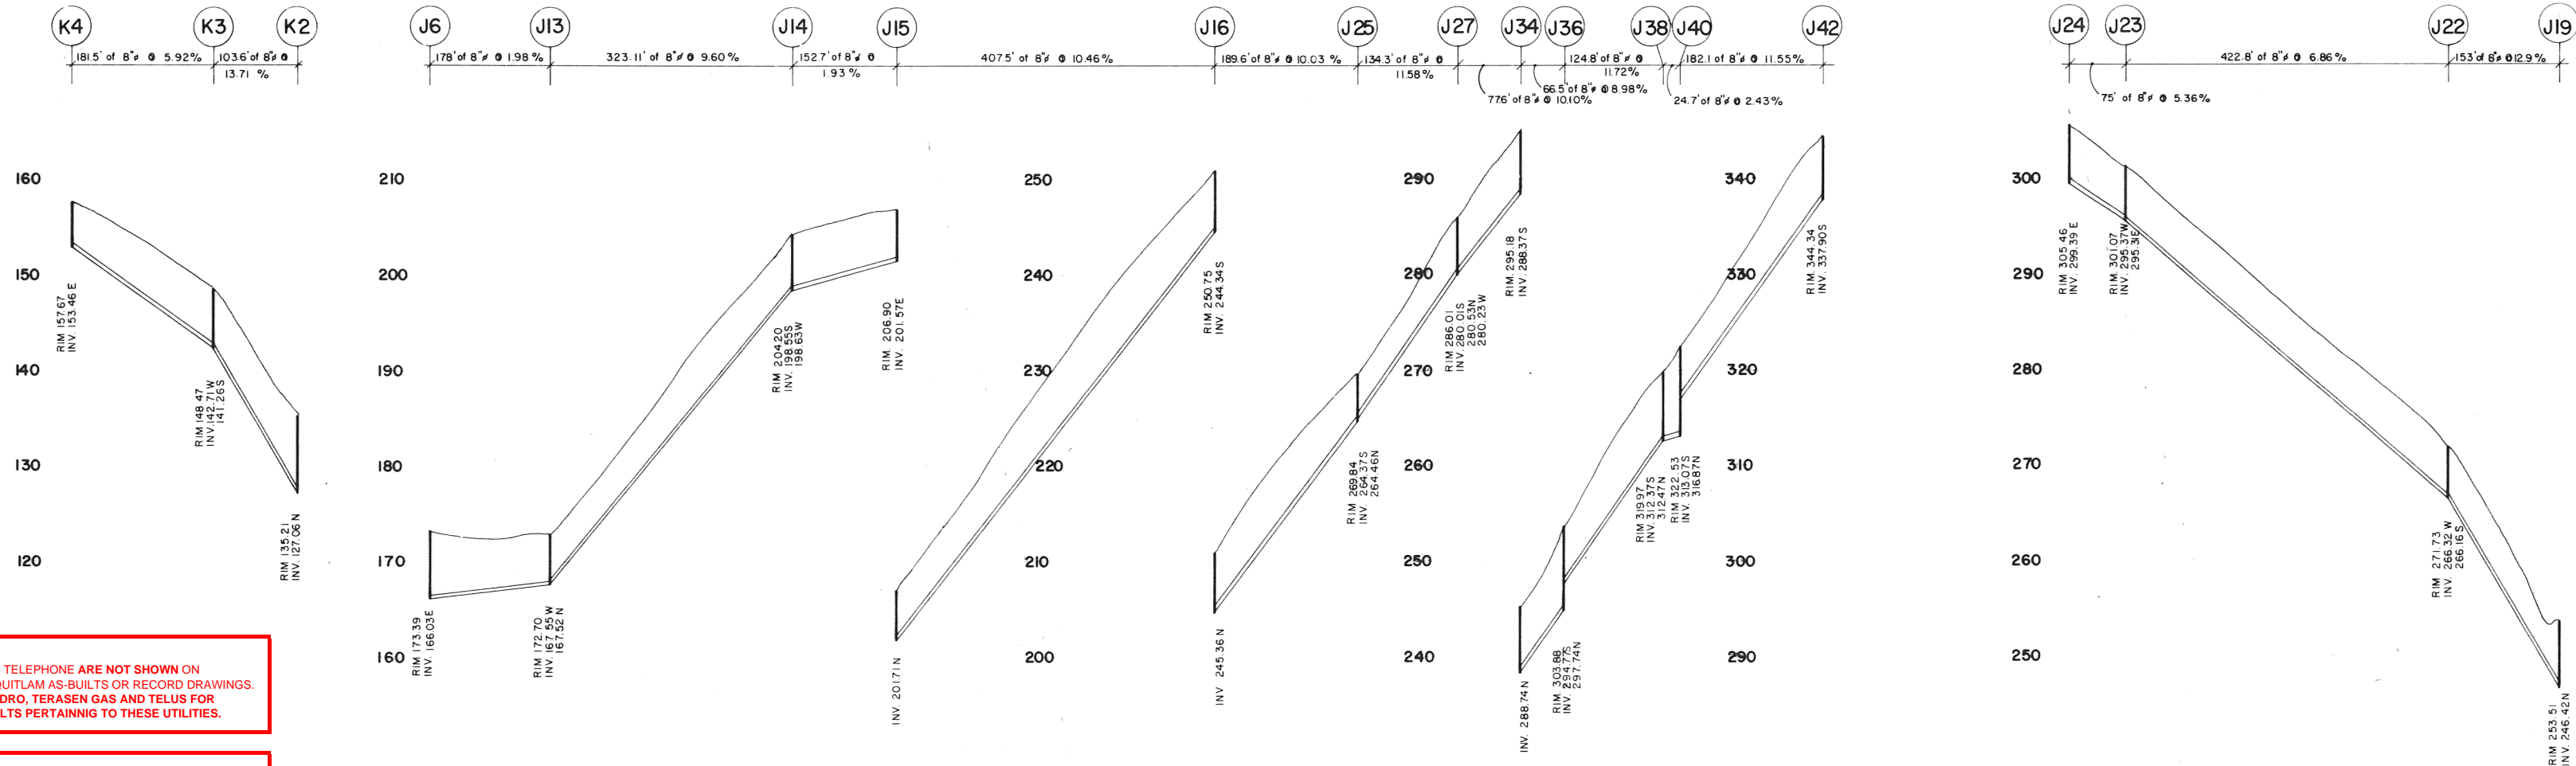


IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

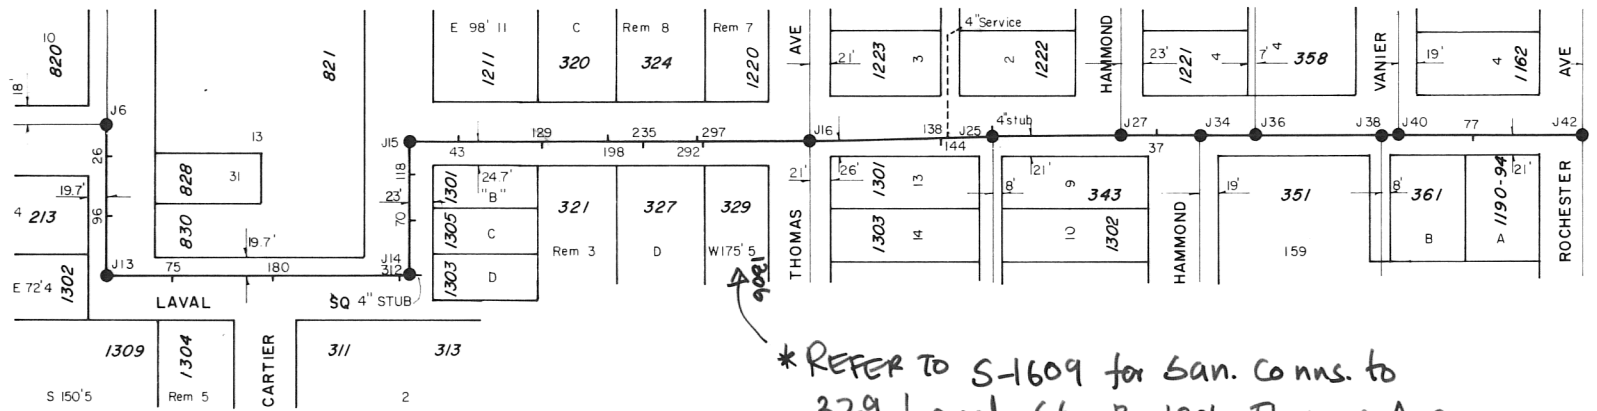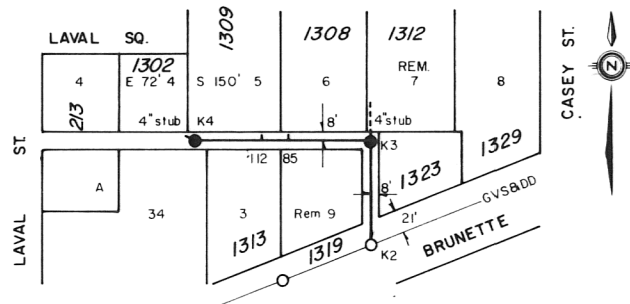

D 269-4

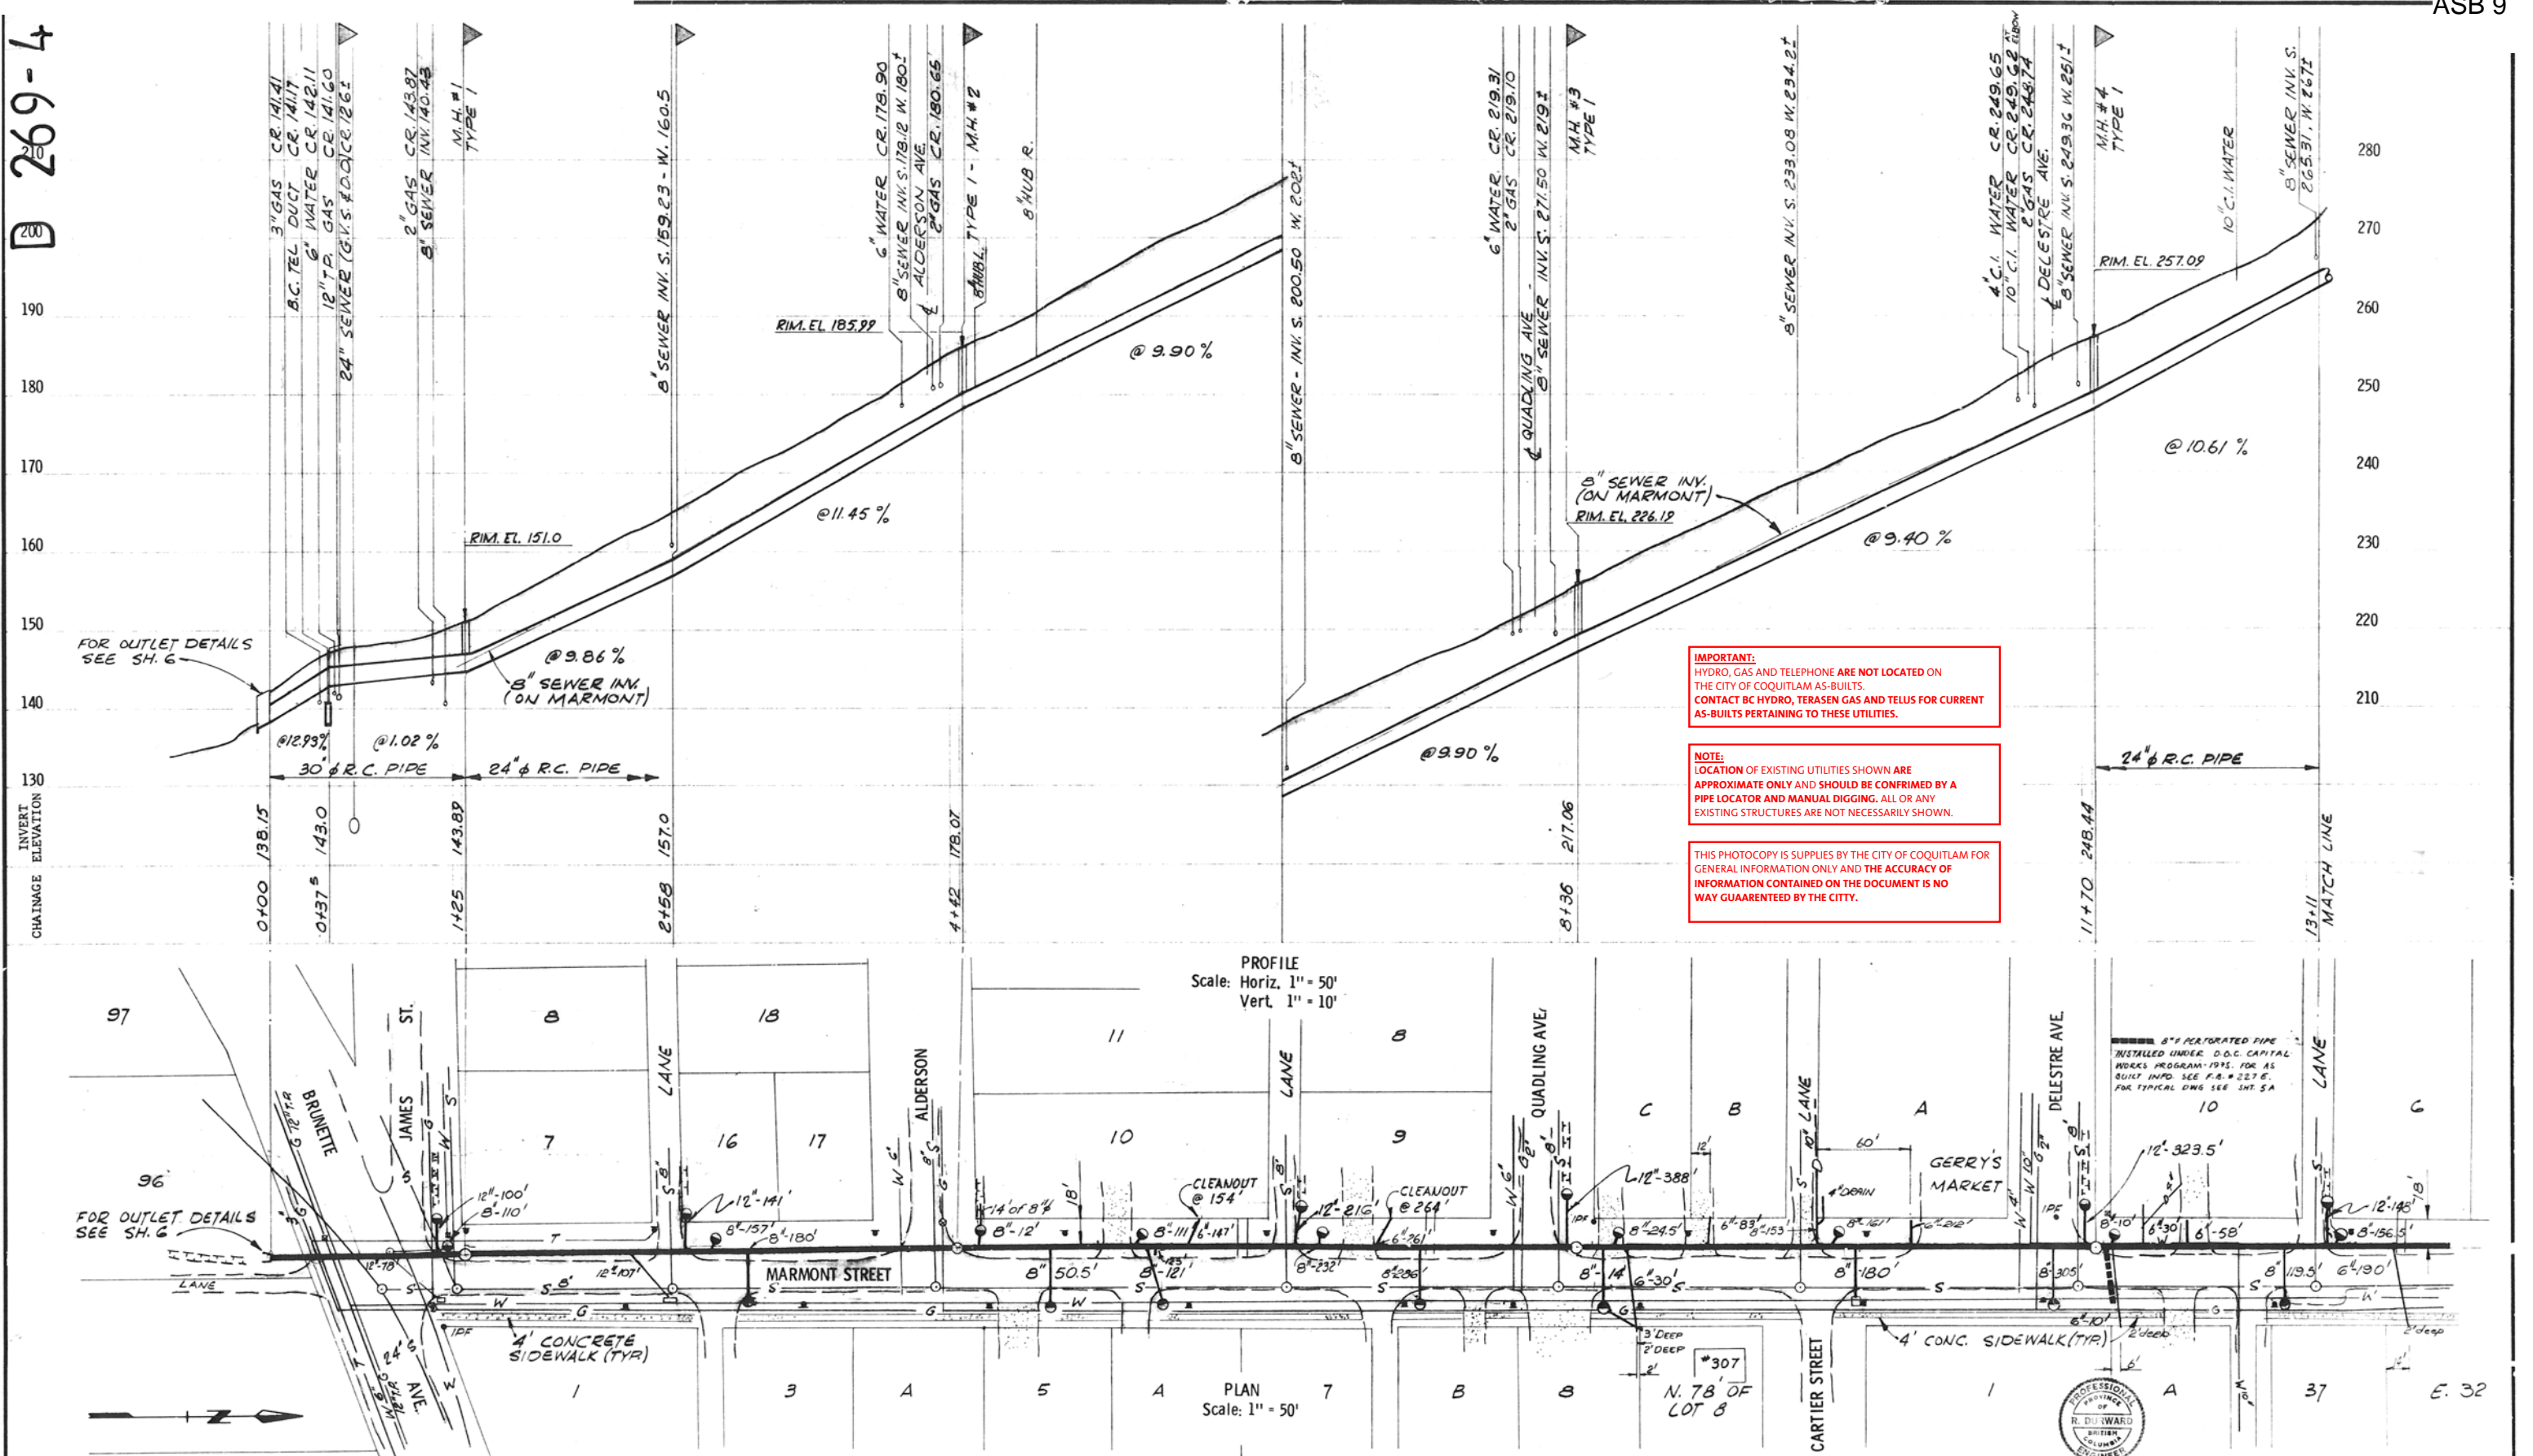


IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT LOCATED ON THE CITY OF COQUITLAM AS-BUILTS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOGRAPH IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NO WAY GUARANTEED BY THE CITY.

DRAWING SYMBOLS			NOTES:			GREATER VANCOUVER SEWERAGE AND DRAINAGE DISTRICT		
<ul style="list-style-type: none"> SEWER MAIN WITH MANHOLE CONNECTIONS TRAVERSE HUB IRON POST FOUND WOODEN POST FOUND HEDGE, TREE POWER POLE TELEPHONE POLE GUY WIRE OR ANCHOR POLE WATER MAIN WATER VALVE BOX 	<ul style="list-style-type: none"> WH - WATER HOUSE CONNECTION FW - FIRE HYDRANT SE - SEWER (EXISTING) SD - STORM DRAIN CB - CATCH BASIN CU - CULVERT GM - GAS MAIN GH - GAS HOUSE CONNECTION OP - OIL PIPELINE UT - UNDERGROUND TEL. CABLES LP - LEAD PLUG FOUND 	<ul style="list-style-type: none"> EC - UNDERGROUND ELEC. CABLES LS - LAMP STANDARD BE - BASEMENT OR MAIN FLOOR ELEV. D - DITCH P - PAVEMENT R - ROCKERIES FI - TYPE I CATCH BASIN INLET FI - TYPE II " " " FI - TYPE III " " " FI - TYPE IV " " " 	<p>1. ALL ELEVATIONS REFER TO G. V. S. & D. D. DATUM. G. V. S. & D. D. 91.37 ± 0.00 GEODETIC.</p> <p>2. ALL HOUSE DRAINS TO BE CONNECTED TO THE STORM SEWER WITH A CLEANOUT INSTALLED AT PROPERTY LINE OR EDGE OF EASEMENT.</p> <p>3. DISTANCES SHOWN FOR CONNECTIONS (8" - 165') REFER TO DOWNSTREAM MH.</p> <p>4. REFER TO FIELD BOOK NO. S 800-18.</p>	<p>Issue Date Desh Dr'n Chkd App'd</p> <p>JEB 76 J.R.</p> <p>MAY 75 W.H. J.R.</p>	<p>DESCRIPTION</p> <p>B.O.C. CAPITAL WORKS PROGRAM-1975 8" PERFORATED PIPE TIED TO STORM SEWER OFF MH #2</p> <p>AS CONSTRUCTED</p>	<p>Design R.D.</p> <p>Des chkd D.W.</p> <p>Dwn/Tx D.W.</p> <p>Dwg chkd R.D.</p> <p>Submitted [Signature]</p> <p>Engineer</p>	<p>COQUITLAM DRAINAGE WORKS (1974)</p> <p>MAJOR WATERCOURSE No. 6</p> <p>PLAN AND PROFILE</p>	<p>SCALE As Shown</p> <p>DATE JUNE 1974</p> <p>SHEET 4</p> <p>DRAWING NO SF-1425</p>

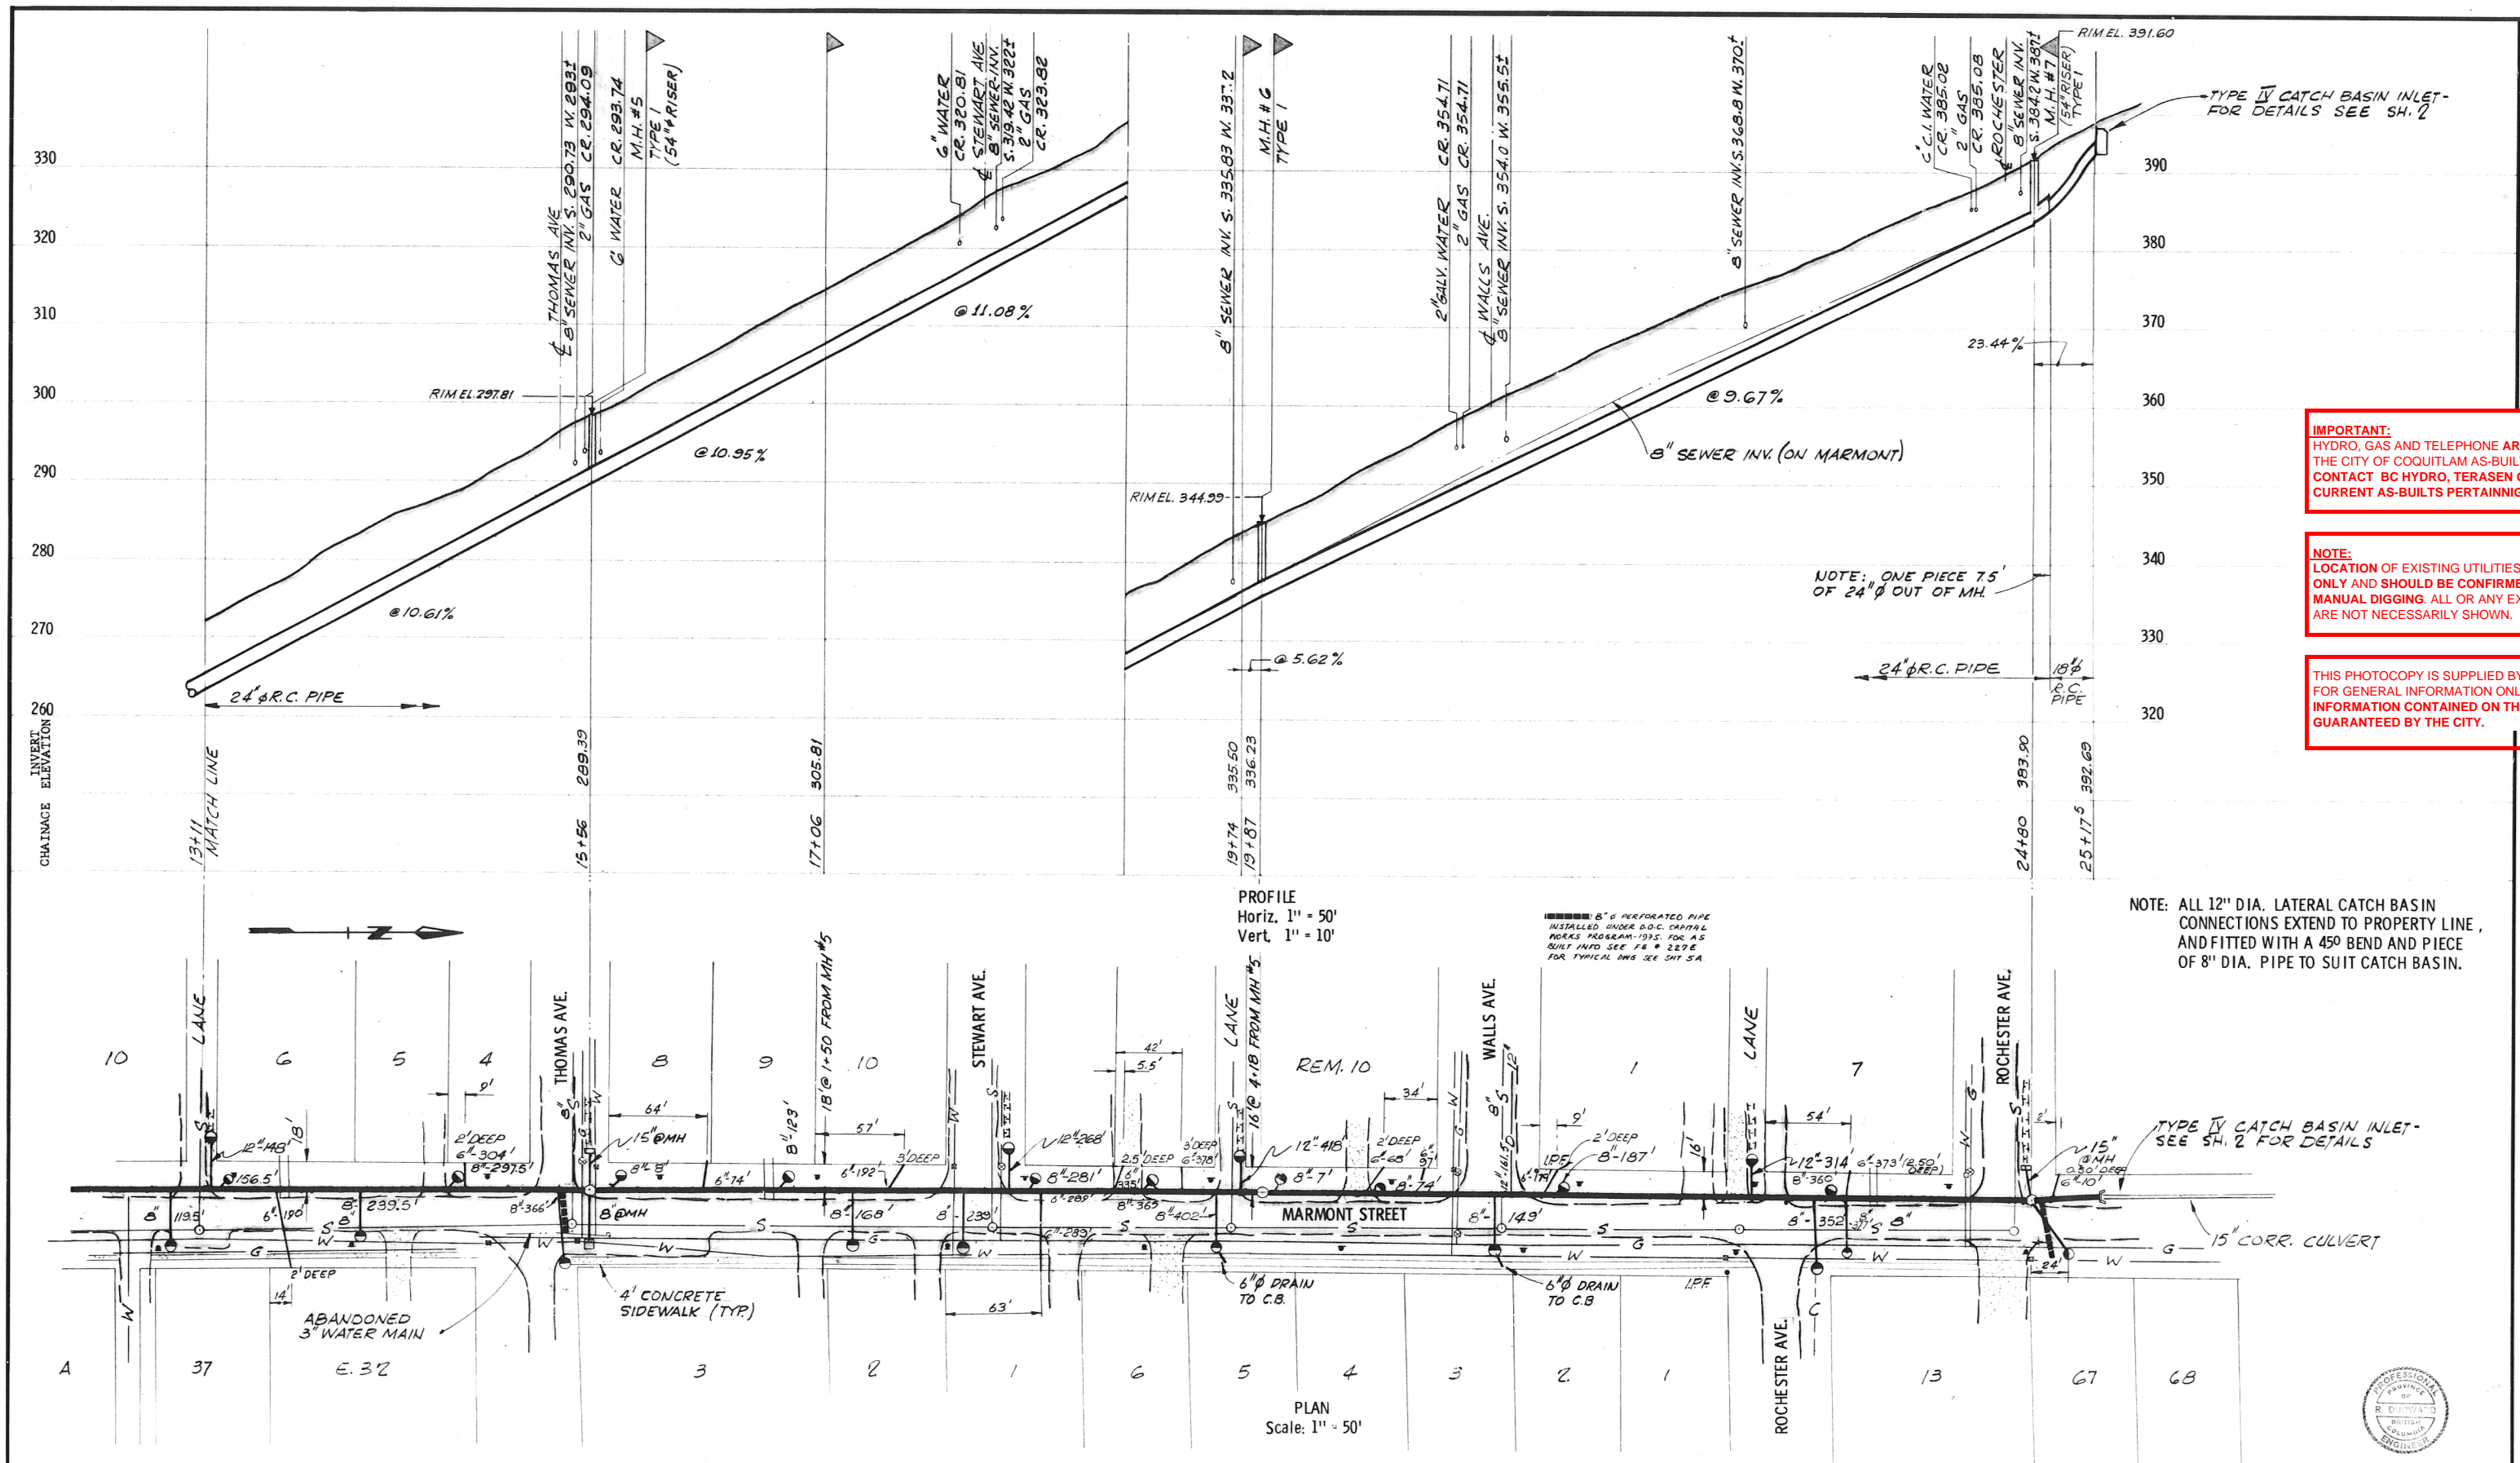

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.


THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

NOTE: ALL 12" DIA. LATERAL CATCH BASIN CONNECTIONS EXTEND TO PROPERTY LINE, AND FITTED WITH A 45° BEND AND PIECE OF 8" DIA. PIPE TO SUIT CATCH BASIN.


DRAWING SYMBOLS			NOTES: 1. ALL ELEVATIONS REFER TO G. V. S. & D. D. DATUM. G. V. S. & D. D. 91.37 = 0.00 GEODETIC. 2. ALL HOUSE DRAINS TO BE CONNECTED TO THE STORM SEWER WITH A CLEANOUT INSTALLED AT PROPERTY LINE OR EDGE OF EASEMENT. 3. DISTANCES SHOWN FOR CONNECTIONS (8" - 165") REFER TO DOWNSTREAM MH. 4. REFER TO FIELD BOOK No. S 800-18.	GREATER VANCOUVER SEWERAGE AND DRAINAGE DISTRICT									
SEWER MAIN WITH MANHOLE CONNECTIONS	WATER HOUSE CONNECTION	UNDERGROUND ELEC. CABLES		Design <u>R.D.</u>	COQUITLAM DRAINAGE WORKS (1974)					SCALE As Shown			
TRAVERSE HUB	FIRE HYDRANT	SEWER (EXISTING)		Des chkd	MAJOR WATERCOURSE No. 6					DATE JUNE 1974			
IRON POST FOUND	STORM DRAIN	DITCH		Drawn/Tr <u>D.W.</u>						PLAN AND PROFILE			
WOODEN POST FOUND	CATCH BASIN	PAVEMENT		Dwg chkd <u>R.D.</u>	Sheet 5								
HEDGE, TREE	CULVERT	ROCKERIES		Submitted <u>[Signature]</u>		DRAWING NO. SF-1425							
POWER POLE	GAS MAIN	FENCE		<u>[Signature]</u> Engineer									
TELEPHONE POLE	GAS HOUSE CONNECTION	TYPE I CATCH BASIN INLET		A.D.C. CAPITAL WORKS PROGRAM 1982 - 8" PERFORATED PIPES TIED TO 12" STORM MAIN, E. NORTH OF MAIN P.							Issue Date Des'n Dr'n Chkd App'd Description		
GUY WIRE OR ANCHOR POLE	OIL PIPELINE	TYPE II " " "		B FEB 78 J8									
WATER MAIN	UNDERGROUND TEL. CABLES	TYPE III " " "		B MAY 75 S.N. JT S									
WATER VALVE BOX	LEAD PLUG FOUND	TYPE IV " " "	AS CONSTRUCTED										

D-269
D-269-5

D-1114

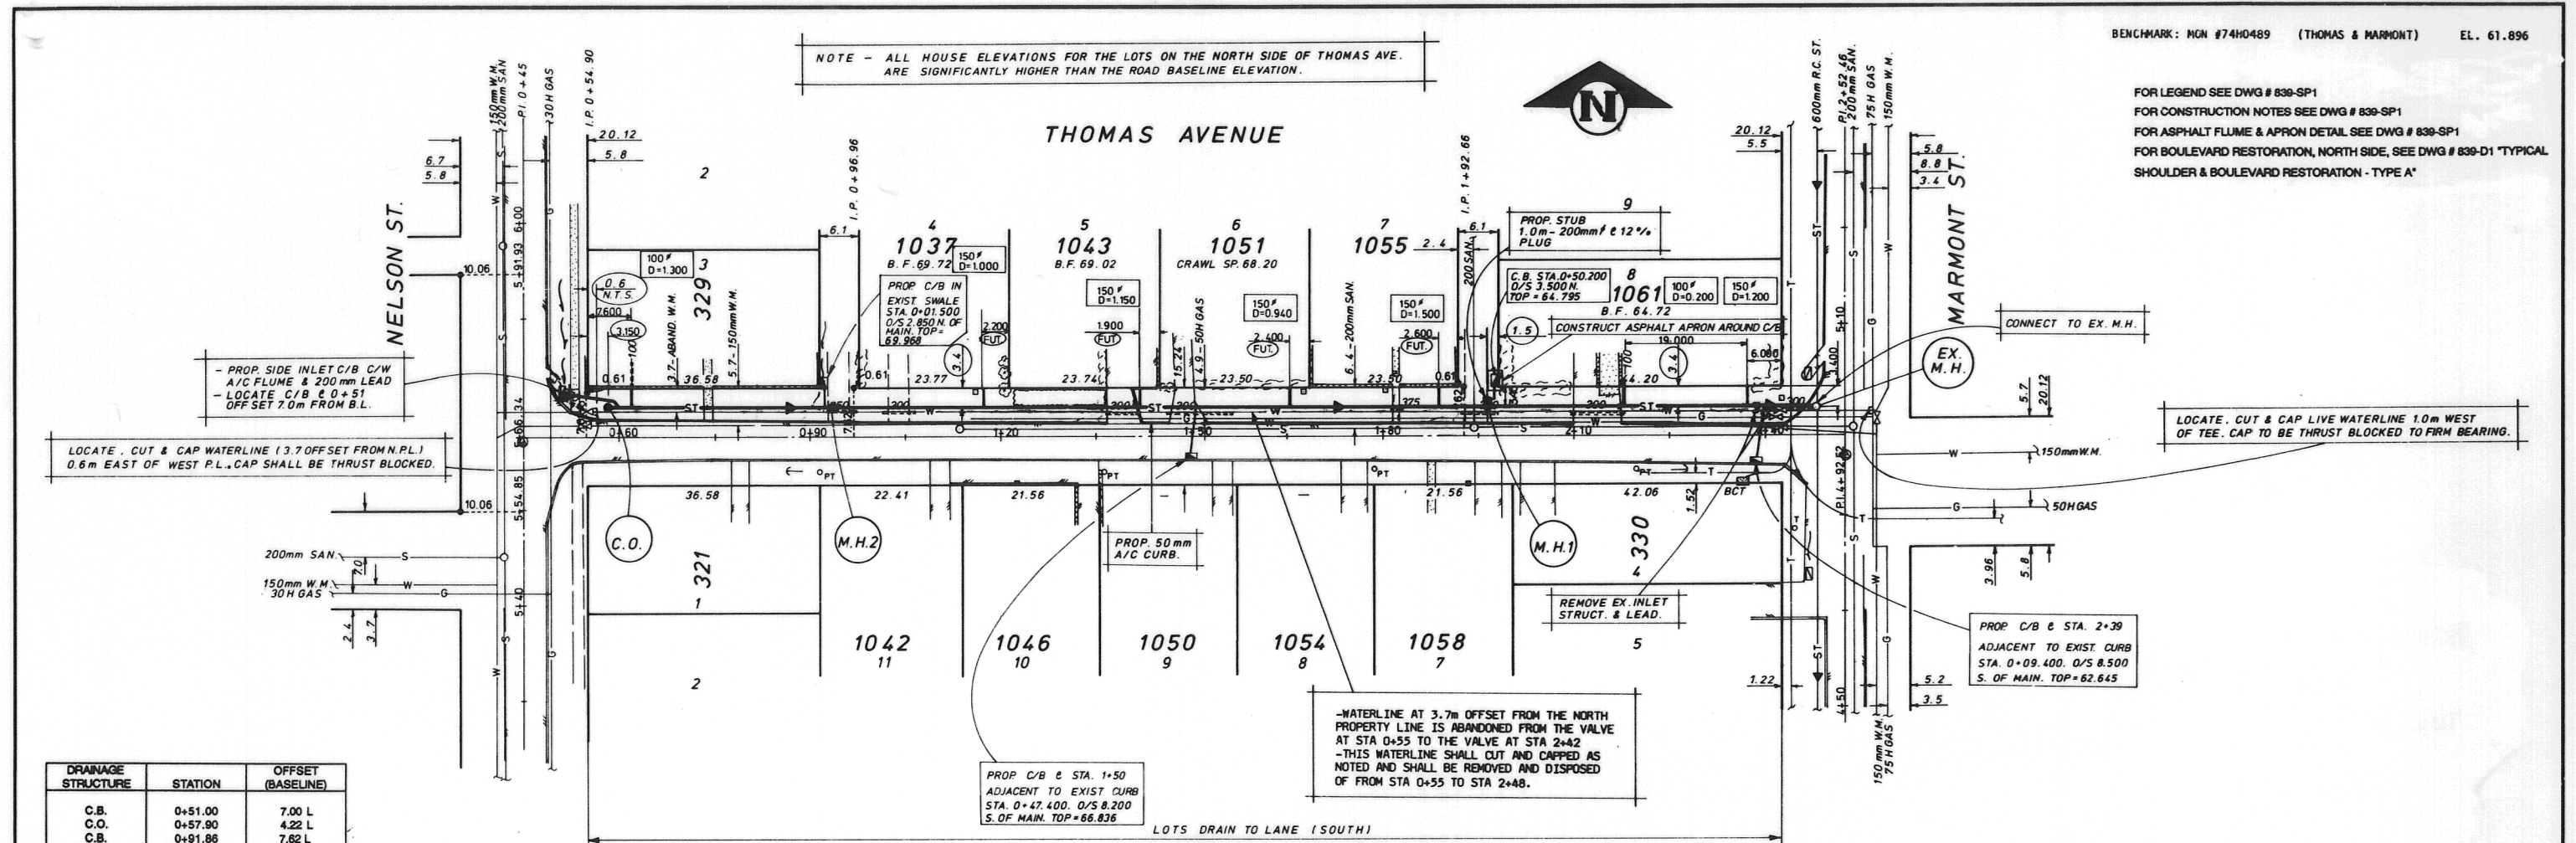

F.B. 509 / 14, 15

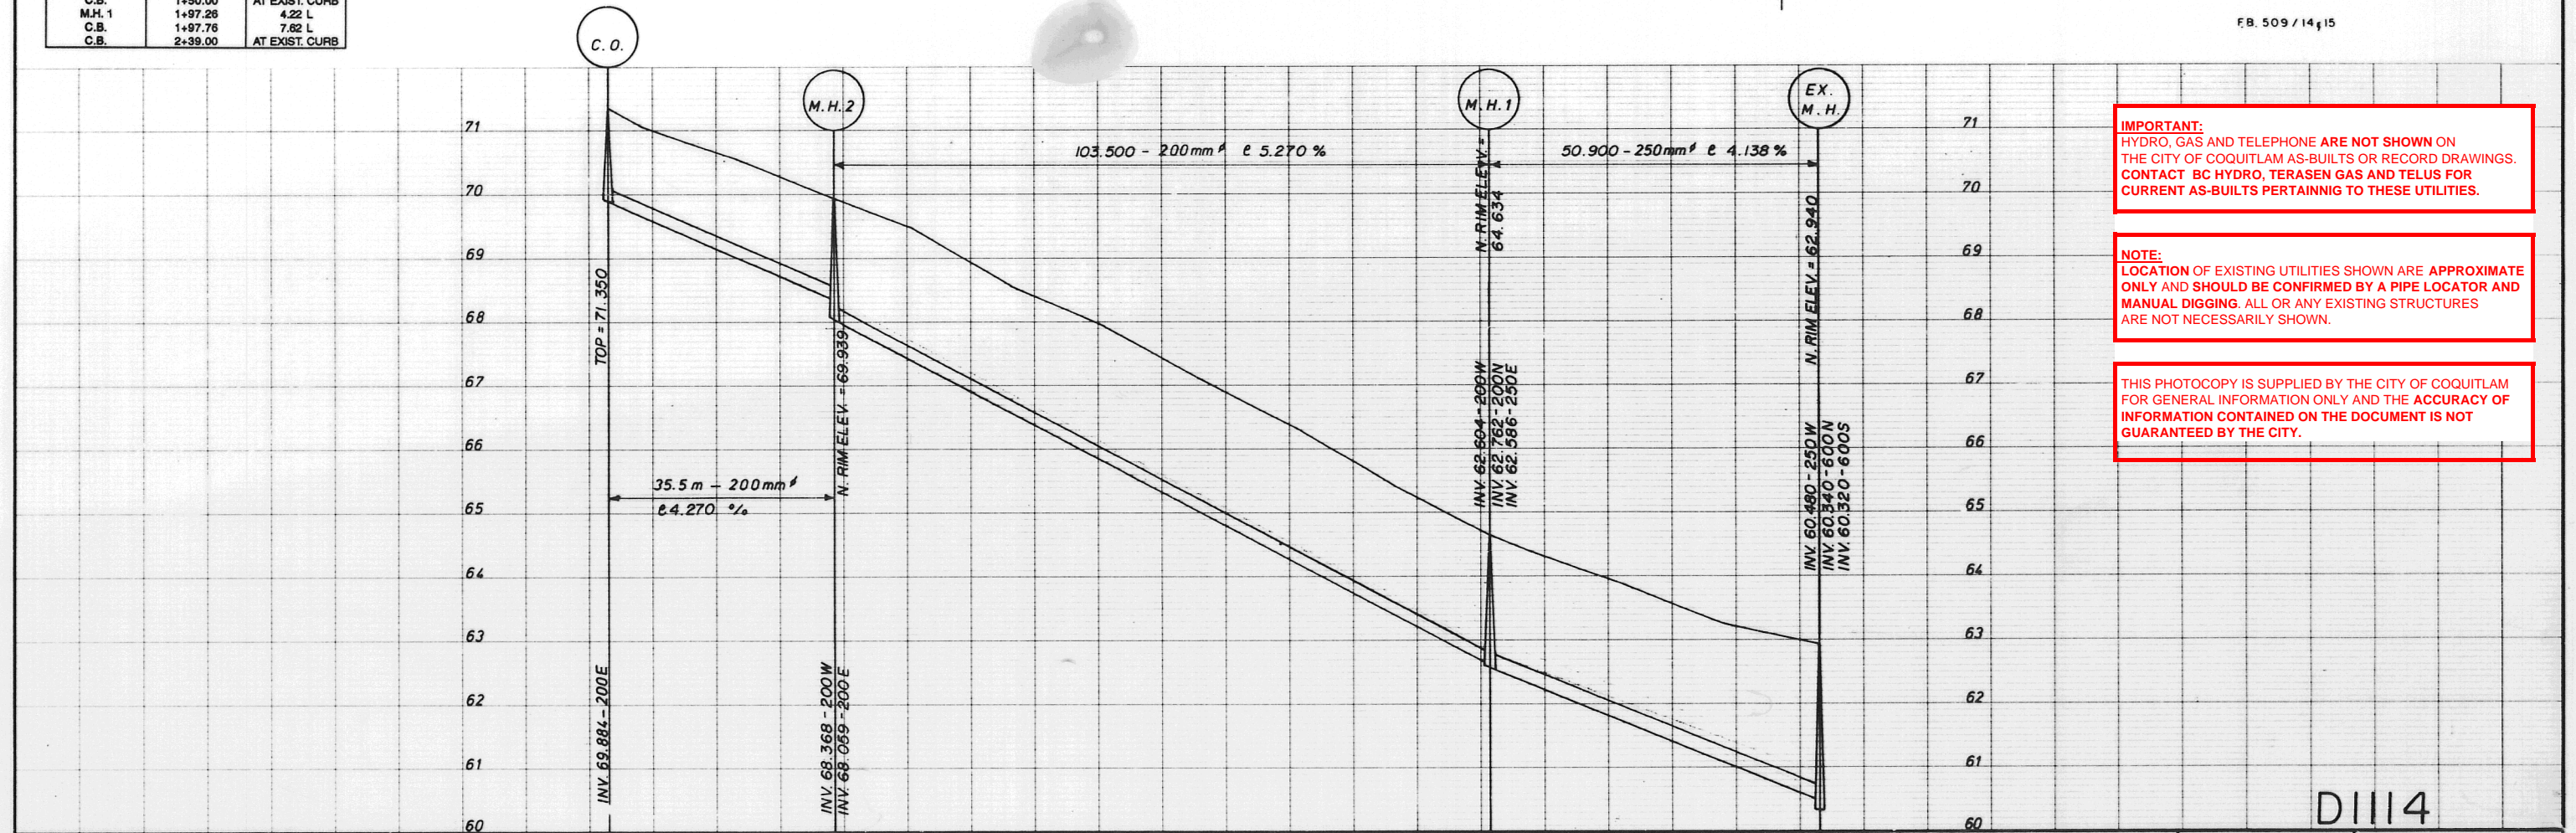


D1114

FIELD BOOK No.	Pg. No.	No.	DATE	REVISION	BY
		1	20 02 89	BOULEVARD RESTORATION, PROFILE REVISED	C.E.
			June 30	"AS CONSTRUCTED"	

R.F. BINNIE & ASSOCIATES LTD.	DISTRICT OF COQUITLAM	SURVEYED BY B.B.	DATE JUNE 1986
# 103 7382 WINSTON STREET BURNABY, B.C. V5A 2G9 PHONE 420 - 1721	STORM SEWER	DRAWN BY S.G.	DRAWING No.
CONSULTING CIVIL ENGINEERS	THOMAS AVENUE - NORTH SIDE	DESIGNED BY M.K.	613-ST8-1
	NELSON ST. - MARMONT ST.	APPROVED BY	SHEET 17 OF 23
		SCALES	REV. 1
		VERTICAL 1" = 50'	
		HORIZONTAL 1" = 100'	

DESTROY ALL PRINTS BEARING PREVIOUS No.

D-1121

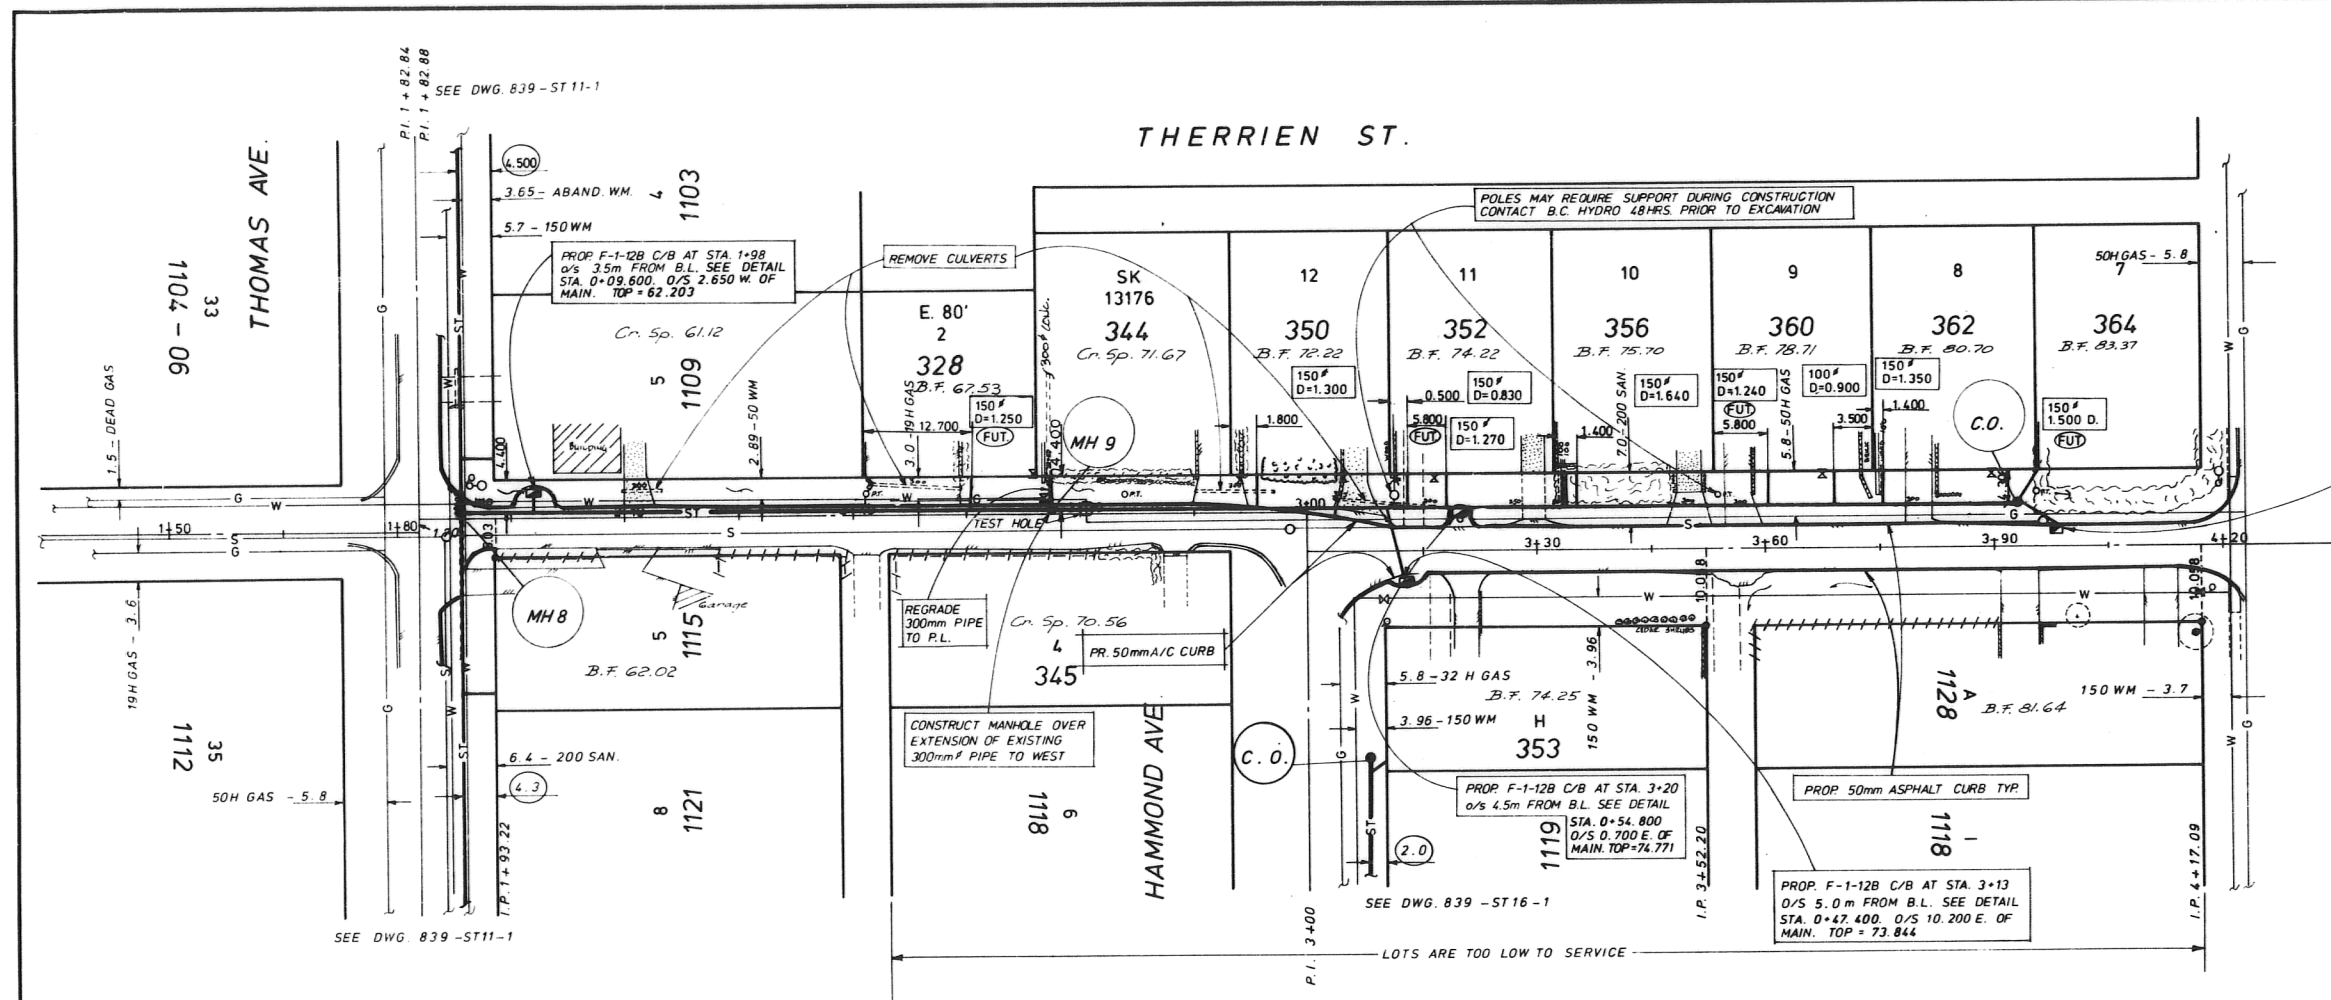


BENCHMARK INFORMATION
 MON #73H0134 ON BRUNETTE AVE. AT MARMONT ST.
 ELEVATION 16.912
 MON #74H0488 ON MARMONT ST. AT QUADLING AVE.
 ELEVATION 40.108

PROP. C/B AT STA. 3+99
 ADJACENT TO PROP. CURB
 STA. 0+06.500, O/S 9.100
 E. OF MAIN. TOP = 82.790

SEE DWG. 839-S2 - "TYPICAL SHOULDER & BOULEVARD CONSTRUCTION - TYPE A"
 FOR BOULEVARD RESTORATION FROM THOMAS TO ROCHESTER, WEST SIDE AND
 FROM HAMMOND TO ROCHESTER, EAST SIDE

FB.501 / 12, 13

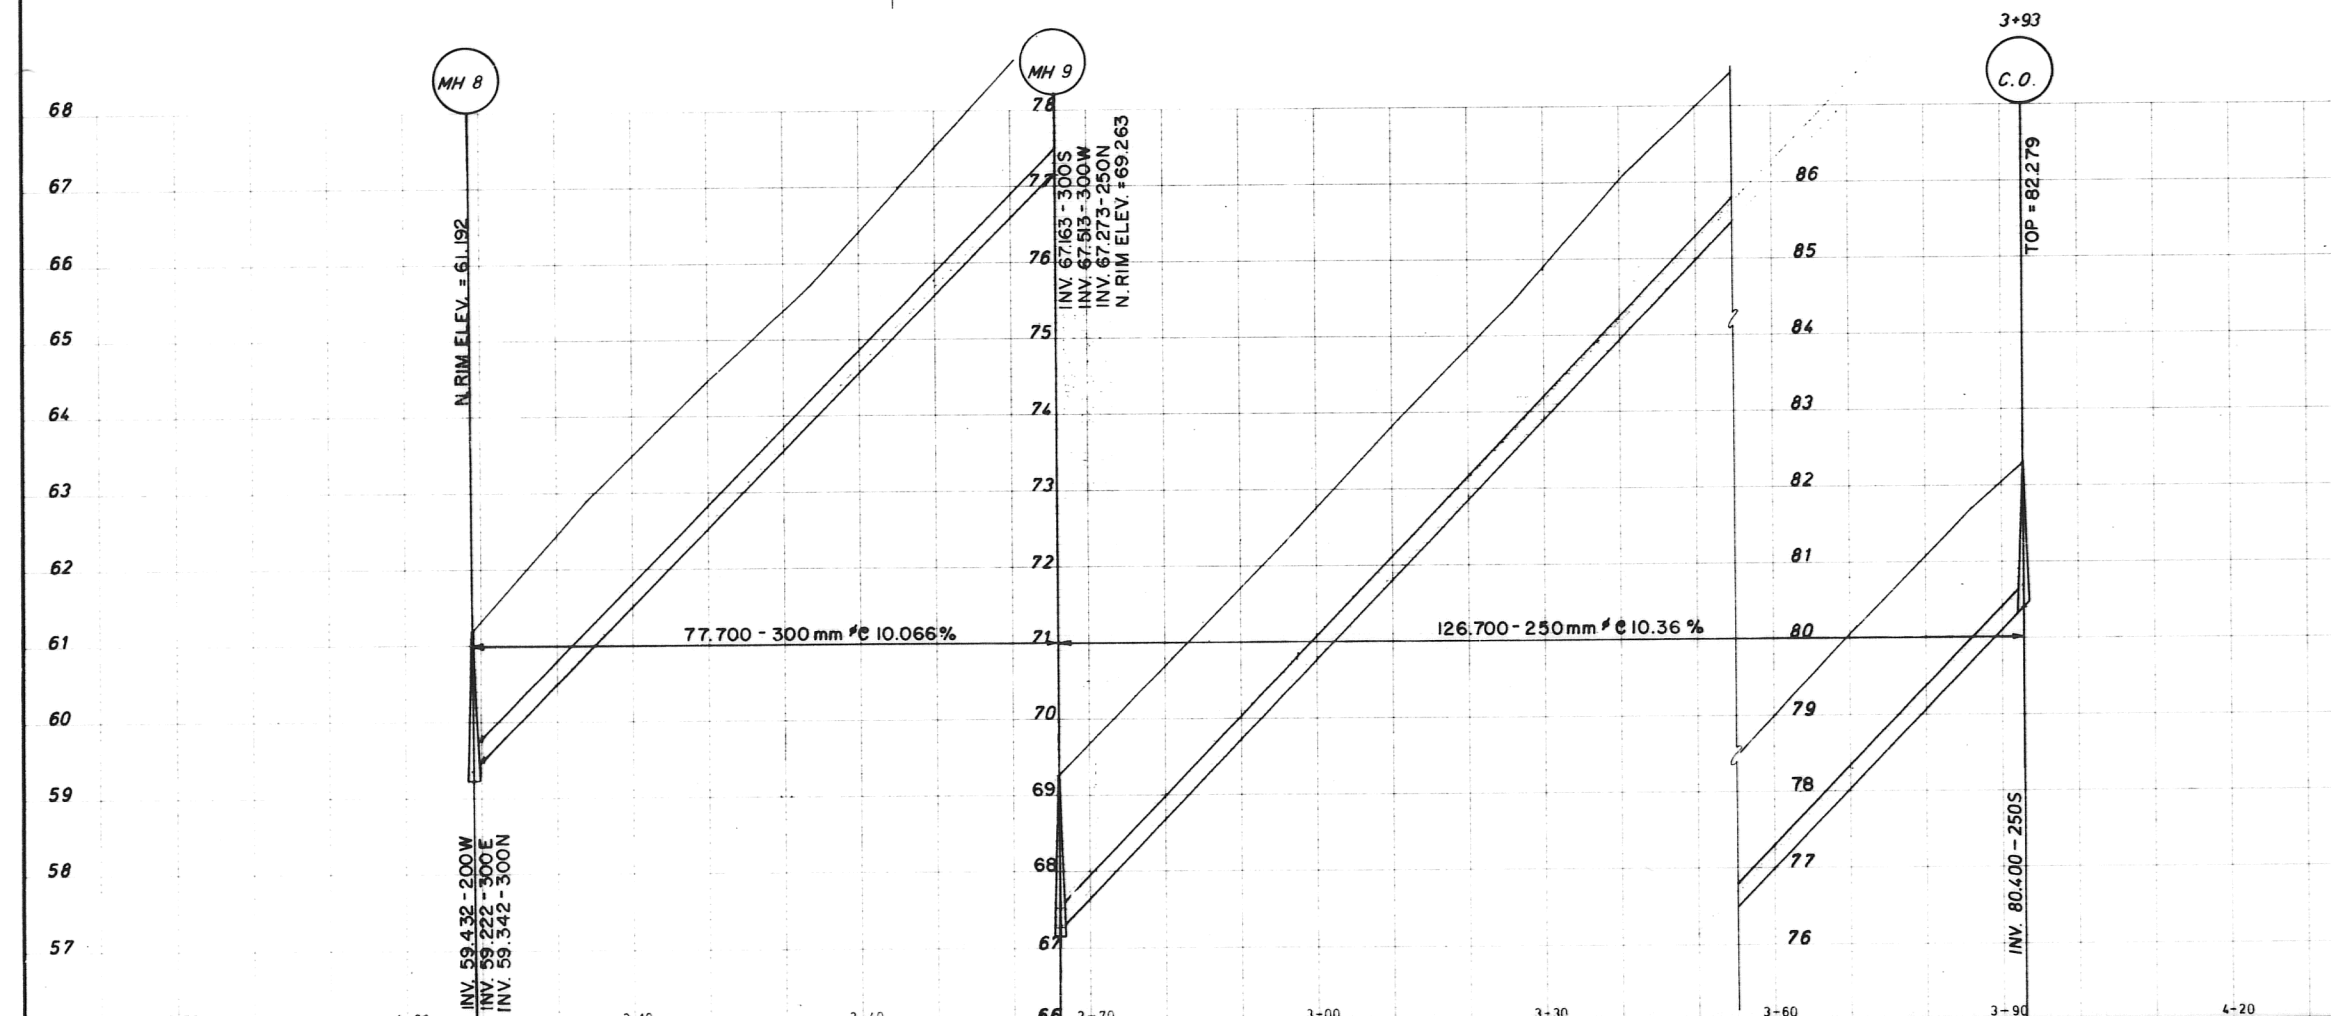

FOR LEGEND SEE DWG. 839-S1
 FOR CONSTRUCTION NOTES SEE DWG. 839-S1
 FOR TYPICAL SHOULDER & BOULEVARD CONSTRUCTION SEE DWG. 839-S2
 FOR F-1-12B SIDE INLET CATCH BASIN FLUME DETAIL SEE DWG. 839-S1
 FOR F-1-12 CATCH BASIN FLUME & APRON DETAIL SEE DWG. 839-S1

FIELD BOOK No.	Pg. No.	No.	DATE	REVISION	BY
		1	15/2/89	LOWER PROFILE, MISC. NOTES ADDED	CE
			June 90	"AS CONSTRUCTED"	



R.F. BINNIE & ASSOCIATES LTD.

CONSULTING CIVIL ENGINEERS

CLIENT **DISTRICT OF COQUITLAM**

STORM SEWER
 THERRIEN ST.
 ROCHESTER AVE. - THOMAS AVE.

SURVEYED BY
 DRAWN BY S.G., P.E.
 DESIGNED BY C.E.

DATE NOV. 1988

DRAWING No.

839-ST5-1

SHEET 3 OF 19

REV. 1

DESTROY ALL PRINTS BEARING PREVIOUS No.

D1121

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON
THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS.
CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR
CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.


NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE
ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND
MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES
ARE NOT NECESSARILY SHOWN.



THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM
FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF
INFORMATION CONTAINED ON THE DOCUMENT IS NOT
GUARANTEED BY THE CITY.

FOR LEGEND SEE DWG 839 - S1
FOR CONSTRUCTION NOTES SEE DWG 839 - S1
FOR TYPICAL SHOULDER & BOULEVARD CONSTRUCTION SEE DWG 839 - S2
FOR F-1-12B SIDE INLET CATCH BASIN FLUME DETAIL SEE DWG 839 - S1
FOR F-1-12 CATCH BASIN FLUME & APRON DETAIL SEE DWG 839 - S1

SEE THE FOLLOWING TYPICAL SECTIONS FOR BOULEVARD RESTORATION:

- FOR LAVAL SQUARE SEE DWG. 839-S2 - "TYPICAL SHOULDER & BOULEVARD CONSTRUCTION - TYPE D"
- FOR LAVAL ST. 0+60 TO 1+20. SEE DWG. 839-S2 - "TYPICAL SHOULDER & BOULEVARD CONSTRUCTION - TYPE B"
- FOR LAVAL ST. 1+20 TO THOMAS AVE. SEE DWG. 839-S2 - "TYPICAL SHOULDER & BOULEVARD CONSTRUCTION - TYPE A"

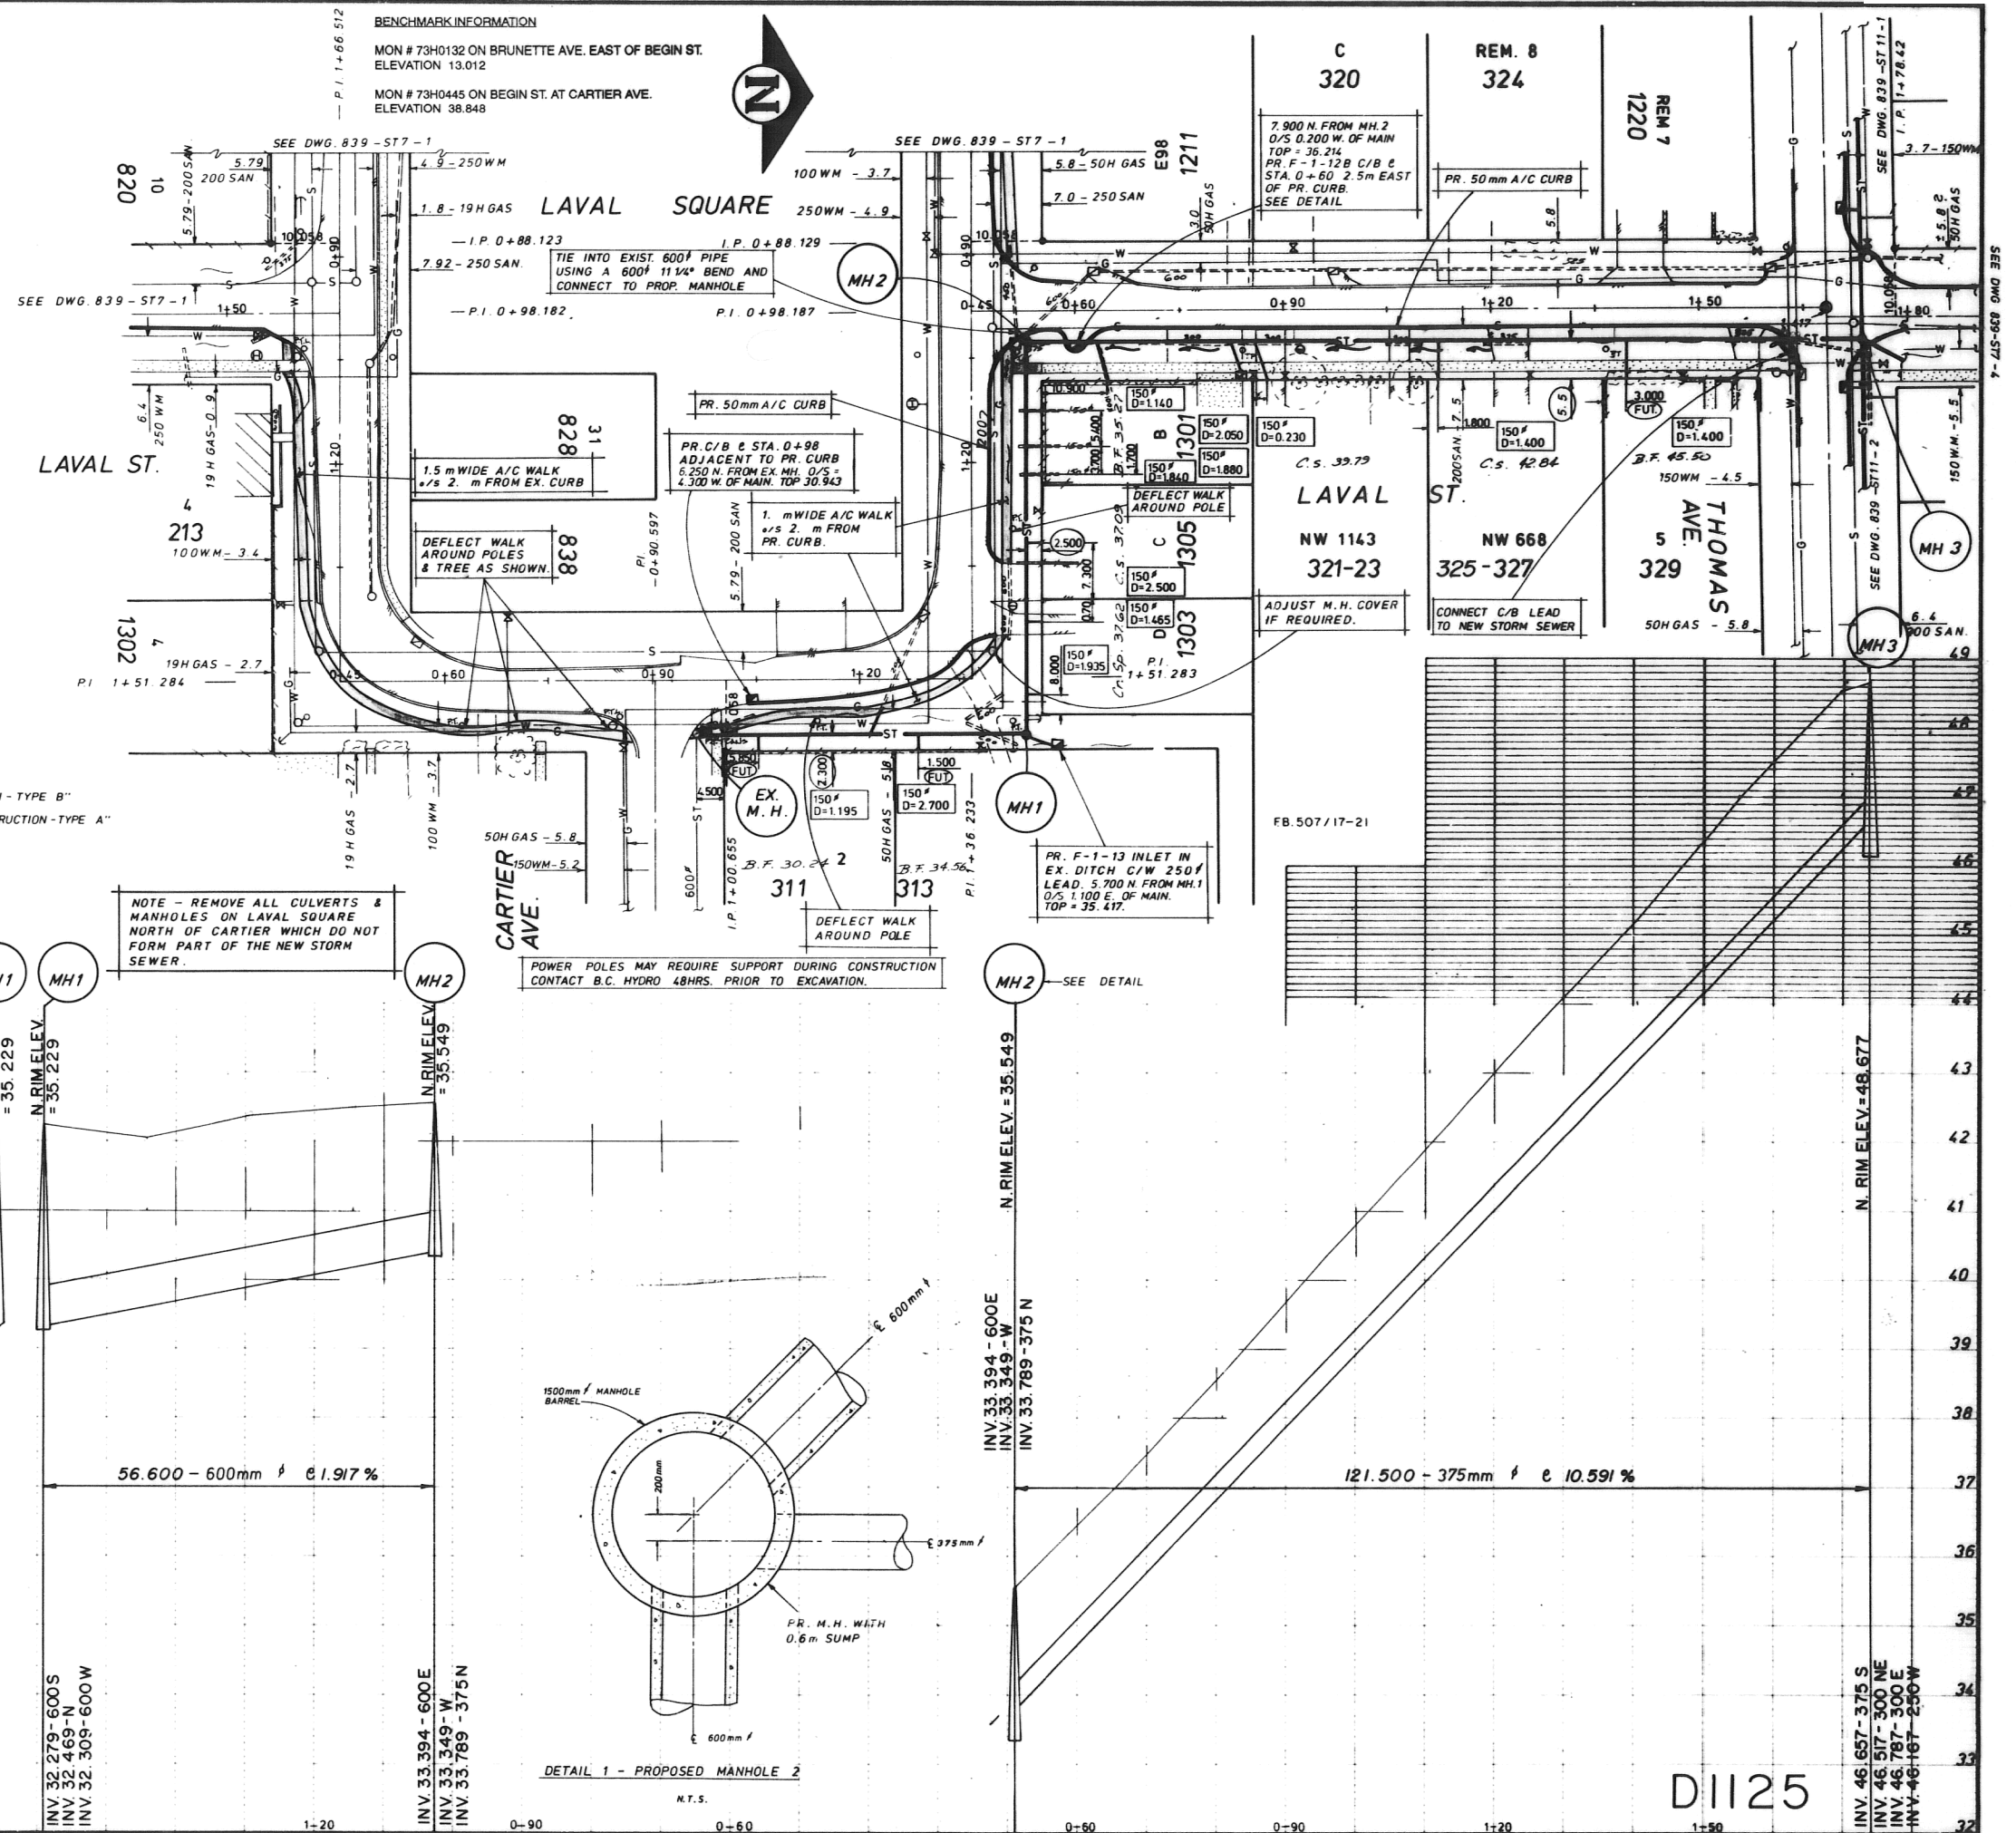

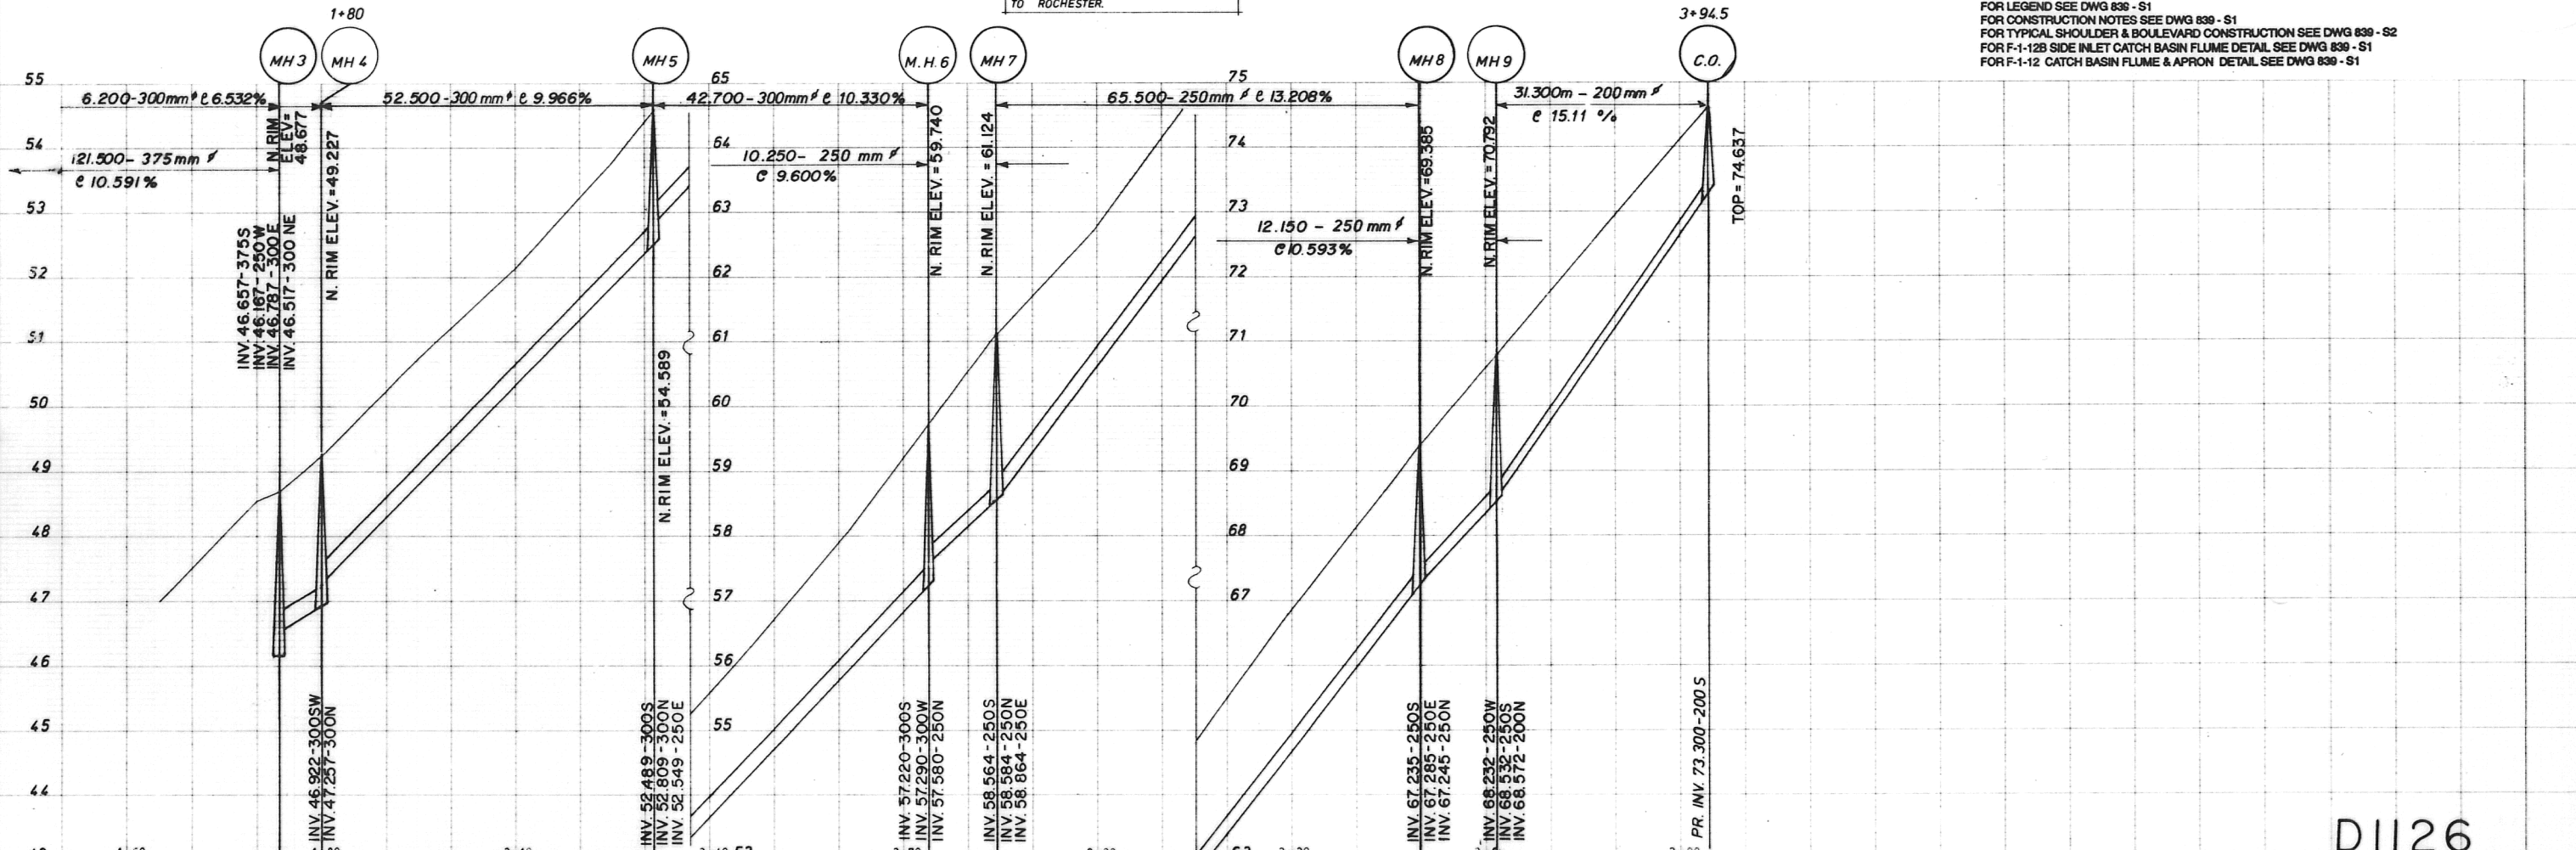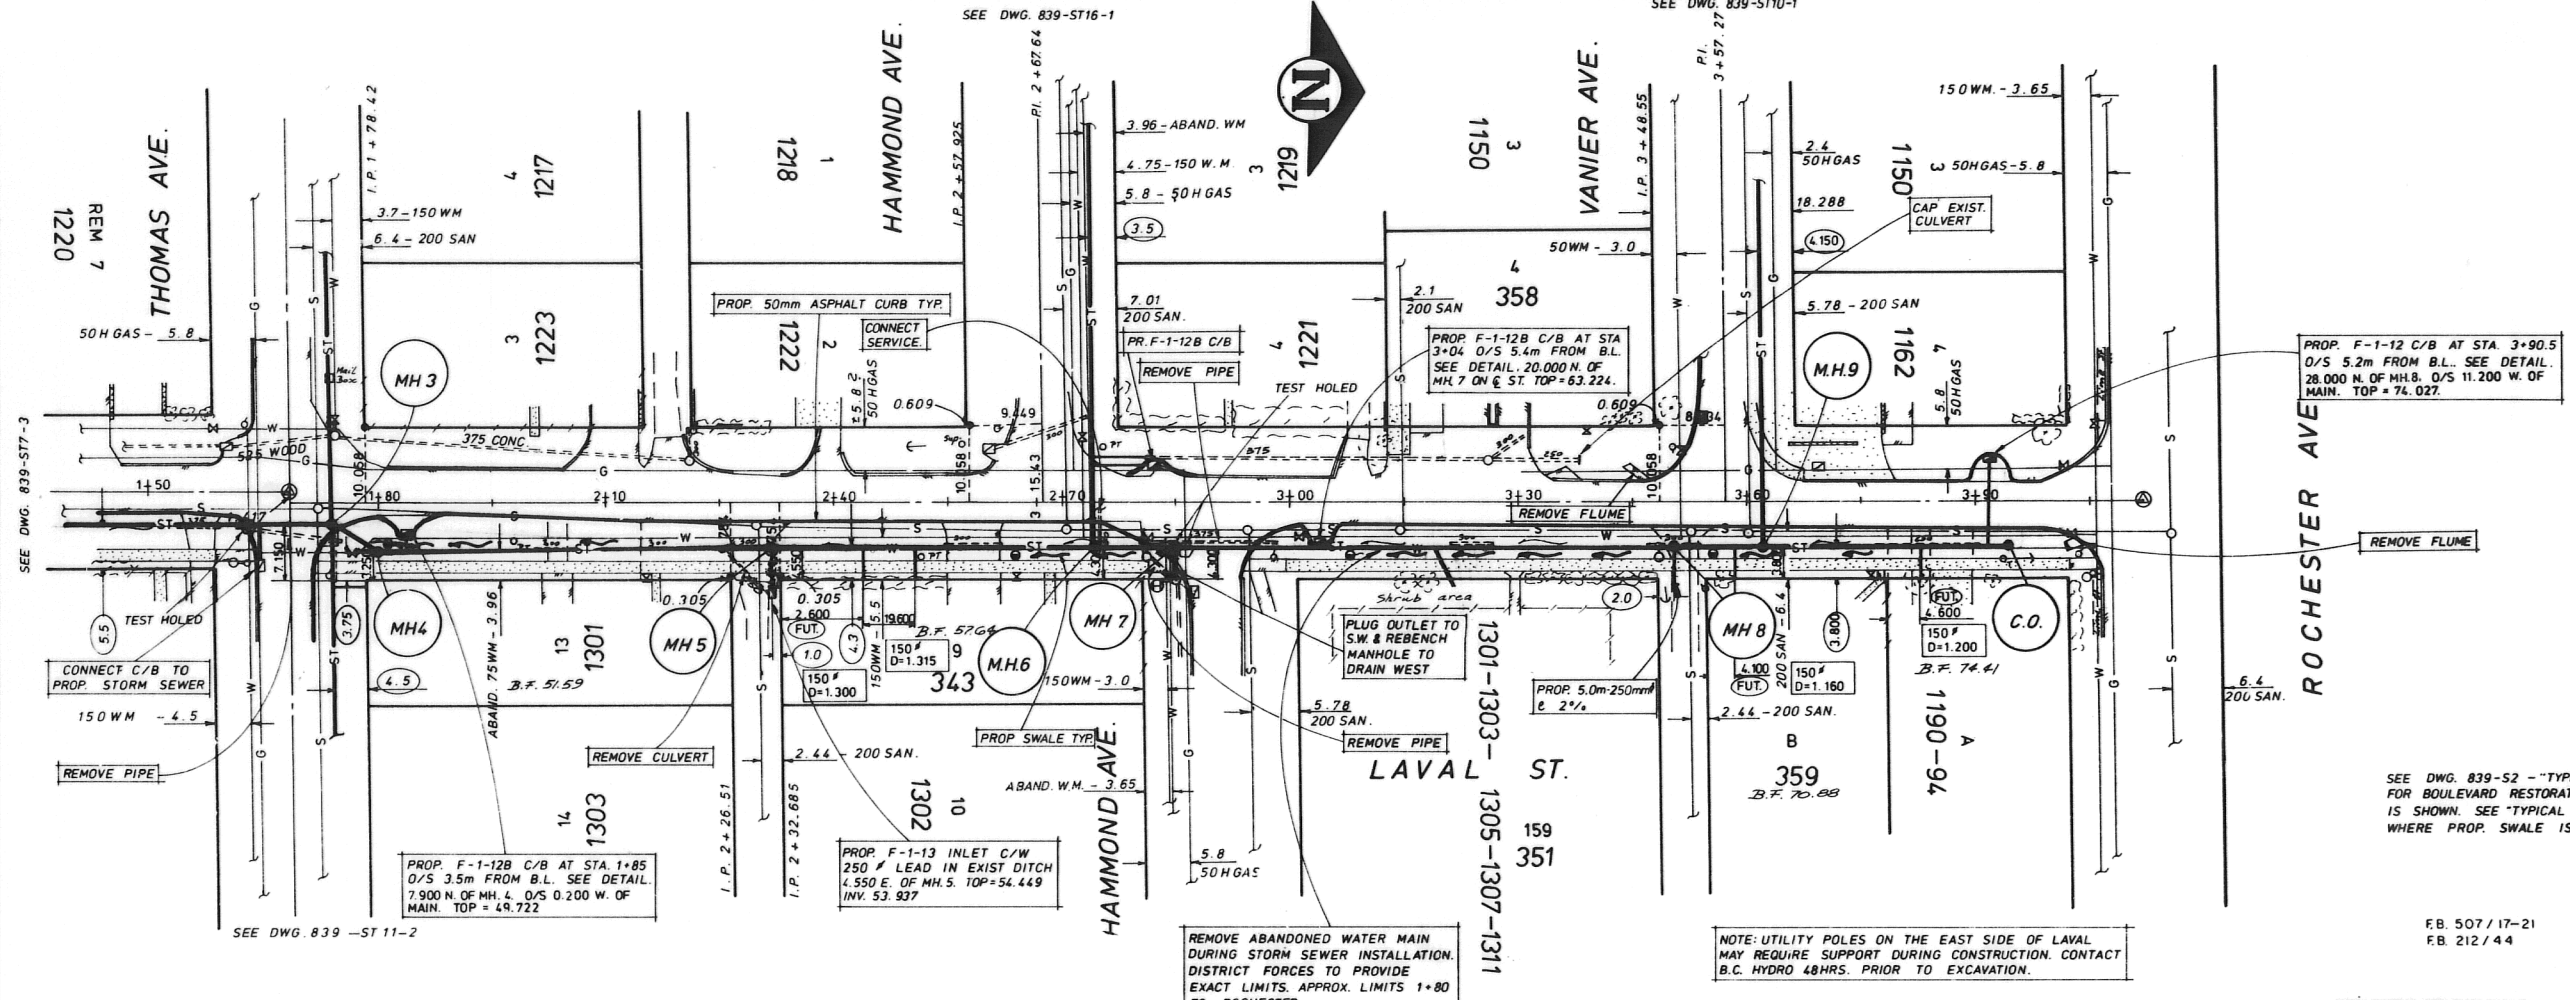

FIELD BOOK No.	Pg. No.	No.	DATE	REVISION	BY
		1	15/2/89	PIPE SIZES, PROFILE CHANGED, MISC. NOTES ADDED	C.E.

R.F. BINNIE & ASSOCIATES LTD.
CONSULTING CIVIL ENGINEERS

CLIENT **DISTRICT OF COQUITLAM**

STORM SEWER
LAVAL ST. (EAST)
LAVAL SQUARE - ROCHESTER AVE.

SURVEYED BY
DRAWN BY *S.G. PR*
DESIGNED BY *C.E.*

DATE NOV 1988


DRAWING No. **839-ST7-4**

SHEET 8 OF 19

REV. 1

DESTROY ALL PRINTS BEARING PREVIOUS No.

D - 1128

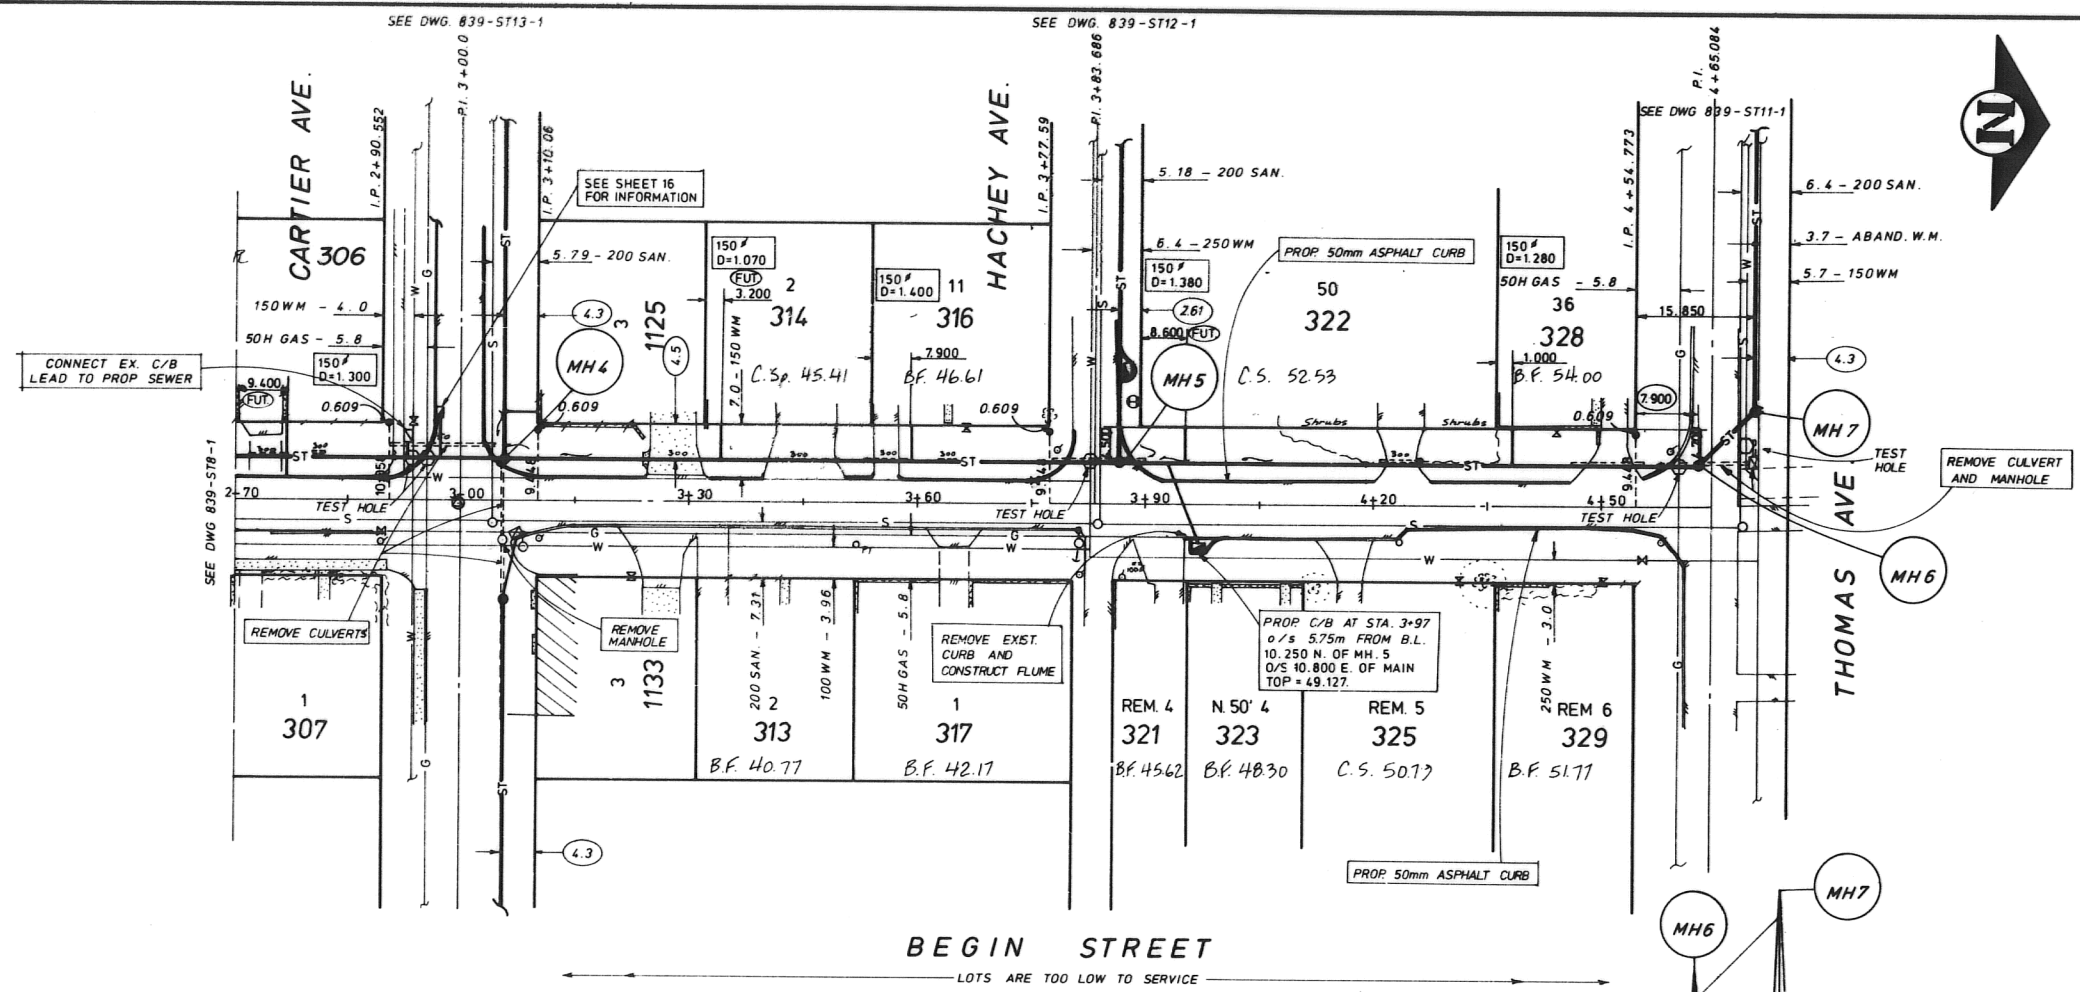

BENCHMARK INFORMATION


MON # 7310132 ON BRUNETTE AVE. EAST OF BEGIN ST.
ELEVATION 13.012

MON # 7310445 ON BEGIN ST. AT CARTIER AVE.
ELEVATION 38.848


FOR BOULEVARD RESTORATION; WEST SIDE, SEE DWG. 839-52
"TYPICAL SHOULDER & BOULEVARD CONSTRUCTION - TYPE A"

FB. 513/6-9

FOR LEGEND SEE DWG. 839-S1
FOR CONSTRUCTION NOTES SEE DWG. 839-S1
FOR TYPICAL SHOULDER & BOULEVARD CONSTRUCTION SEE DWG. 839-S2
FOR F-1-12B SIDE INLET CATCH BASIN FLUME DETAIL SEE DWG. 839-S1
FOR F-1-12 CATCH BASIN FLUME & APRON DETAIL SEE DWG. 839-S1

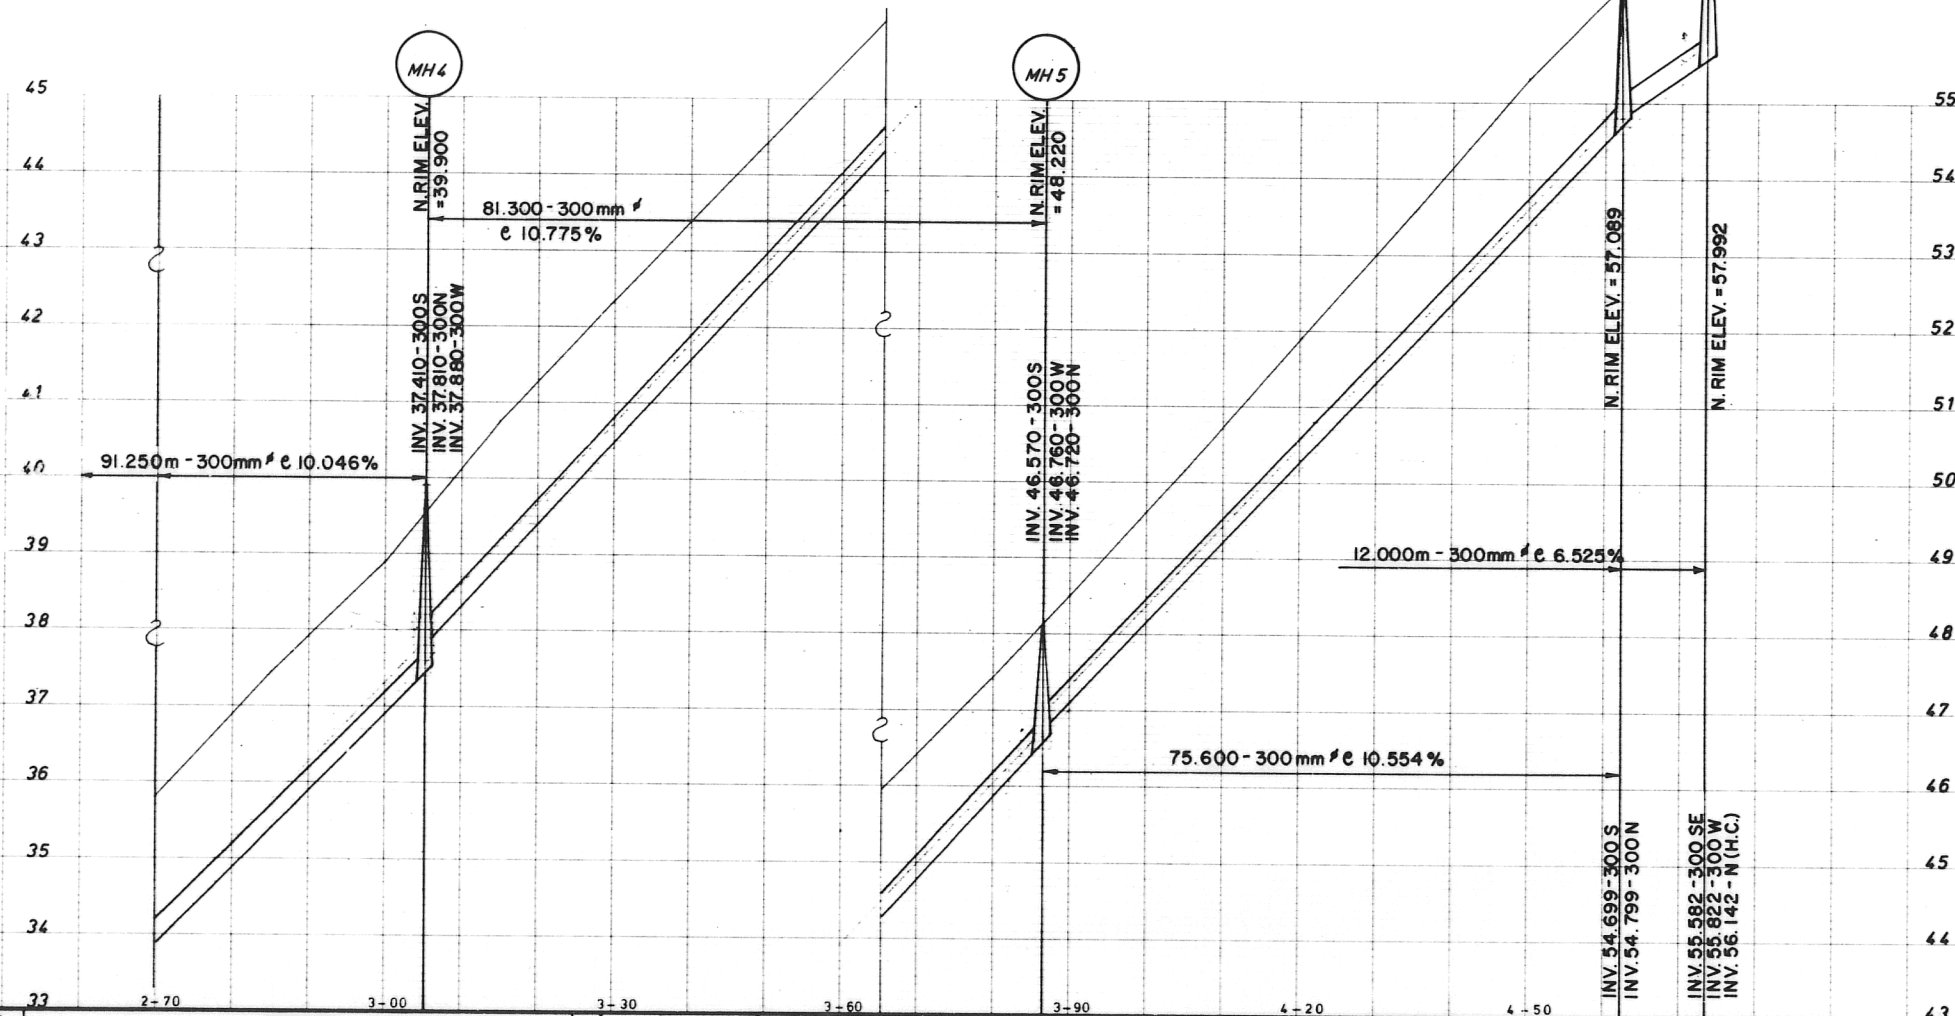

FIELD BOOK No.	Pg. No.	No.	DATE	REVISION	BY
		1	15/2/89	MISC. NOTES ADDED	C.E.



R.F. BINNIE & ASSOCIATES LTD.
CONSULTING CIVIL ENGINEERS



CLIENT **DISTRICT OF COQUITLAM**
STORM SEWER
BEGIN ST.
THOMAS AVE. - BRUNETTE AVE.

SURVEYED BY	DATE NOV. 1988
DRAWN BY S.G., P.R.	DRAWING No.
DESIGNED BY C.E.	839-ST8-2
SCALES	REV. 1
VERTICAL 1" = 50'	SHEET 10 OF 19
HORIZONTAL 1" = 100'	

DESTROY ALL PRINTS BEARING PREVIOUS No. 1

BENCHMARK INFORMATION
 MON # 73H0436 ON LAVAL ST. AT THOMAS AVE.
 ELEVATION 47.998
 MON # 73H0422 ON ROCHESTER AVE. AT LAVAL ST.
 ELEVATION 76.743

D-1131

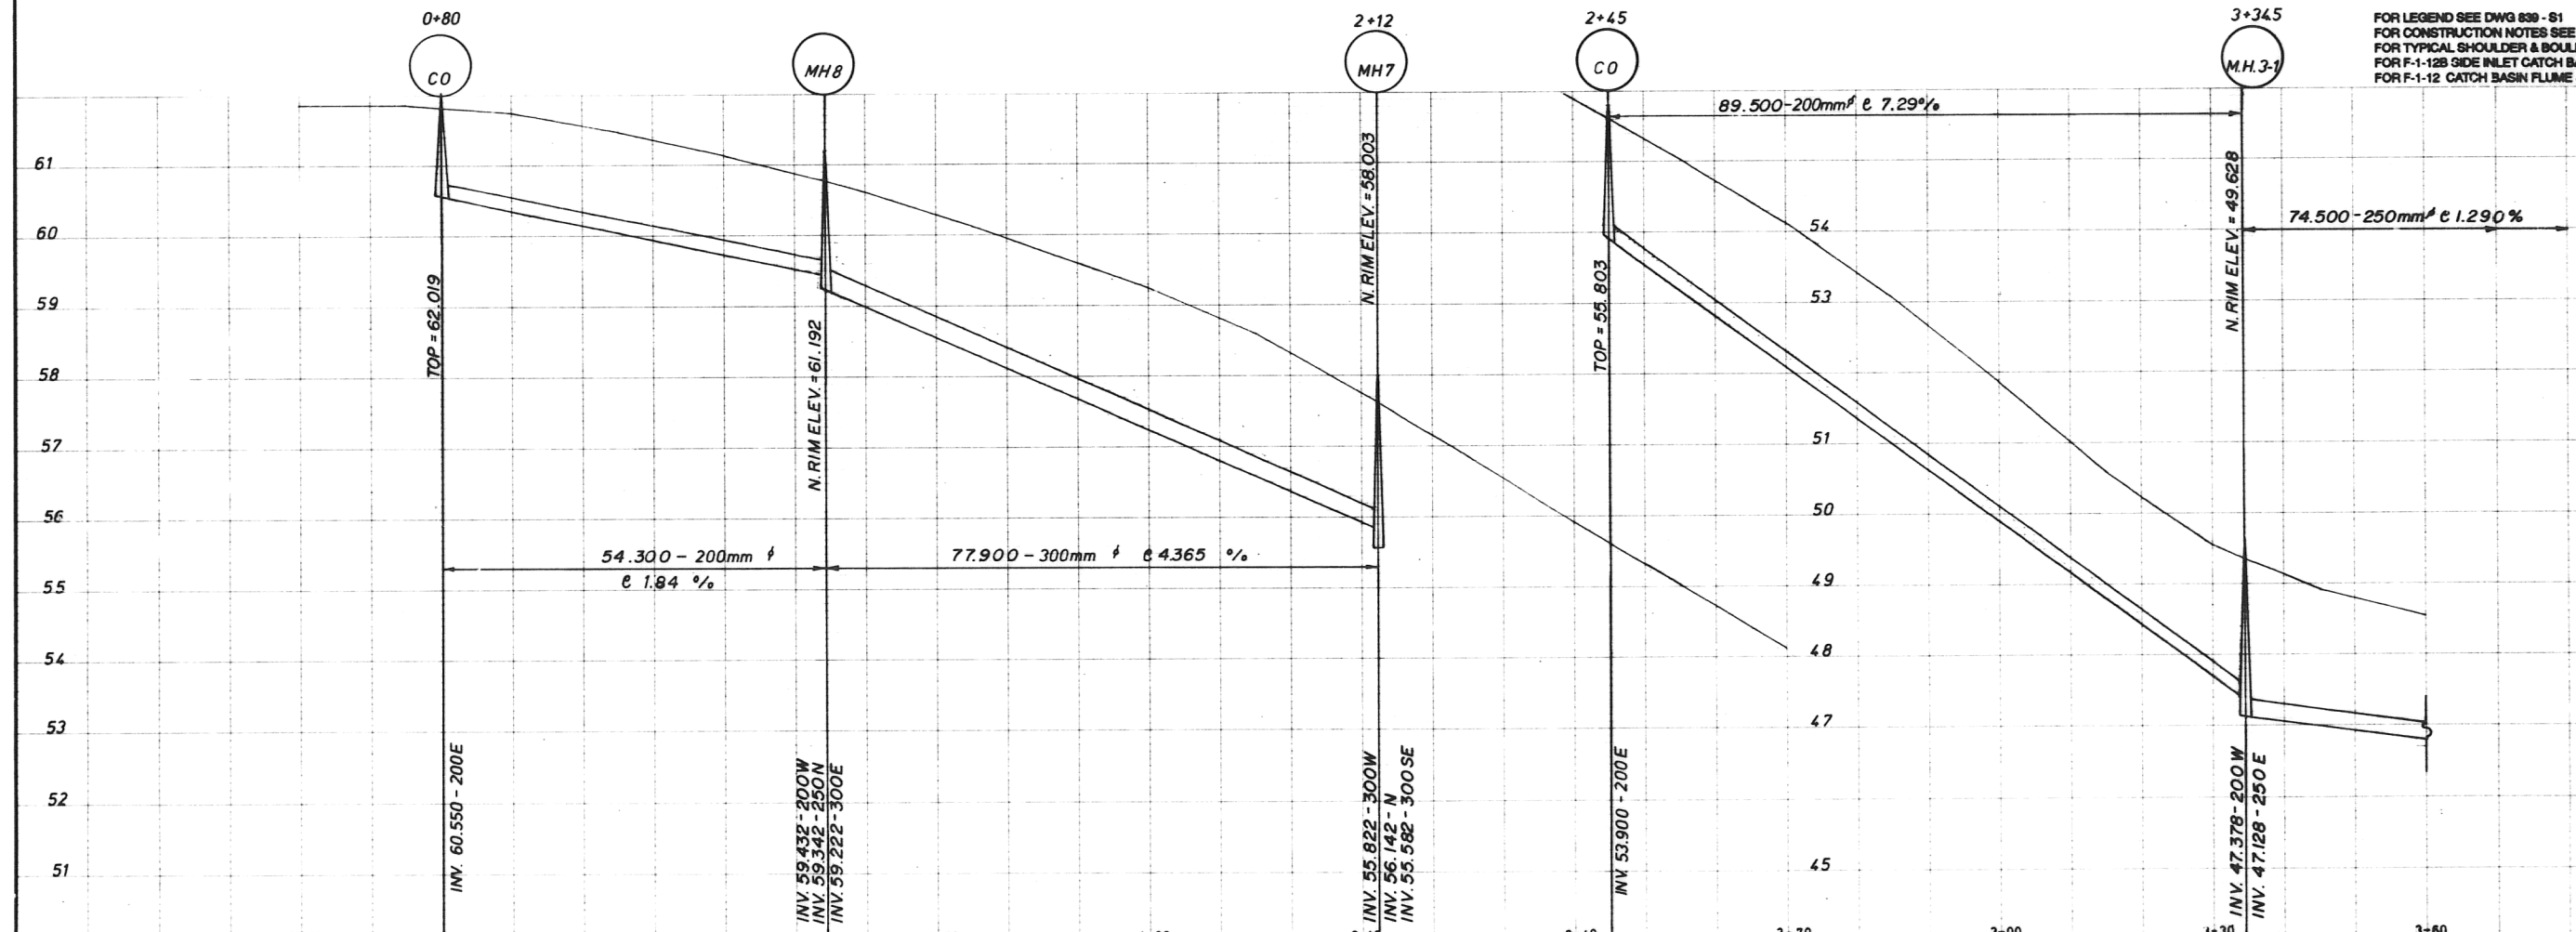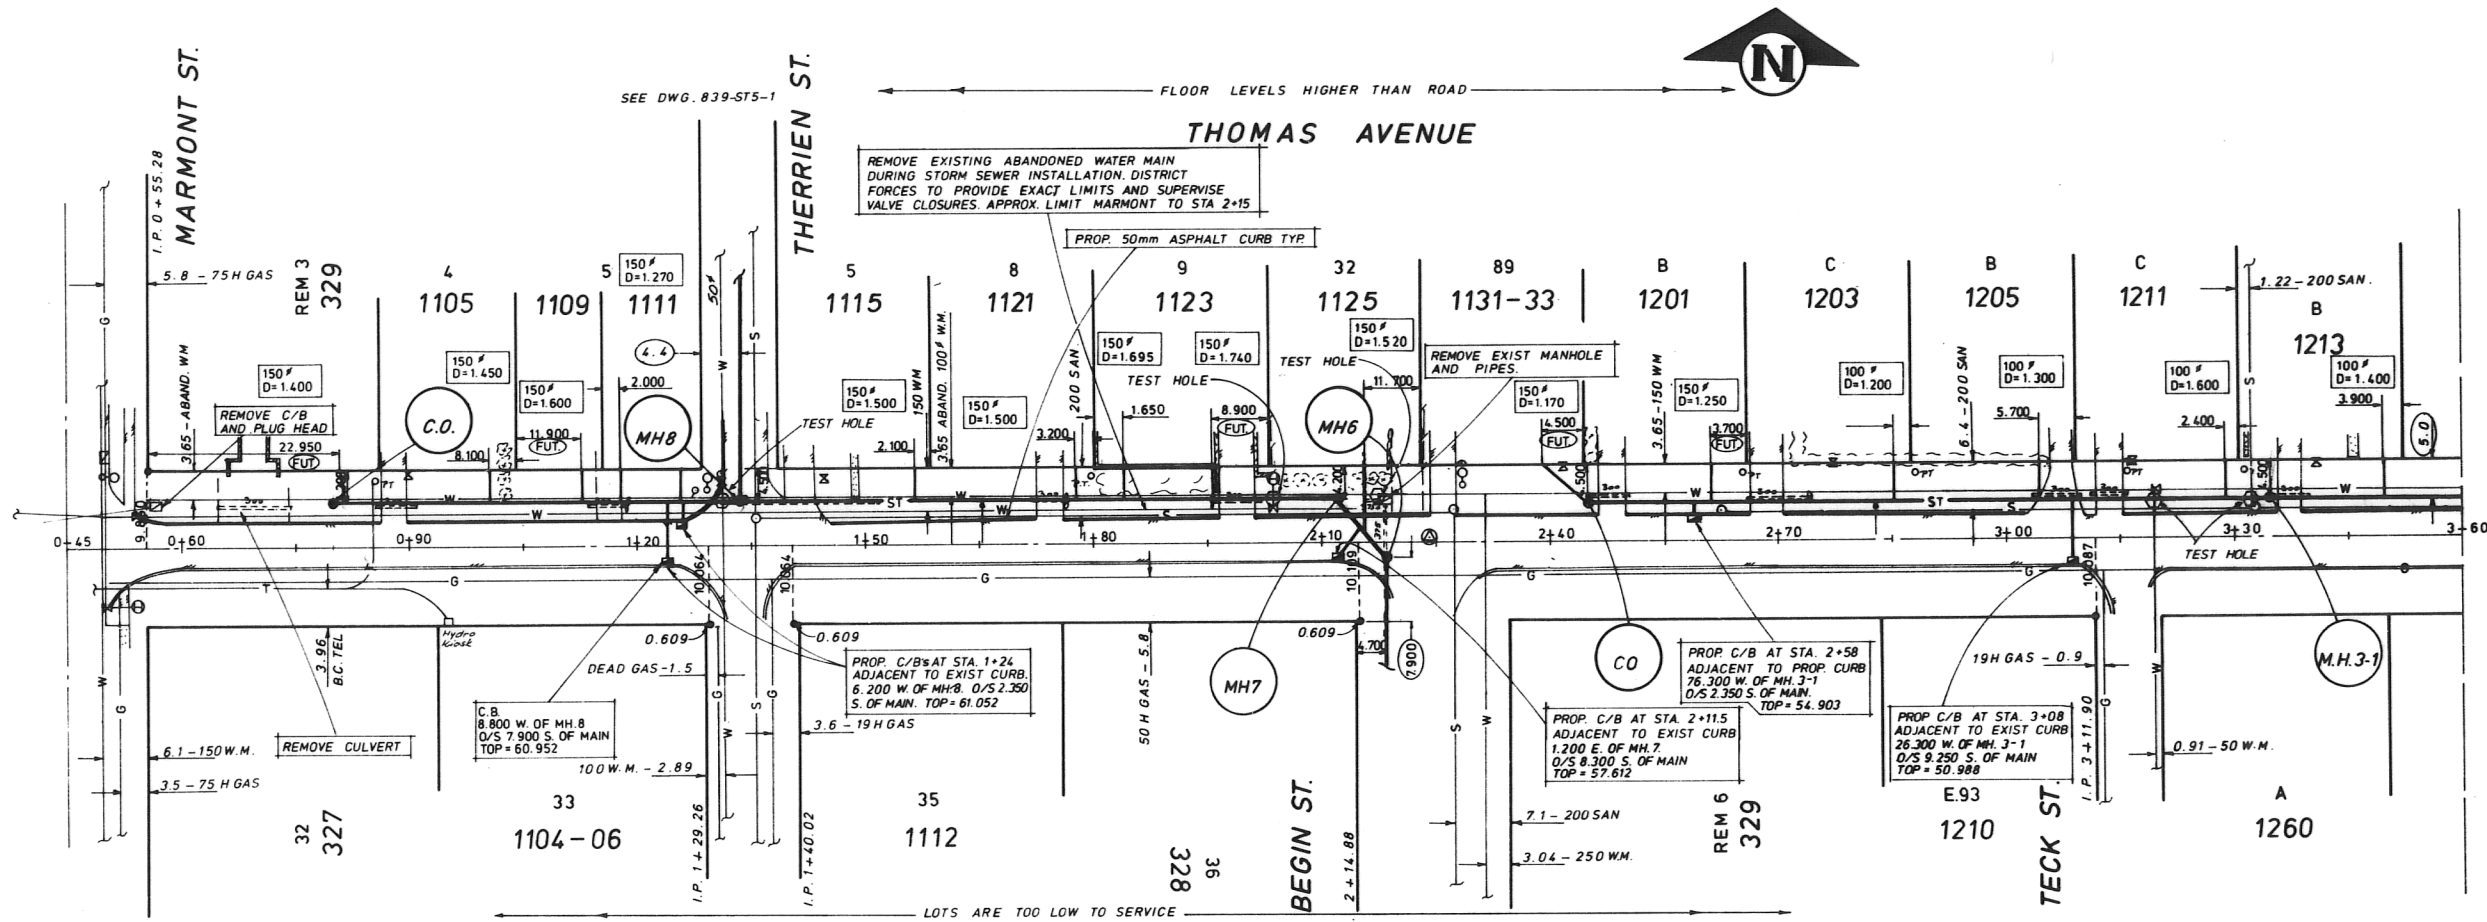

FIELD BOOK No.	Pg No.	No.	DATE	REVISION	BY
		1	89-02-15	PROFILES CHANGED, MISC. NOTES ADDED.	C.E.

R.F. BINNIE & ASSOCIATES LTD.
 CONSULTING CIVIL ENGINEERS

CLIENT **DISTRICT OF COQUITLAM**

STORM SEWER
 THOMAS AVE. (NORTH SIDE)
 MARMONT ST. - CASEY ST.

SURVEYED BY
 DRAWN BY S.G., 7/2
 DESIGNED BY C.E.


DATE NOV. 1988
 DRAWING No.
839-ST11-1

SCALES
 VERTICAL 1:50
 HORIZONTAL 1:


SHEET 13 OF 19 REV. 1

BENCHMARK INFORMATION
 MON # 73H0436 ON LAVAL ST. AT THOMAS AVE.
 ELEVATION 47.998
 MON # 73H0422 ON ROCHESTER AVE. AT LAVAL ST.
 ELEVATION 76.743

D - 1132

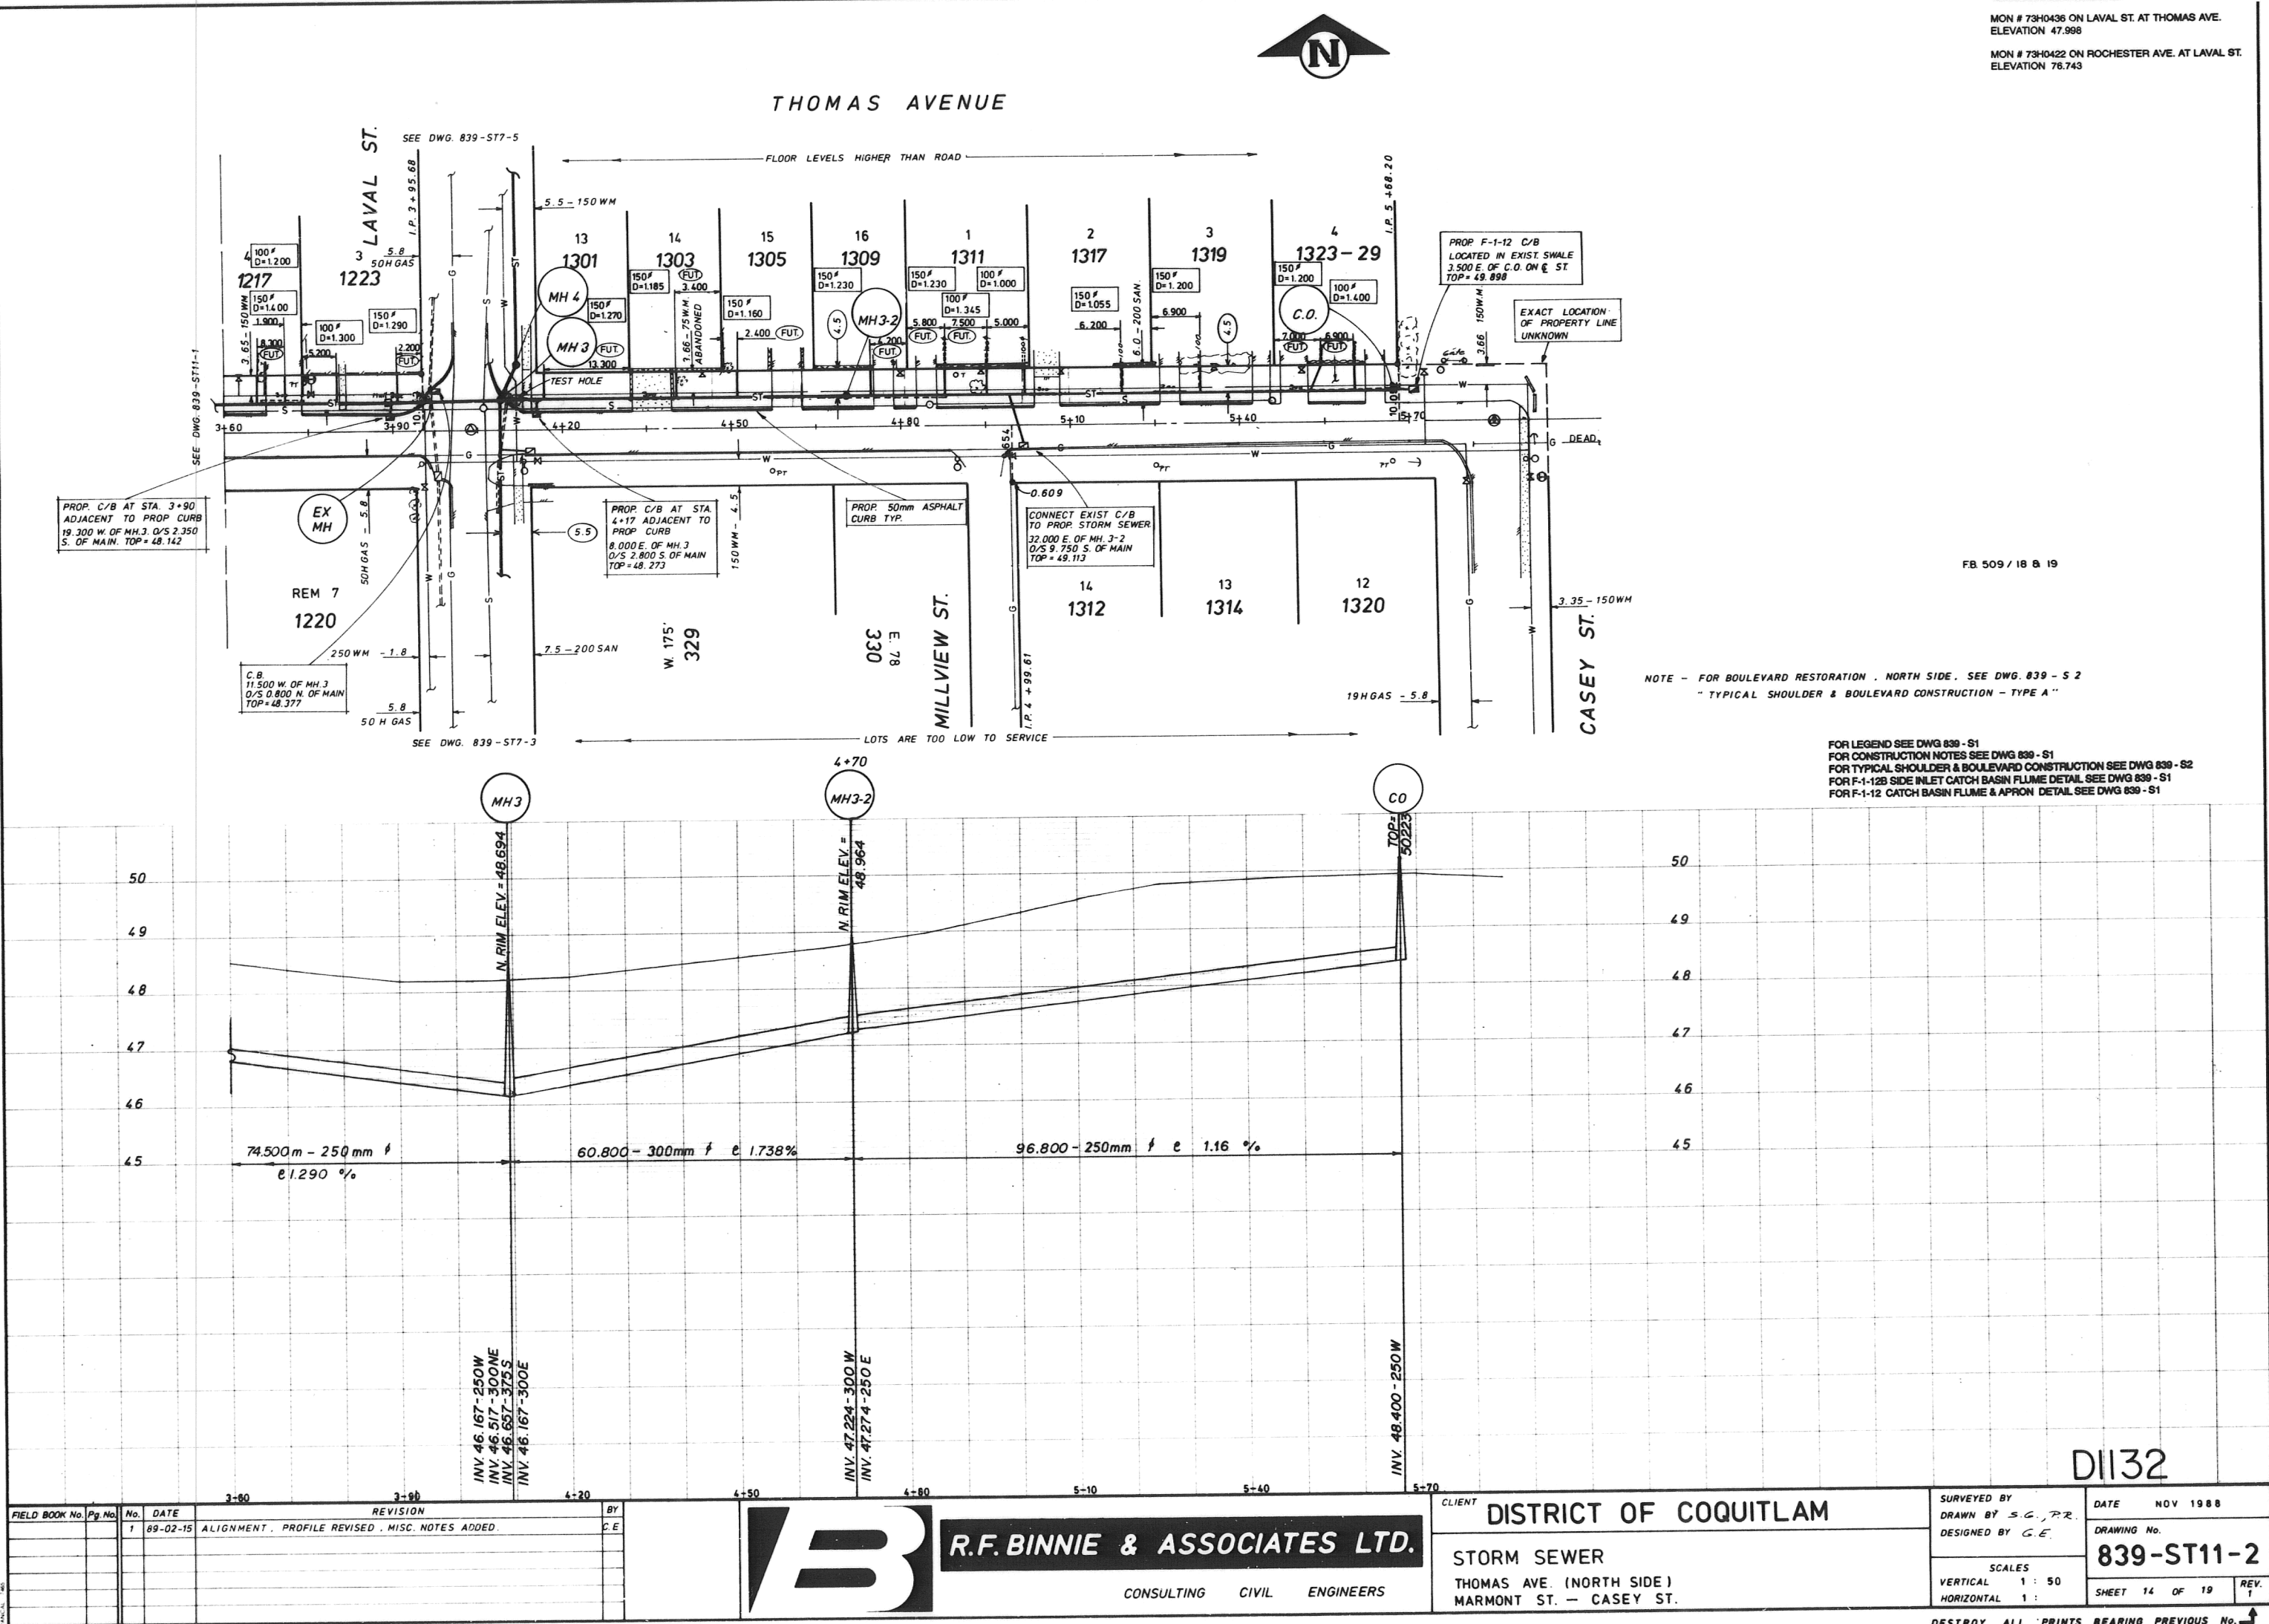

D 1478-2

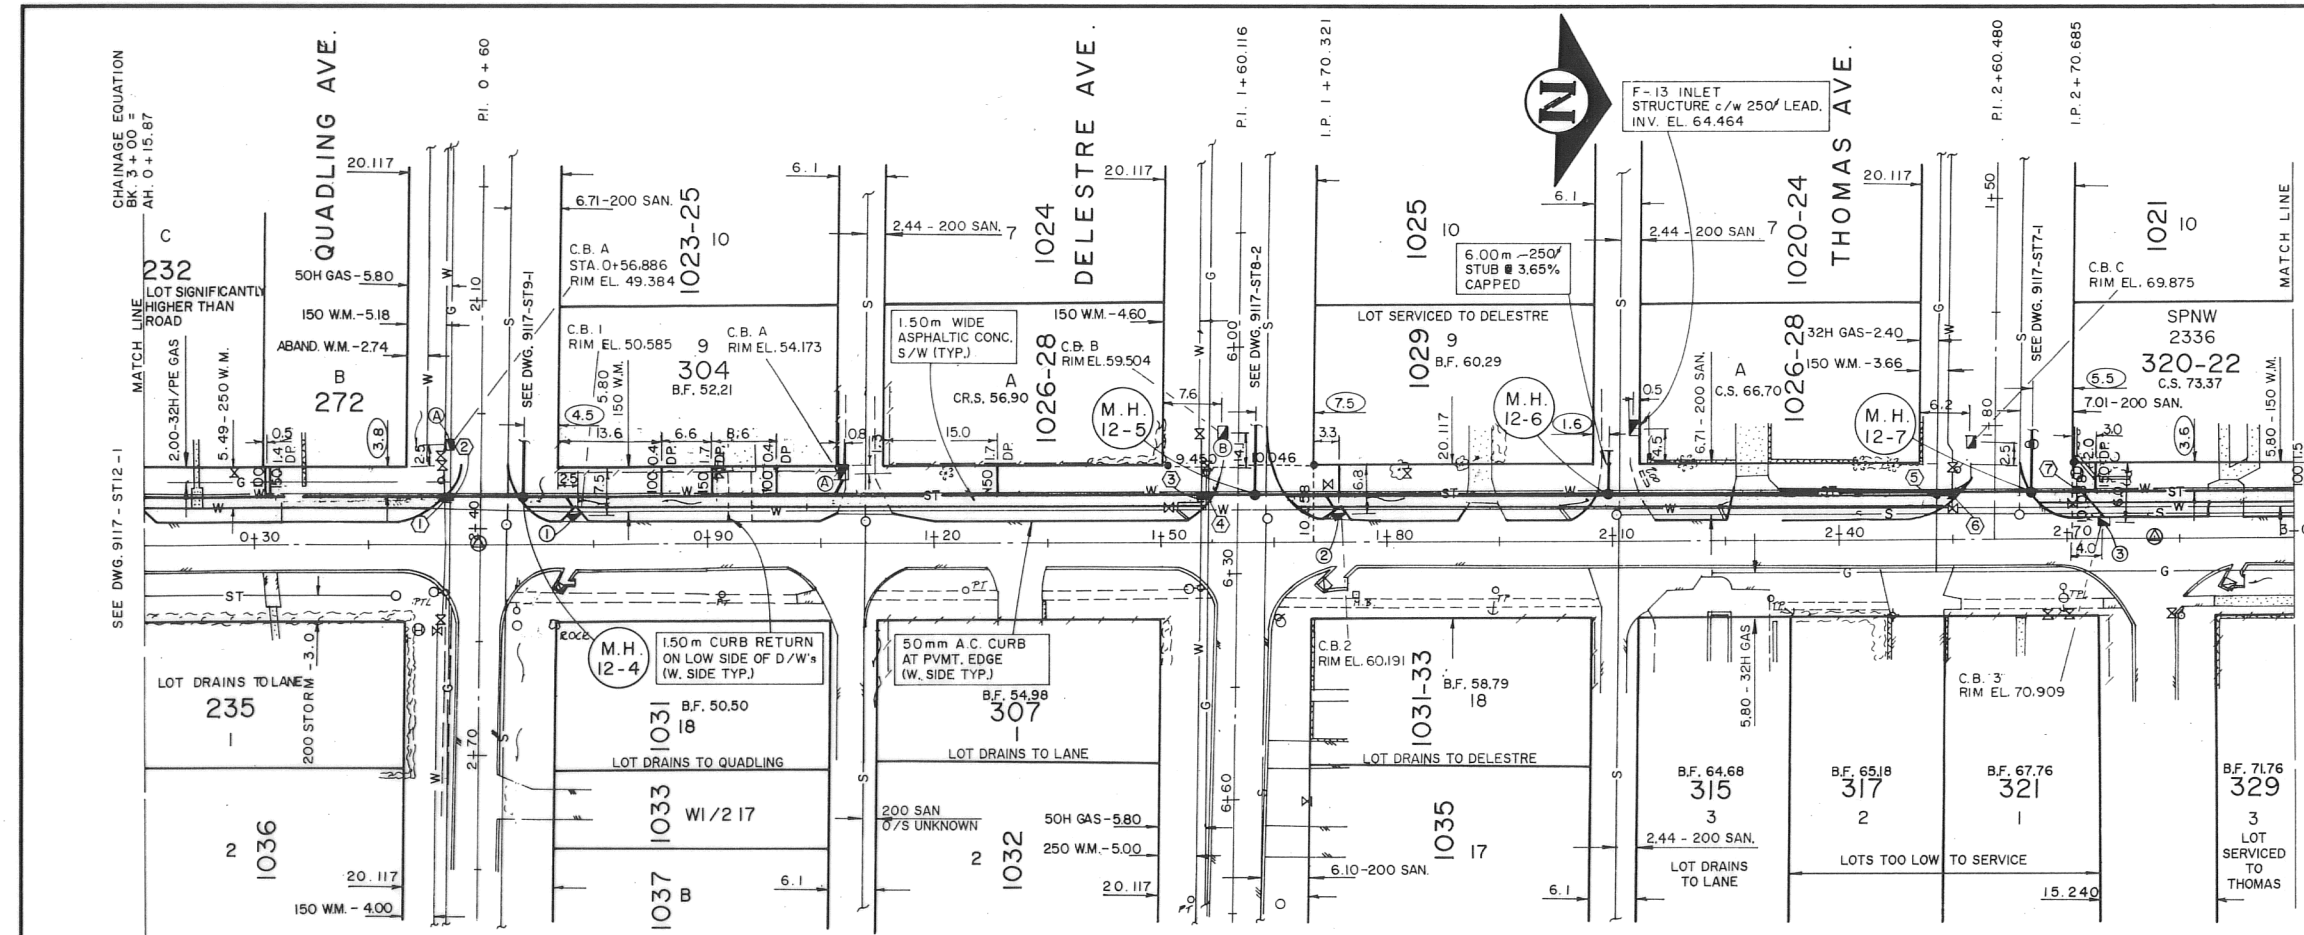




D-1482

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT LOCATED ON
THE CITY OF COQUITLAM AS-BUILTS.
CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT
AS-BUILTS PERTAINING TO THESE UTILITIES.


NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE
APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A
PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY
EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR
GENERAL INFORMATION ONLY AND THE ACCURACY OF
INFORMATION CONTAINED ON THE DOCUMENT IS NO
WAY GUARANTEED BY THE CITY.

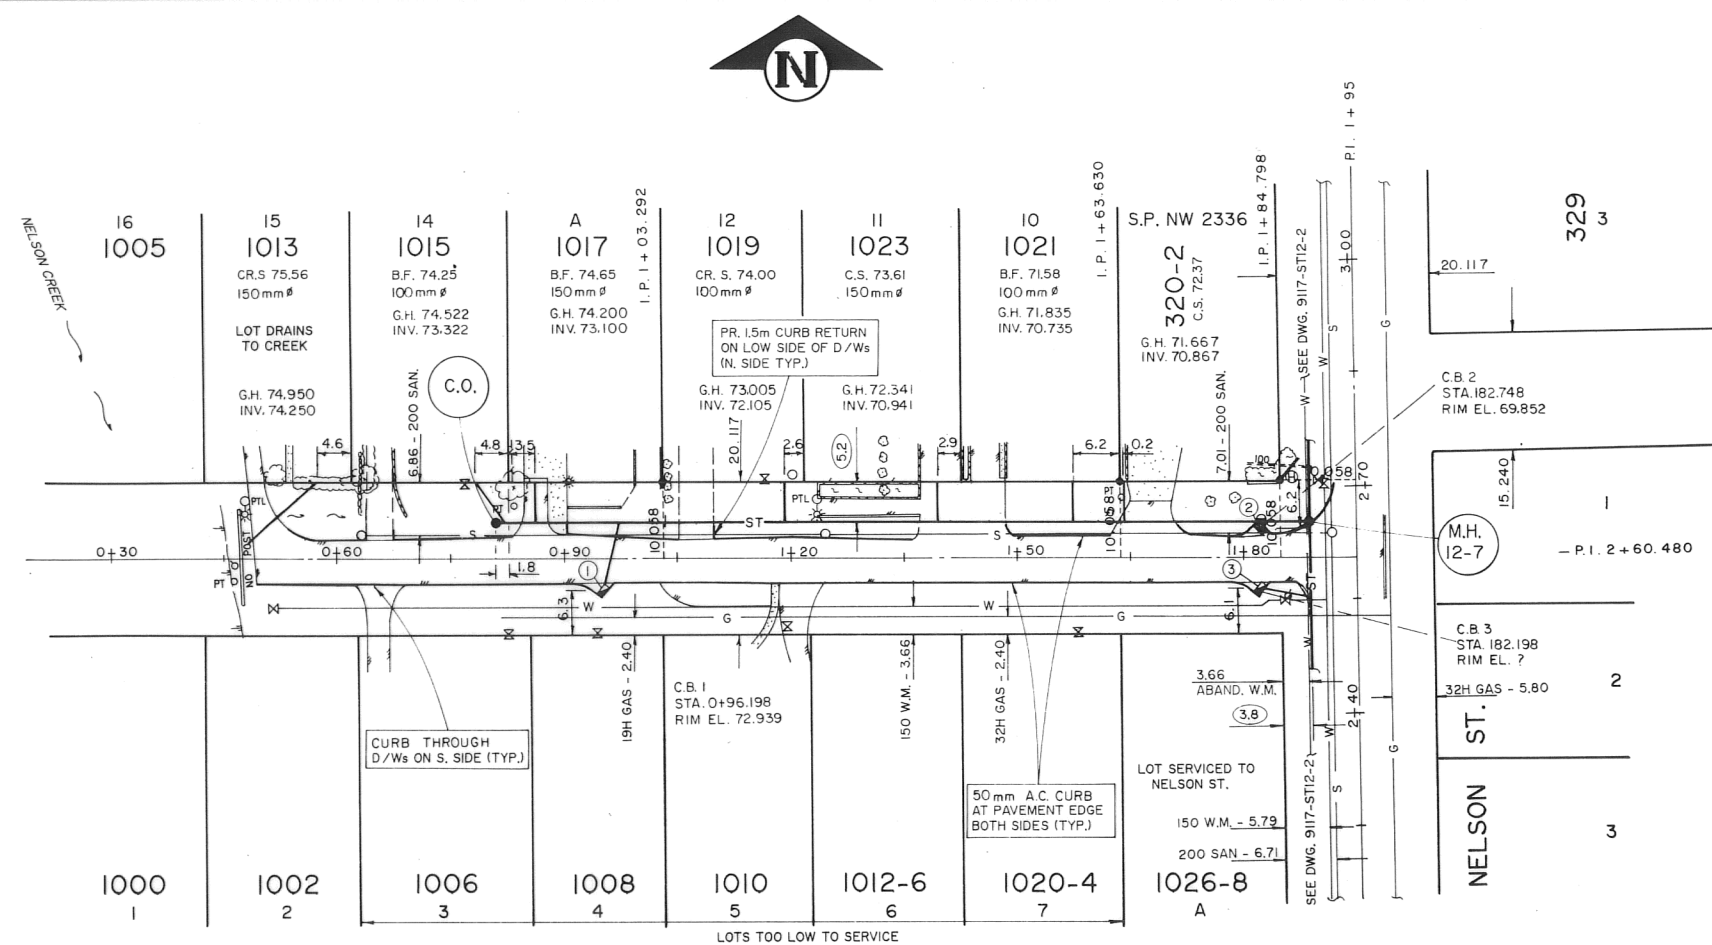


CATCH BASIN INFORMATION TABLE		
CB NO.	STATION & OFFSET TO CENTRE OF CB BARREL	DESCRIPTION
1	STA. 0 + 95 - 4.05 S	F-1-12 B
2	STA. 1 + 82 - 4.05 N	F-1-12 B
3	STA. 1 + 82 - 4.05 S	F-1-12 B

* SEE DETAIL 'B' DRAWING NO. 9117-D

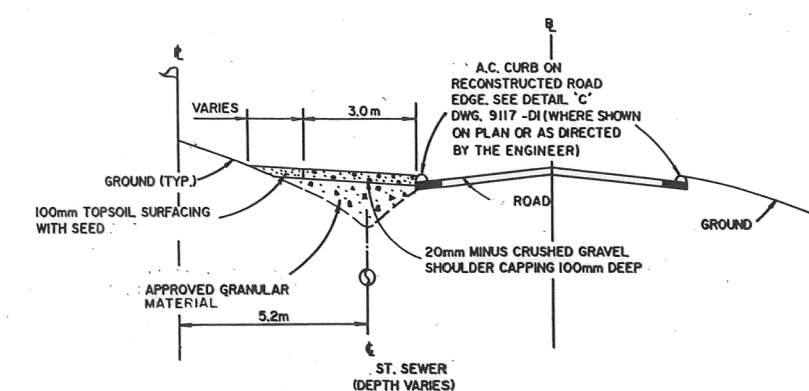

TYPICAL SECTION SHOULDER & BOULEVARD CONSTRUCTION
THOMAS AVE. - WEST END TO NELSON ST.
N.T.S.

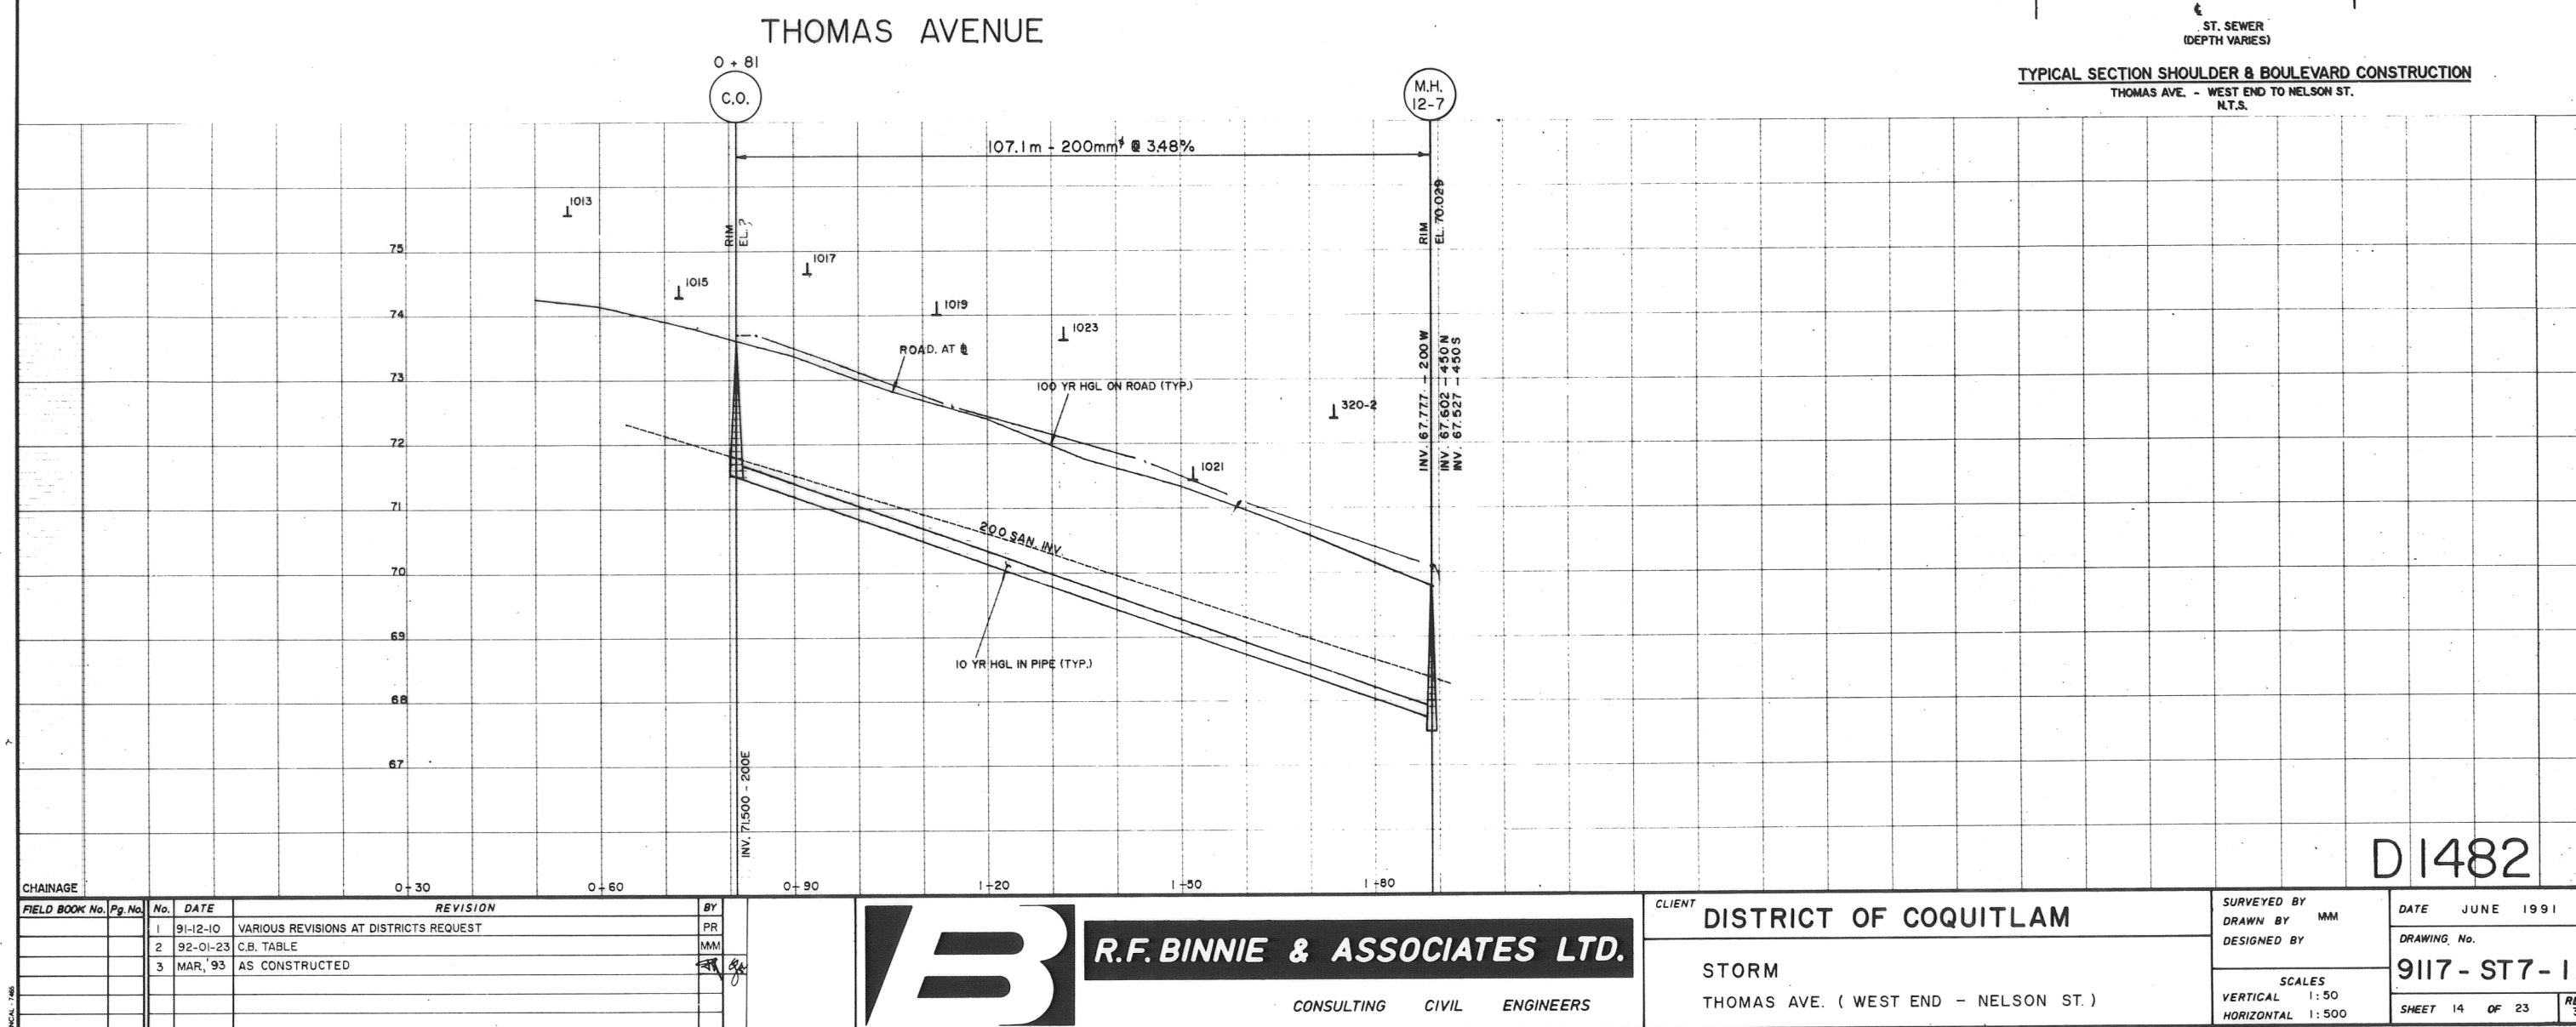

D 1482


SURVEYED BY DRAWN BY MM DESIGNED BY	DATE JUNE 199
	DRAWING No. 9117 - ST7 -
SCALES VERTICAL 1:50 HORIZONTAL 1:500	SHEET 14 OF 23

DESTROY ALL PRINTS BEARING PREVIOUS NO.

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT LOCATED ON THE CITY OF COQUITLAM AS-BUILTS.
CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NO WAY GUARANTEED BY THE CITY.

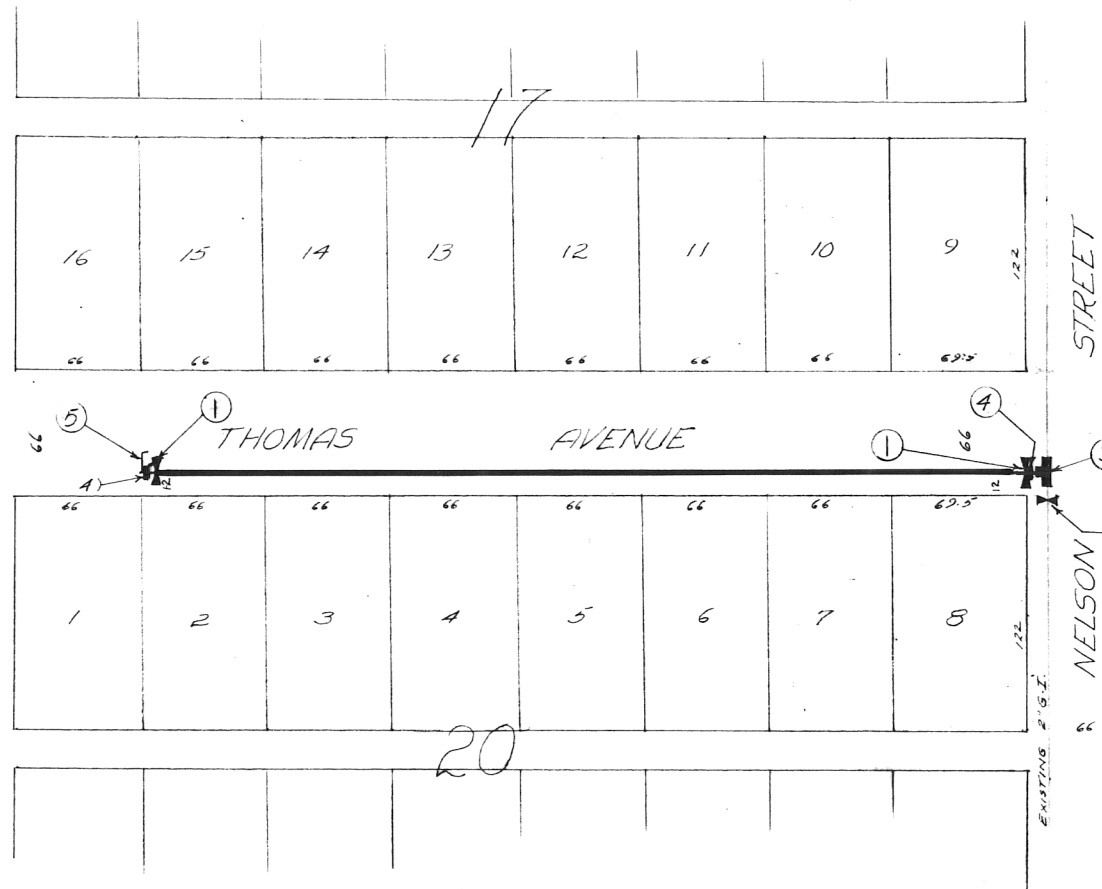


PIPE AND FITTINGS REQUIRED		QUANTITY
ITEM		
①	6" C.I. HUB GATE VALVE	2
②	2" GATE VALVE	2
③	2X2X2 G.I. TEE	1
④	6" C.I. CAP WITH 2" IPT	2
⑤	2" STANDPIPE	1
⑥	6" G.I. CLASS'D PIPE	Approx. 477'

DISTRICT OF COQUITLAM
LOCAL IMPROVEMENT
ON
THOMAS AVENUE
SCALE 1"=50'

N.F.H.	DEC. 8, 1989	9-504
--------	--------------	-------

THIS IS A REDUCED DRAWING W 9-504

REVISION	NO	DATE	BY	CHK'D	<div><div><div>PROPOSED</div><div>EXISTING</div></div><div>ST SEWER — ST — SAN SEWER — SAN — GAS — G — WATER — W — U/G ELEC. — BCH — U/G TEL. — BCT —</div><div><div>PROPOSED</div><div>EXISTING</div></div><div>VALVE — MANHOLE —</div><div>STORM INLET TYPES I — II — III — IV —</div></div>	<div><div>DITCH</div><div>UTILITY POLE</div><div>FIRE HYDRANT</div><div>IRON PIN</div><div>BASEMENT ELEV.</div><div>EDGE OF PVMT.</div></div>	DESIGNED —	APP'D —	<div><div>DISTRICT OF COQUITLAM</div><div>ENGINEERING DEPARTMENT</div></div>	<div><div>WATERMAINS</div><div>THOMAS AVENUE</div><div>WEST OFF NELSON STREET</div></div>	FILE —
							DRAWN —	DATE —			DWG — 9-504
							CHECKED —	SCALE			SHEET
							DATE —	HORIZ — VERT. —			OF

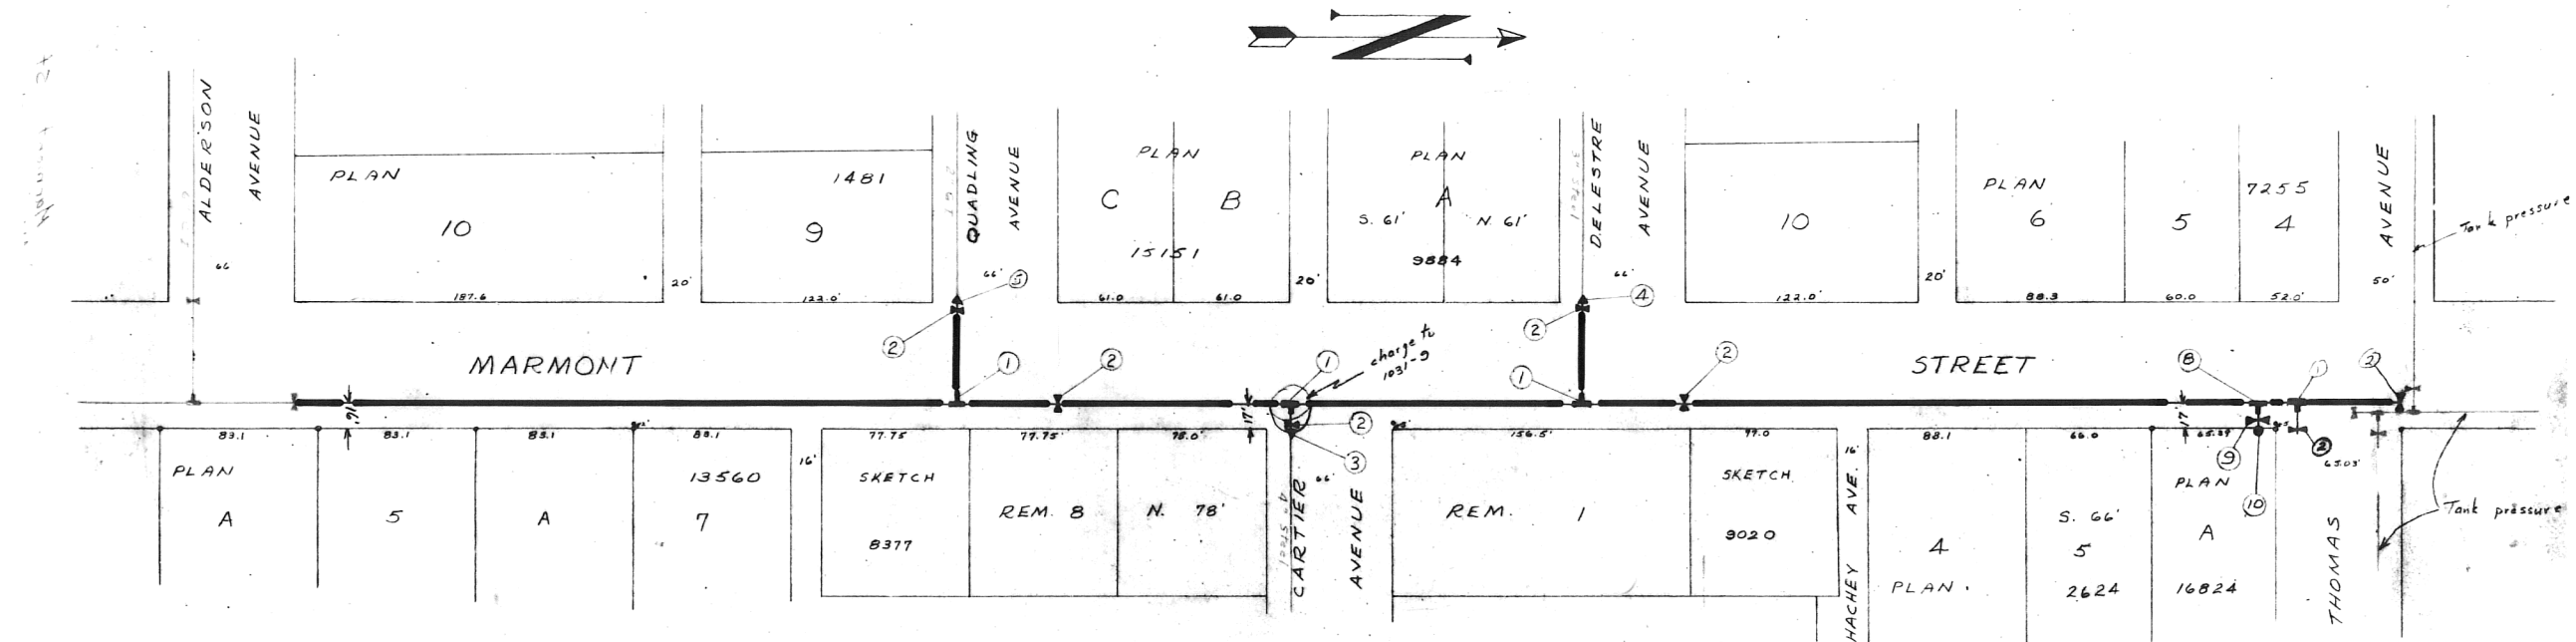

<u>No.</u>	<u>Description.</u>	<u>Quantity.</u>
①	6"x6"x6" C.I. Hub Tee	3
②	6" C.I. Hub Gate Valve	6
③	6" C.I. to 4" Steel Adapter	1
④	6" C.I. to 3" Steel Adapter	1
⑤	6" Cap with 2" IPT	1
⑥		
⑦	6" C.I. Class D Pipe	1150 ± 1174
⑧	6"x6"x6" C.I. Hub & Flanged Tee	1
⑨	6" C.I. Hub & Flanged Gate Valve	1
⑩	6" C.I. #1 Hydrant	1

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON
THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS.
CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR
CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE
ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND
MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES
ARE NOT NECESSARILY SHOWN.


**THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM
FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF
INFORMATION CONTAINED ON THE DOCUMENT IS NOT
GUARANTEED BY THE CITY.**

DISTRICT of COQUITLAM
G" C. I. WATERMAIN
MARMONT ST.
ALDERSON - THOMAS
Scale 1" = 50'

Drawn by - EKN	Date - Nov /56	Plan No. - 1031-6
-------------------	-------------------	----------------------

THIS IS A REDUCED DRAWING W 1031-6

				<table><tr><td>ST SEWER</td><td>PROPOSED</td><td>EXISTING</td><td rowspan="5">LEGEND <table><tr><td>VALVE</td><td>PROPOSED</td><td>EXISTING</td></tr><tr><td>MANHOLE</td><td></td><td></td></tr><tr><td colspan="3">STORM INLET TYPES</td></tr><tr><td>I</td><td>II</td><td>III</td></tr><tr><td>IV</td><td></td><td></td></tr></table></td><td rowspan="5">DITCH UTILITY POLE FIRE HYDRANT IRON PIN BASEMENT ELEV. EDGE OF P.V.M.T.</td><td colspan="2">DESIGNED -</td><td colspan="2">APP'D -</td><td rowspan="5">DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT</td><td colspan="2">WATERMAINS</td><td colspan="2">FILE -</td></tr><tr><td>SAN SEWER</td><td>ST</td><td>ST</td><td colspan="2">DRAWN -</td><td colspan="2">DATE -</td><td colspan="2">MARMONT STREET</td><td colspan="2">DWG - 1031-6</td></tr><tr><td>GAS</td><td>SAN</td><td>SAN</td><td colspan="2">CHECKED -</td><td colspan="2"></td><td colspan="2"></td><td colspan="2"></td></tr><tr><td>WATER</td><td>W</td><td>W</td><td colspan="2">DATE -</td><td colspan="2">SCALE HORIZ. - VERT. -</td><td colspan="2">ALDERSON AVE. TO THOMAS AVE.</td><td colspan="2">SHEET OF</td></tr><tr><td>U/G ELEC.</td><td>BCH</td><td>BCH</td><td colspan="2"></td><td colspan="2"></td><td colspan="2"></td><td colspan="2"></td></tr><tr><td>U/G TEL.</td><td>BCT</td><td>BCT</td><td colspan="2"></td><td colspan="2"></td><td colspan="2"></td><td colspan="2"></td></tr></table>				ST SEWER	PROPOSED	EXISTING	LEGEND <table><tr><td>VALVE</td><td>PROPOSED</td><td>EXISTING</td></tr><tr><td>MANHOLE</td><td></td><td></td></tr><tr><td colspan="3">STORM INLET TYPES</td></tr><tr><td>I</td><td>II</td><td>III</td></tr><tr><td>IV</td><td></td><td></td></tr></table>	VALVE	PROPOSED	EXISTING	MANHOLE			STORM INLET TYPES			I	II	III	IV			DITCH UTILITY POLE FIRE HYDRANT IRON PIN BASEMENT ELEV. EDGE OF P.V.M.T.	DESIGNED -		APP'D -		DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT	WATERMAINS		FILE -		SAN SEWER	ST	ST	DRAWN -		DATE -		MARMONT STREET		DWG - 1031-6		GAS	SAN	SAN	CHECKED -								WATER	W	W	DATE -		SCALE HORIZ. - VERT. -		ALDERSON AVE. TO THOMAS AVE.		SHEET OF		U/G ELEC.	BCH	BCH									U/G TEL.	BCT	BCT									N ^o DATE BY CHK'D	
ST SEWER	PROPOSED	EXISTING	LEGEND <table><tr><td>VALVE</td><td>PROPOSED</td><td>EXISTING</td></tr><tr><td>MANHOLE</td><td></td><td></td></tr><tr><td colspan="3">STORM INLET TYPES</td></tr><tr><td>I</td><td>II</td><td>III</td></tr><tr><td>IV</td><td></td><td></td></tr></table>	VALVE	PROPOSED	EXISTING	MANHOLE			STORM INLET TYPES			I	II	III	IV			DITCH UTILITY POLE FIRE HYDRANT IRON PIN BASEMENT ELEV. EDGE OF P.V.M.T.	DESIGNED -		APP'D -		DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT	WATERMAINS			FILE -																																																																	
VALVE	PROPOSED	EXISTING																																																																																											
MANHOLE																																																																																													
STORM INLET TYPES																																																																																													
I	II	III																																																																																											
IV																																																																																													
SAN SEWER	ST	ST	DRAWN -		DATE -		MARMONT STREET		DWG - 1031-6																																																																																				
GAS	SAN	SAN	CHECKED -																																																																																										
WATER	W	W	DATE -		SCALE HORIZ. - VERT. -		ALDERSON AVE. TO THOMAS AVE.		SHEET OF																																																																																				
U/G ELEC.	BCH	BCH																																																																																											
U/G TEL.	BCT	BCT																																																																																											

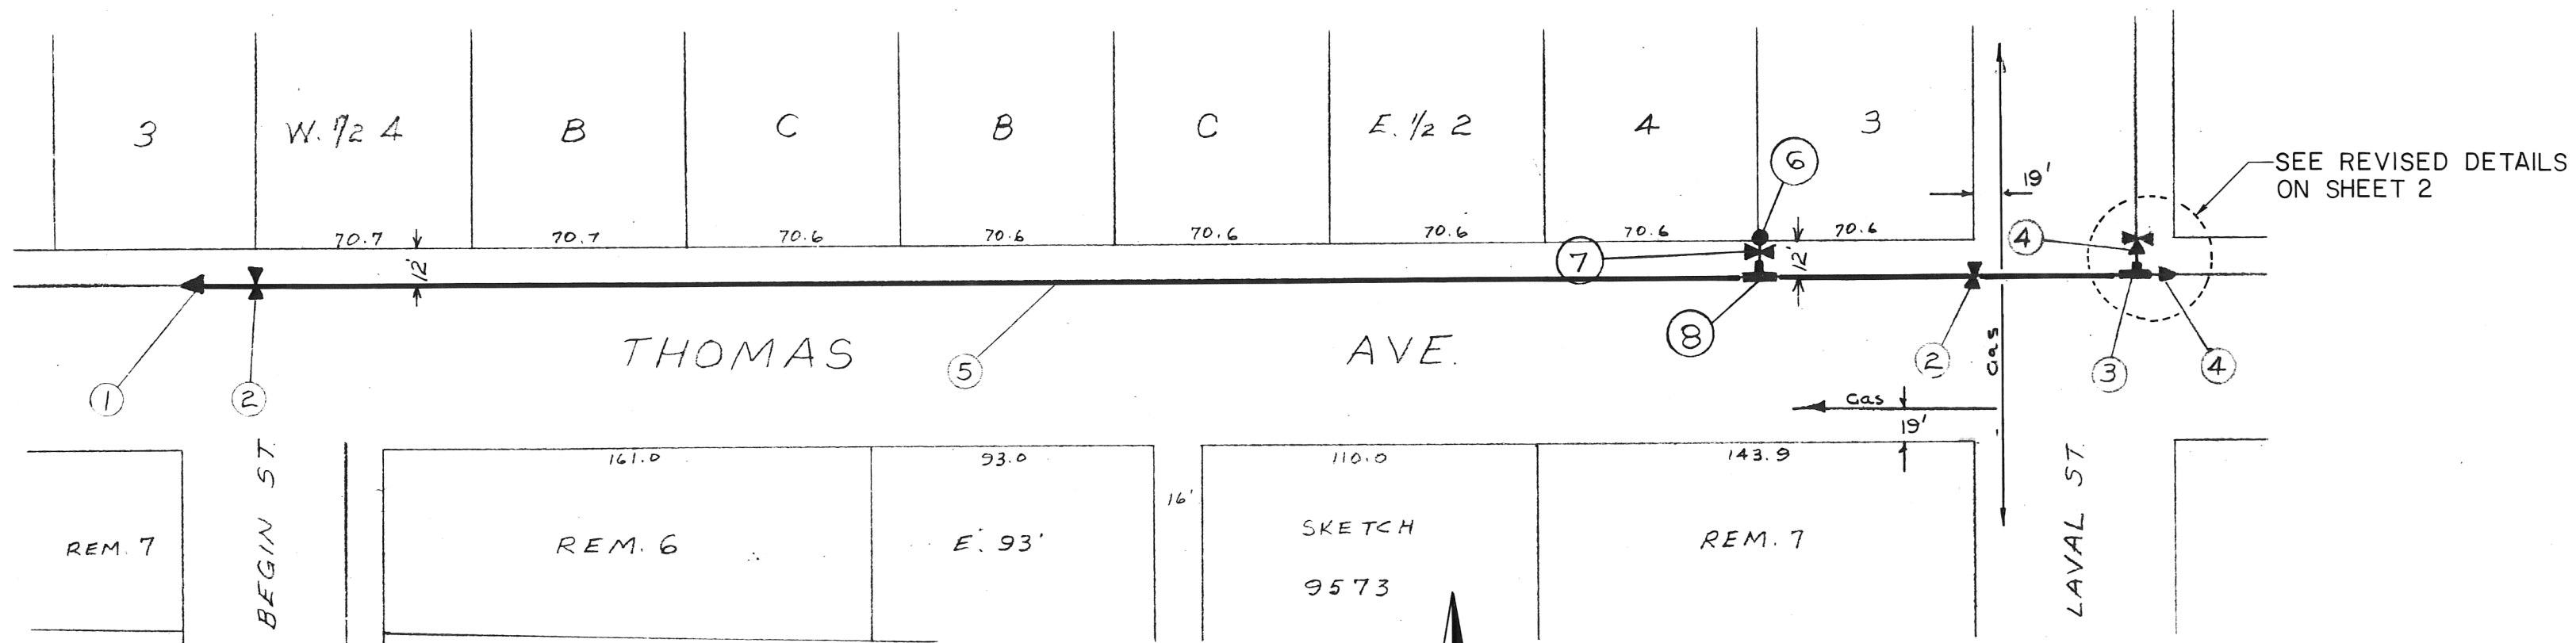


No.	Description	Quantity
①	6" C.I. to 4" W.S. Adapter	3
②	6" C.I. Hub Gate Valve Mech	2 1
③	6" x 6" x 6" C.I. Hub Tee Mech	1
④	6" C.I. to 3" W.S. Adapter	2
⑤	6" C.I. Hub Pipe	865' ±
⑥	6" C.I. N° 1 HYDRANT Mech	1
⑦	6" C.I. HUB MECH. VALVE flanged	1
⑧	6" x 6" x 6" C.I. HUB MECH & FLANGE TEE	1
10	4" C.I. pipe	28'
11	4" - 45° C.I. Hub Bonds.	4

DISTRICT of COQUITLAM
6" C.I. WATERMAIN
THOMAS AVE.
BEGIN TO LAVAL
Scale 1" = 50'

Drawn by - E K N	Date - /60	Plan No - 1031-22
---------------------	---------------	----------------------

Amedd 21.6.60

W 1031-22-1

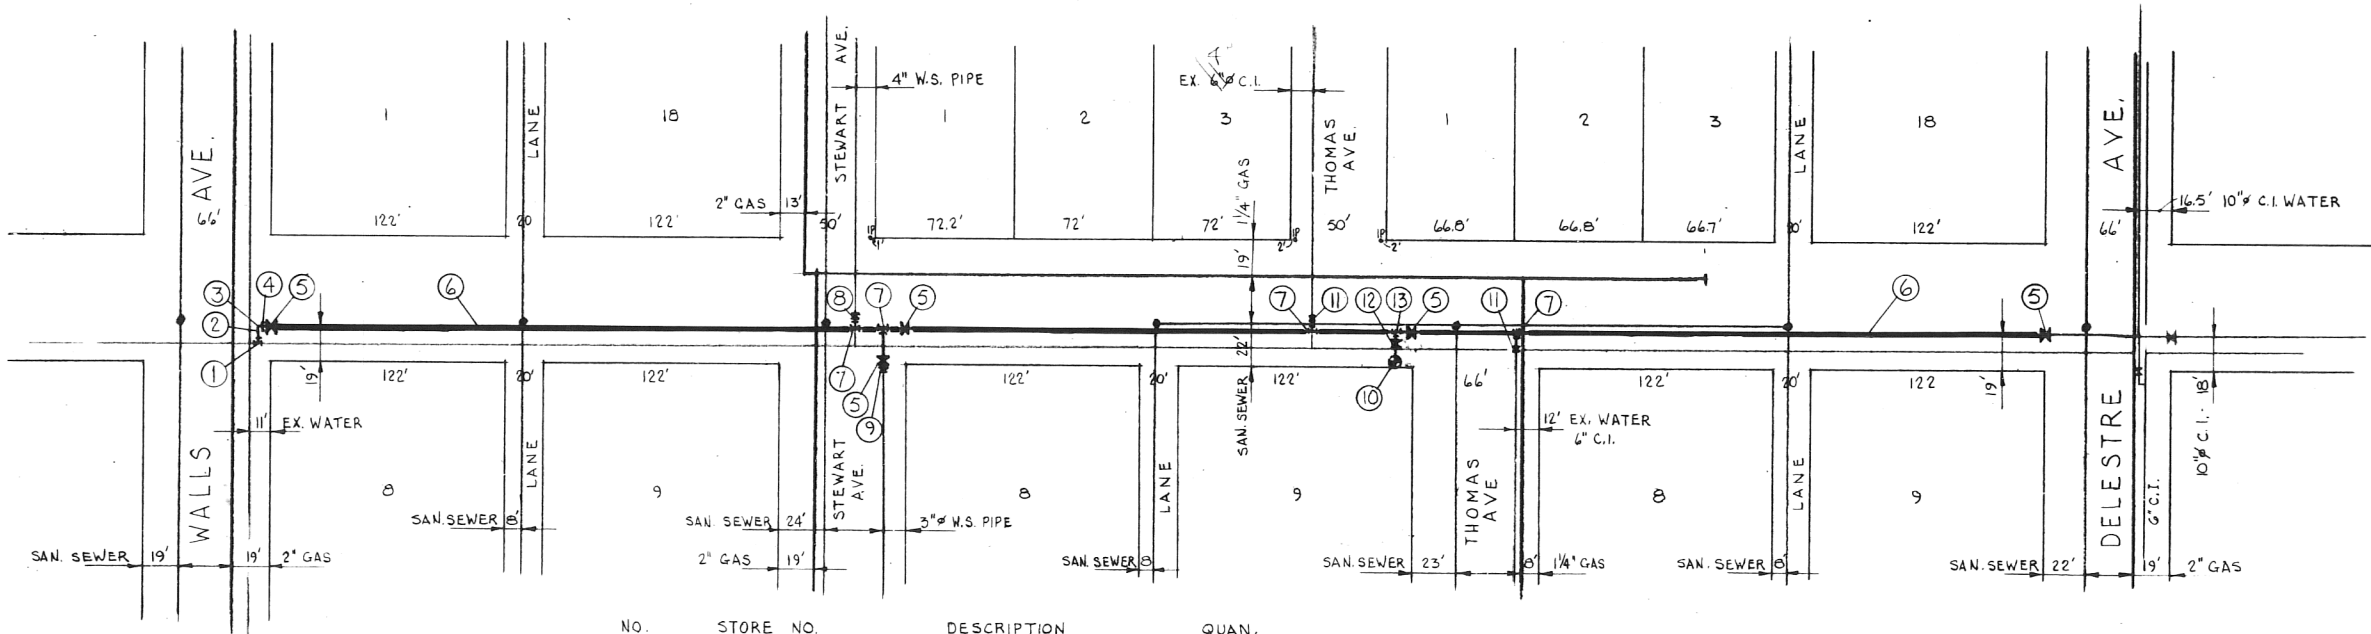

NO.	STORE NO.	DESCRIPTION	QUAN.
1		2" GAL. T. TEE	1
2		2" GAL. I. PIPE	10'
3		2" GAL. I x 90° ELBOW	1
4	3504	6" HM x 2" IPT REDUCER	1
5	3708	6" HM VALVE	5
6	1710	6" C.I. TYTON PIPE	970'
7	3628	6" HM TEE	4
8		6" HM x 4" W.S. ADAPTER	1
9		6" HM x 3" W.S. ADAPTER	1
10	3402	6" NO. 1 HYDRANT	1
11		6" DRESSER	2
12	3706	6" HM x FLG. VALVE	1
13	3626	6" x 6" HM x 6" FLG. TEE	1

DISTRICT OF COQUITLAM
6" C.I. REPLACEMENT W/M
ON NELSON ST. FROM
WALLS AVE. TO DELESTRE
AVE.


Drawn by:	Scale:	Date:	Plan no.
L.T.S.	1" = 50'	29 JAN. 1965	1031 - 44

THIS IS A REDUCED DRAWING W 1031-44

<table><tr><td>ST. SEWER</td><td>ST</td><td>ST</td></tr><tr><td>SAN SEWER</td><td>SAN</td><td>SAN</td></tr><tr><td>GAS</td><td>G</td><td>G</td></tr><tr><td>WATER</td><td>W</td><td>W</td></tr><tr><td>UG ELEC.</td><td>BCH</td><td>BCH</td></tr><tr><td>UG TEL.</td><td>BCT</td><td>BCT</td></tr></table>	ST. SEWER	ST	ST	SAN SEWER	SAN	SAN	GAS	G	G	WATER	W	W	UG ELEC.	BCH	BCH	UG TEL.	BCT	BCT	<table><tr><td>PROPOSED</td><td>EXISTING</td></tr><tr><td>ST</td><td>ST</td></tr><tr><td>SAN</td><td>SAN</td></tr><tr><td>G</td><td>G</td></tr><tr><td>W</td><td>W</td></tr><tr><td>BCH</td><td>BCH</td></tr><tr><td>BCT</td><td>BCT</td></tr></table>	PROPOSED	EXISTING	ST	ST	SAN	SAN	G	G	W	W	BCH	BCH	BCT	BCT	<table><tr><td colspan="4">LEGEND</td></tr><tr><td>VALVE</td><td>MANHOLE</td><td>STORM INLET TYPES</td><td>DITCH</td></tr><tr><td>I</td><td>II</td><td>III</td><td>IV</td></tr></table>	LEGEND				VALVE	MANHOLE	STORM INLET TYPES	DITCH	I	II	III	IV	DESIGNED -	APP'D -	DISTRICT OF COQUITLAM ENGINEERING DEPARTMENT	WATERMAINS NELSON STREET WALLS AVE. TO DELESTRE AVE.	FILE -
	ST. SEWER	ST	ST																																																
	SAN SEWER	SAN	SAN																																																
	GAS	G	G																																																
WATER	W	W																																																	
UG ELEC.	BCH	BCH																																																	
UG TEL.	BCT	BCT																																																	
PROPOSED	EXISTING																																																		
ST	ST																																																		
SAN	SAN																																																		
G	G																																																		
W	W																																																		
BCH	BCH																																																		
BCT	BCT																																																		
LEGEND																																																			
VALVE	MANHOLE	STORM INLET TYPES	DITCH																																																
I	II	III	IV																																																
DRAWN -	DATE -	DWG - 1031-44																																																	
CHECKED -	SCALE -	SHEET																																																	
DATE -	HORIZ - VERT. -	OF																																																	


NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE
APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A
PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY
EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND **THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NO WAY GUARANTEED BY THE CITY.**



DISTRICT OF COQUITLAM
INSTALLATION OF 6" C.I.
WATERMAIN ON MARMONT
STREET BETWEEN THOMAS
AVENUE AND ROCHESTER
AVENUE - REPLACEMENT -

NO.	STORE NO.	DESCRIPTION	QUAN.
		6" CAPS	3
2		6" HM X 4" W.S. ADAPTER	1
3	3708	6" HM VALVE	2
4	3628	6" HM TEE	5
5	3512	6" HM X 90° ELBOW	2
6		6" DRESSER	1
7	1710	6" C.I. TYTON PIPE	1071'
8	3510	6" X 4" HM. REDUCER	2
9	3004	4" HM X 4" W.S. ADAPTER	1
10	3504	6" HM X 2" IPT REDUCER	1
11	3402	6" NO1 HYDRANT (145 LBS)	1
12	3706	6" HM X 6" FLG. VALVE	1
13	3626	6" X 6" HM X 6" FLG. TEE	1
14	3508	6" HM X 45° ELBOW	4
15	3622	6" X 6" X 4" HM TEE	1
16	3302	4" HM X 22 1/2° ELBOW	1
		4" C.I. TYTON PIPE	17'

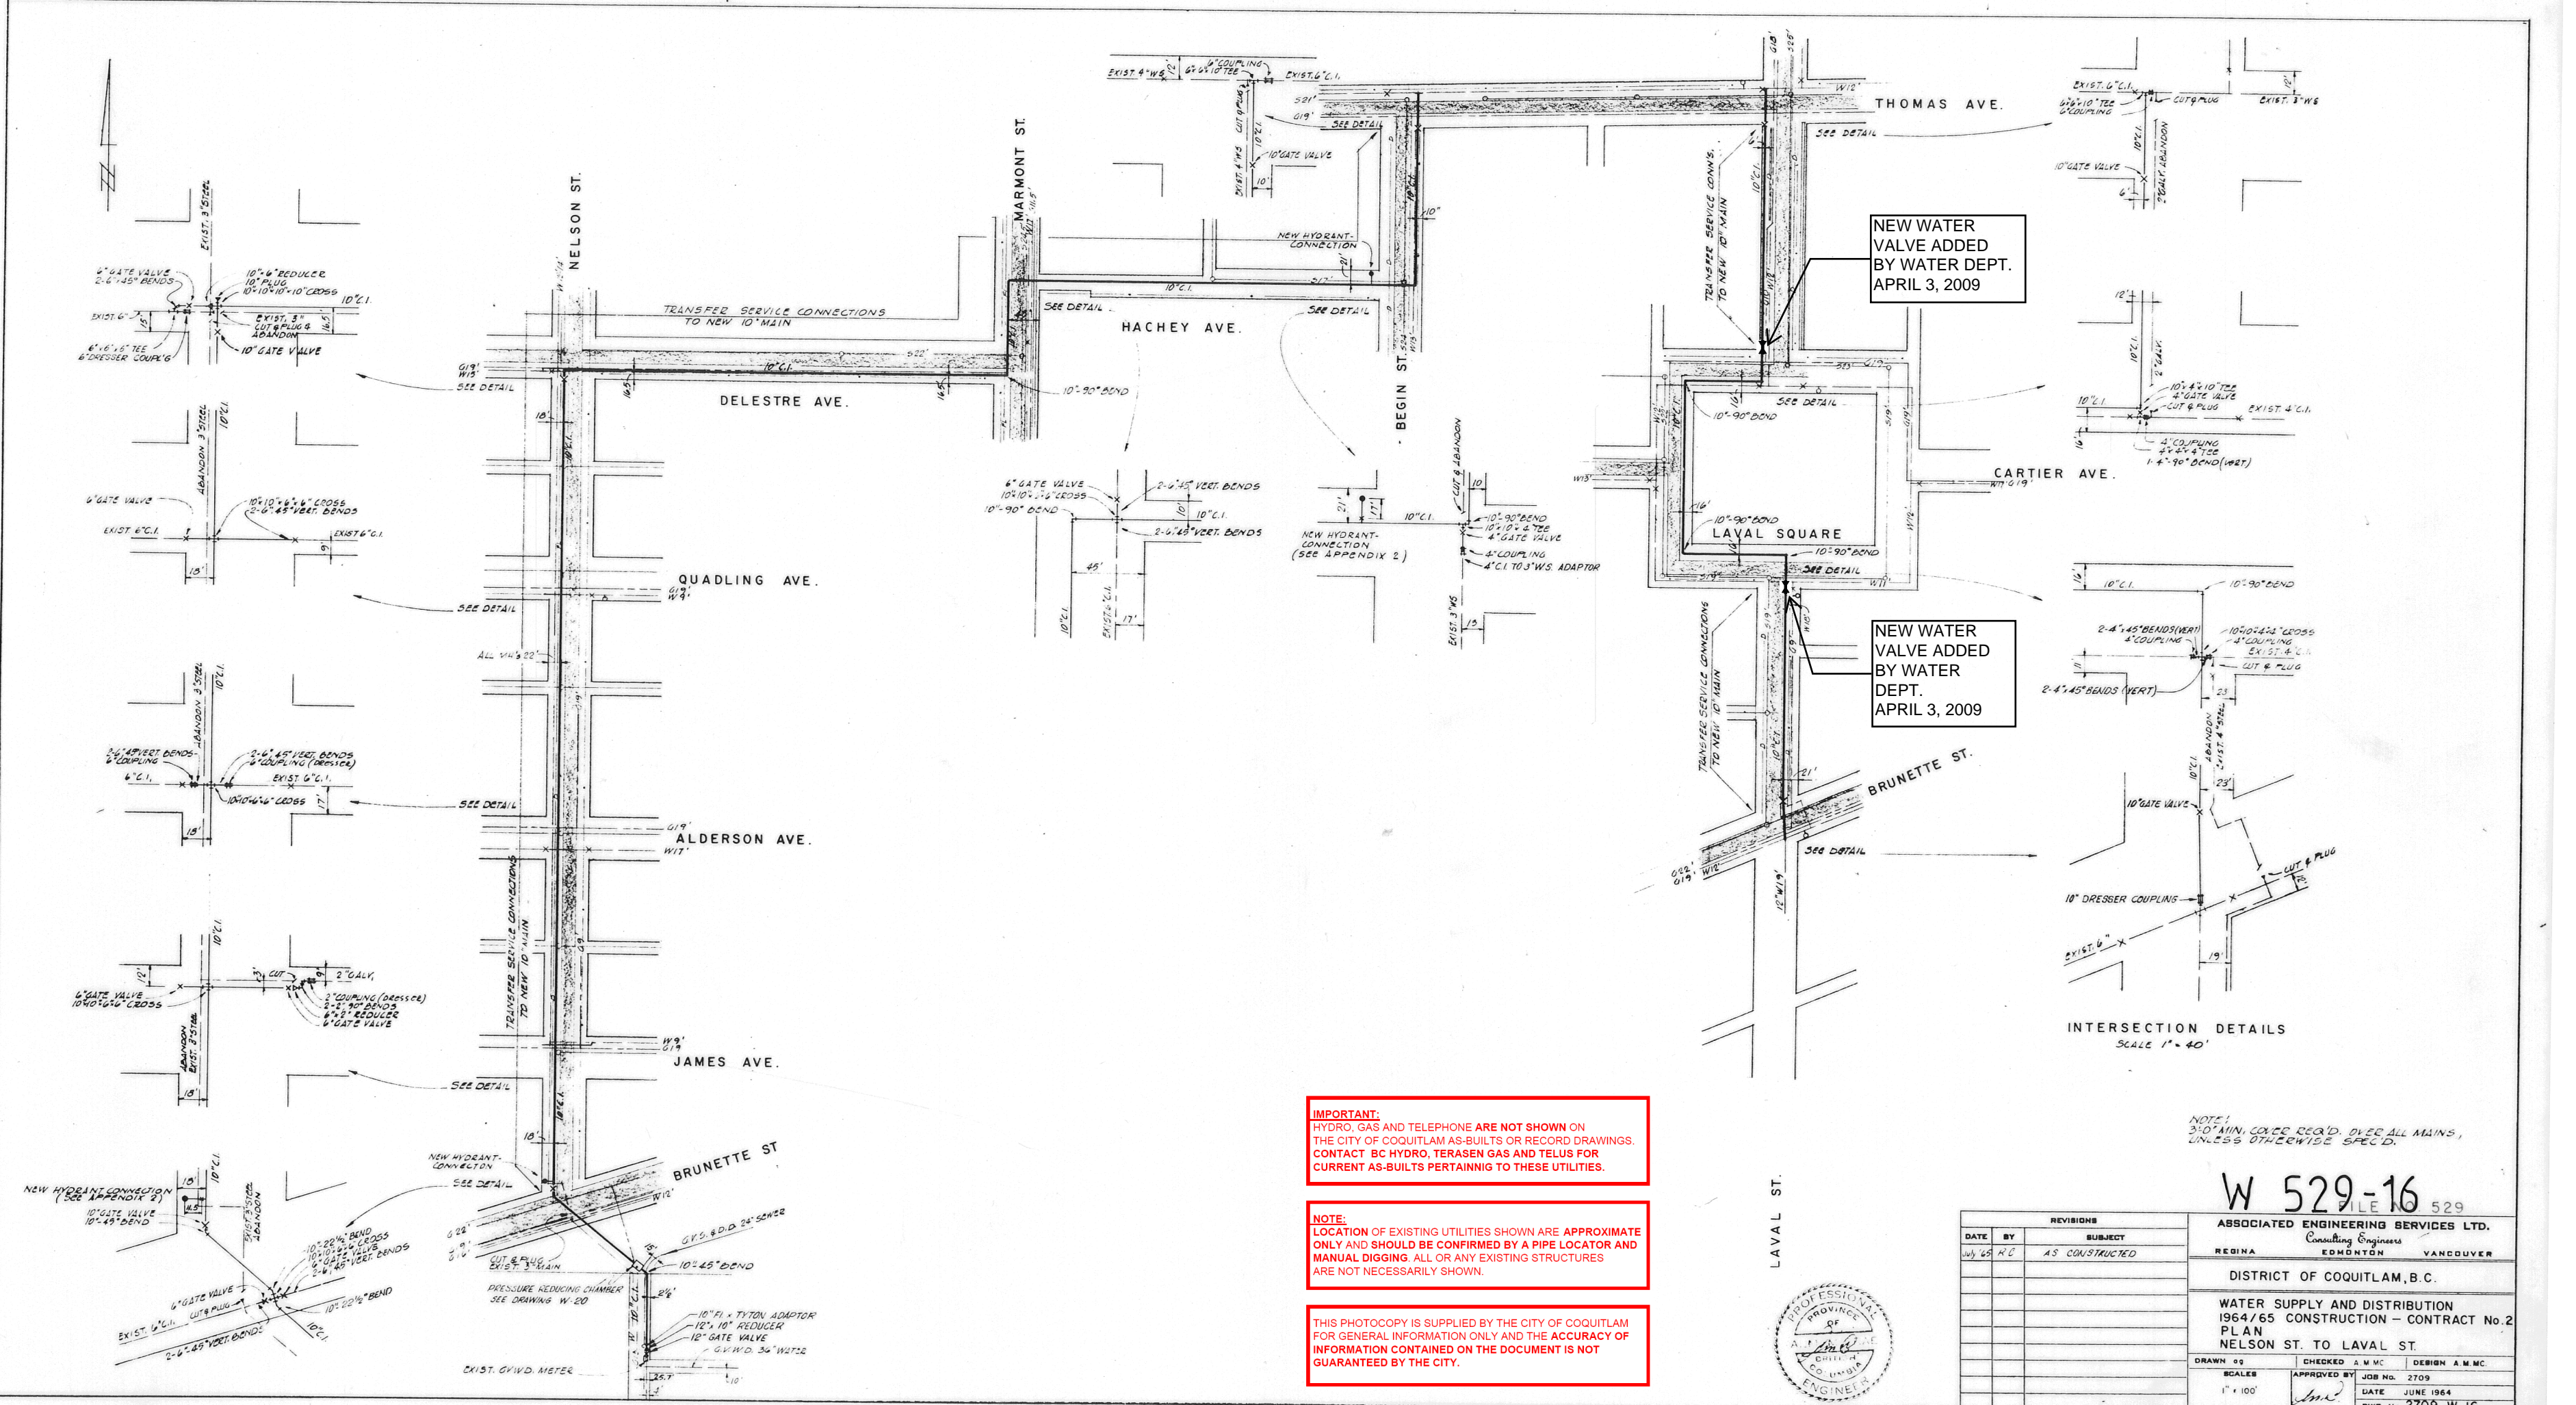

NEW WATER VALVE ADDED BY WATER DEPT. APRIL 3, 2009

NEW WATER VALVE ADDED BY WATER DEPT. APRIL 3, 2009


IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.



NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

NOTE:
3'-0" MIN. COVER REQ'D. OVER ALL MAINS, UNLESS OTHERWISE SPEC'D.



REVISIBNS			FILE NO 529		
			ASSOCIATED ENGINEERING SERVICES LTD. Consulting Engineers		
			REGINA EDMONTON VANCOUVER		
			DISTRICT OF COQUITLAM, B.C.		
			WATER SUPPLY AND DISTRIBUTION 1964/65 CONSTRUCTION - CONTRACT No.2 PLAN NELSON ST. TO LAVAL ST.		
DATE BY SUBJECT			DRAWN BY CHECKED A.M.M.C. DESIGN A.M.M.C.		
July 65 HC AS CONSTRUCTED			JOB No. 2709		
			DATE JUNE 1964		
			DWS. No. 2709-W-16		
			SCALES 1" = 100'		
			APPROVED BY 		

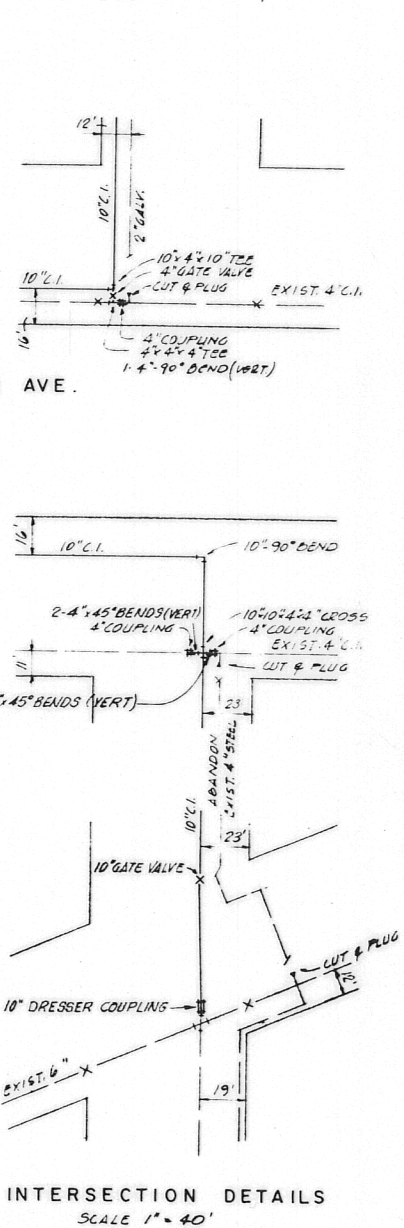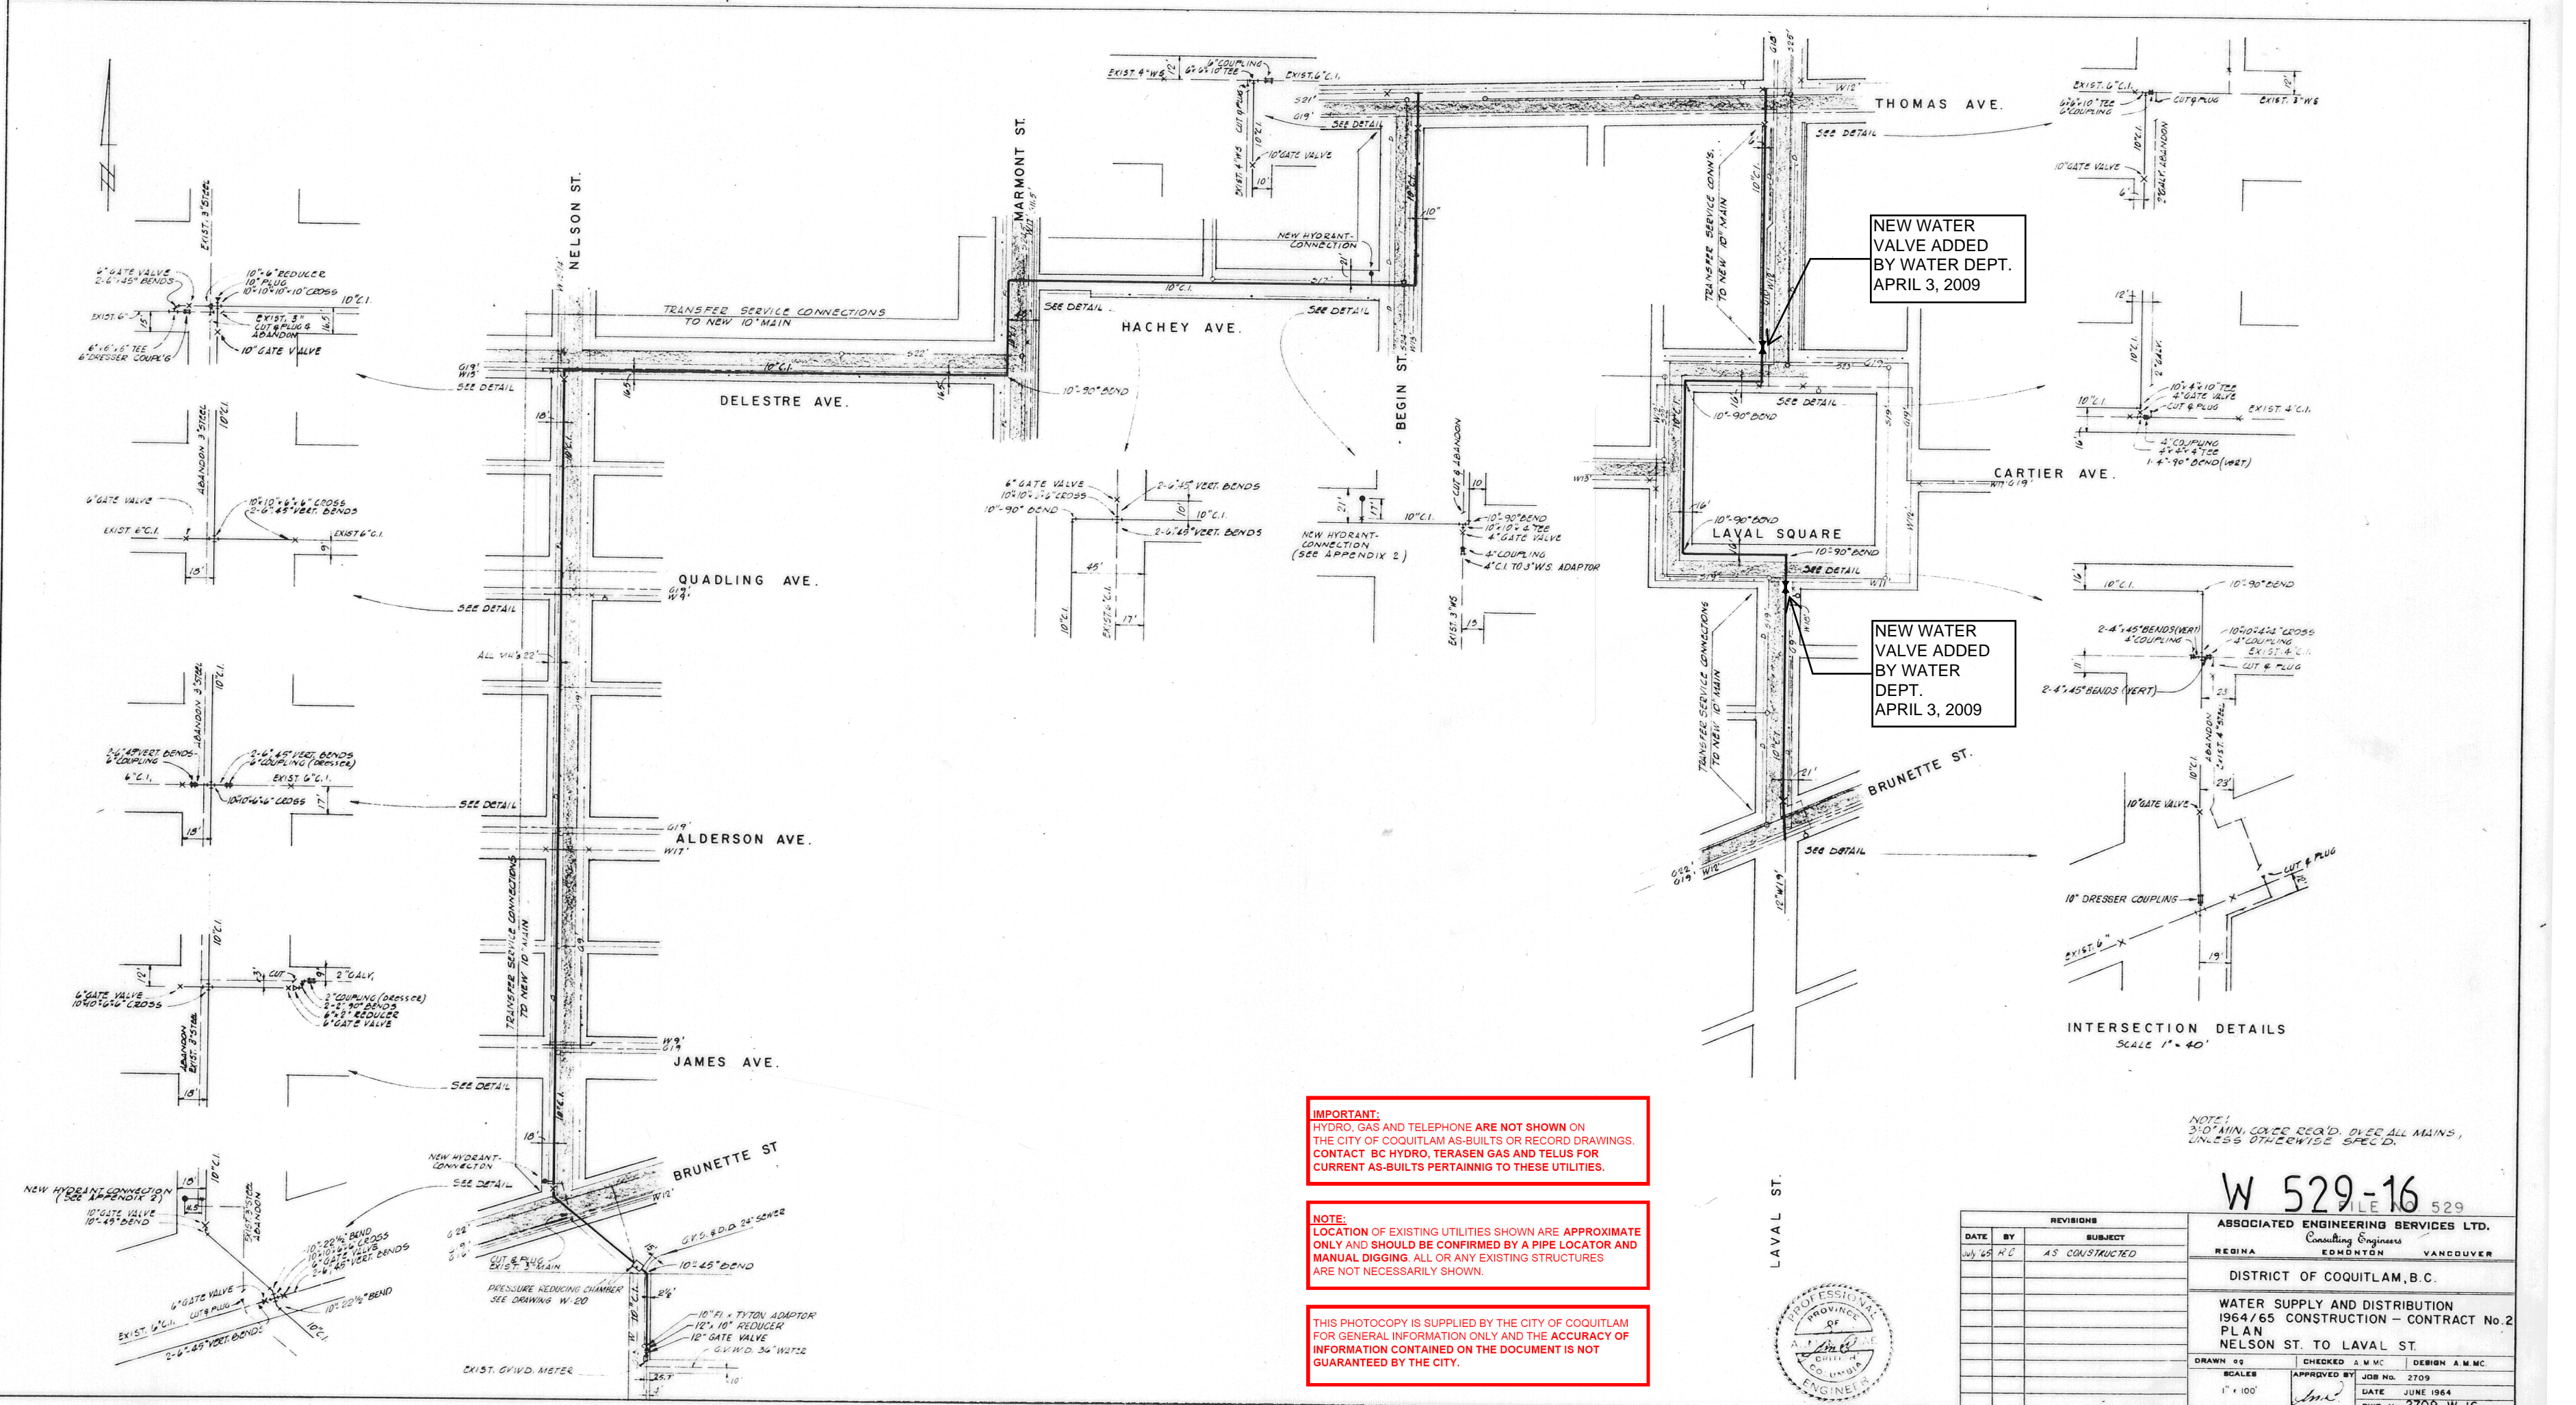

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.


NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

NOTE:
3'0" MIN. COVER REQ'D. OVER ALL MAINS, UNLESS OTHERWISE SPEC'D.




REVISIBNS			FILE NO 529		
			ASSOCIATED ENGINEERING SERVICES LTD. Consulting Engineers		
			REGINA		EDMONTON
			VANCOUVER		
			DISTRICT OF COQUITLAM, B.C.		
			WATER SUPPLY AND DISTRIBUTION 1964/65 CONSTRUCTION - CONTRACT No.2 PLAN NELSON ST. TO LAVAL ST.		
DATE			DRAWN BY		CHECKED
BY			A.M.M.C.		DESIGN
SUBJECT			A.M.M.C.		
July 65			RC		AS CONSTRUCTED

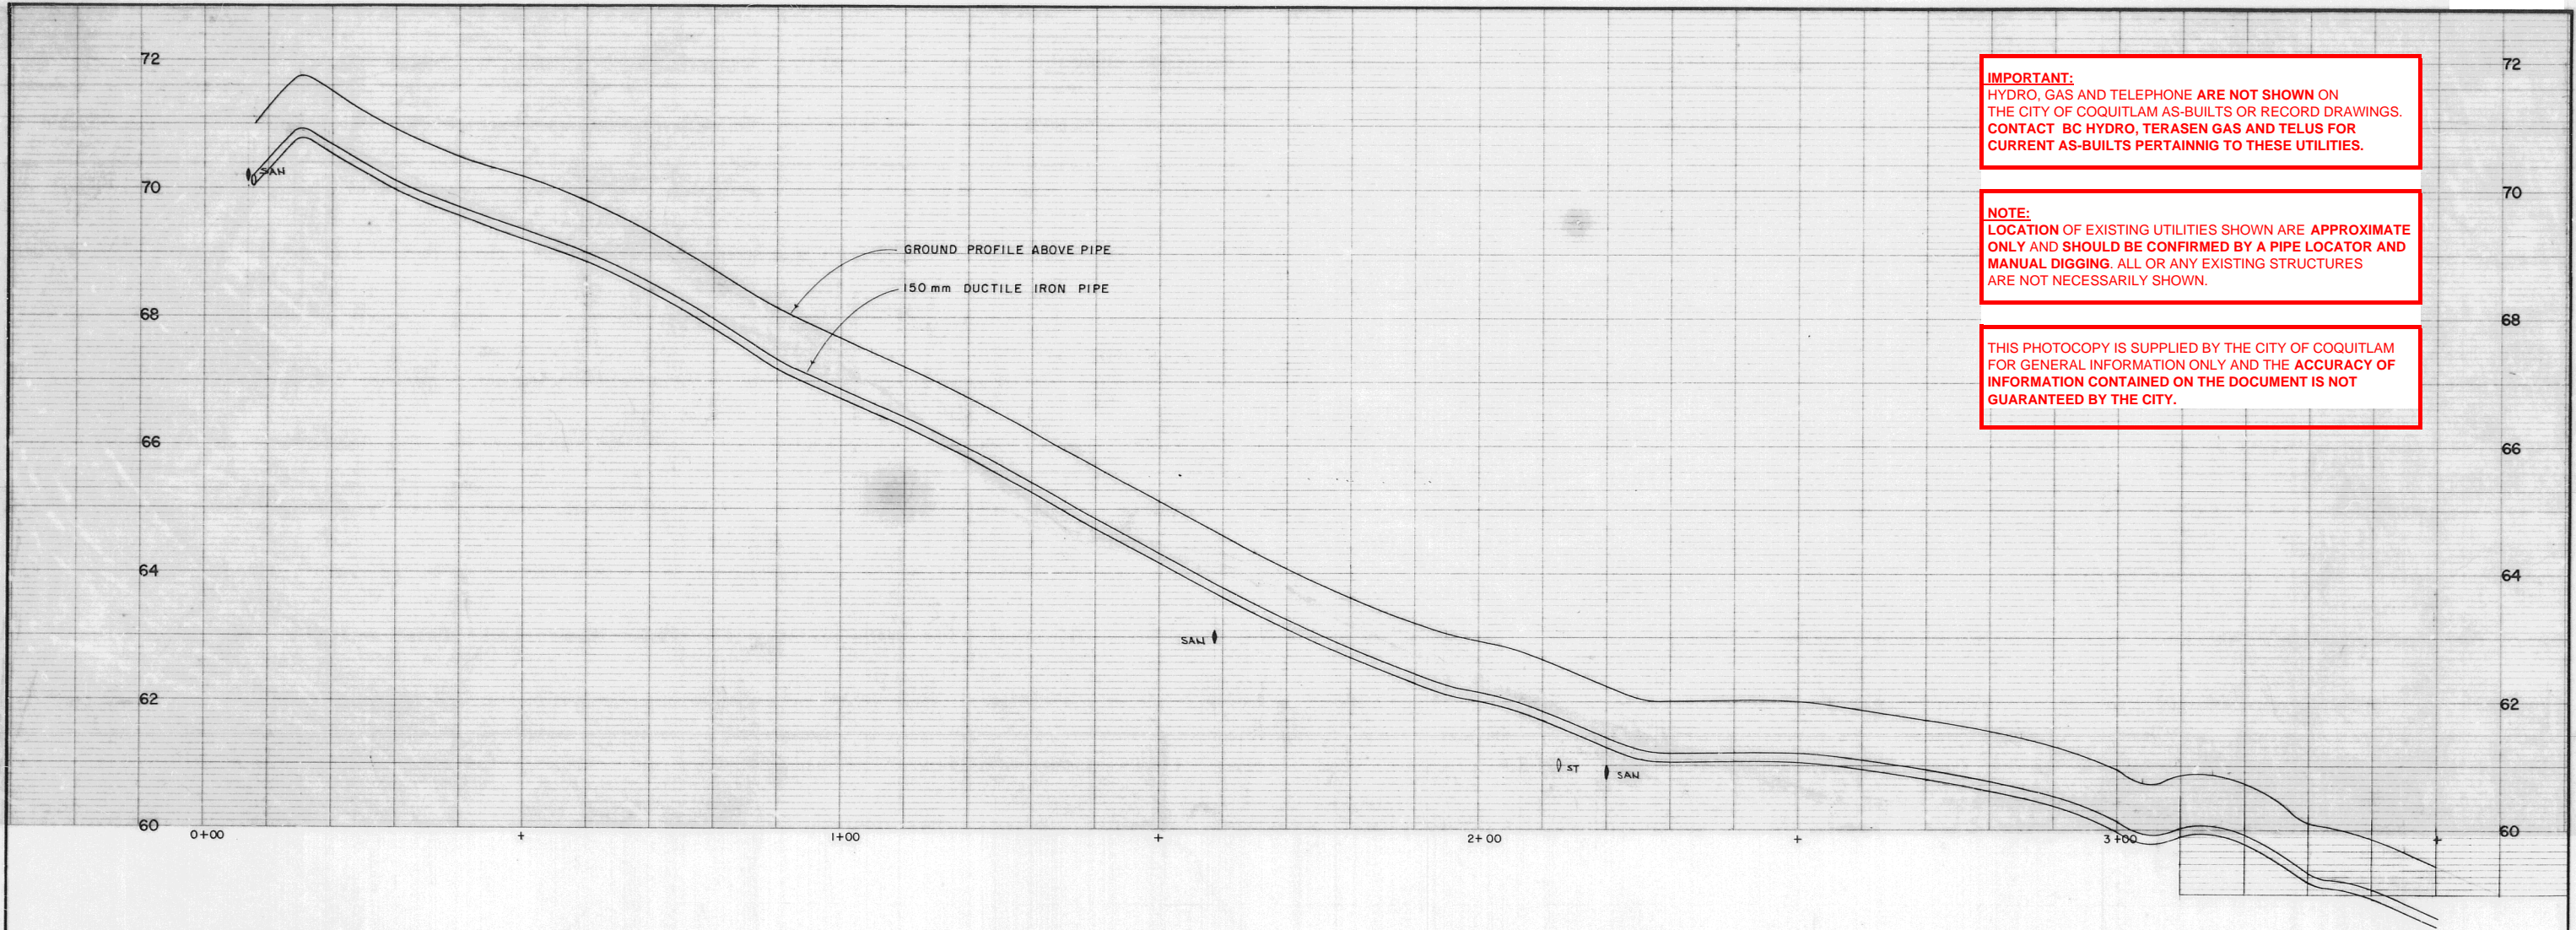

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

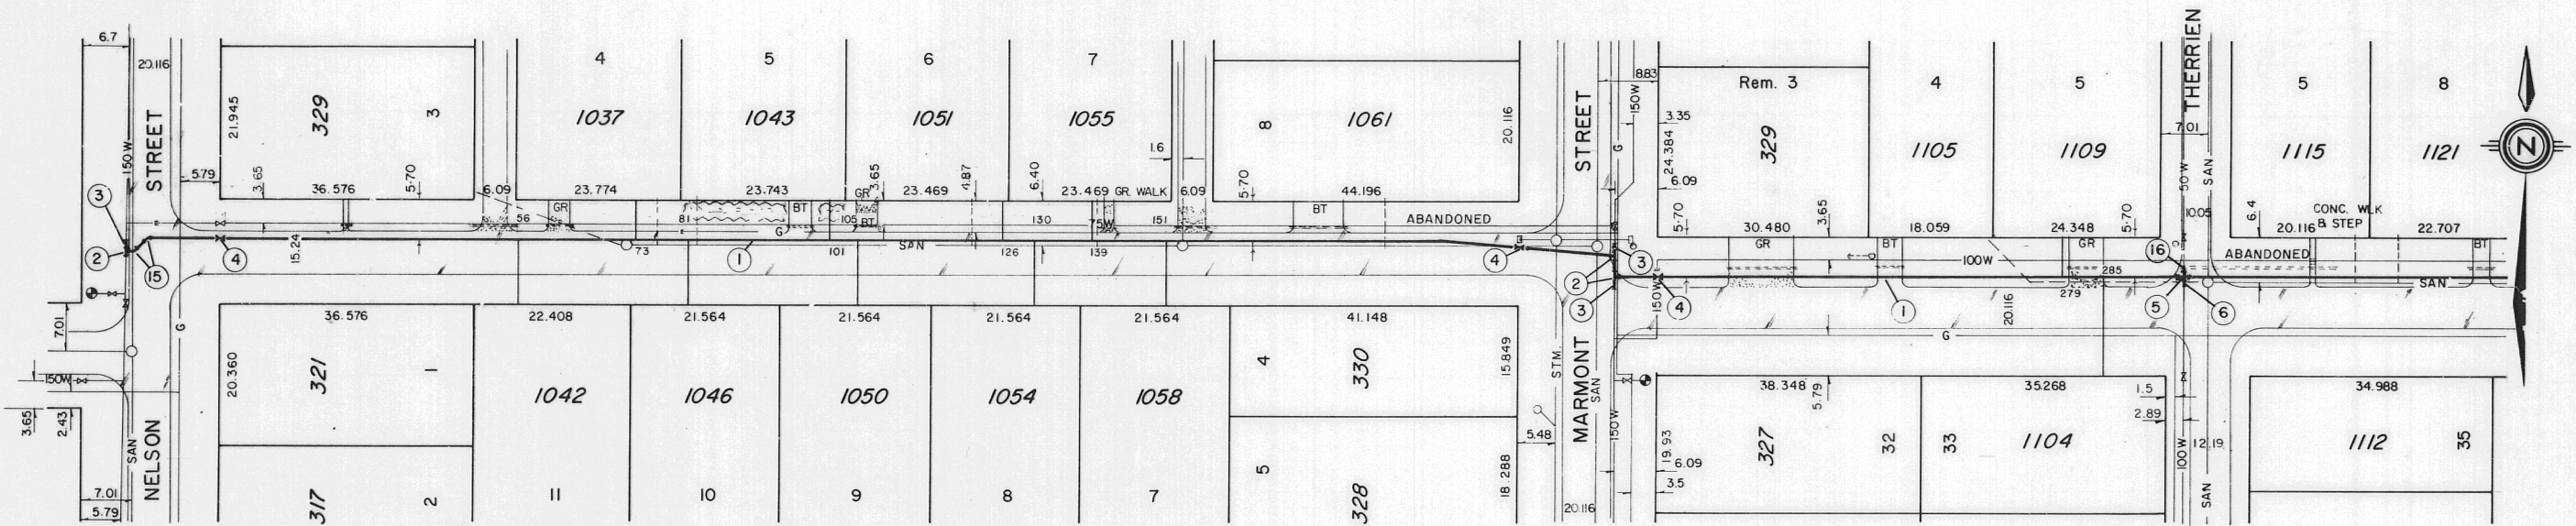

THOMAS AVENUE

2-1

Proposed STORM SEWER - ST SAN SEWER - SAN GAS - G WATER - W UG ELECTRIC - BCH UG TELEPHONE - BCT VALVE - V MANHOLE - M	Existing STORM SEWER - ST SAN SEWER - SAN GAS - G WATER - W UG ELECTRIC - BCH UG TELEPHONE - BCT VALVE - V MANHOLE - M	Legend DITCH - D UTILITY POLE - UP FIRE HYDRANT - FH IRON PIN - IP BASEMENT ELEV - BE EDGE OF PAVT - EP INTG SURVEY MON - ISM	STORM INLET TYPES I - I II - II III - III IV - IV V - V
---	---	---	---


REV	DATE	DRN	CHD
I	81-01	R.W.	AS BUILT

DISTRICT OF COQUITLAM Engineering Department

DESIGNED -
DRAWN - W.H.
METRIC SCALE - 1:500
APPROVED -
DATE - 79 5 01

WATERMAIN
THOMAS AVENUE
NELSON ST TO LAVAL ST


FILE - 702
CONSULTANTS DWG NO -
DISTRICT DWG NO -
SHEET 1 OF 2

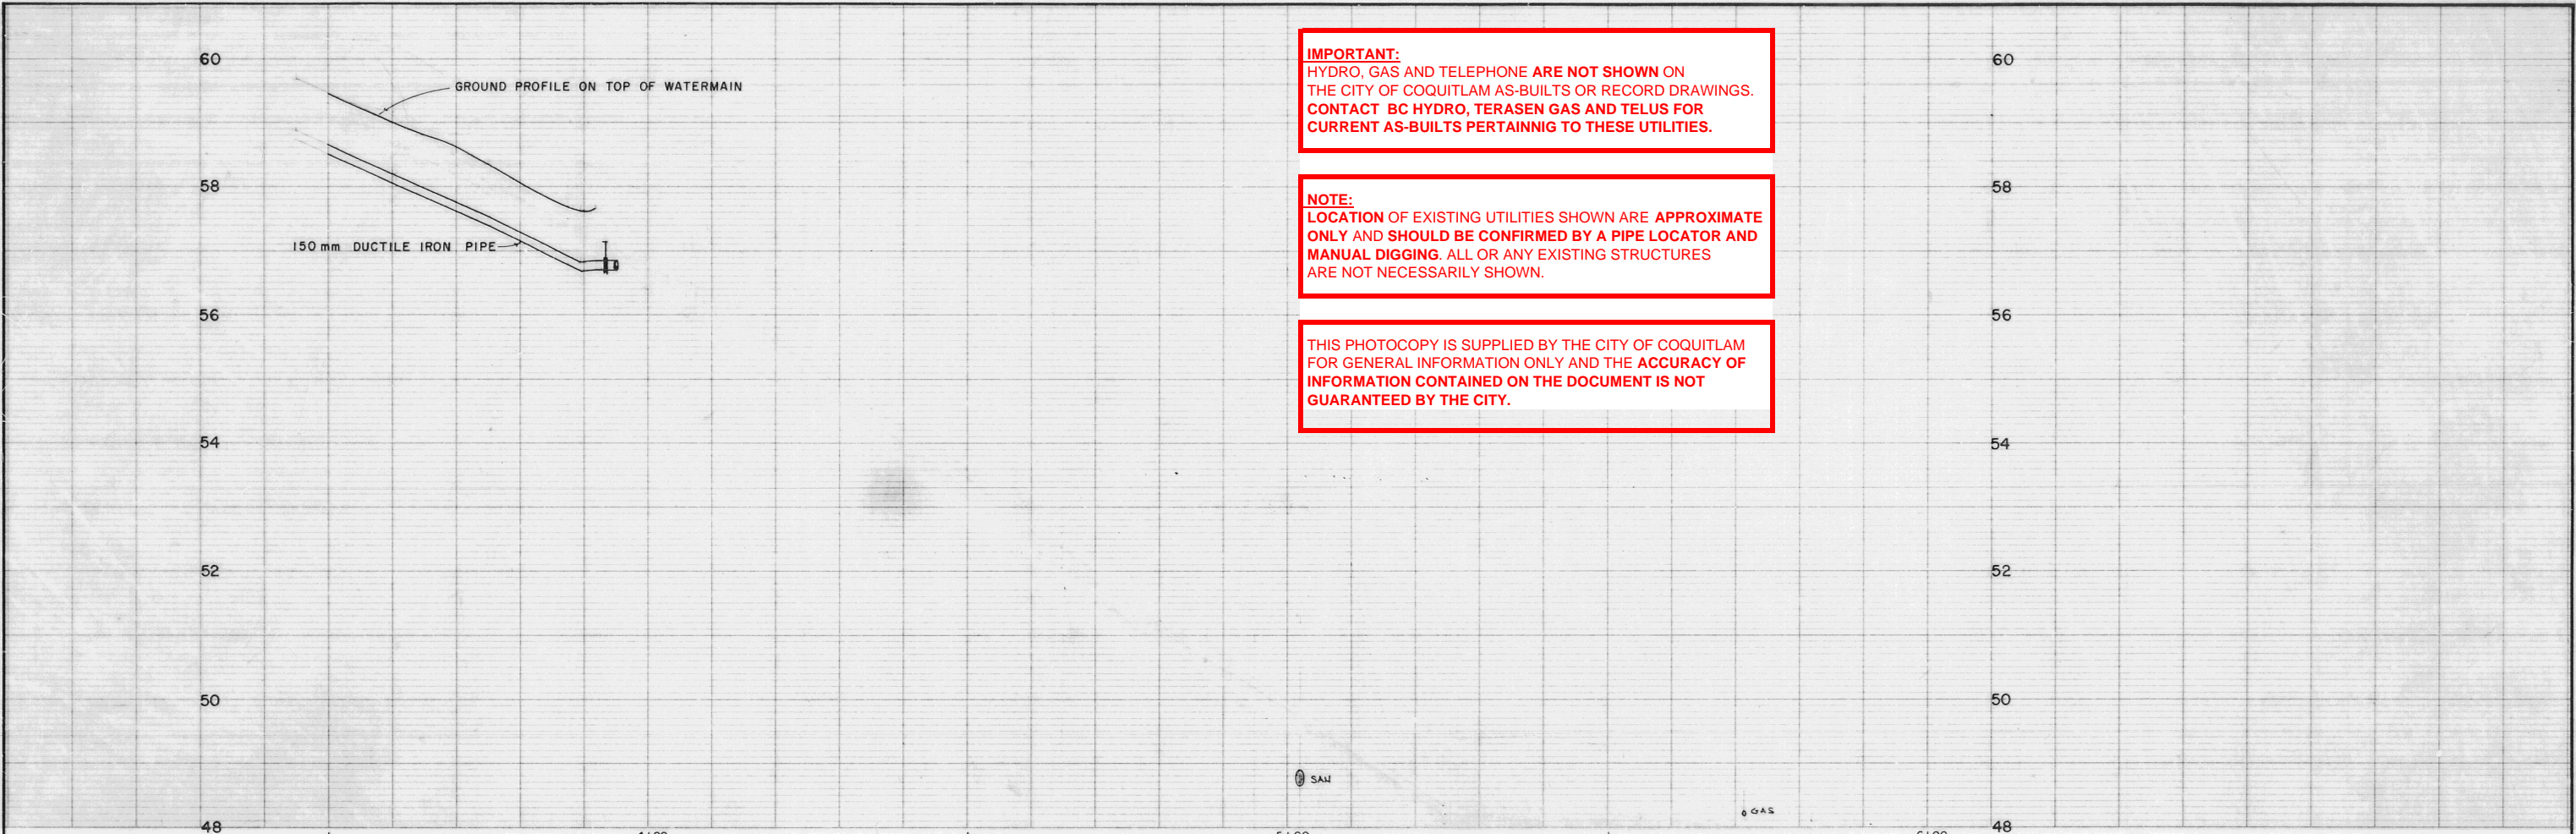

IMPORTANT:
HYDRO, GAS AND TELEPHONE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, TERASEN GAS AND TELUS FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

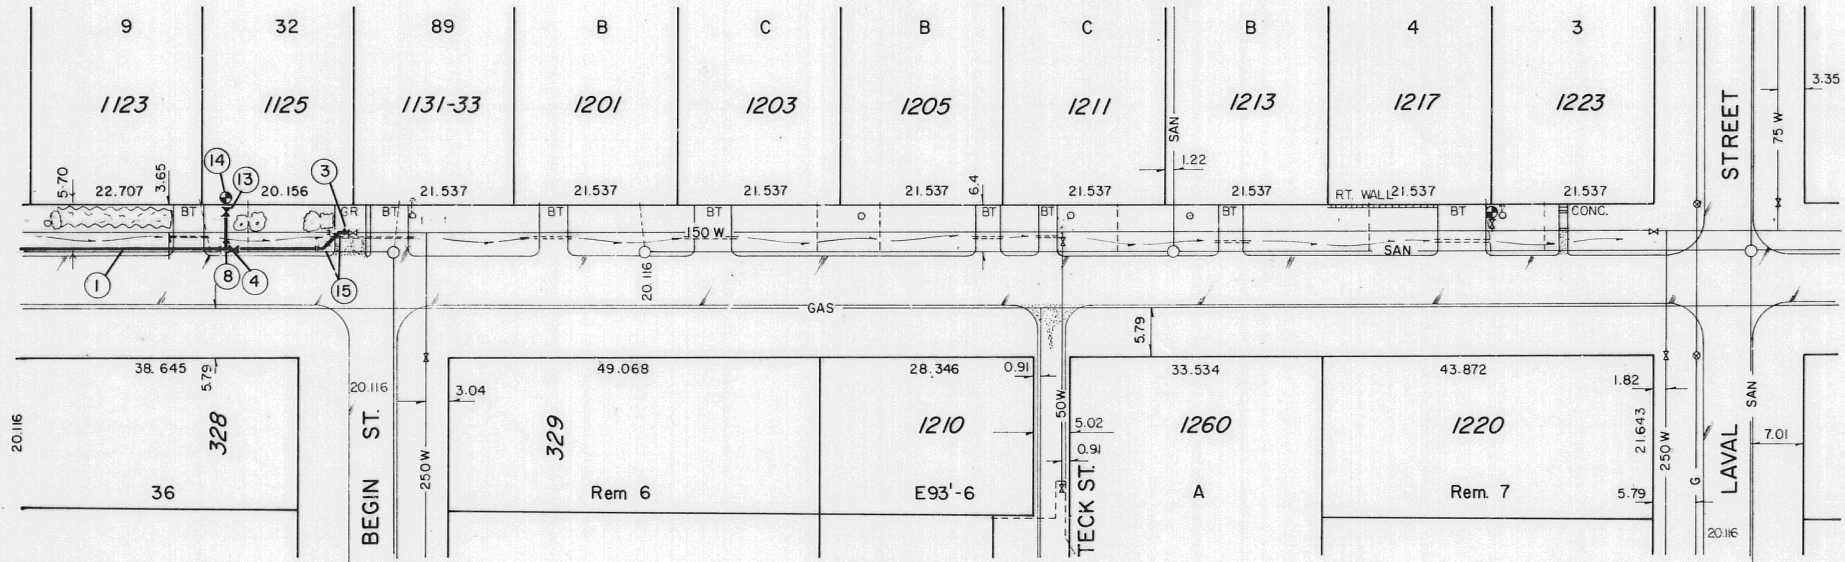

NOTE
1. FIELD BOOK REFERENCE - BK 292A
2. INTEGRATED SURVEY MON. 73 H0433 ELEV. 71.492
3. HOUSE CONNECTIONS TO BE LOCATED AND RECORDED AT TIME OF INSTALLATION.
4. WATERMAIN COVER, 1.0M MINIMUM
5. ALL WORK TO CONFORM TO DISTRICT STANDARDS.

NUMBER	DESCRIPTION	QUANTITY
1	150mm DUCTILE IRON PIPE	392M±
2	150x150x150 TEE	3
3	150 mm DRESSER	4
4	150 mm VALVE	4
5	150 x 150 x 100 x 100 CROSS	1
6	100 mm DRESSER	1
7	75mm x 45° ELBOW	1
8	150 x 150 HM x 150 FLG	1
9	75 x 100 DRESSER/REDUCER	1
10	150 x 150 x 100 TEE	1
11	150 x 150 x 250 TEE	1
12	150 x 150 x TEE	1
13	150HMx150 FLG VALVE	1
14	150mm No 2 HYDRANT	1
15	150 x 45° ELBOW	4
16	100 x 50 I.P.T. REDUCER	1
17	150 x 75 REDUCER	1

THOMAS AVENUE

W-702-2

Legend

Proposed	Existing
STORM SEWER - ST	STORM SEWER - ST
SAN SEWER - SAN	SAN SEWER - SAN
GAS - G	GAS - G
WATER - W	WATER - W
UG ELECTRIC - BCH	UG ELECTRIC - BCH
UG TELEPHONE - BCT	UG TELEPHONE - BCT
VALVE - V	VALVE - V
MANHOLE - M	MANHOLE - M

DITCH UTILITY POLE
FIRE HYDRANT
IRON PIN
BASEMENT ELEV
EDGE OF PMT
INTEG SURVEY MON

STORM INLET TYPES -
I - II - III - IV - V

DESIGNED -	WH
DRAWN -	WH
METRIC SCALE -	1:500
SCALE -	1:50
APPROVED -	
DATE -	79 5 01

REV#	DATE	DRW	CHD
1	81-01	R.W.	AS BUILT

DISTRICT OF COQUITLAM Engineering Department

WATERMAIN
THOMAS AVENUE
NELSON ST. TO LAVAL ST.




FILE - 702

CONSULTANTS
DWG. NO. -

DISTRICT
DWG. NO. -

SHEET 2 OF 2

W-864

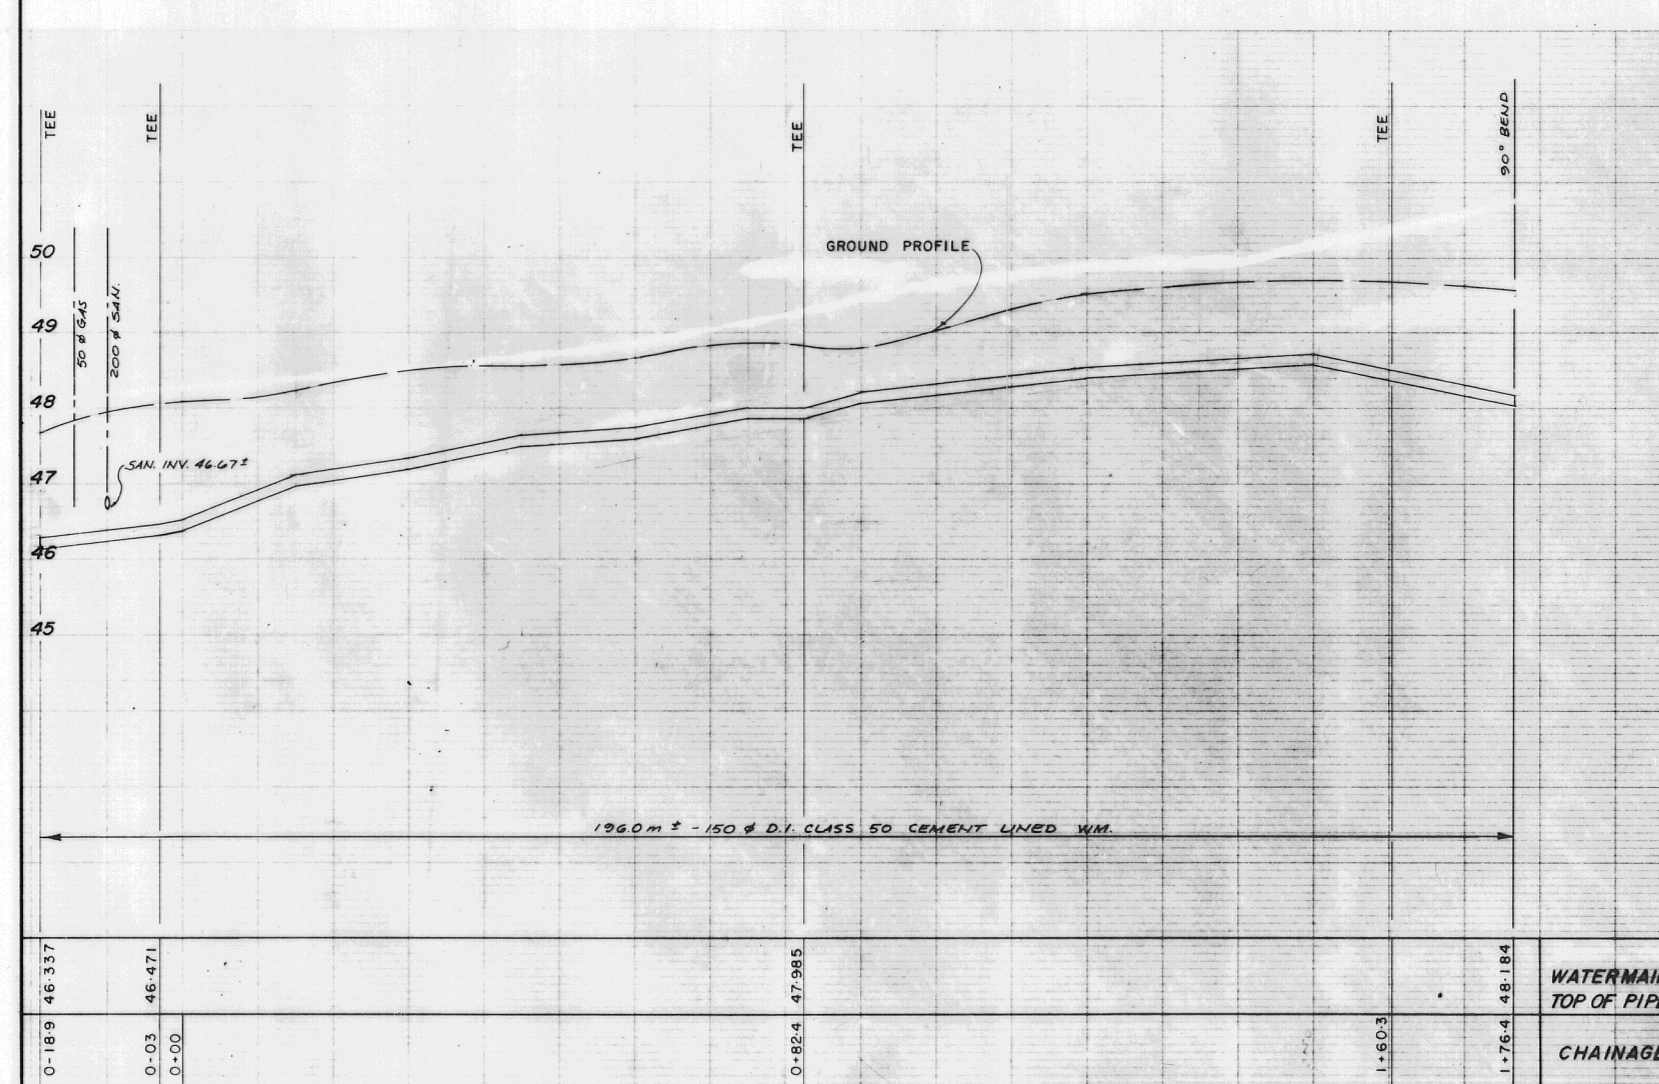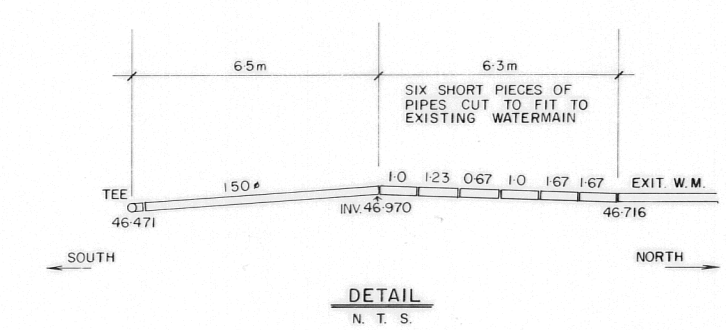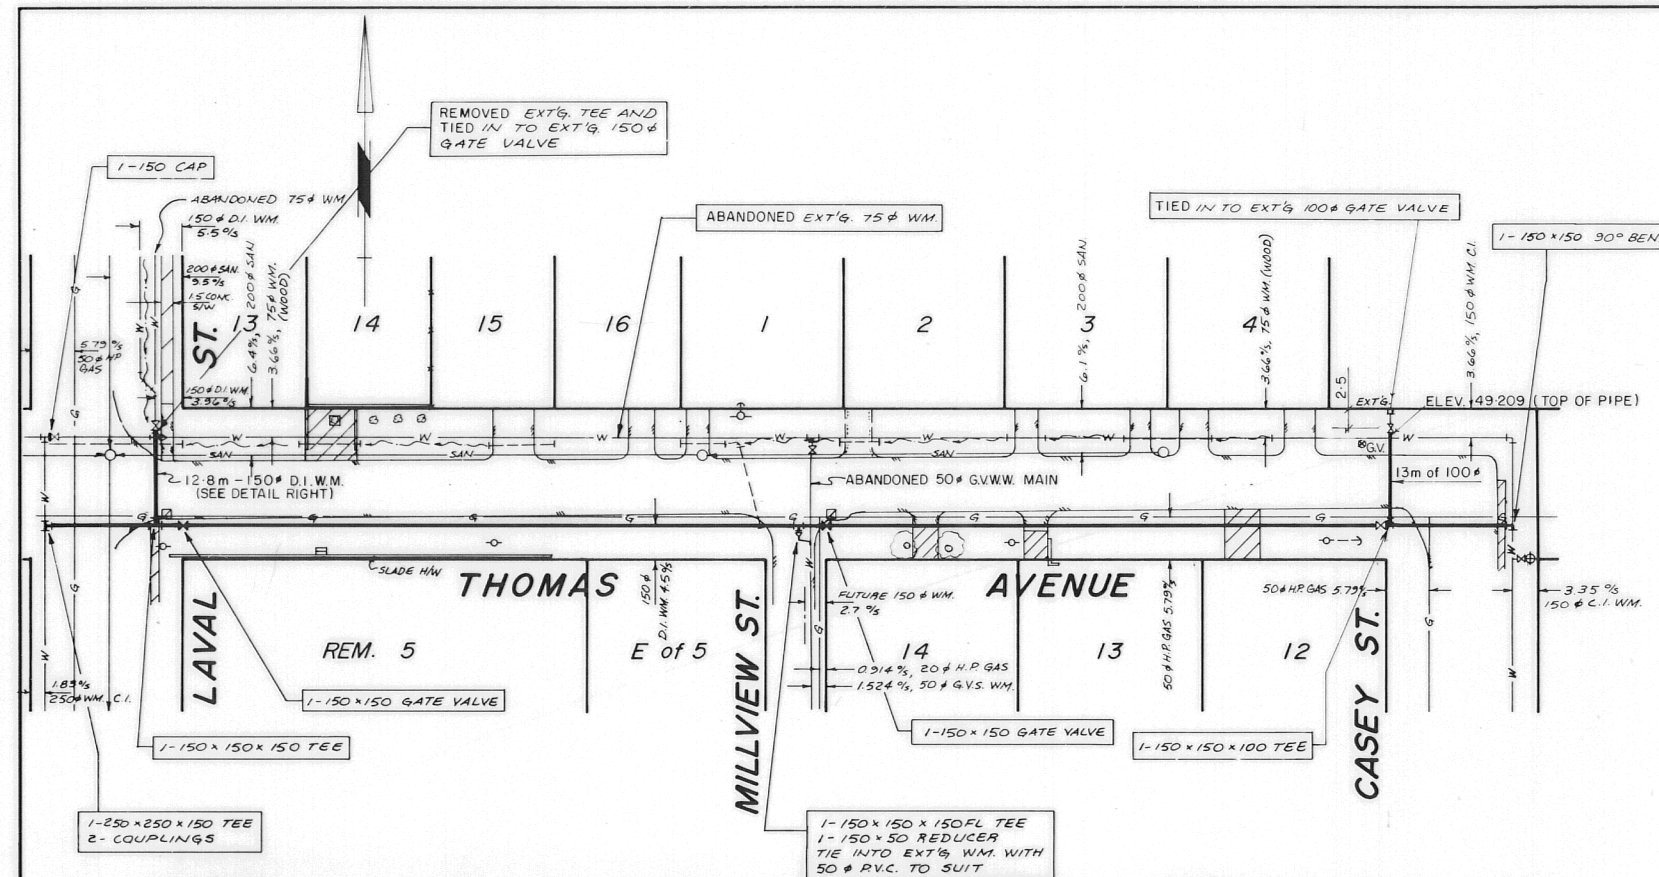


- SANITARY SEWER NOTES**
- ALL SANITARY MAINS TO BE PVC. SDR 35
 - ALL SANITARY CONNECTIONS TO BE PVC. SDR 28
 - ALL SANI. CONNECTIONS TO BE 100# MIN.
 - SAN. CONNECTIONS TO EXISTING MAIN TO BE DONE BY CONTRACTOR AND WITNESSED BY COQUITLAM INSPECTOR
 - ALL MANHOLES TO BE 1050#, UNLESS OTHERWISE NOTED
 - PIPE MATERIALS TO MEET CURRENT COQUITLAM STANDARDS AND SPECIFICATIONS
 - ALL WYES TO BE MANUFACTURED.
- LEGEND:**
- 432 INDICATES MIN. BASEMENT ELEV. BASED ON DESIGN. INV.
 - INDICATES SAN. CONN. INV. AT R IN PROFILE
 - INDICATES SAN. CONN. INV. AT R IN PLAN.
- GENERAL NOTES**
- ALL CONSTRUCTION AND MATERIALS MUST CONFORM TO CURRENT DISTRICT OF COQUITLAM ENGINEERING STANDARDS IN BY-LAW NO. 1023 AND TO THE SATISFACTION OF THE COQUITLAM INSPECTOR.
 - ALL EXISTING AMENITIES TO BE RESTORED TO THE SATISFACTION OF THE MUNICIPAL INSPECTOR. IN SPECIAL CASES THE INSPECTOR MAY REQUIRE WRITTEN ACCEPTANCE OF THE RESTORATION WORKS FROM THE AFFECTED PROPERTY OWNERS.
 - PROPERTY OWNERS DIRECTLY AFFECTED BY THE PROPOSED WORKS TO BE GIVEN 48 HOURS NOTICE PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 - CONTRACTOR TO EXPOSE ALL EXISTING UTILITIES AT PROPOSED CROSS OVER POINTS AND TIE-IN POINTS PRIOR TO ANY CONSTRUCTION TO VERIFY LOCATIONS AND INVERTS, AND SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES OR OMISSIONS.
 - CONTRACTOR MAY REUSE ANY SALVAGEABLE WM. JOINTS AND FITTINGS, SUBJECT TO THE DISTRICT OF COQUITLAM'S APPROVAL.
- WATERMAIN NOTES**
- ALL JOINTS TO BE "TYTON" EXCEPT:
 - MAIN VALVES AND FITTINGS TO BE TM OR FL.
 - HYDRANT TEES TO BE TM x TM x FL.
 - HYDRANT VALVES TO BE TM OR FL.
 - HYDRANTS TO BE TC. TYPE 20P
 - ALL WATERMAINS TO BE DUCTILE IRON CEMENT LINED CLASS 50, AT 0.10% MIN.
 - ALL TESTING AND CHLORINATION TO BE DONE BY THE CONTRACTOR AND WITNESSED BY THE COQUITLAM INSPECTOR. 48 HOURS NOTICE IS REQUIRED.
 - EXISTING SERVICE CONNECTIONS TO BE CONNECTED TO PROPOSED WATERMAIN.
 - ALL ABANDONED VALVES TO BE BURIED.
 - ALL ABANDONED TEES TO BE CAPPED.
 - CONCRETE THRUST BLOCKS TO BE INSTALLED WHERE REQUIRED.
 - FOR TYPICAL DETAILS SEE COQUITLAM DRAWINGS:
 - TRENCH DETAILS F.1.2
 - VALVE RISES F.2.2
 - HYDRANTS F.2.4
 - BLOWOFF ASSEMBLY F.2.5
 - SERVICE CONNECTIONS F.2.7
 - THRUST BLOCKING F.2.8
 - FIELD BOOK No 292A, PAGES 14-15 & 20-25.

REV. DATE	DR. APP.	CLIENT	DRAWING TITLE	SCALE	DESIGNED P.L.B.	DATE
A 7/81	RLB DWL	DISTRICT OF COQUITLAM	PROPOSED WATERMAIN UPGRADING	HOR. 1:500	THOMAS AVE.	JUNE 1981
B 83-05	D			VER. 1:50		
PROJECT			THOMAS AVE.	HUNTER, LAIRD ENGINEERING (1980) LTD. CONSULTING CIVIL ENGINEERS NEW WESTMINSTER, B.C. TEL. 525-4881		
				DRAWN P.L.B.		DRAWING NO.
				CHECKED D.W.L.		2 OF 25
				FB. A P. 36		JOB NO. E 1068

DESTROY PRINTS OF THIS DRAWING BEARING PREVIOUS LETTERS




THOMAS AVE.


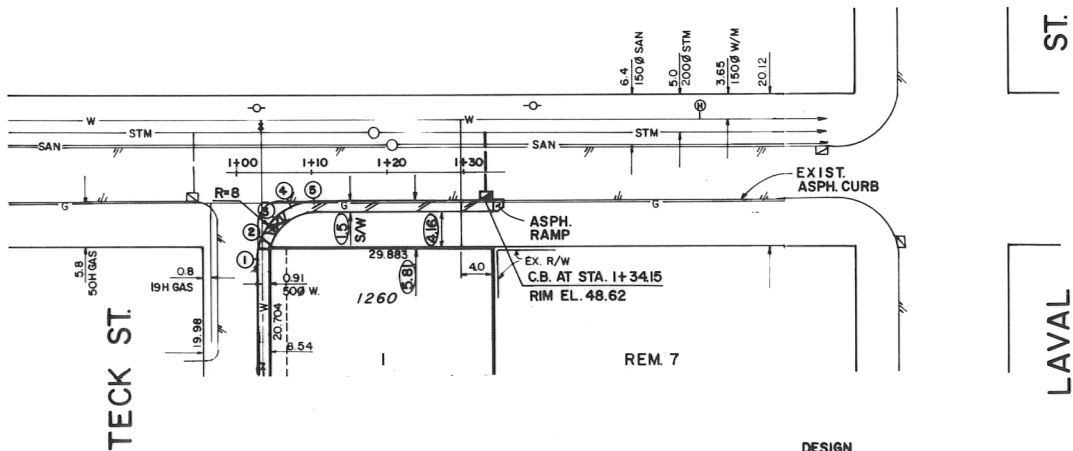


HACHEY AVE.


TECK ST.

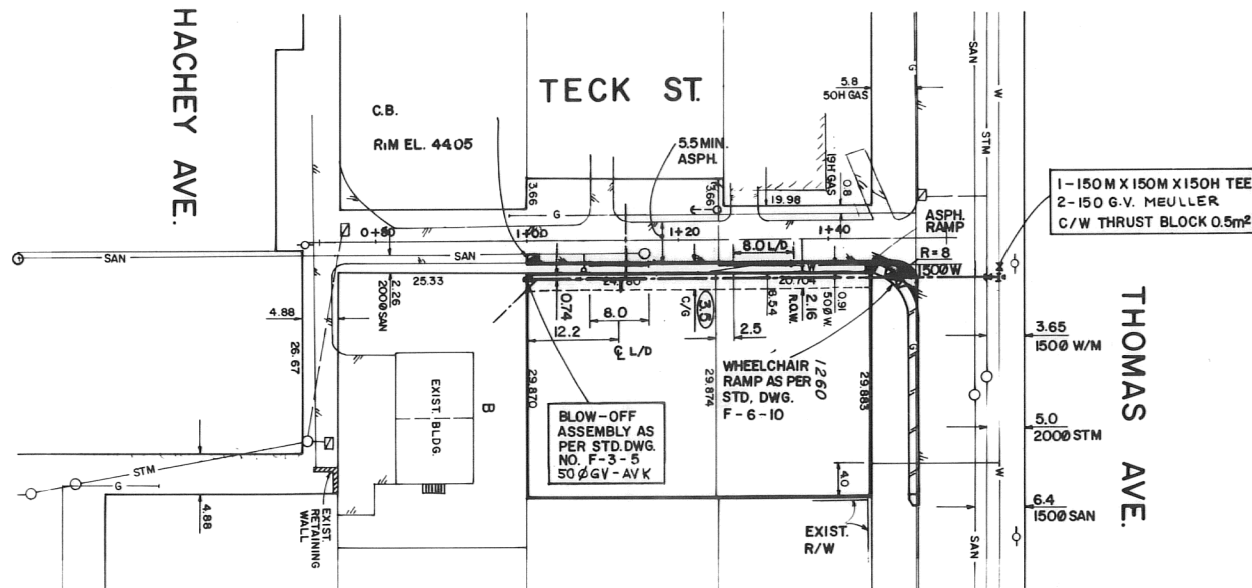

THOMAS AVE.

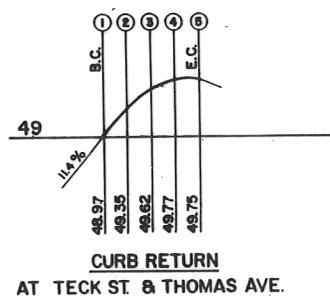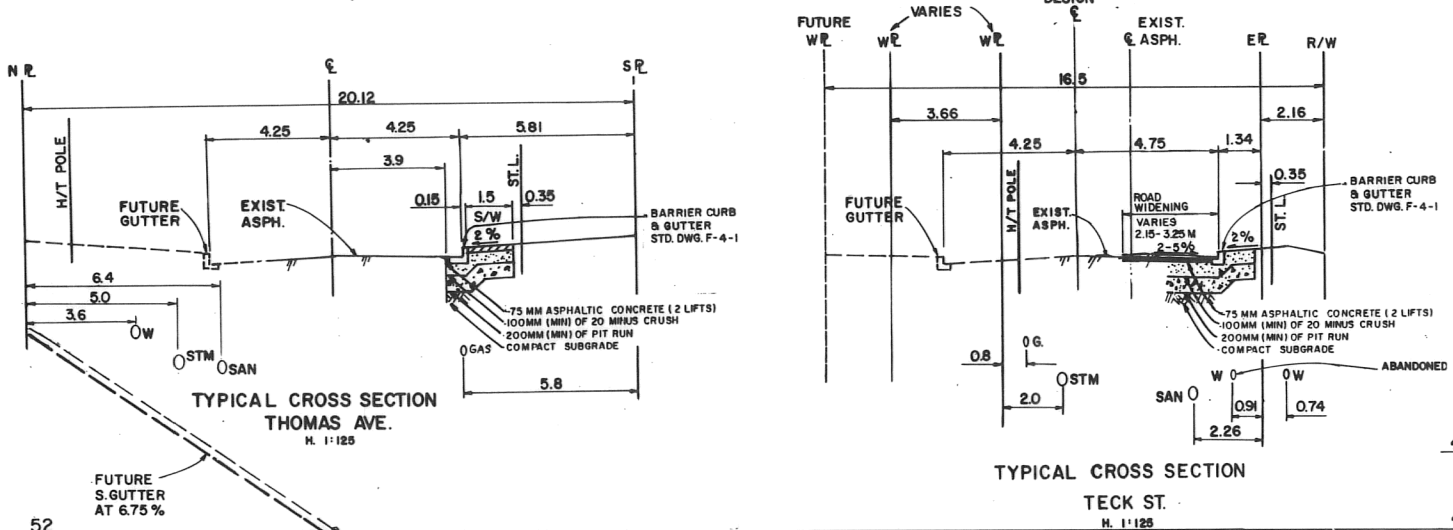


NOTE: K-VALUE & GRADES DOES NOT MEET BYLAW STOP SIGN (TRAFFIC CONTROL) AT TECK ST.

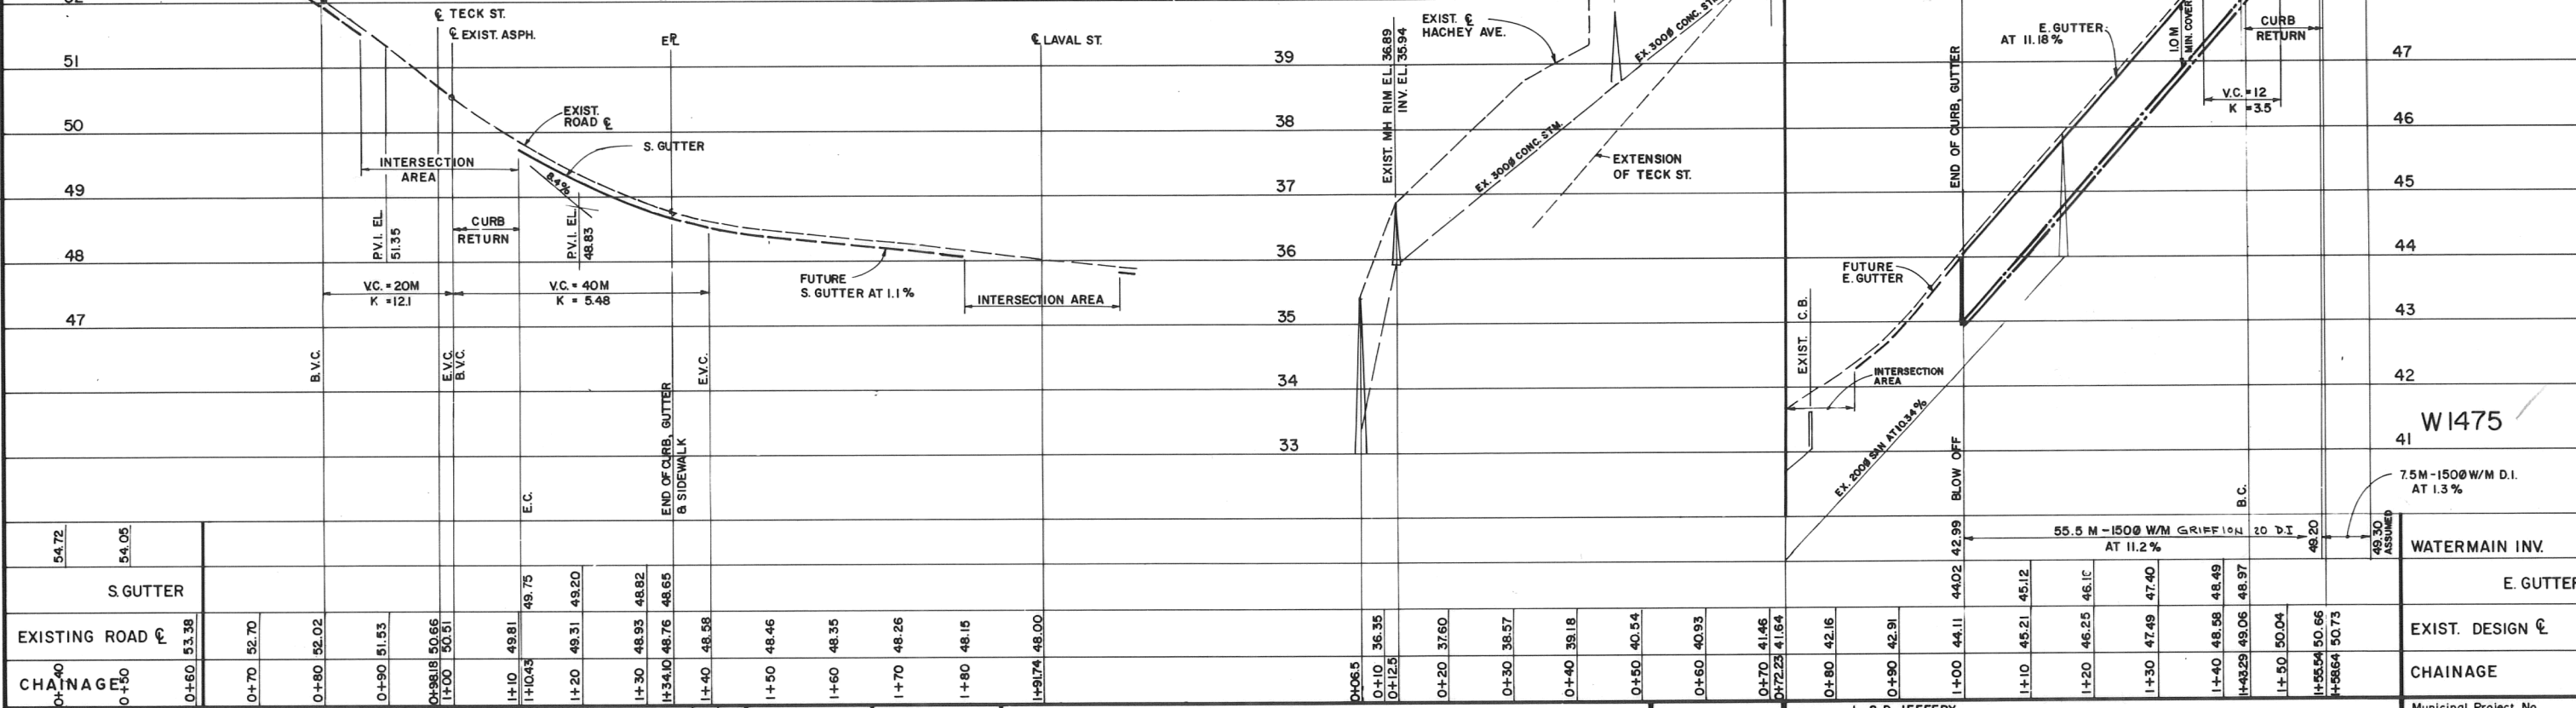

Bench Mark	No.	Date	Revision	Dr.	Ch.	Design	M.S.	Scale	<div>SIMIC engineering Ltd.</div> <div>Professional Services</div>	<div>Client</div> <div>L. & D. JEFFERY 968 JARVIS ST. COQUITLAM, B.C. V3J 4Z9</div>	<div>Municipal Project No.</div> <div>8-3517</div>		
	1	92.09.10	AS PER COQ. ENG. REQ.	HB	MS	Drawn	H.B.	H. 1:500					
	2	93.06.02	AS CONSTRUCTED	HB	MS			V. 1:50					
						Checked							
						Approved		Date JULY 1992					
All elevations are geodetic and refer to OLD CONTR. mon. no. 73H0436 at intersection of THOMAS AVE. & LAVAL ST.								<div>Box 1231-202-1118 AUSTIN AVE. COQUITLAM, B.C. V3J 6Z9 PHONE (604) 939-5533</div>			<div>ROADWORKS & WATERWORKS</div> <div>SUBDIVISION OF 1260 THOMAS AVE., COQUITLAM, B.C. P.C.L.A (EX. PL. 9573) OF LOTS 7 & 8, BLK. 4, DL. 46, 6P1, PLAN 2624, N.W.D.</div>	Drawing No.	Revision
Elevation: 47.998M												MSE-192	2
												Sheet 2 of 6	

STA 0+096.41
1 - 150TYT X 150TYT X 100TYT X
100TYT CROSS EXIST. C/W
THRUST BLOCK (0.35m²)
1 - 100TYT X TYT GATE VALVE
4 - 150 DI CLASS 50 SPOOL PIECES
2 - 150 MECH. COUPLINGS
1 - HYDRANT ASSEMBLY
HYDRANT ASSEMBLY AS PER
C.O.C. STD. DWG. F-3-4.

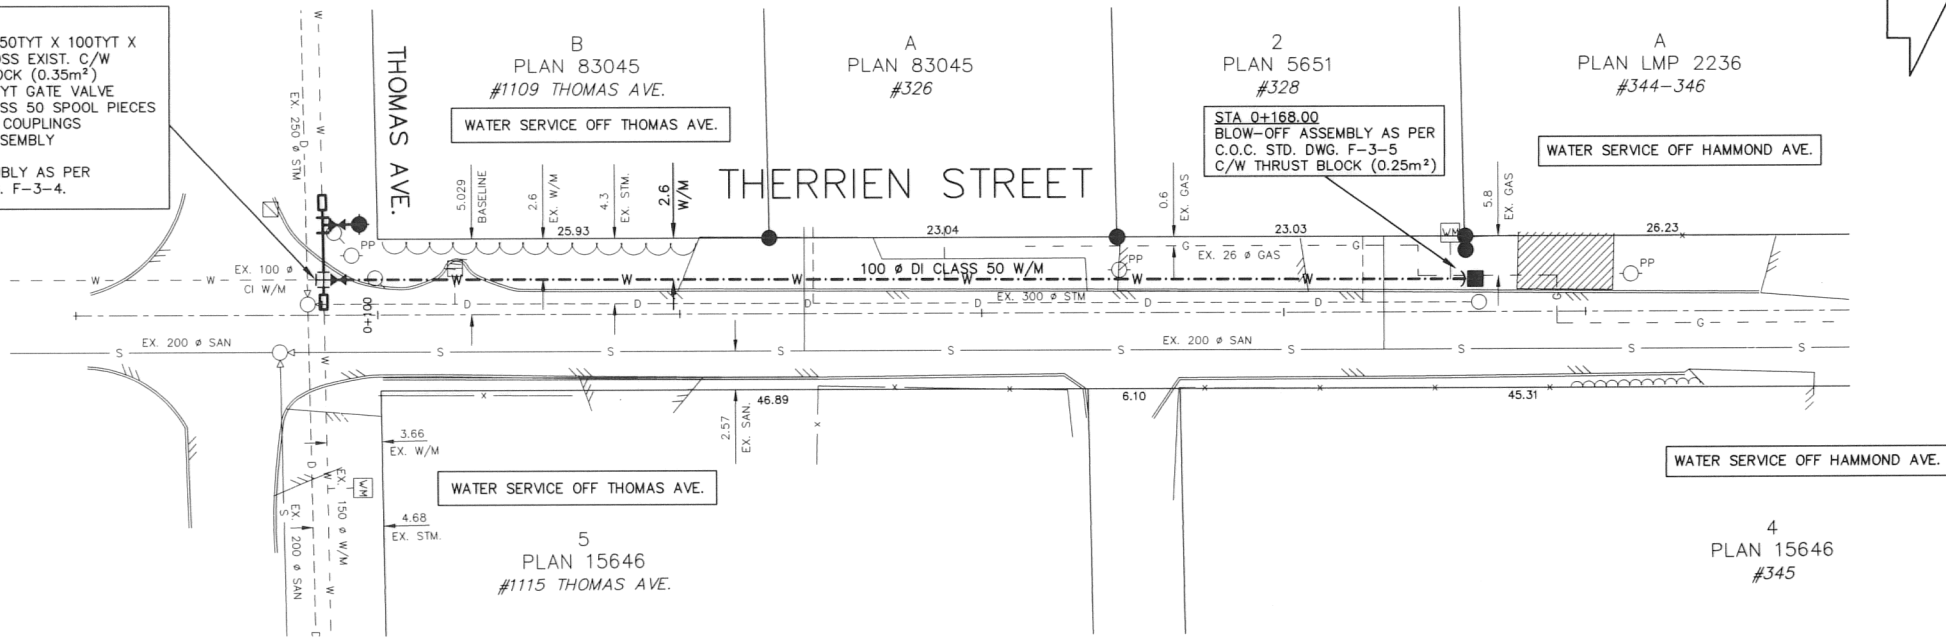


D.I. WATERMAIN
HYDRANTS CANADA VALVE
FITTINGS B.B.
BRASS MEULLER

BENCHMARK:
MONUMENT 73H0435 LOCATED AT INTERSECTION
OF THOMAS AVENUE AND BEGIN STREET
ELEV. 56.694m

GENERAL NOTES

- 1. ALL WATERMAINS ARE CEMENT LINED CLASS 50 DI PIPE.
- 2. WATERMAIN INSTALLED WITH 1.0m MINIMUM COVER.
- 3. ALL WATER SERVICE CONNECTIONS ARE 19mm DIAMETER UNLESS OTHERWISE NOTED.
- 4. LOCATION OF WATER SERVICE CONNECTIONS DERIVED FROM CITY OF COQUITLAM SERVICE RECORDS.

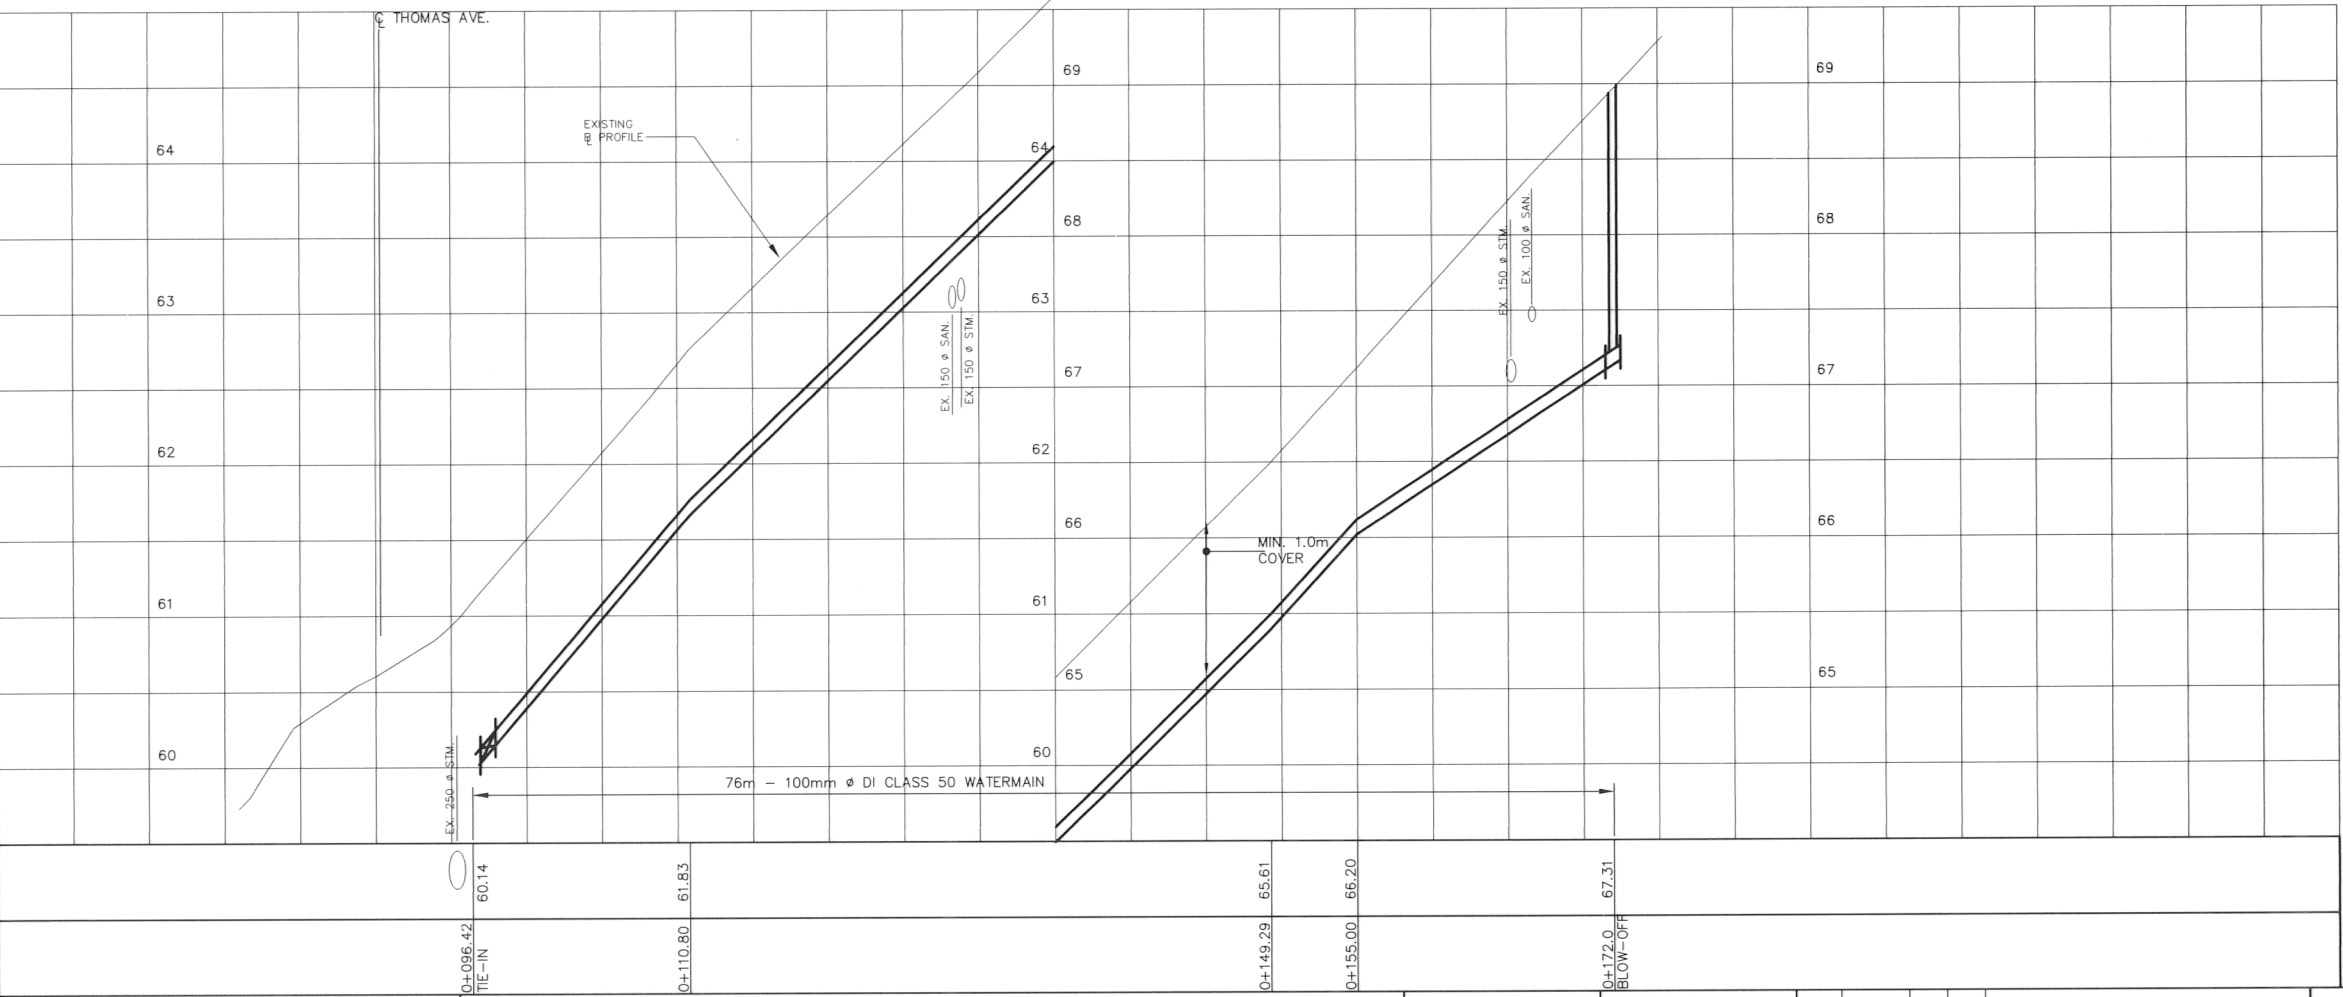

W-1783



R.F. Binnie & Associates Ltd.
CIVIL ENGINEERS

SURREY 103-7382 BURNABY 604-420-1721
TEL: 604-574-3336 TEL: 604-420-1721 FAX: 604-420-4743 TEL: 604-892-9222





REV'D	DATE	DRN	CH'D
4	28/01/98	DCA	WDFP
3	8/10/97	KFB	WDFP
2	10/06/97	BWD	WDFP
1	27/05/97	KFB	WDFP

CITY OF COQUITLAM Engineering Department

DESIGNED - WDFP
DRAWN - KFB
METRIC SCALE - HORIZ. 1:250
SCALE - VERT. 1:25
APPROVED -
DATE - APR. 25/97


1997 WATERMAIN
REPLACEMENT PROJECT
THERRIEN STREET
NORTH OF THOMAS AVE.

FILE -
CONSULTANTS
DWG No- B9710-W3
CITY
DWG No
SHEET 3 OF 9

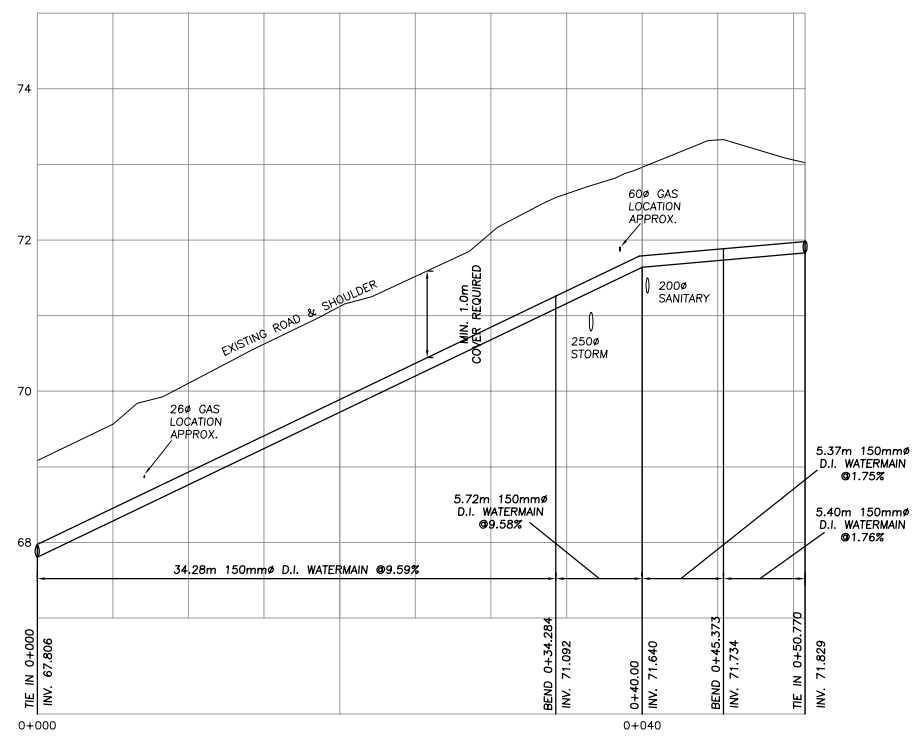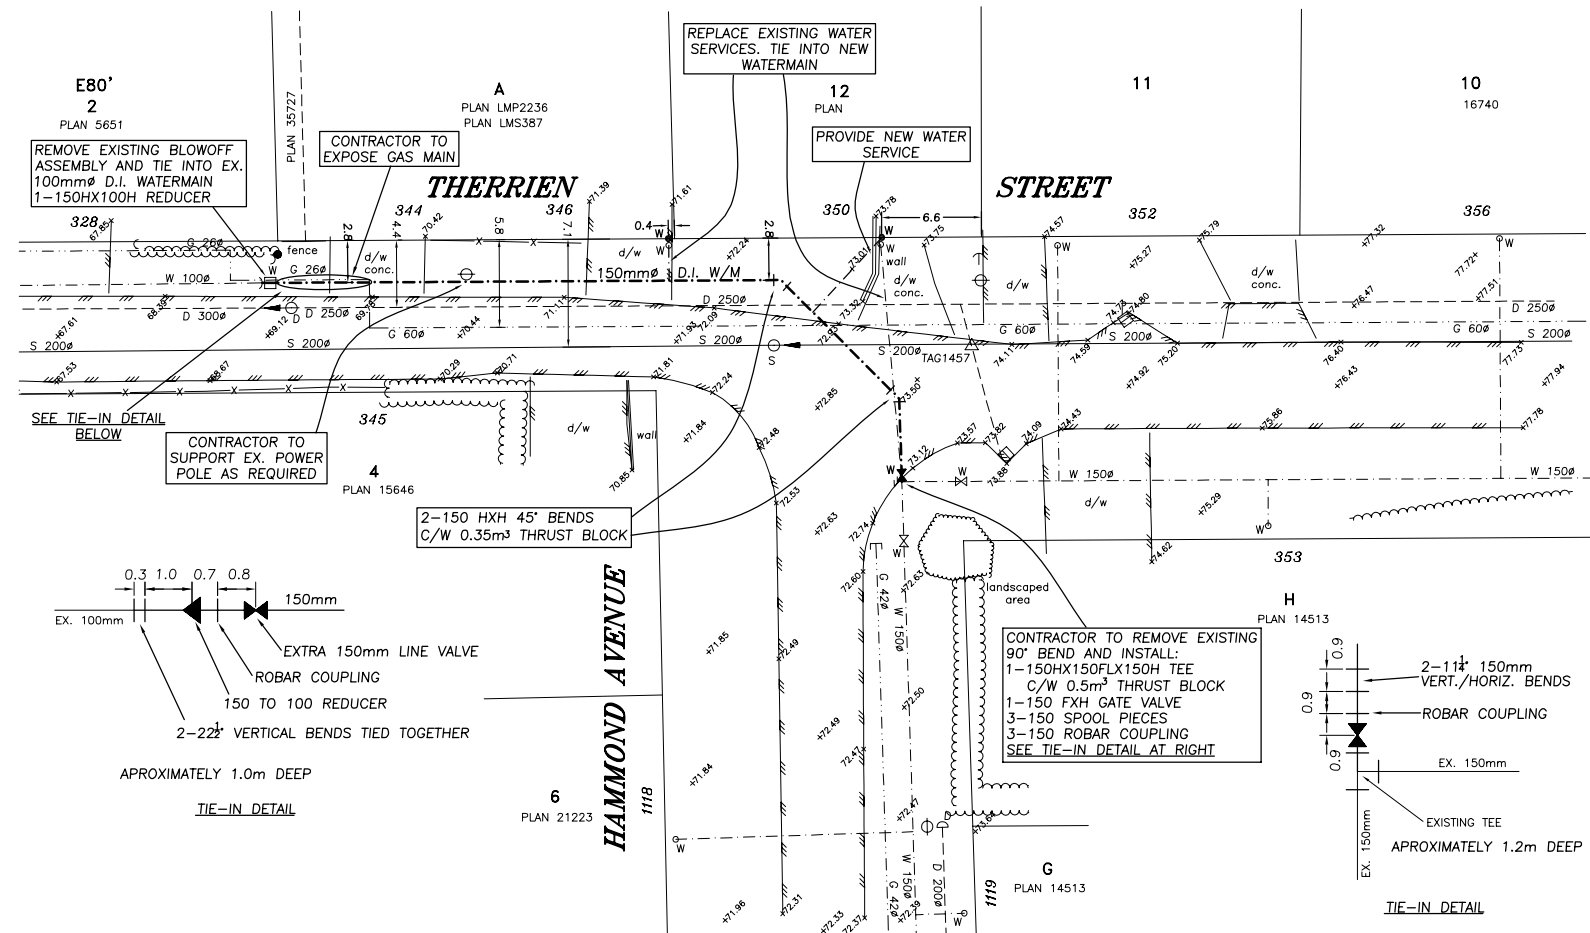

Note:
Location of existing utilities shown are approximate and should be confirmed by pipe locator and manual digging. All or any existing structures are not necessarily shown.

This photocopy is supplied by the City of Coquitlam for general information only and the accuracy of the information contained on the document is in no way guaranteed by the City.



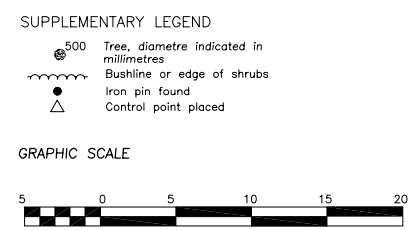


COQ. ASBUILT No.
W2089-02

PLOT DATE/TIME: August 23, 2007 10:46:21 AM

Destroy All Prints Bearing Rev. No. less than one indicated below

Edge of pavement			Drainage sewer, MH			Sanitary sewer, MH			U/G signal/light duct			 Engineering & Public Works 3000 Guildford Way, Coquitlam, B.C. V3B 7N2	Project THERRIEN STREET Hachey Ave. To Hammond Ave. WATERMAIN	DESIGNED	SCALE Horiz. 1:250 Vert. 1:50	DATE FEB 09 07	
Asphalt curb			Drainage service, Cleanout			Sanitary service, Cleanout			Streetlight, davit					DRAWN A.S.K.	DWG FILE: 07Therri02095532A		
Concrete sidewalk			Catch basin, top inlet			Sanitary sewer, forcemain			Streetlight, post top					CHECKED	SHEET OF 2	REV.	
Concrete curb			Catch basin, side inlet			U/G electrical duct, MH			Traffic signal pole					APPROVED	2	1	
Watermain and valve			Catch basin, round			Utility pole			Traffic signal post								
Water service box/curb stop			Swale			Utility pole with light			Traffic street sign								
Hydrant			Ditch			Junction box			Flasher								
Water blowoff			Culvert			U/G telecommunication, MH			Signal fixture								
Water air valve			Inlet/Outlet Structure			U/G gas main and valve			Combination traffic signal pole								
												1	FEB 12 07	ASBUILT - ISSUE			
												REV.	DATE	REVISION			

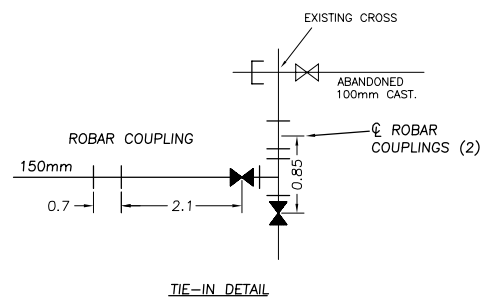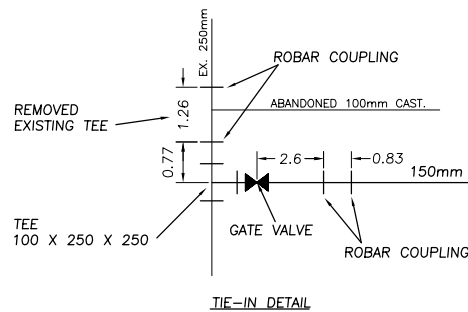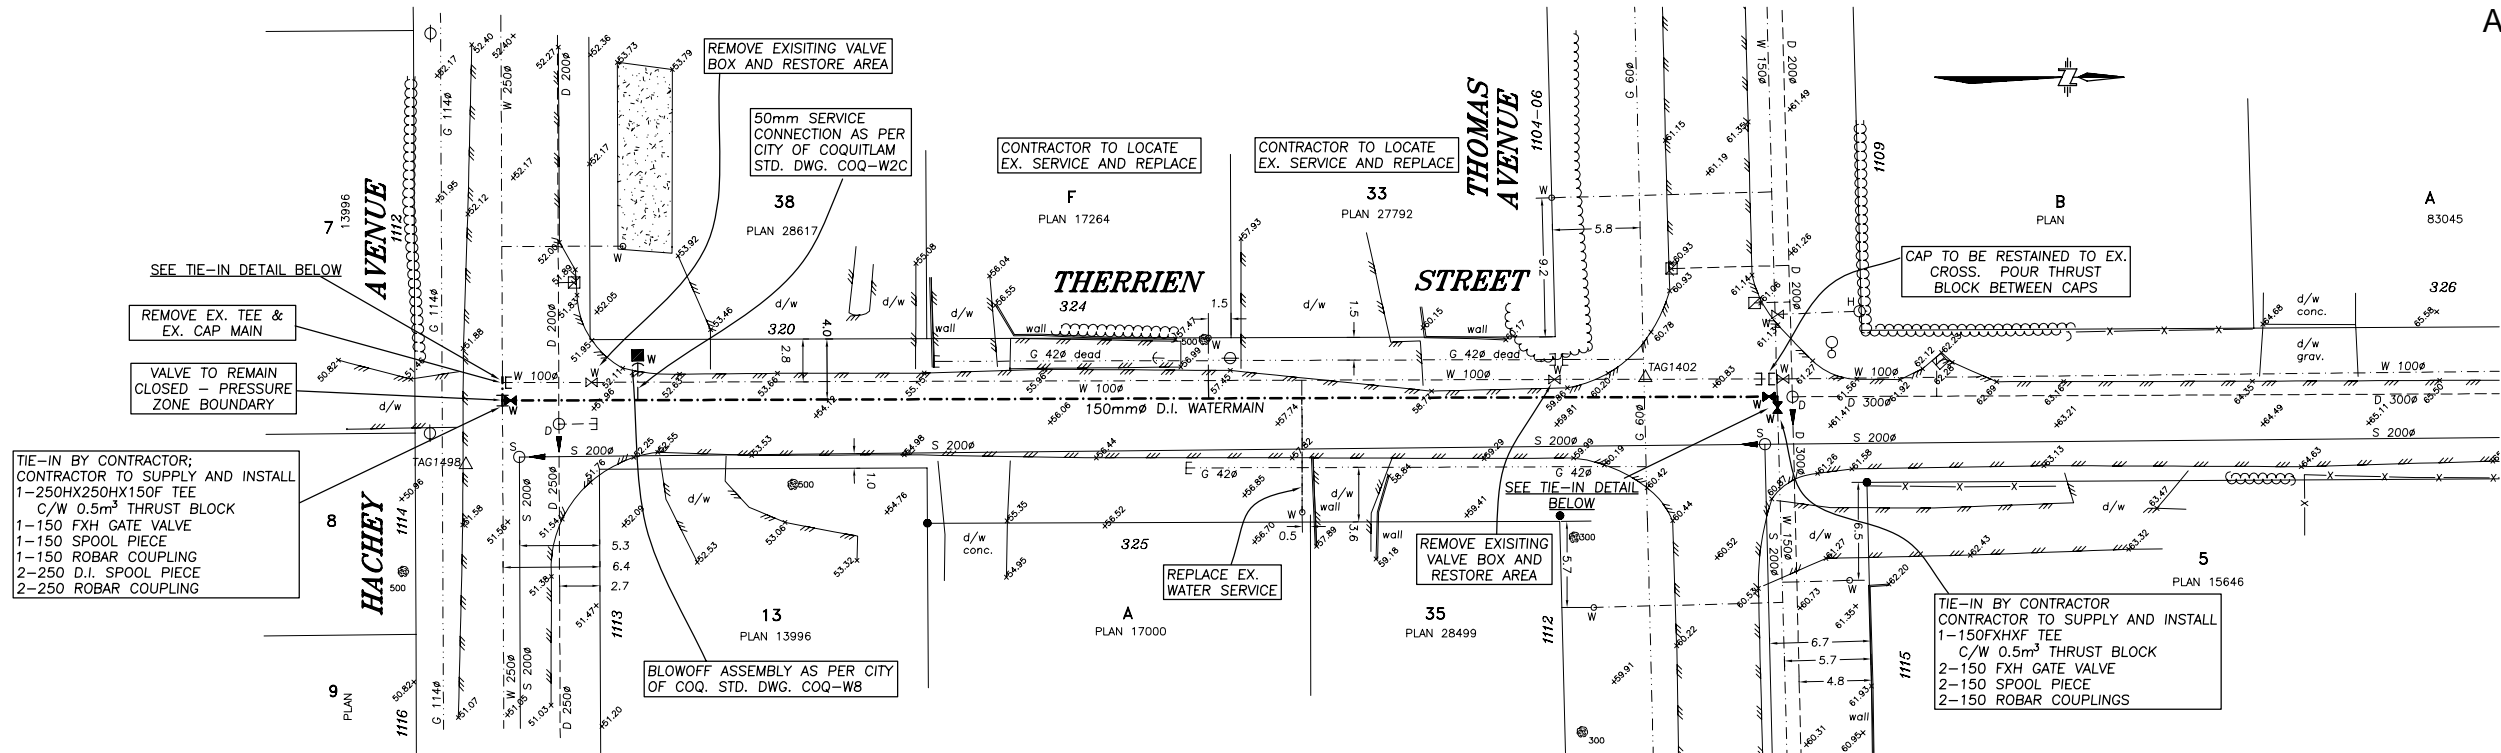

SUPPLEMENTARY LEGEND


- 500 Tree, diameter indicated in millimetres
- Bushline or edge of shrubs
- Iron pin found
- Control point placed

GRAPHIC SCALE



NOTES:

- ELEVATIONS ARE GEODETIC.
- SURVEY IS BASED UPON NAD27 UTM GROUND COORDINATES. DATE OF SURVEY COMPLETION IS DECEMBER 16, 2004.
- THE LOCATION OF EXISTING UNDERGROUND UTILITIES ARE INDICATED IN THE PUBLIC ROAD ALLOWANCE ONLY AND ARE SHOWN APPROXIMATE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. HYDRO/TEL UNDERGROUND DUCTS ARE NOT SHOWN.
- BASEMAP WAS COMPILED FROM INTEGRATED CONTROL MONUMENT TIES AND LIMITED LEGAL EVIDENCE FOUND. ACCURACY IS ESTIMATED AT $\pm 0.3m$.

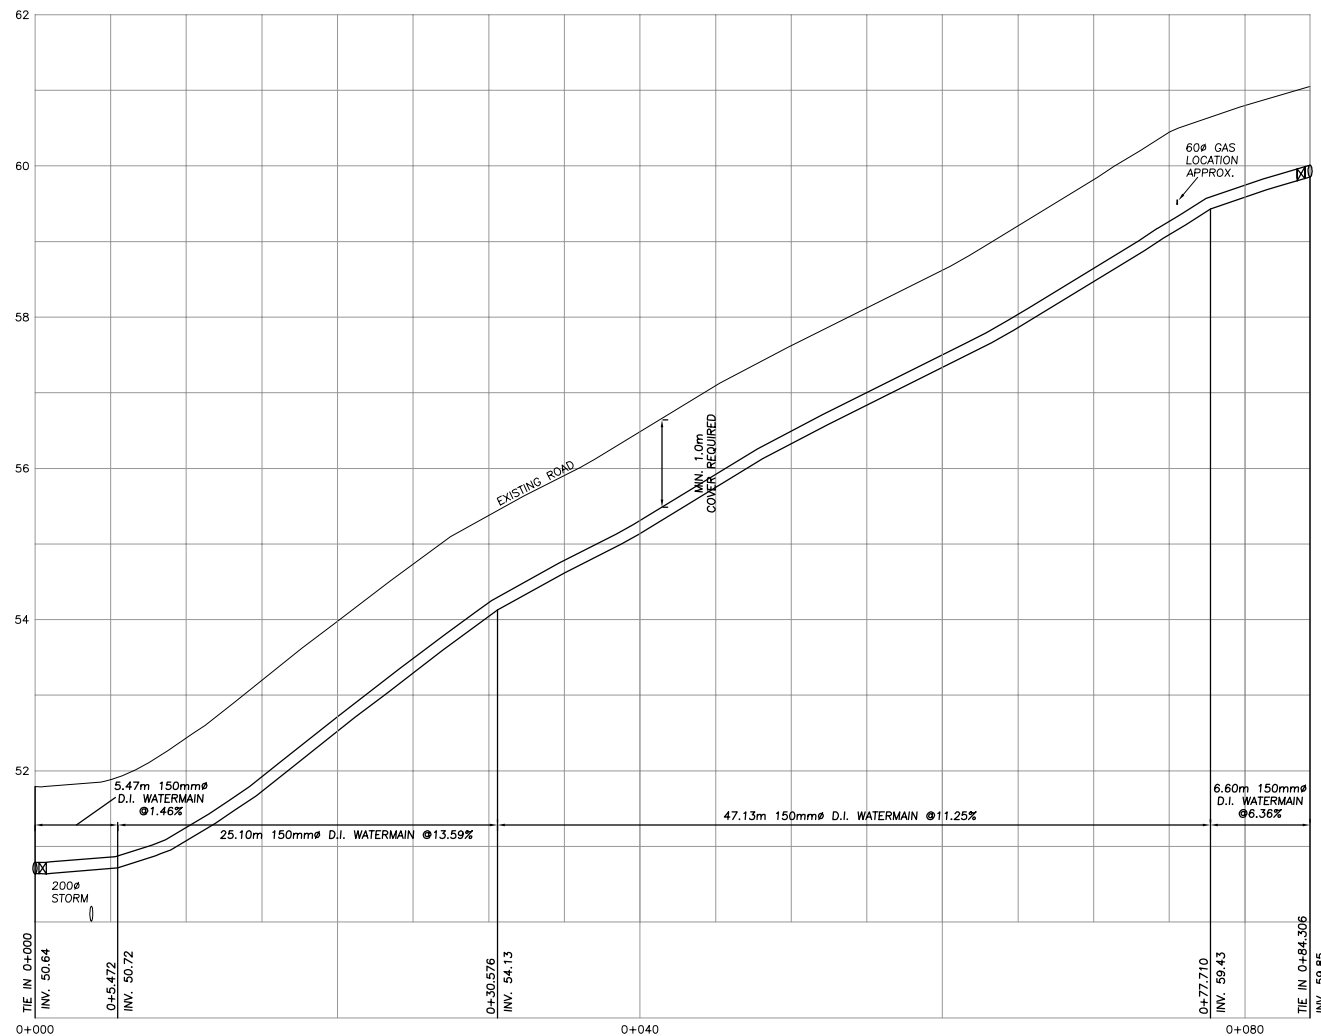

This photocopy is supplied by the City of Coquitlam for general information only and the accuracy of the information contained on the document is in no way guaranteed by the City.

Note:
Location of existing utilities shown are approximate and should be confirmed by pipe locator and manual digging. All or any existing structures are not necessarily shown.

COQ. ASBUILT No.

W2089-01

PLOT DATE/TIME: August 23, 2007 10:52:11 AM

	EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED		EXISTING	PROPOSED																		
Edge of pavement			Drainage sewer, MH			Sanitary sewer, MH			U/G signal/light duct			Streetlight, davit			Streetlight, post top			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole														
Asphalt curb			Drainage service, Cleanout			Sanitary sewer, forcemain			Streetlight, post top			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole																				
Concrete sidewalk			Catch basin, top inlet			U/G electrical duct, MH			Utility pole			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole																				
Concrete curb			Catch basin, side inlet			Utility pole with light			Junction box			U/G telecommunication, MH			U/G gas main and valve			U/G signal/light duct			Streetlight, davit			Streetlight, post top			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole					
Watermain and valve			Catch basin, round			Swale			Utility pole			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole																				
Water service box/curb stop			Swale			Ditch			Utility pole with light			Junction box			U/G telecommunication, MH			U/G gas main and valve			U/G signal/light duct			Streetlight, davit			Streetlight, post top			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole		
Hydrant			Culvert			Inlet/Outlet Structure			Sanitary sewer, MH			U/G signal/light duct			Streetlight, davit			Streetlight, post top			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole											
Water blowoff			Inlet/Outlet Structure						Sanitary sewer, MH			U/G signal/light duct			Streetlight, davit			Streetlight, post top			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole											
Water air valve									Sanitary sewer, forcemain			Streetlight, post top			Traffic signal pole			Traffic signal post			Traffic street sign			Flasher			Signal fixture			Combination traffic signal pole																	


Destroy All Prints Bearing Rev. No. less than one indicated below

REV.	DATE	REVISION
1	FEB 12 07	ASBUILT ISSUE



Engineering & Public Works
3000 Guildford Way, Coquitlam, B.C. V3B 7N2

Project	THERRIEN STREET			DESIGNED	SCALE	DATE
	Hachey Ave. To Hammond Ave.			DRAWN	Horiz. 1:250	FEB 09 07
	WATERMAIN			A.S.K.	Vert. 1:50	
	CHECKED	SHEET	OF	2	REV.	
	APPROVED	1			1	

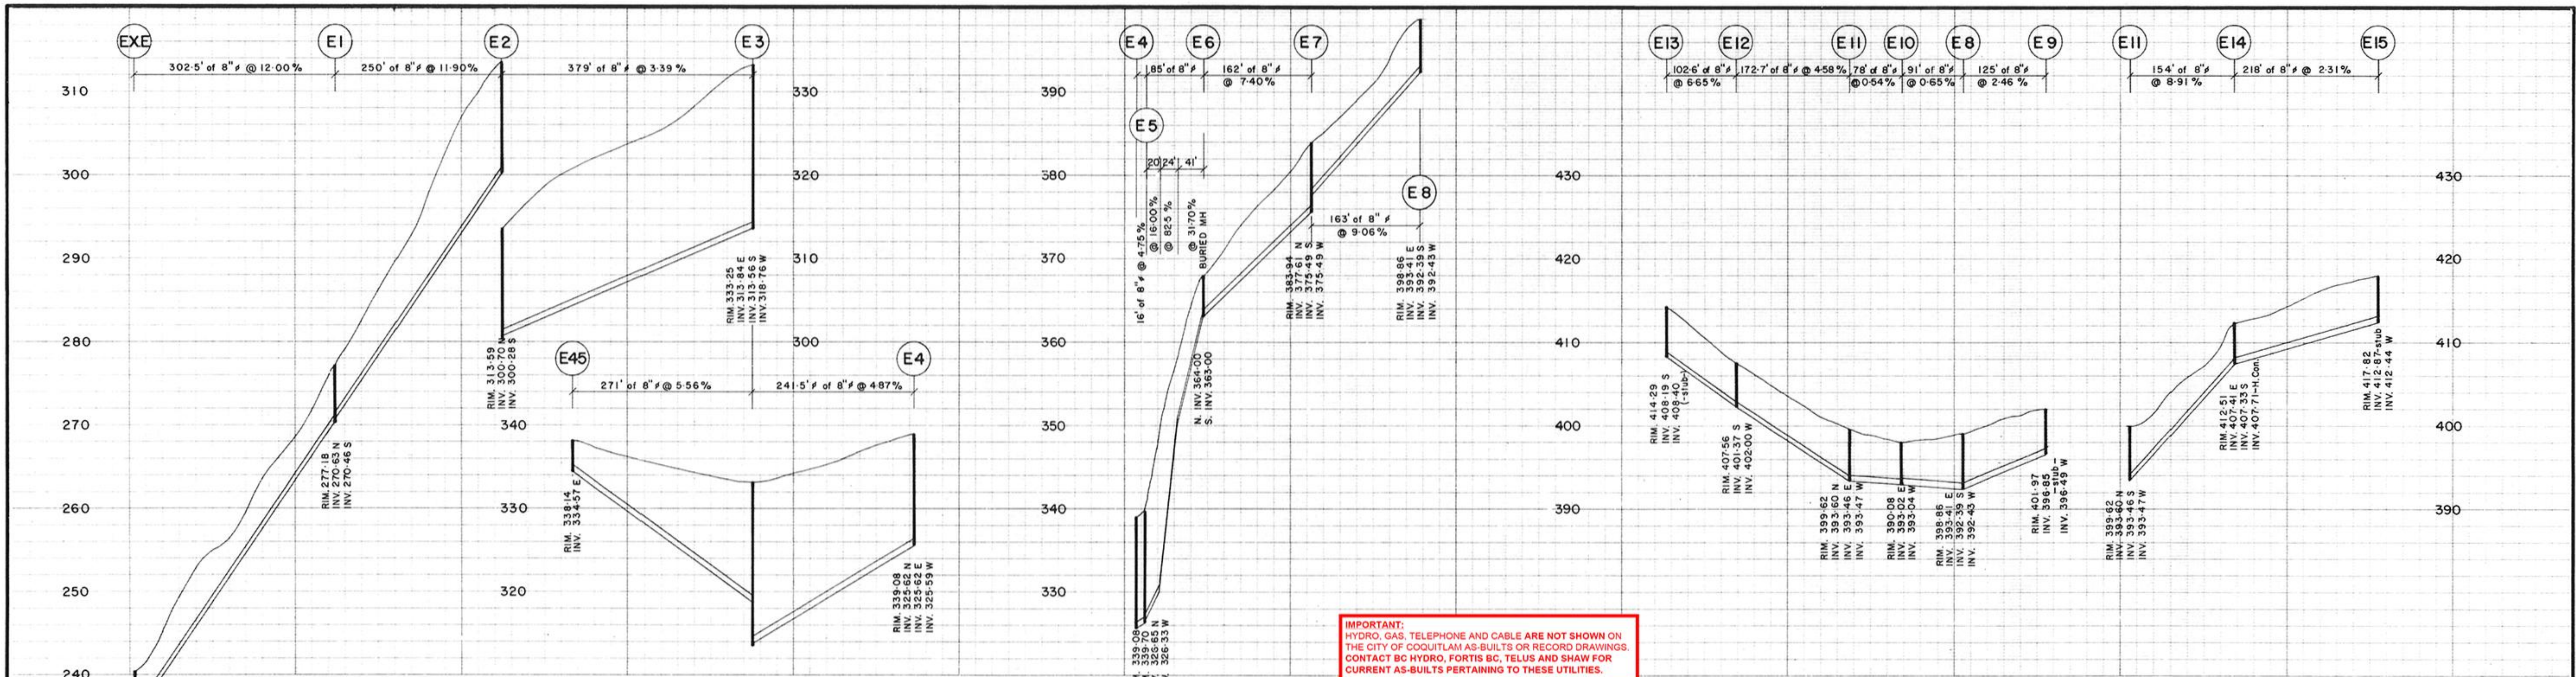

IMPORTANT:
HYDRO, GAS, TELEPHONE AND CABLE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, FORTIS BC, TELUS AND SHAW FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.



THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

* Refer to S-556 for Sanitary, storm & water conns. to 1241, 1251, 1261-1263 Rochester Ave.

This section of sanitary main is abandoned. Please see S2096-01 & 02 for upsized main.

SAN MANHOLE
RIM: 66.54
N. INV: 63.26
S. INV: 65.55

* Refer to S-441 for Sanitary Service Connections to family Swimming pool in Rochester Park.

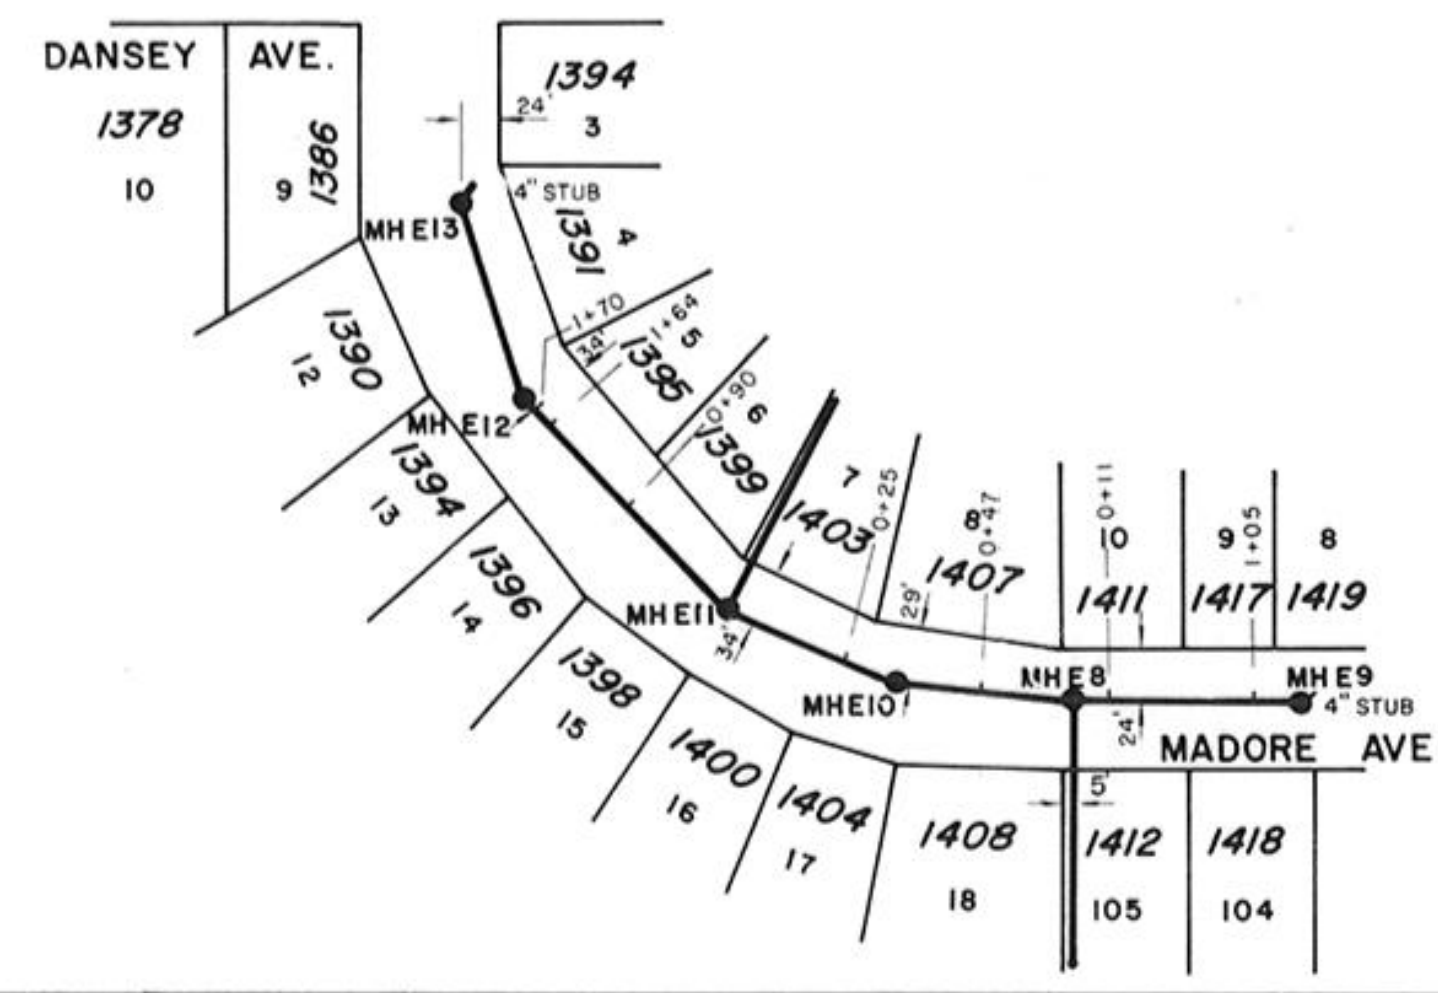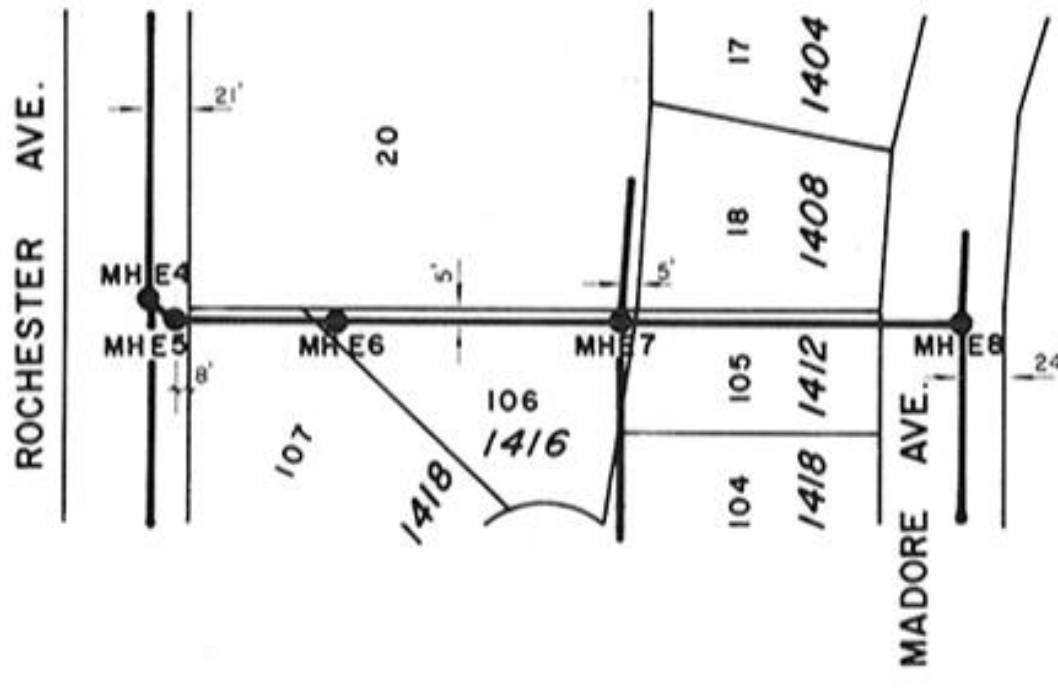


NOTE
FIELD BOOK REFERENCE, BOOK NO 195C
INTEGRATED SURVEY MON. 73H0437, 75H0423

MANHOLE ADDED BETWEEN E1 & E2 (SEE REV. CLOUD)				REVISION			
N°				DATE			
BY				CH'D			
PROPOSED				EXISTING			
ST SEWER - ST				ST			
SAN SEWER - SAN				SAN			
GAS - G				G			
WATER - W				W			
U/G ELEC - BCH				BCH			
U/G TEL - BCT				BCT			
LEGEND				STORM INLET TYPES			
I -				II -			
III -				IV -			
DITCH				UTILITY POLE			
VALVE				FIRE HYDRANT			
MANHOLE				IRON PIN			
BASEMENT ELEV.				EDGE OF PVT			
DESIGNED -				APP'D -			
DRAWN - D. W.				DATE -			
CHECKED -				SCALE			
DATE - OCT. 1975				HORIZ - 1" = 100'			
				VERT - 1" = 8'			
DISTRICT OF COQUITLAM				SANITARY SEWER			
ENGINEERING DEPARTMENT				AUSTIN SEWER AREA			
				RE-SURVEYED 1975, AS CONSTRUCTED			
				FILE - S-185			
				DWG -			
				SHEET 15 OF 27			

IMPORTANT:
HYDRO, GAS, TELEPHONE AND CABLE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, FORTIS BC, TELUS AND SHAW FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.

THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

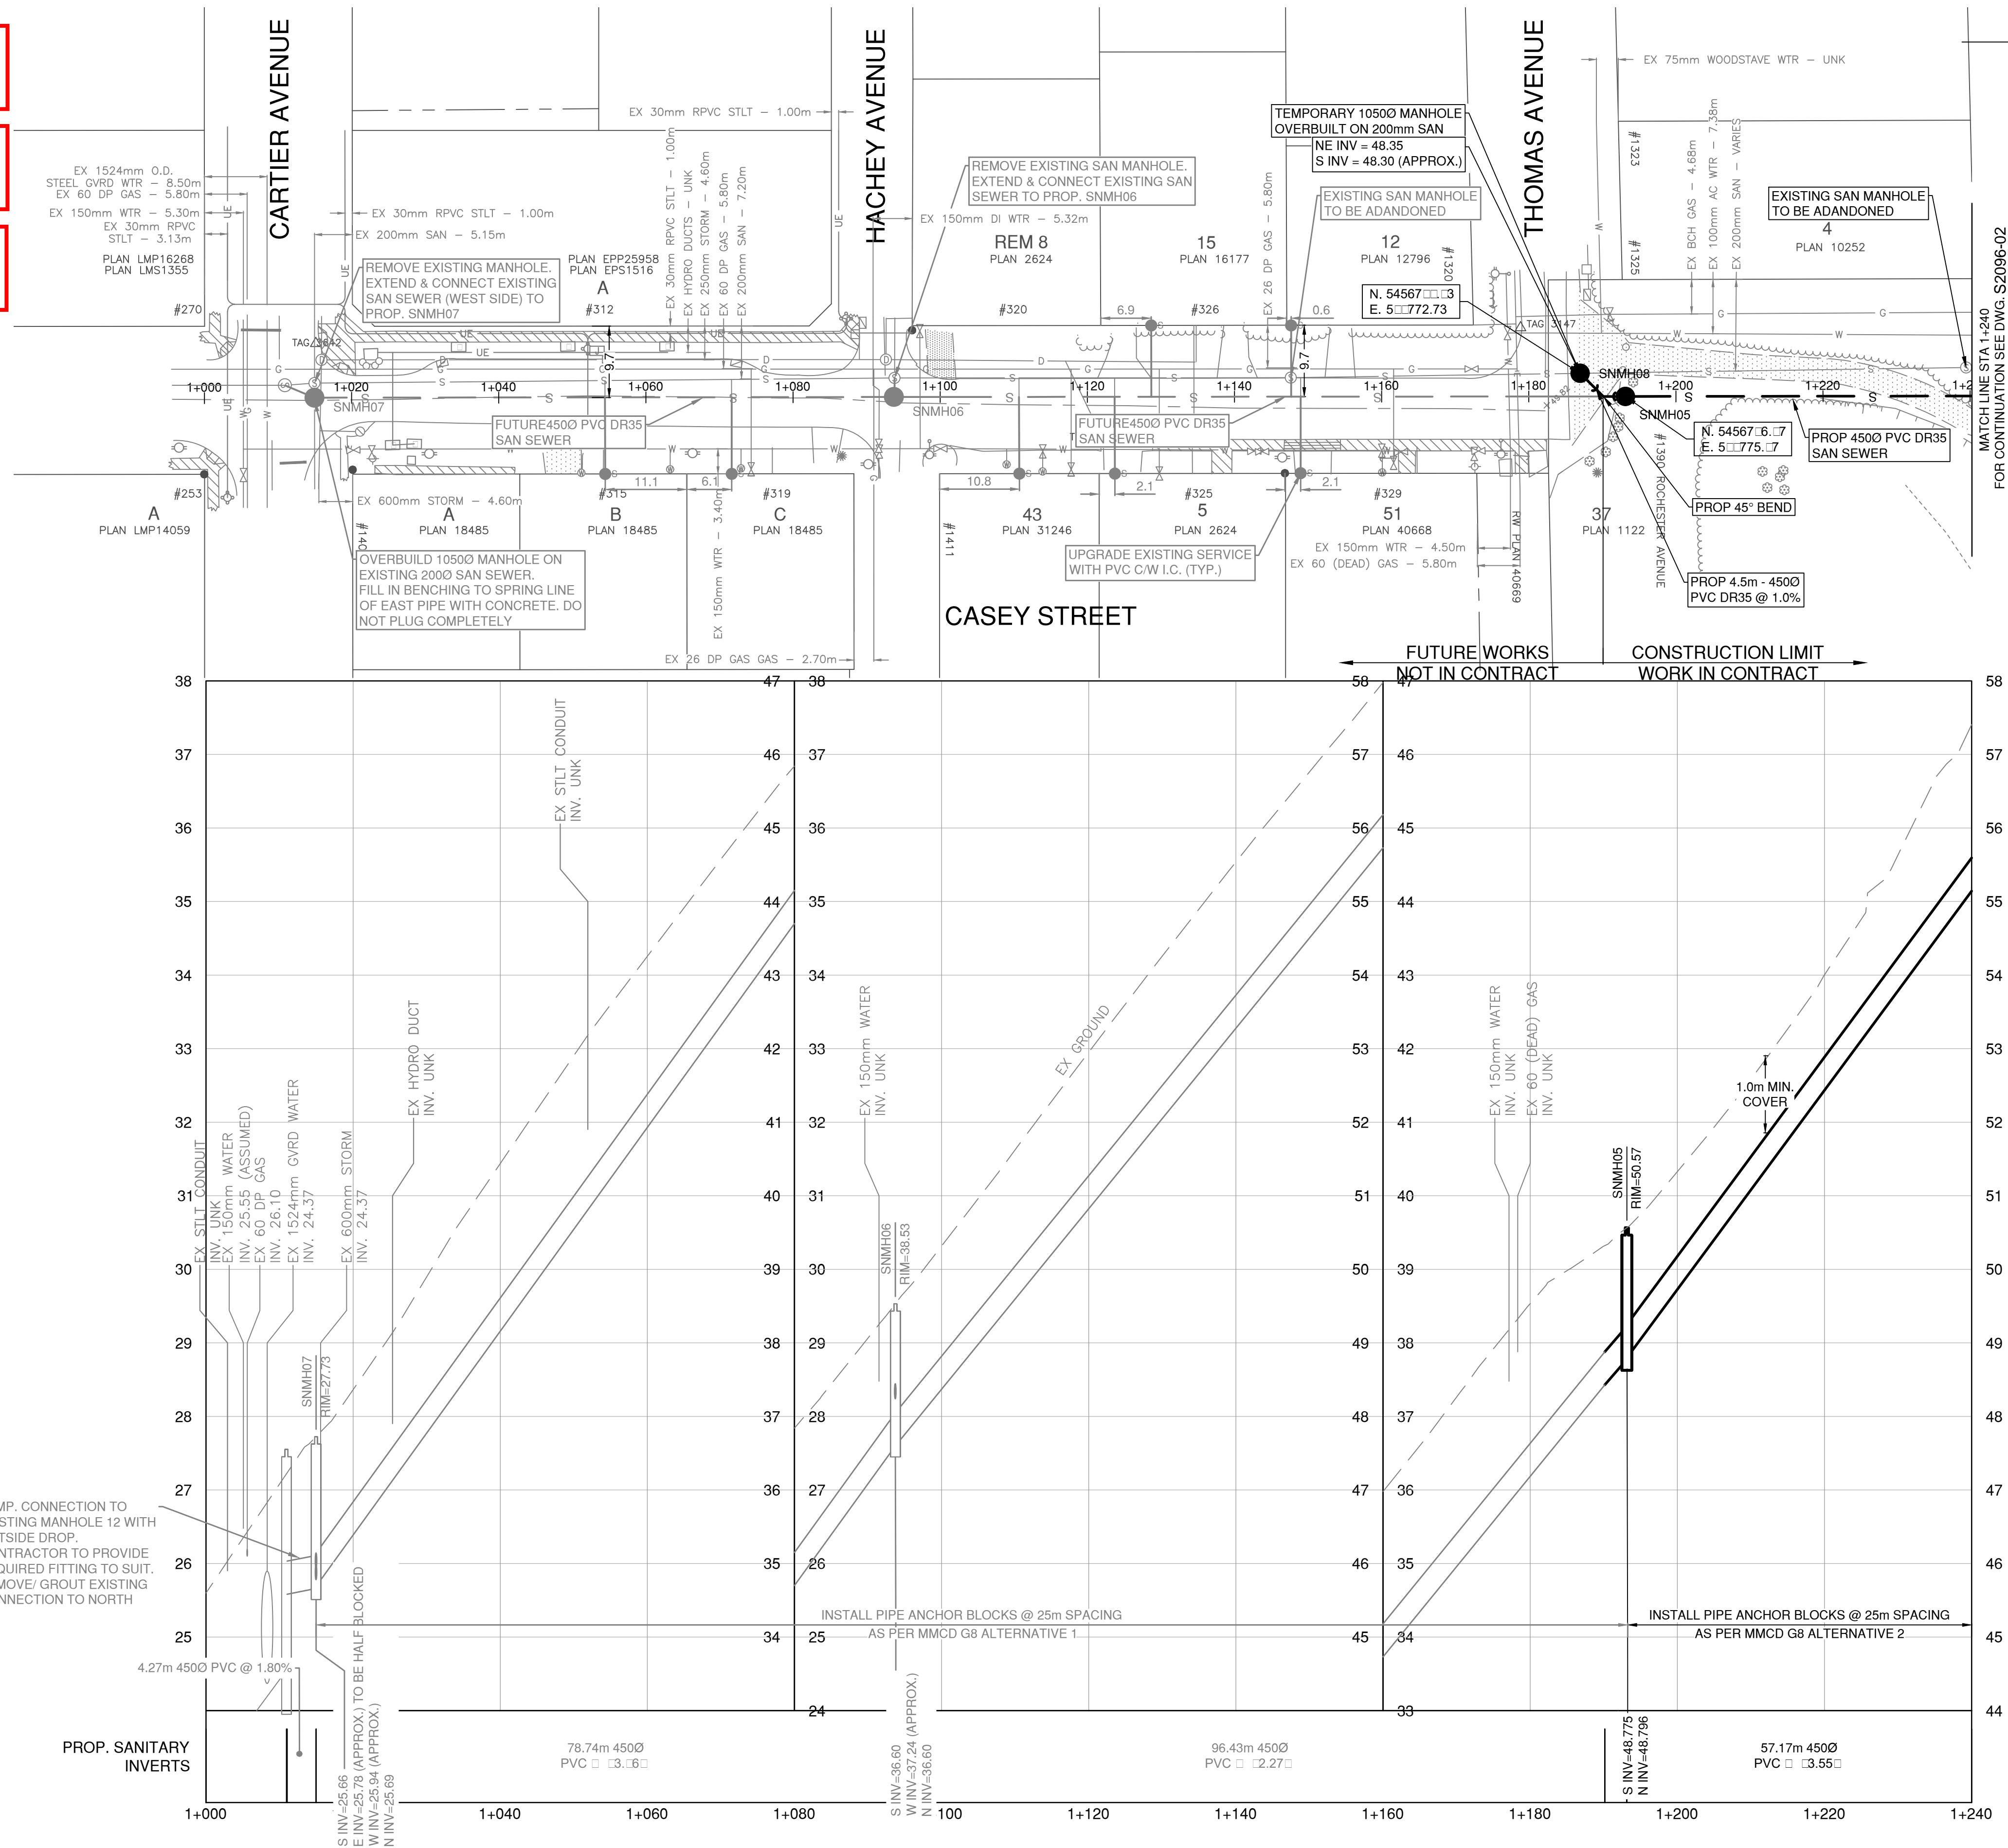

SUPPLEMENTARY LEGEND

- #100 House Number (Civic Address)
- Misc. Gate Post
- Vegetation Deciduous
- Vegetation Conifer
- Sump
- Water Meter
- Guy Wire
- Gravel
- Wall
- Fence
- Garden line
- Hedge, Tree or Bush line
- Embankment Bottoms
- Embankment Tops

NOTES:

- ALL MATERIALS AND CONSTRUCTION SHALL CONFORM TO MMCD 2000 (GOLD) EDITION AND CITY OF COQUITLAM SUPPLEMENTARY SPECIFICATIONS.
- PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL CONFIRM THE LOCATION AND ELEVATION OF ALL EXISTING UNDERGROUND UTILITIES. NOTIFY THE CONTRACT ADMINISTRATOR OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
- THE CONTRACTOR SHALL RECORD COMPLETE AND ACCURATE AS-BUILT INFORMATION ON A SET OF CURRENT CONSTRUCTION DRAWINGS DURING CONSTRUCTION AND SUBMIT THE INFORMATION TO THE CONTRACT ADMINISTRATOR.
- THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THE VICINITY OF A RETAINING WALL AND/OR ADJACENT STRUCTURE.
- ALL EXISTING SURFACES SHALL BE RESTORED TO ORIGINAL OR BETTER CONDITION SUBSEQUENT TO CONSTRUCTION.
- UNLESS OTHERWISE INDICATED, SANITARY SEWER MATERIALS SHALL BE:
 - **MAINS** = PVC DR 35
 - **SERVICE CONNECTION:**
 - 100mm DIA, 150mm DIA = PVC DR 28
 - 200mm DIA AND GREATER = PVC DR 35
 - **MANHOLES** = 1050mm DIA. PRECAST REINFORCED CONCRETE
- MANHOLES SHALL BE INSTALLED AS PER MMCD STANDARD DRAWINGS S1 AND S2. BENCHING SHALL BE AS PER MMCD STANDARD DRAWING S3. MANHOLE FRAMES AND COVERS SHALL CONFORM TO CITY OF COQUITLAM STANDARD DRAWING COQ-S16.
- FOR TYPICAL TRENCH SECTION SEE CITY OF COQUITLAM STD. DWG. COQ-G4 AMENDED.
- EXISTING SANITARY SEWER AND MANHOLES TO BE REMOVED AS PART OF THE TRENCH EXCAVATION FOR NEW MAINS OR SERVICES, OR ABANDONED, SEALED, AND FILLED AS PER THE FOLLOWING SPECIFICATIONS:
 - PIPES SHALL BE PLUGGED IN THE MANHOLE WITH CONCRETE FILLED SAND BAGS. PRIOR TO BURYING, FIELD INSPECTOR TO WITNESS THAT PIPES HAVE BEEN PLUGGED.
 - CAST IRON FRAMES AND COVERS, BRICKS AND/OR PRE-CAST CONCRETE RINGS, AND THE TOP OF THE MANHOLE STRUCTURE SHALL BE REMOVED AND THE MANHOLE CASTINGS SHALL BE DISPOSED OFF-SITE BY THE CONTRACTOR.
 - MANHOLE SECTIONS SHALL BE REMOVED TO MIN 1.2m BELOW GRADE.
 - MANHOLES SHALL BE FILLED WITH 19mm CRUSH AND COMPACTED IN 0.3m LIFTS TO 95% MODIFIED PROCTOR DENSITY.
- ALL EXISTING UTILITY SERVICE CONNECTIONS NOT SHOWN FOR CLARITY.
- ELEVATIONS ARE DERIVED FROM CONTROL TAG 3143. ELEVATION=73.574m [CGVD28 (GVRD 2005)] LOCATED ON THE SOUTH SIDE OF ROCHESTER AVENUE AT #1390.
- THIS PLAN SHOWS HORIZONTAL GROUND LEVEL MEASURED DISTANCES. PRIOR TO COMPUTATION OF NAD83 U.T.M. COORDINATES MULTIPLY BY THE COMBINED FACTOR 0.9995887. SURVEY IS BASED ON FILE: "13ROCHES0328307TO.DWG" DATED APRIL 5, 2013. DATE OF MOST RECENT SURVEY COMPLETION IS MARCH 26, 2015.
- BASEMAP WAS IMPORTED FROM CITY OF COQUITLAM G.I.S. COORDINATE GEOMETRY. ACCURACY IS ESTIMATED AT ±0.15m.

COQ. AS-BUILT NO.
S2096-01

Edge of pavement	Hydrant	Sanitary service	Traffic street sign
Watermain and valve	Water air valve	Sanitary cleanout	Pedestrian Pushbutton
Drainage sewer, MH	Water blowoff	Utility pole (joint pole)	Signal pole
Drainage ditch	Water service	Utility pole with light	Flasher
Sanitary sewer, MH	Catch basin, top inlet	Streetlight, davit	Junction box
Sanitary forcemain	Catch basin, side inlet	Streetlight, post top	Survey Traverse Hub
Gasmain and valve	Comb signal pole	Traffic signal pole	Survey Iron Pin
Hydro duct, MH	Drainage service	Traffic signal post	Survey Lead Plug
Telephone duct, MH	Drainage cleanout		Survey Monument

NO.	DATE	BY	REVISIONS	ENG.
7				
6				
5	2016-2-7	EA	ISSUED ASBUILT	TDB
4	2015-7-3	TL	ISSUED FOR CONSTRUCTION	TDB
3	2015-7-2	TL	ISSUED FOR TENDER	TDB
2	2015-6-5	TL	ISSUED FOR DESIGN REVIEW	TDB
1	2015-5-2	TL	PRELIMINARY DESIGN	TDB

DESIGN BY	DATE
DL	2015-5-2
DRAWN BY	DATE
EA	2015-5-2
CHECKED BY	DATE
TDB	2015-5-2
APPROVED BY	DATE
TDB	2015-5-2

PARSONS

METROTOWER 1, SUITE 5300, 4710 KINGSWAY,
BURNABY, BRITISH COLUMBIA, CANADA V5H 4A2
TEL: 604-436-5300 FAX: 604-436-5300
www.parsons.com

Coquitlam

Engineering & Public Works

3000 Guildford Way, Coquitlam, B.C. V3B 7N2

SCALE	HORIZ.	5	SCALE	VERT.	5
SHEET	OF				
ENG PROJECT	NUMBER	EB3	2EBA		

PROJECT
AUSTIN HEIGHTS SEWER
CASEY STREET
DESCRIPTION
SANITARY SEWER

S

File: EB3\2EBA\1-1.RC


PLOT DATE: December 7, 2016

COQ AS BUILT
D3031
W3408


IMPORTANT:
HYDRO, GAS, TELEPHONE AND CABLE ARE NOT SHOWN ON THE CITY OF COQUITLAM AS-BUILTS OR RECORD DRAWINGS. CONTACT BC HYDRO, FORTIS BC, TELUS AND SHAW FOR CURRENT AS-BUILTS PERTAINING TO THESE UTILITIES.

NOTE:
LOCATION OF EXISTING UTILITIES SHOWN ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED BY A PIPE LOCATOR AND MANUAL DIGGING. ALL OR ANY EXISTING STRUCTURES ARE NOT NECESSARILY SHOWN.


THIS PHOTOCOPY IS SUPPLIED BY THE CITY OF COQUITLAM FOR GENERAL INFORMATION ONLY AND THE ACCURACY OF INFORMATION CONTAINED ON THE DOCUMENT IS NOT GUARANTEED BY THE CITY.

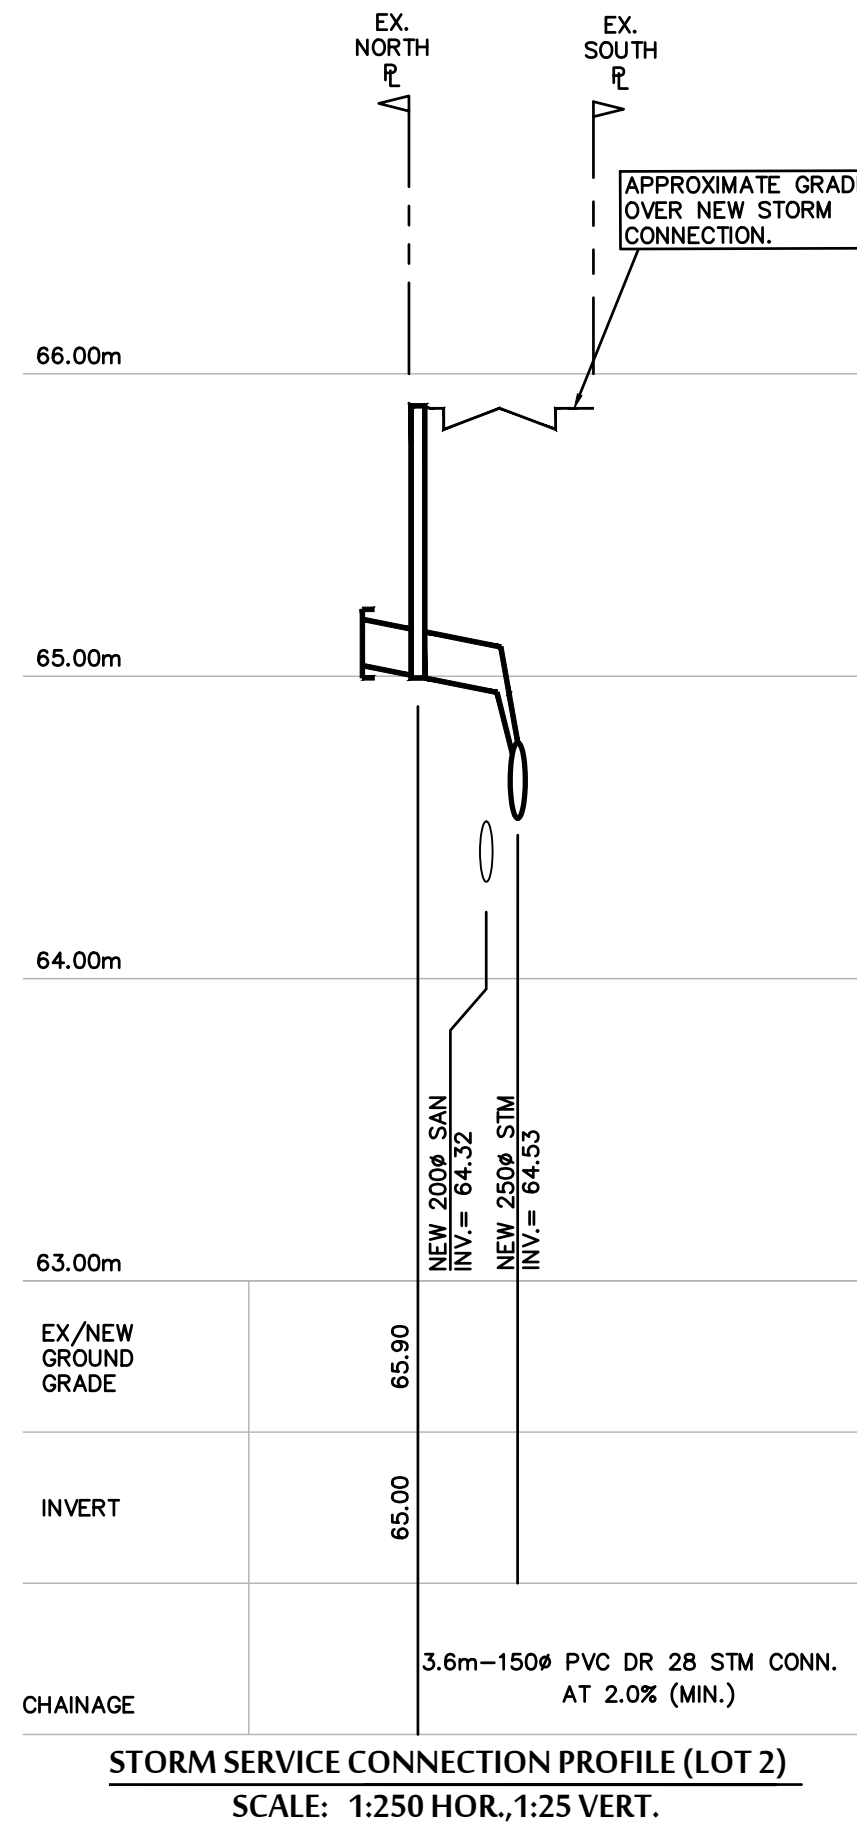

- STORM SEWER GENERAL NOTES**
- UNLESS OTHERWISE INDICATED STORM SEWER MATERIALS SHALL BE.
MAINS - 250mm DIA - PVC DR 35
- 300mm DIA - PVC DR 35 OR CONCRETE C14 CLASS 3
- 375mm TO 675mm - CONCRETE C76 CLASS 3
CATCH BASIN LEADS - SINGLE CB - 150mm PVC DR 28
- DOUBLE CB - 200mm PVC DR 35
MANHOLES - PRECAST REINFORCED CONCRETE
1050mm DIA MH MAINS UP TO 450mm DIA
1200mm DIA MH MAINS 525mm AND 600mm IN DIA
1350mm DIA MH MAINS 675mm AND 750mm IN DIA
1500mm DIA MH MAINS 900mm TO 1050mm IN DIA OR RISER MH
CATCH BASINS - STANDARD - 600mm DIA PRECAST REINFORCED CONCRETE
- SIDE INLET - 900mm DIA PRECAST REINFORCED CONCRETE
 - MANHOLES SHALL BE INSTALLED AS PER MMCD STANDARD DRAWING S1 AND S2. BENCHING SHALL BE AS PER MMCD STANDARD DRAWING S3. MANHOLE FRAMES AND COVERS SHALL CONFORM TO CITY OF COQUITLAM STANDARD DRAWING COQ-S16.
 - STANDARD CATCH BASINS SHALL BE INSTALLED AS PER MMCD STANDARD DRAWING S11. SIDE INLET CATCH BASINS SHALL BE INSTALLED AS PER CITY OF COQUITLAM STANDARD DRAWING COQ-S11A. CATCH BASIN RIM ELEVATIONS FOR STANDARD AND SIDE INLET CATCH BASINS SHALL BE SET 30mm BELOW FINISHED GRADE.
 - INSPECTION CHAMBER SHALL BE INSTALLED FOR ALL CONNECTIONS AS PER MMCD STANDARD DRAWING S9.
 - STORM CONNECTIONS TO BE AS PER MMCD S8 AND 150mm DIA PVC UNLESS OTHERWISE NOTED.
 - TRENCHING SHALL BE AS PER CITY OF COQUITLAM STANDARD DRAWING COQ-G4.

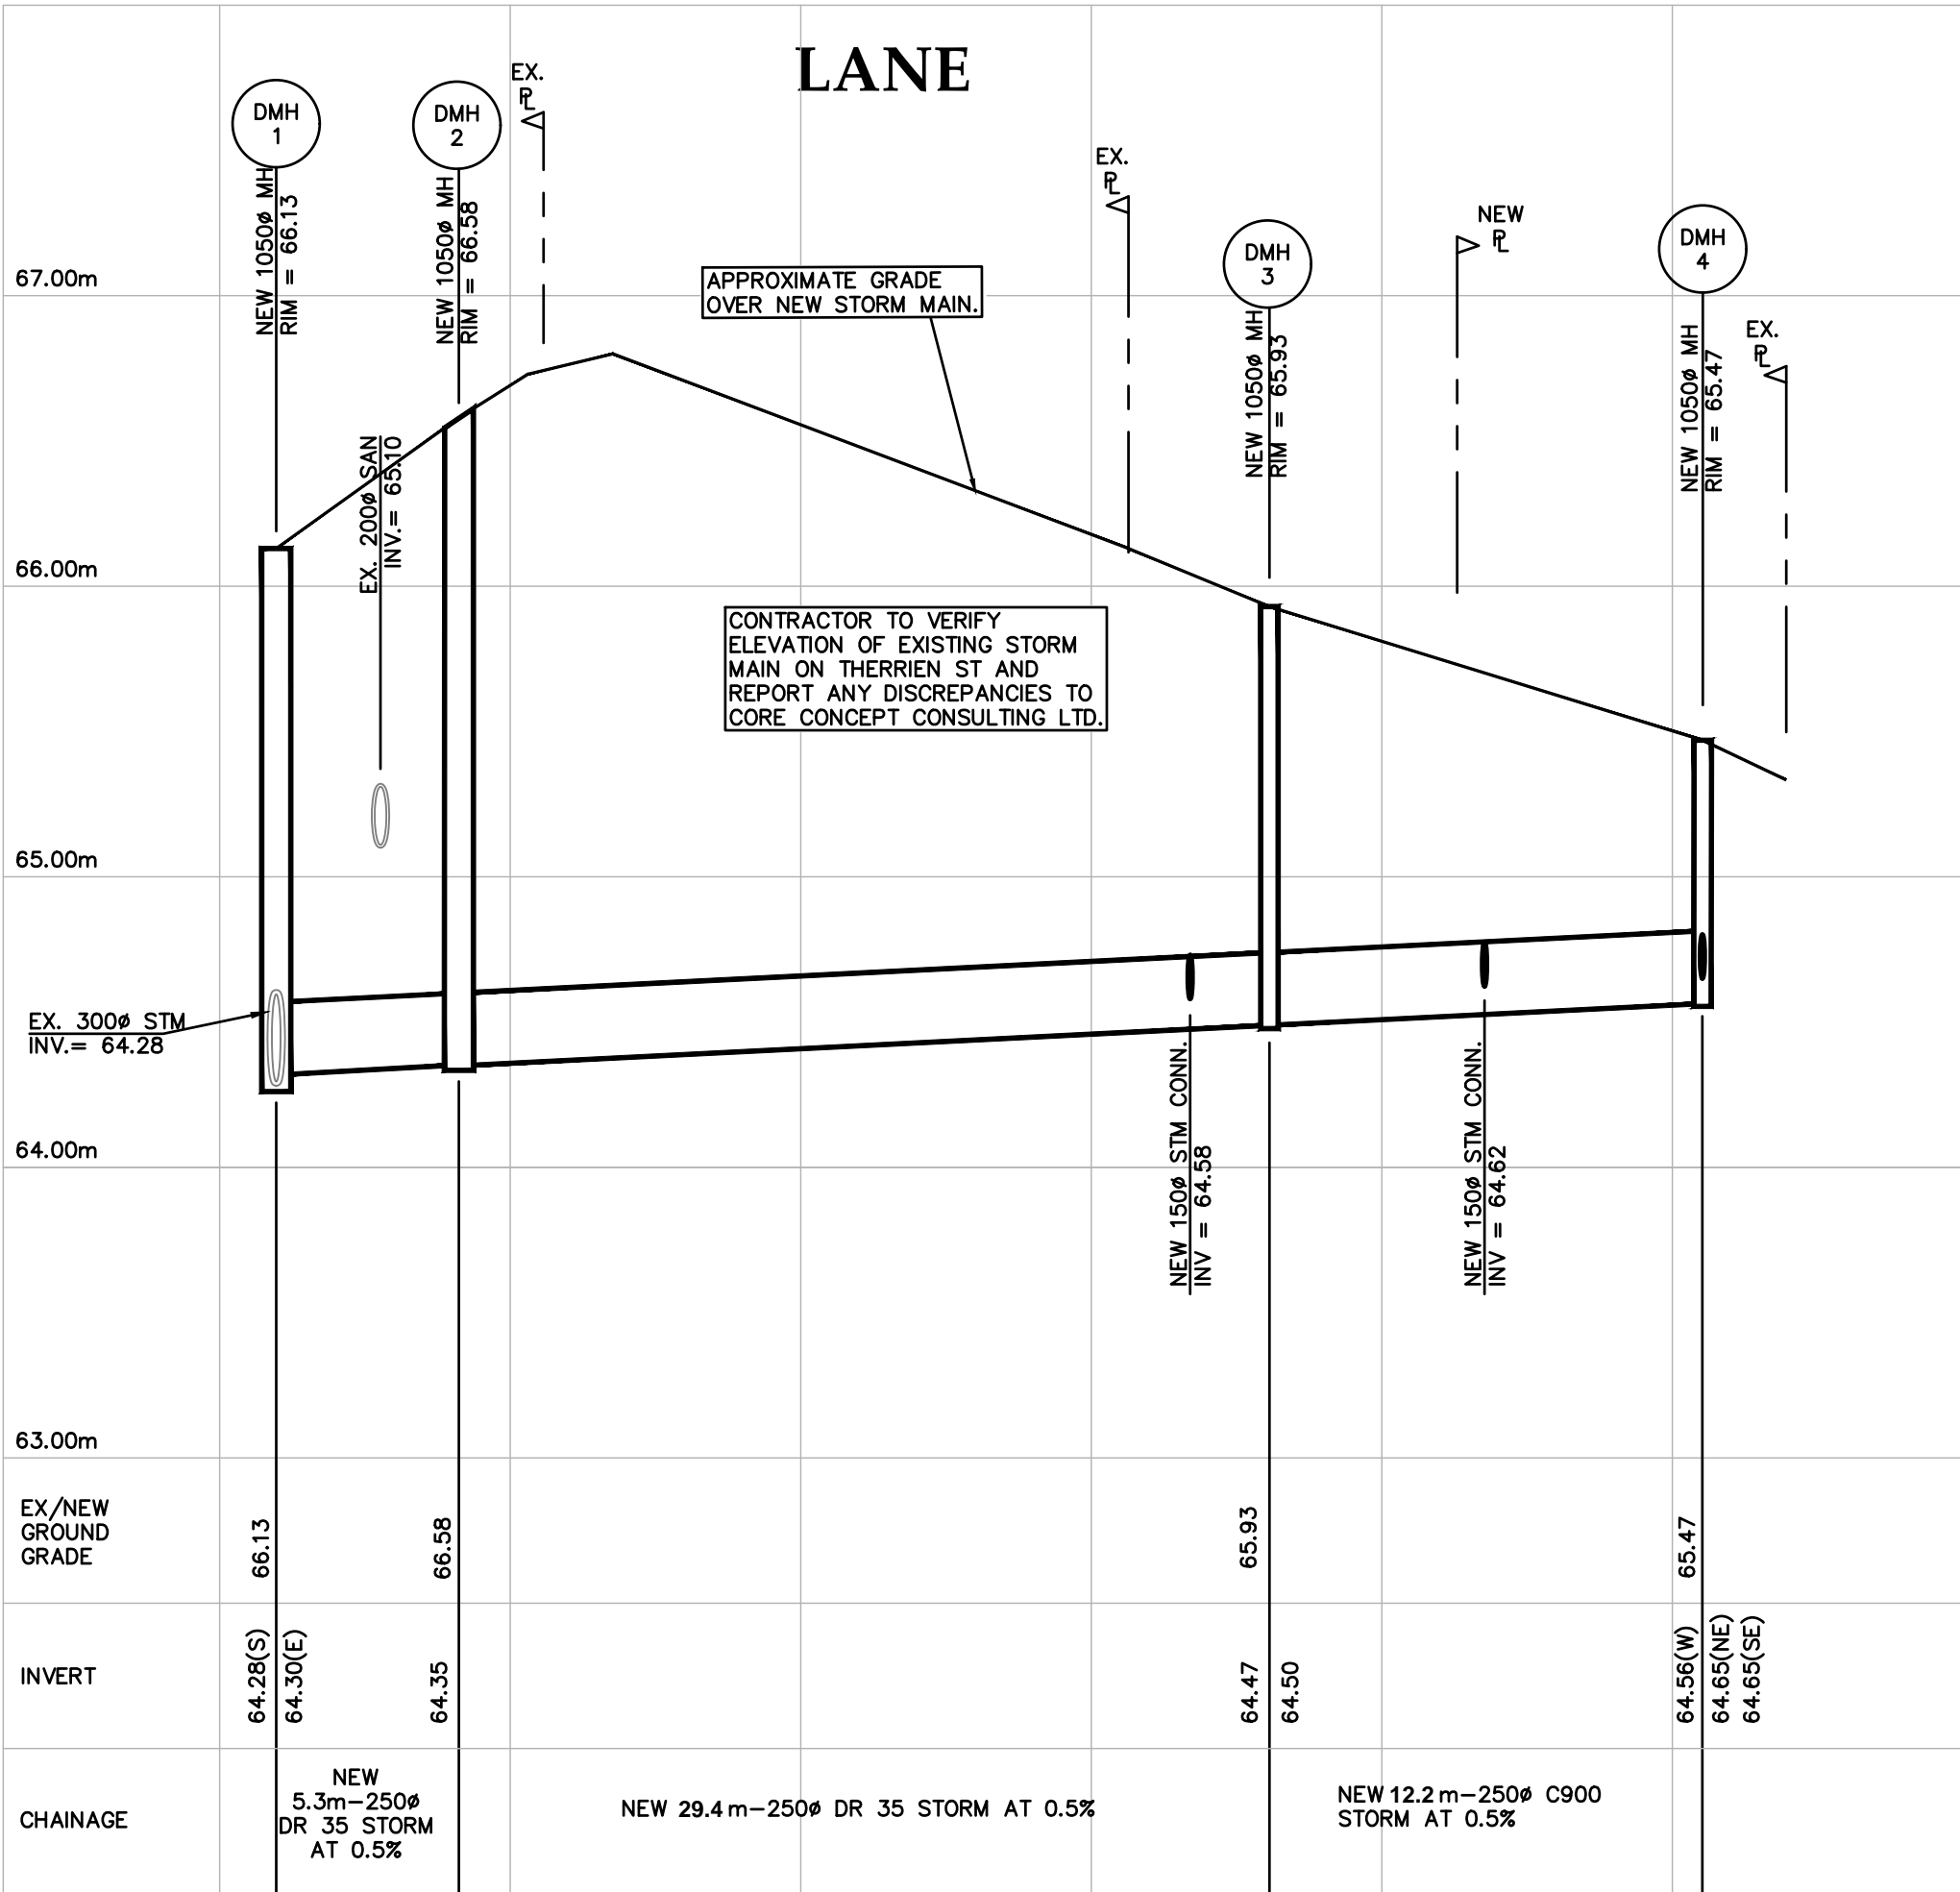

- WATERMAIN GENERAL NOTES**
- UNLESS OTHERWISE INDICATED WATERMAIN PIPE MATERIAL SHALL BE:
i) PVC CLASS 150 OR 200 DR 18
ii) DUCTILE IRON CLASS 50, CEMENT MORTAR LINED
 - FIRE HYDRANT LEADS SHALL BE DUCTILE IRON CLASS 50.
 - FITTINGS SHALL BE GREY IRON SUITABLE FOR 1380kPa WORKING PRESSURE.
 - GATE VALVES SHALL BE CAST IRON SUITABLE FOR 1380kPa WORKING PRESSURE.
 - CONFIRM WATERMAIN WORKING PRESSURE WITH ENGINEER PRIOR TO PRESSURE TESTING.
 - CONFIRM THRUST BLOCK END AREAS WITH ENGINEER PRIOR TO CONSTRUCTION.
 - DEFLECTION OF PIPE JOINTS SHALL NOT EXCEED ONE-HALF MAXIMUM DEFLECTION SPECIFIED IN AWWA C500 OR ONE-HALF MAXIMUM DEFLECTION RECOMMENDED BY PIPE MANUFACTURER. JOINT DEFLECTION IS NOT PERMITTED FOR PVC PIPE UNLESS HIGH DEFLECTION PVC COUPLINGS (RATED FOR 1380kPa) OPERATING PRESSURE ARE USED.
 - TESTING AND CHLORINATION OF WATERMAINS TO BE PERFORMED BY THE CONTRACTOR WITNESSED BY THE CITY OF COQUITLAM ENGINEERING AND PUBLIC WORKS INSPECTOR.
 - JOINTS SHALL BE RESTRAINED WITH UNI-FLANGE SERIES 1300 FITTINGS WHERE REQUIRED.
 - WATER SERVICE CONNECTION TO BE AS PER THE MMCD STANDARD DRAWING W2b UNLESS OTHERWISE NOTED.
 - WATER SERVICE CONNECTION TO BE 20mm COPPER, TYPE K, UNLESS OTHERWISE NOTED.
 - TRENCHING SHALL BE AS PER CITY OF COQUITLAM STANDARD DRAWING COQ-G4.

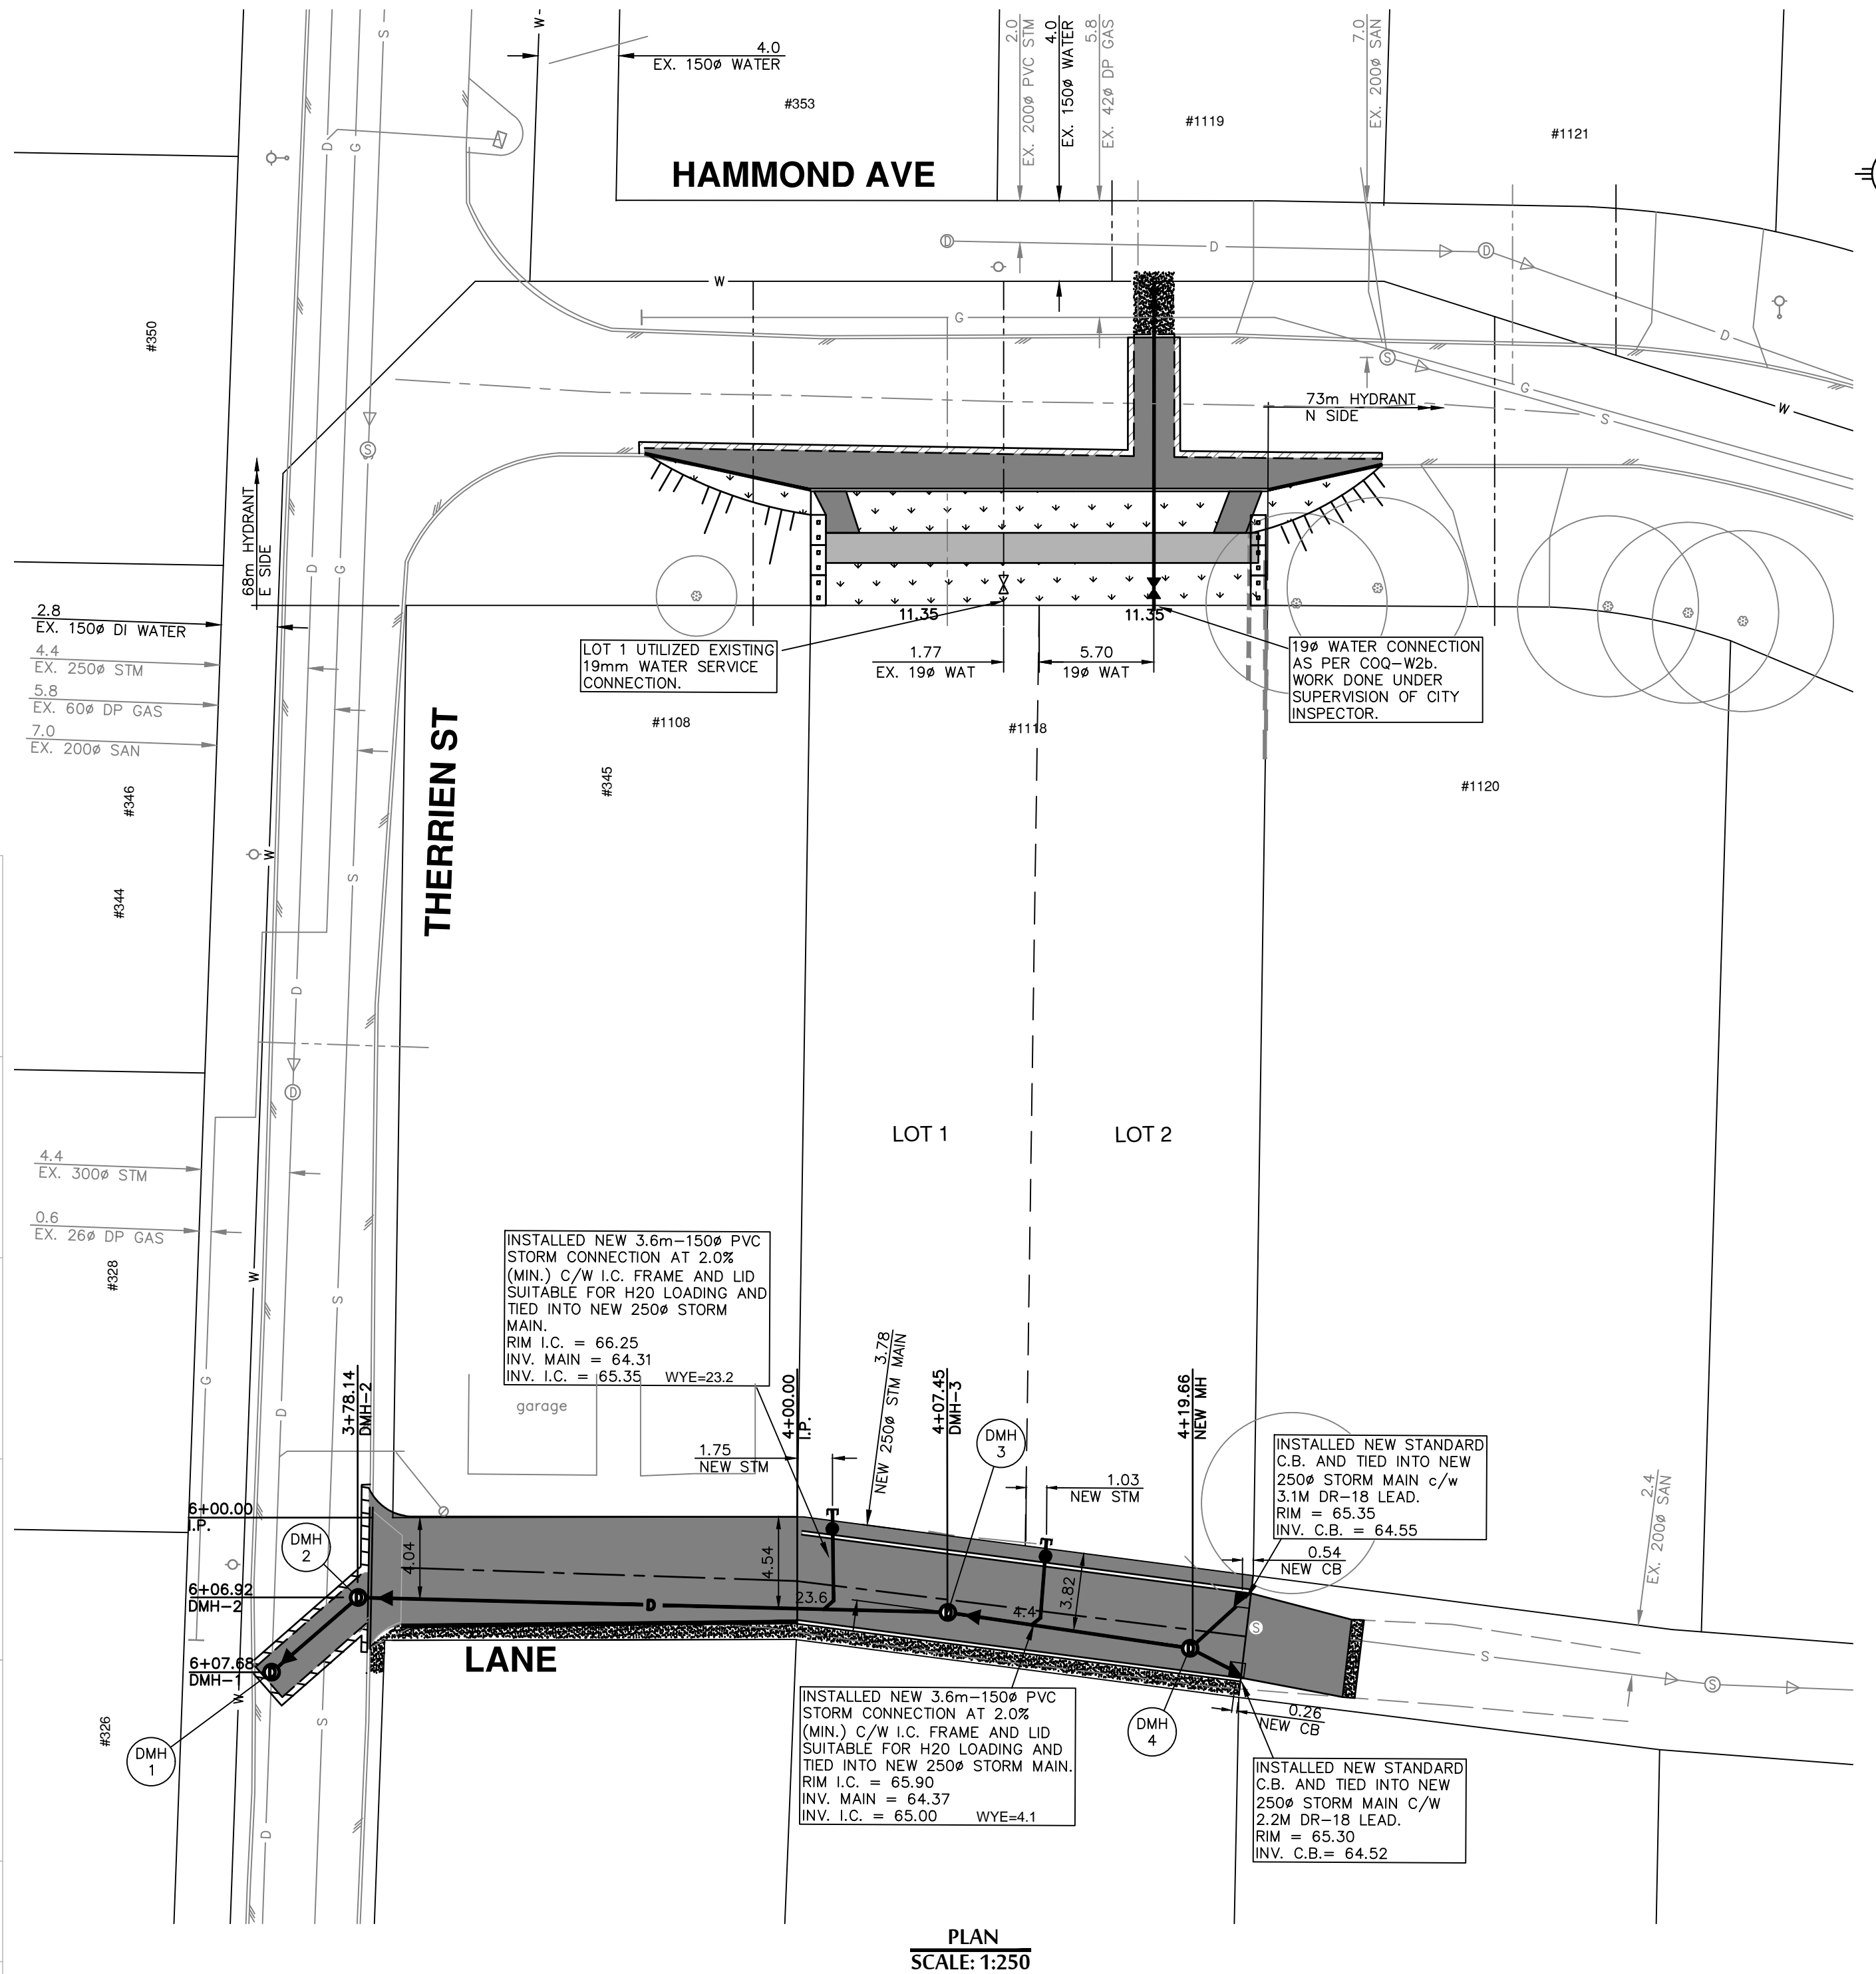

STORM MAIN CALCULATION:
10 YEAR STORM FREQUENCY

LOCATION			CATCHMENT AREA		LAND USE & RUNOFF COEFFICIENT / AREA				FLOW TIME			RAINFALL	RUNOFF	SEWER DESIGN					
Road	From MH	To MH	Incremental Area No.	A (ha)	Land Use	R	RA	Σ (RA)	Ti (min)	Tt (min)	Tc (min)	Intensity (mm/hr)	Design Flow (m³/s)	Capacity (m³/s)	Diameter (mm)	Slope (%)	n	Velocity (m/s)	Pipe Length (m)
Back Lane (1118 Hammond - 1108 Hammond)	DMH-3	DMH-1	4 LOTS	0.21	SF	0.67	0.14	0.14	10.00	0.00	10.00	29.0	0.011	0.025	200	0.50	0.012	0.80	46.2

ELEVATIONS ARE GEODETIC
REFERRED TO MONUMENT 73H0435
ELEVATION = 56.660 m

Core Concept Consulting Ltd.
tel. 604.249.5040
fax. 604.249.5041
#220-2639 Viking Way, Richmond, BC, V6V 3B7
www.coreconceptconsulting.com
Core Concept Consulting Project No. 15143

SANDY GILL

Coquitlam
Engineering & Public Works
3000 Guildford Way, Coquitlam, B.C. V3B 7N2

6.	30 JAN 2019	TS	AS-CONSTRUCTED	TS
5.	31 MAY 2017	SP	REVISION: STORM SEWER 2	RF
4.	11 MAY 2017	TS	REVISION: STORM SEWER	RF
3.	11 JAN 2017	SP	CITY APPROVAL	RF
2.	1 DEC 2016	SP	THIRD SUBMISSION	RF
1.	16 NOV 2016	TS	SECOND SUBMISSION	RF
0.	13 APR 2016	SL	FIRST SUBMISSION	RF
NO.	DATE	BY	REVISIONS	ENG.

DESIGN BY	DATE
SL	MAR 2016
DRAWN BY	DATE
GG	MAR 2016
CHECKED BY	DATE
TS/JP	MAR 2016
APPROVED BY	DATE
RF	MAR 2016

STAMP
28 OCT 2019

SCALE	1:250	SCALE	AS SHOWN
HORIZ	1:250	VERT.	1:250
SHEET	6	OF	8
ENG PROJECT NUMBER	15143		

PROJECT	1118 HAMMOND AVENUE
DESCRIPTION	SERVICING PLAN STORM SEWER & WATERWORKS

***Appendix D -
Street Lighting Inspection Report***

Street Lighting Inspection Report

CAUTION: Where possible, all inspections must be carried out prior to BC Hydro connections. Once electrical connections have been made, the inspections must be performed with the MAINS circuit breaker turned OFF, and locked out.

This report is in addition to the **Coquitlam Street Lighting** Inspection report, issued by Coquitlam civil inspectors.

Project: _____ SLIM No. _____

Address / Location / Cross Street: _____

Electrical Contractor: _____ Permit No. _____

Contact Name: _____ Phone: _____

City Inspector: _____ Inspection date: _____

MM/DD/YYYY

NOTE: Inspection for Capital Projects Typically completed by Engineer on Record.

- **BC Electrical Permit / Coquitlam Street Light Inspection Report**
 - **BC Electrical permit:** Permit #, proper address, electrical contact name & phone, quantity of lights, service details, earthing electrode (rod or plate), etc.
 - **Coquitlam Inspection form:** Location, contractor name & phone, site details, number of lights & wattages, drawings and civil inspector name & phone number
 - Review street lighting plans.
- **Hydro DIP Service (if used)**
 - RPVC conduit held down with clamps and lag bolts (per MMCD).
 - RPVC conduit section from grade up to 3-meters, install 3-meters of rigid steel guard over RPVC. Steel guard attached to wood pole with lag bolts (per MMCD).
 - Check for weather head a quantity of conductors (no bond conductor)
 - Proper sized conductors and colours per plans, MMCD or BC Hydro standards
 - All conductors stranded. Colours per plans
- **Hydro tub**
 - Round tub with concrete lid, BCH
 - Check for quantity of black squibs, conductors: black, red, white (no bond conductor)
- **Concrete Bases**

Bases for street lighting poles and service bases

 - Proper quantity of conduits, per Coquitlam supplemental or MMCD plans
 - Top of base approximately 70-mm (2.5 inches) above final grade
 - Top of base level, check 2-axis
 - V-groove to drain water (remove any concrete slag in groove). If no V-groove, then washers between street light base and top of concrete

- **Conduits (if available for viewing)**
 - Check proper locations and installation per plans
 - 600-mm below boulevard and sidewalks; 900-mm below asphalt
 - Check for yellow CAUTION tape placement
 - Check sizes per plans
 - Conduits clear of obstructions, CB's, other services.
 - All conduits provided with nylon pull cords
 - Empty conduits, blown clear and both ends capped – not glued.
- **Service Base / Kiosk / Electrical Panel**
 - Service base / Kiosk in proper location, orientation, and per approved plans
 - Top of base level, check 2-axis
 - **Enclosure bonding adherence:** interior paint or powder coating around pole bonding stud opening shall be ground off to bare steel / galvanizing.
 - **Bond stud details** (one 3/8 bolt, 2 nuts, one split lock-washer). Assembled within pole: Split lock-washer between first nut and pole surface and tighten this nut; install ring lug and another nut and tighten 2nd nut on to the ring lug / first nut.
 - Bond conductor terminated within electrical panel at the bonding buss
 - All conductors stranded copper. Colours per plans
 - Terminal connections on terminal blocks, contactor and splitter buss, are tight
 - Electrical panel shall meet MMCD, aluminum or stainless steel, per plans.
 - Electrical panel mounted with 4 bolts & nuts.
 - Proper main disconnect breaker. Define here: _____ Amps
 - Branch breakers (if used):
 - Proper branch breakers. List here: _____
 - All branch breakers labelled on a water resistant label
 - Photo Cell Control (PEC) panel-mounted fuse holder & 10-Amp fuse (ATM or KTK)
 - PEC Bypass switch shall be provided with a 3-position rotary switch (OFF-HAND-AUTO –or– HAND-OFF-AUTO). A 2-position toggle switch is no longer acceptable.
 - PEC conductors:
 - To be terminated on a 3-position terminal block within the electrical panel.
 - If no terminal block, wire PEC conductors on to the PEC bypass switch shall be a direct connection - no spliced conductors with wire nuts.
- **Receptacles (if used):**
 - Ground Fault Circuit Interrupter (GFCI) or corrosion resistant
 - Provided with covers. If individual covers, then provided with spring action covers, or aluminum cover over GFCI box/receptacle. Per Coquitlam drawings SS-E7-19 and/or SS-E7-20
 - Eyebolts in close proximity to the receptacle, to tie off power cords, span support cables, etc. Per Coquitlam supplemental drawing SS-E7-19
 - All conductors stranded copper, sized and colours per plans
 - Inline fuse-holder:
 - Located in hand hole (best), or junction box
 - Check for proper assembly - LOAD side to luminaire
 - Pull on conductors to check for proper crimping.
 - Receptacle fuse, note part number: _____
 - Receptacle conductors taped together, separate of luminaire & PEC conductors

○ Street light poles / fixtures

City of Coquitlam has started using LED luminaires. In preparation for LED lighting, many developers have installed LED lighting. The notes below are the same if HPS or LED.

- Street light locations versus driveways (2-m), trees (6-m), CB's (2-m), etc.
- Base flange level, check 2-axis
- Proper fixture / wattage label (i.e. 10 = 100W, 15 = 150W, 42 = 42 watt (LED), etc.). Circle whichever applies
- Check all hand-holes
- **Pole bonding adherence:** interior paint around pole bonding stud opening shall be ground off to bare steel / galvanizing. The stud and hardware installed immediately after grinding (no rust/corrosion)
- **Pole bond stud details** (one 3/8 bolt, 2 nuts, one split lock-washer). Assembled within pole: Split lock-washer between first nut and pole surface and tighten this nut; install rig lug and another nut and tighten 2nd nut on to the ring lug / first nut.
- All conductors stranded copper, colours per plans
- Pole bonding conductors: Two #6 RW90, a #12 RW90 to luminaire, pig-tailed together and with a # 6 RW90 to a suitable ring lug to the pole bonding stud. Ring lug between the 2 nuts
- Proper PEC conductors:
 - Constant run of conductors from the electrical panel to the PEC (no splices or wire nuts)
 - Red, black, white (#12 RW90 minimum). Taped together and with a PEC label
- Proper luminaire conductors: black, white, green (#12 RW90 minimum). Taped together and with a label
- Luminaire conductors taped together, separate of the PEC conductors
- PEC conductors (#12 RW90 minimum) separately bundled from the luminaire conductors
- Inline fuse-holder:
 - Check for proper assembly - LOAD side to luminaire,
 - Pull on conductors to check for proper crimping.
- Proper luminaire fuse. Fuse part number: _____
- All large gauge conductors, #6 and larger, 3 conductors or more, splices shall utilize split bolts, duct seal, rubberized tape, covered in vinyl tape and then scotch coated
- Generally, wire nuts (trade name: MARRETTE) will be a future maintenance issue.

- **Junction Boxes (if used)**

Coquitlam uses POLYMOLD junction boxes (OLD CASTLE, SYNERTECH, etc.), moving away from precast concrete boxes with steel lids. The concrete/steel lids will be a maintenance issue in following years.

- Proper locations, tops set to final grade and per plans
- If SYNERTECH junction boxes:
 - If in boulevards, grassed a concrete ring surrounding outer lip.
 - Security using PENTA bolts and flat washers.
- Junction box lids may not be marked (comm boxes shall be labelled COMM)
- Steel lids bonded (if powered conductors within)
- All large gauge conductors, #8 and larger, 3 conductors or more, splices shall utilize split bolts, rubberized tape, covered in vinyl tape. Wire nuts are permitted for #12 and smaller conductors. Generally, wire nuts will be a future maintenance issue.
- Conductors used in JB's must be rated for immersed in water (RW90 or better). CABTIRE cables not approved for permanent installations.
- Conductors labelled with yellow wire tags, marked with applicable circuits, and water proof ink
- Check for fuses and fuse-holders. Fuse-holders labelled with yellow wire tags, marked with water proof ink to indicate applicable circuits.
- Check for RPVC support bars (if required)
- All conduits provided with nylon pull cords
- Empty conduits capped at each end (if visible)

- **Security**

Security hardware is required on all:

- New poles:
 - WCE has a similar security cover, reverse threaded "flower" bolt and reinforced backer bar on all poles. Contractor issues one (1) tool bit or key to Coquitlam Traffic Operations staff.
 - Nova Pole security cover, reverse thread security "flower" bolt and reinforced backer bar. Contractor issues one (1) tool bit to Coquitlam Traffic Operations staff.
 - One security vendor style only per project. Combinations of Nova and WCE not permitted.
 - WCE Bulldog cover & round lock assembly and Wire Sentry products are no longer acceptable in Coquitlam
- Service bases shall be provided with a robust padlocking tab, and 3/8-16 threaded holes on either side of the padlock tab.
- Padlocks supplied by TRAFOPS staff and installed on service bases or kiosks ("L" for lighting; "T" for combination Traffic / Street lighting)

THIS PAGE LEFT BLANK FOR ADDITIONAL COMMENTS